


TYPE U "DE-ION" AIR CIRCUIT-BREAKER

600 to 2000 Amperes, 2500 and 5000 Volts, 60 Cycles

Types 25-U-20, 25-U-25, 50-U-12, 50-U-20

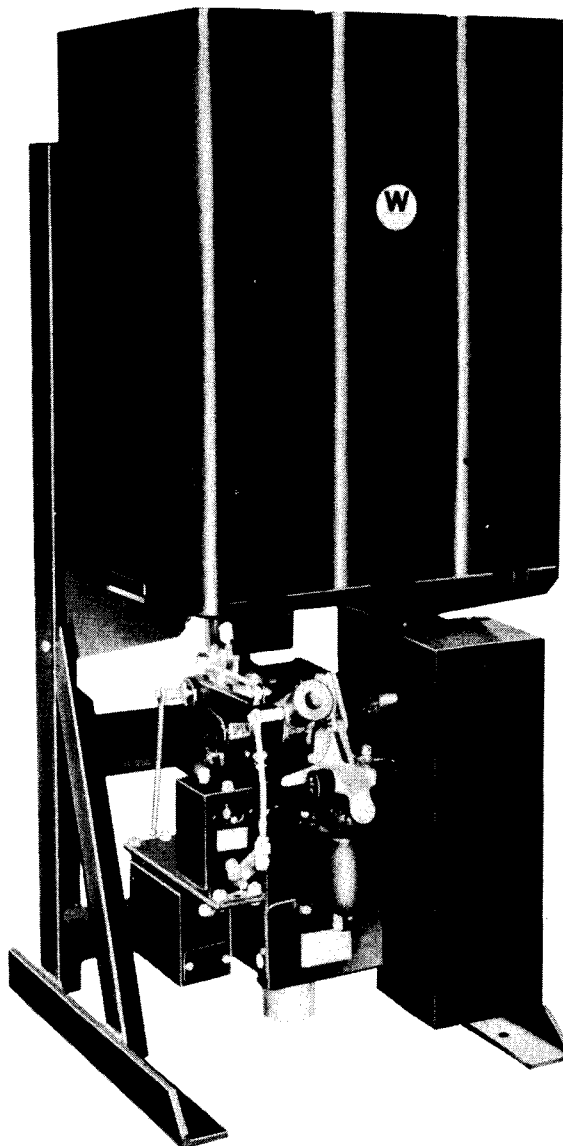

Frontispiece

Type 50-U-20 "De-Ion" Air Circuit-Breaker for Floor Mounting  
(Three-pole, 600-Ampere, 5000-Volt)

*50 U 12 600 amps Int Rating  
12,500 amps at  
100,000 KVA*

Westinghouse Electric and Manufacturing Company

East Pittsburgh, Pa.

TABLE OF CONTENTS

<u>Description</u>	<u>Page</u>
TABLE OF ILLUSTRATIONS - - - - -	1
APPLICATION - - - - -	2
DESCRIPTION - - - - -	2
OPERATION - - - - -	4
Installation of De-Ionizing Chamber or Arc Chute - -	4
Chute Lifter for Cell or Cubicle Mounting - - - - -	5
Installation of Pole Unit Barriers- - - - -	5
INSPECTION AND MAINTENANCE - - - - -	6
Frequency of Inspection - - - - -	6
Caution - - - - -	6
General - - - - -	6
Heaters - - - - -	6
Insulation - - - - -	6
Arc Box - - - - -	7
De-Ionizing Chamber - - - - -	7
Insulation of Gaps - - - - -	7
Contacts - - - - -	7
Adjustments - - - - -	7
Contacts - - - - -	7
Contact Spring - - - - -	8
ELECTRIC CLOSING MECHANISM - - - - -	8

## TABLE OF ILLUSTRATIONS

Frontispiece	Three-Pole 600-Ampere, 5000-Volt, Type 50-U-20 "De-ion" Air Circuit-Breaker for Floor Mounting.
Figure 1	Three-Pole, 600-Ampere, 5000-Volt, Type 50-U-20 "De-Ion" Air Circuit-Breaker, Showing Pole Units in Various Stages of Assembly.
Figure 2	Contact System of Types 25-U-20, 25-U-25, 50-U-12 and 50-U-20 "De-ion" Air Circuit- Breakers.
Figure 3	De-ionizing Chamber of Type 50-U-20 "De-ion" Air Circuit-Breaker.
Figure 4	Partially Assembled De-ionizing Chamber of Type 25-U-25 "De-ion" Air Circuit-Breaker.
Note	The copper and steel plates are arranged in pairs in the same plane. These pairs of plates are spaced apart by the insulating spacers which are so shaped as to define the annular path in which the short arcs ro- tate and also to form individual vents for each short arc. The radial slots in the cop- per plates reduce eddy currents in these plates which in turn prevents weakening of the magnetic fields for rotating the short arcs in the annular paths.
Figure 5 (A & B)	Typical Arrangement of Component Parts, Show- ing Method of Drawing and Extinguishing the Arc in the Type U "De-ion" Air Circuit-Breaker.
Figure 6	Installing Arc Chute on Type 50-U-20 "De-ion" Air Circuit-Breaker.
Figure 7	De-ion Air Circuit-Breaker in Cubicle Showing Use of Arc Chute Lifter.
Figure 8	Outline Drawing of Types 25-U-20, 25-U-25, 50-U-12 and 50-U-20, 3-Pole "De-ion" Air Circuit-Breakers.

TYPE U "DE-ION" AIR CIRCUIT-BREAKER  
600 to 2000 Amperes, 2500 and 5000 Volts, 60 Cycles  
Types 25-U-20, 25-U-25, 50-U-12; 50-U-20

APPLICATION

The "De-ion" air circuit-breakers described herein are designed for operating service at from 600 to 2000 amperes at 2500 and 5000 volts a-c. They may be used in general applications where conventional breakers might be applied. They are also suitable for applications requiring long life and low maintenance under high repetitive duty. They operate entirely without oil and require only a normal atmosphere. They may be supplied for individual floor mounting or they may be included in complete metal-clad switching equipment. This line of breakers is covered by one frame size. Unless otherwise noted, instructions given in this book apply to all ratings listed above.

DESCRIPTION

Fig. 1 shows a 600-ampere, 5000-volt, Type 50-U-20 breaker for floor mounting, shown with the pole units in various stages of assembly. The 3 poles of the breaker form a unit assembly on a steel mounting plate located above the solenoid operating mechanism. The high tension parts are separated from the operating mechanism and controlled by a 1/8 inch sheet steel barrier. The left-hand pole unit is shown without de-ionizing chamber to show the contacts, pole unit, operating rod and other details. The center pole is shown with the arc chute in operating position. The right-hand pole unit is shown complete with pole unit barrier in position.

Fig. 8 shows the outline dimensions of a standard floor mounting 3-pole breaker. Dimensions, except as noted, are the same for all ratings.

The operating rods for the 3 pole units extend through the back mounting plate to levers on a shaft extending lengthwise of the breaker. This shaft is rotated by a pull rod connecting to the solenoid mechanism.

Fig. 2 shows the operation of the contacts. The stationary contacts are solidly mounted on the upper and lower line terminal bushings and they are bridged in the closed position by a solid copper movable contact member with a renewable contact block on the upper end. This movable contact bar is operated, through the compression spring shown, by the actuating lever which is pivoted to the lower contact foot casting and is moved to the closed or open position by the insulating pull rod. The movable contact bar is pivoted to the pull rod pin near its center through an elongated hole which causes the bar to rock, in the initial part of the opening stroke, to the first position shown in dot-dash lines. In this position, the main contact surfaces are

separated and the arc tips are touching. The contact surfaces at the lower terminal bushing are separated but these points are connected by the flexible shunt as shown. The rocking of the movable contact bar is limited by the set screw stop and the movable contact bar and actuating lever then continue to the open position as a unit. Bumpers, located on the back side of the rear mounting plate, limit the travel of the breaker in the open position by bumper arms welded to the main operating shaft.

In closing, the reverse action takes place, the arc tips touching first. The movable contact bar rocks until the lower contacts touch and the contact spring is further compressed to insure adequate pressure on both the upper and lower main contact surfaces.

Fig. 3 shows a de-ionizing chamber rated at 5 Kv. and Fig. 4 shows a partially dismantled chamber. It contains pairs of copper and steel plates, shaped as shown on the left, Fig. 4, and located in the same plane, separated by thin insulating spacers, shaped as shown on the right, to form a series of gaps. These gaps are in groups separated by radial field coils whose function will be described later. This assembly is clamped tightly between stiff end plates by 3 insulated studs, as shown, which also function as conductors for the main magnetic field as described later.

Referring to Figs. 3 and 4, the lower part of the interior of the arc chute contains the arc box, which encloses the space between the lower edges of the copper plates, and the arc tips. This box consists of hard fiber liners each of which contains an insert of asbestos composition near the contacts. An arc horn, located near the rear end (L.H. in Fig. 3) of the arc box, extends slightly forward and above the stationary contact when the chute is on the breaker. This horn is insulated from the rear end plate by fiber spacers and connects to the rear ends of the 2 lower tie studs.

These studs are connected to the upper tie stud by 2 copper straps at the front of the chute. The upper stud is connected to the rear end plate. The tie studs, connecting straps and arc horn complete a 1-turn loop which forms the main magnetic field for moving the arc from the contacts into the plate assembly. See "Operation" below.

## OPERATION

The de-ionizing chamber is built up of copper plates insulated from each other to form a series of gaps, as shown in Fig. 5. Each copper plate is partially surrounded by a steel plate of the same thickness, Fig. 5.

As the contacts separate, the arc is drawn as shown in Fig. 5, and the circuit is completed as indicated by the broken arrows. It rises due to the magnetic field of the arc current, impinges on the arc horn immediately above, and current begins to flow through the one-turn loop. The individual steel plates act as a magnetic yoke which, when energized by the one-turn loop, supply additional magnetic field for moving the arc into the plate structure.

When the arc impinges on the copper plates, the radial field coils are introduced into the circuit. These coils supply the field for spinning the arc around the annular path, in the same manner that the armature conductor of a series motor is driven in a circular path by the field of the motor. The arc, as shown, is now broken up into a number of short arcs. The spinning action continues until a zero point occurs in the current. At that instant the circuit is interrupted.

This action takes place much more quickly than it can be described. Complete interruption of the arc-drawing, moving it into the gaps, and spinning it - usually requires only one-half to one cycle on a 60 cycle wave. The arc may be spun at the rate of 20 revolutions per half cycle.

Details of the plates are shown in Fig. 5. Refractory inserts insulate against the heat caused by the arc as the contacts open. The flux, indicated by dotted arrows, forces the arc into the annular path where it is spun around under the influence of the radial flux field. The bars, part of which are shown on each side at the bottom, are connected to the conductor in the center of the annular path and are shown more clearly in Figs. 1, 3 and 4.

## INSTALLATION OF DE-IONIZING CHAMBER OR ARC CHUTE

The de-ionizing chambers or arc chutes are generally shipped packed separately from the breaker to guard against damage in shipment. Otherwise, all frame mounted and metal-clad breakers will be shipped from the factory completely assembled and adjusted. No change in adjustment should be required and none should be made unless it is obvious that they have been disturbed.

The arc chute is supported by a post type insulator at the top of the rear mounting plate and by the contact foot of the upper terminal bushing. As shown on the left of Fig. 3, it is held at the top by the hook-plate and at the bottom by 2 bolts through the 2 holes in the lower end of the rear end plate (L.H. in Fig. 3 and 6). The hook plate fits over 2 flanged pins located in the post type insulator. A copper connecting bar is

bolted to a lug on the bottom of the front end plate, shown on the right of Fig. 3 and to the contact foot of the lower terminal bushing.

To install an arc chute, lift it to the position shown in Fig. 6, guide the hook plate over the flange pins and release it so that the lower end of the rear end plates comes to rest against the pads on the upper contact foot. The arc chute will hang in this position without additional support while the 2 bolts are inserted and tightened into the upper contact foot. Insert the bolt through the copper connecting bar and tighten into the lug in the bottom of the front end plate. This completes the installation of the arc chute.

#### CHUTE LIFTER FOR CELL OR CUBICLE MOUNTING

For breakers in a closely confining cell or where the breaker unit is relatively high, an arc chute lifter is provided for use as shown in Fig. 7. To install an arc chute with it, place the lifter bar in position as shown, over the pole unit. Roll the carriage to the front of the cell, hang the chute on the carriage by means of the hooks on chute end plates and push to the rear of the cell. Engage the chute hook plate with the flange pins on the post insulator. Release the front hangar of the lifter bar and, holding the bar with one hand and guiding the arc chute with the other, lower the bar slowly until the arc chute hangs in position on the breaker. Remove the lifter and complete the installation of the arc chute as outlined above.

#### INSTALLATION OF POLE UNIT BARRIERS

After the arc chutes are mounted on the breaker, install the pole unit barriers. Place the bottom of the pole unit barrier on the horizontal sheet steel barrier. Slide it to the rear until the front edge will slide down between the front flanges of the steel barrier, the slot in the pole unit barrier engaging the captive bolt in the front flange. Push the pole unit barrier down firmly on the steel barrier and tighten the captive bolt. On the outer pole units, make sure that the lower edges of the sides of the pole unit barriers are set inside the turned up flange of the steel barrier.

## INSPECTION AND MAINTENANCE

### FREQUENCY OF INSPECTION

The frequency of inspection, cleaning, etc. will depend upon the activity and duty to which the breaker is subjected and upon the cleanliness of the atmosphere and surroundings of the breaker. For breakers in highly repetitive load switching duty with relatively few automatic openings, it is recommended that inspections be made at intervals of 5000 to 6000 operations or every 2 to 3 months. If atmospheric conditions are particularly dirty, the insulating parts should be cleaned as outlined under "Insulation" at more frequent intervals. If automatic openings on short circuit are unusually high, the frequency of inspections should be increased. Where air conditions are clean and activity not high, as in most feeder service, the inspection periods may be increased to 6 months or 1 year.

### CAUTION

Parts of the circuit-breaker itself in the high-voltage compartment of the housing are at line potential and the breaker should be isolated from the circuit by disconnecting switches, in line with standard practice for conventional circuit-breakers, before the pole unit barriers are removed.

### GENERAL

Inspect the breaker structure in general and see that all bolts, nuts, etc. are tight and that all spring cotters, etc. are in place. Note evidence of excessive wear or other improper operation of the various parts.

In operating the breaker by hand there should be no binding or excessive friction. In opening the breaker slowly by hand bumper arms should come to rest securely against their bumpers and there should be no excessive friction or binding.

### HEATERS

These breakers are generally equipped with space heaters mounted under the high voltage compartment for use under conditions of high atmospheric moisture. It is important that these heaters be used at all times when atmospheric conditions are favorable to the condensation of moisture or under conditions of excessive humidity. This applies particularly to conditions during shutdown periods although the heater might possibly be required under normal running conditions.

### INSULATION

All insulating parts should be kept clean and free from accumulations of dirt or dust. Dry compressed air should be used to blow off loose dust. It should also be blown into the de-ionizing chamber to remove any loose particles. In doing this, the air should be directed into the arc box, upward toward the top of the stack and downward through the individual gap vents along the top of the stack. Other parts may be wiped off with a clean dry cloth.



## ARC BOX

If there are indications of severe burning or excessive deposits of soot, etc., in the arc box, it may be cleaned with sandpaper or a file. To do this conveniently, the de-ionizing chamber may be removed from the breaker.

## DE-IONIZING CHAMBER

Insulation of Gaps. Each gap between pairs of copper and steel plates may be "lighted" or "rung" out with a light or bell ringer at not more than 250 volts per gap. Each gap should be open, but in case of extremely severe duty, some may become short-circuited by particles being blown from the arc box or contacts. Loose particles may be removed by blowing out the chamber thoroughly with dry compressed air directed in both top and bottom. If this does not remove the particles, pass 100 to 200 amperes at not more than 125 volts a-c. through the shorted gaps. This may be applied by thin copper straps inserted between the copper plates on each side of the shorted gaps. This should burn the gaps clean instantly but any short-circuits not removed by this treatment can be left until such time as the stack is disassembled. In an emergency a chamber may be used with as many as 15 per cent of the gaps short-circuited but it is recommended that any chambers having shorted gaps which do not clean up with the above treatment be disassembled and any damaged parts be replaced.

## CONTACTS

See that the bolts holding the contacts in place are tight. Under normal conditions, the contacts should be good for a large number of operations at the rated rupturing capacity of the breaker. A moderate amount of burning on the main contact surfaces will not impair their current carrying ability due to the high pressure used. The contacts should not be kept in service if the arc tips touch in the closed position as this means that some pressure will be taken from the main contact surfaces. This will cause excessive heating due to current being diverted through the arc tips, which are of relatively high resistance.

## ADJUSTMENTS

These breakers are completely adjusted at the factory and individually checked by tests. No change in adjustments should be required and none should be made unless it is obvious that something has been disturbed.

### 1. Contacts

Refer to Fig. 2. In the fully closed position the main contact surfaces should be on firm contact and the clearance between the arc tips should be  $\frac{3}{32}$  to  $\frac{1}{8}$  inch in a new breaker. This clearance may change due to wear on the main contact surfaces and when it

decreases to the point when the arc tips are in contact in the fully closed position, the contacts should be renewed. This condition should not be reached until the breaker has had a large number of operations

Close the breaker by hand until the arc tips just touch. The clearance between the upper main contact surfaces should be  $1/16$  to  $1/8$  inch. This is not critical but a change in adjustment can be made by turning the set screw stop, shown on the lower right in Fig. 2.

## 2. Contact Spring

In closing the breaker, after the lower main contact (on the lower terminal bushing foot) has touched, there should be a further compression of the contact spring of approximately  $1/8$  inch in proceeding to the fully closed position. This condition can be altered by changing the adjustment on the pole unit pull rods. A change in the adjustment of these rods may also require a change in the adjustment of the solenoid mechanism pull rod. The factory adjustment of this feature should be satisfactory and it is recommended that it not be disturbed at all unless it is certain that maladjustment has occurred.

## ELECTRIC CLOSING MECHANISM

The closing mechanism generally supplied is the type "SA-3" with a special main operating lever. See W. E. & M. Co., Instruction Book No. 5567.

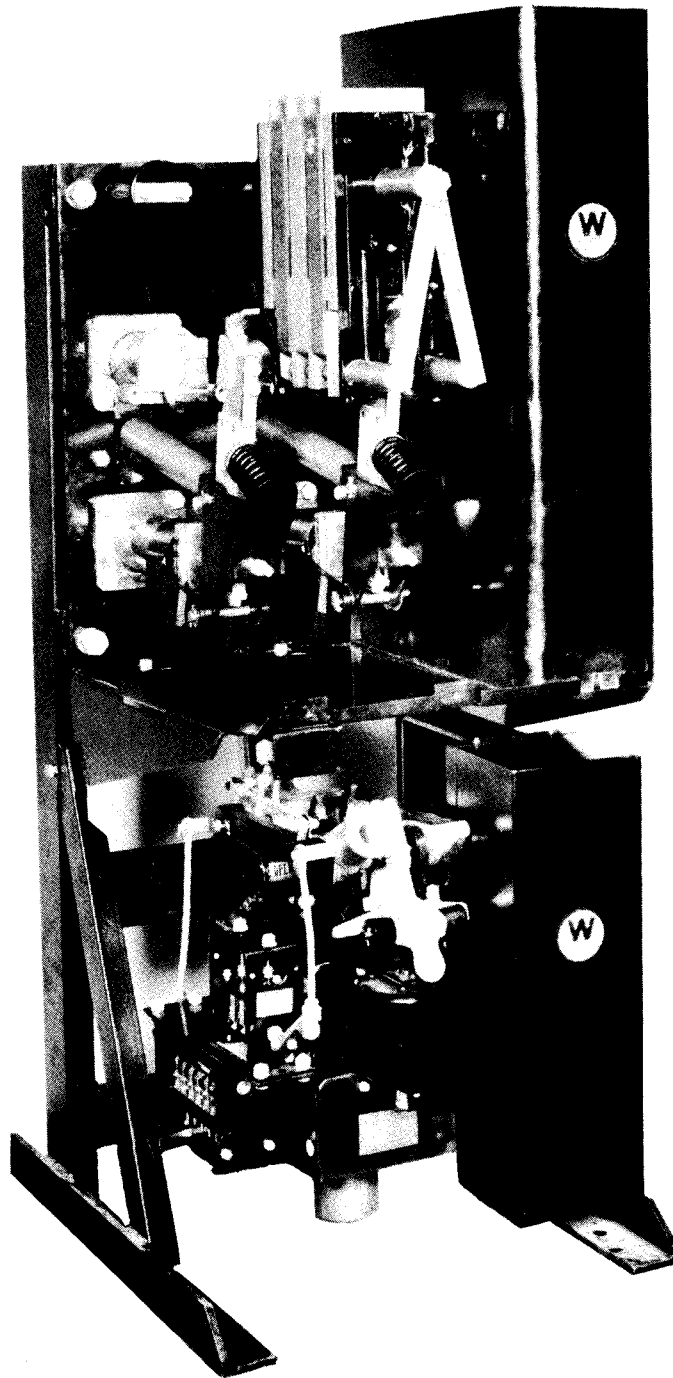


Figure 1  
Type 50-U-20 "De-Ion" Air Circuit-Breaker  
Showing Pole Units in Various Stages of Assembly  
(Three-pole, 600-Ampere, 5000-Volt)

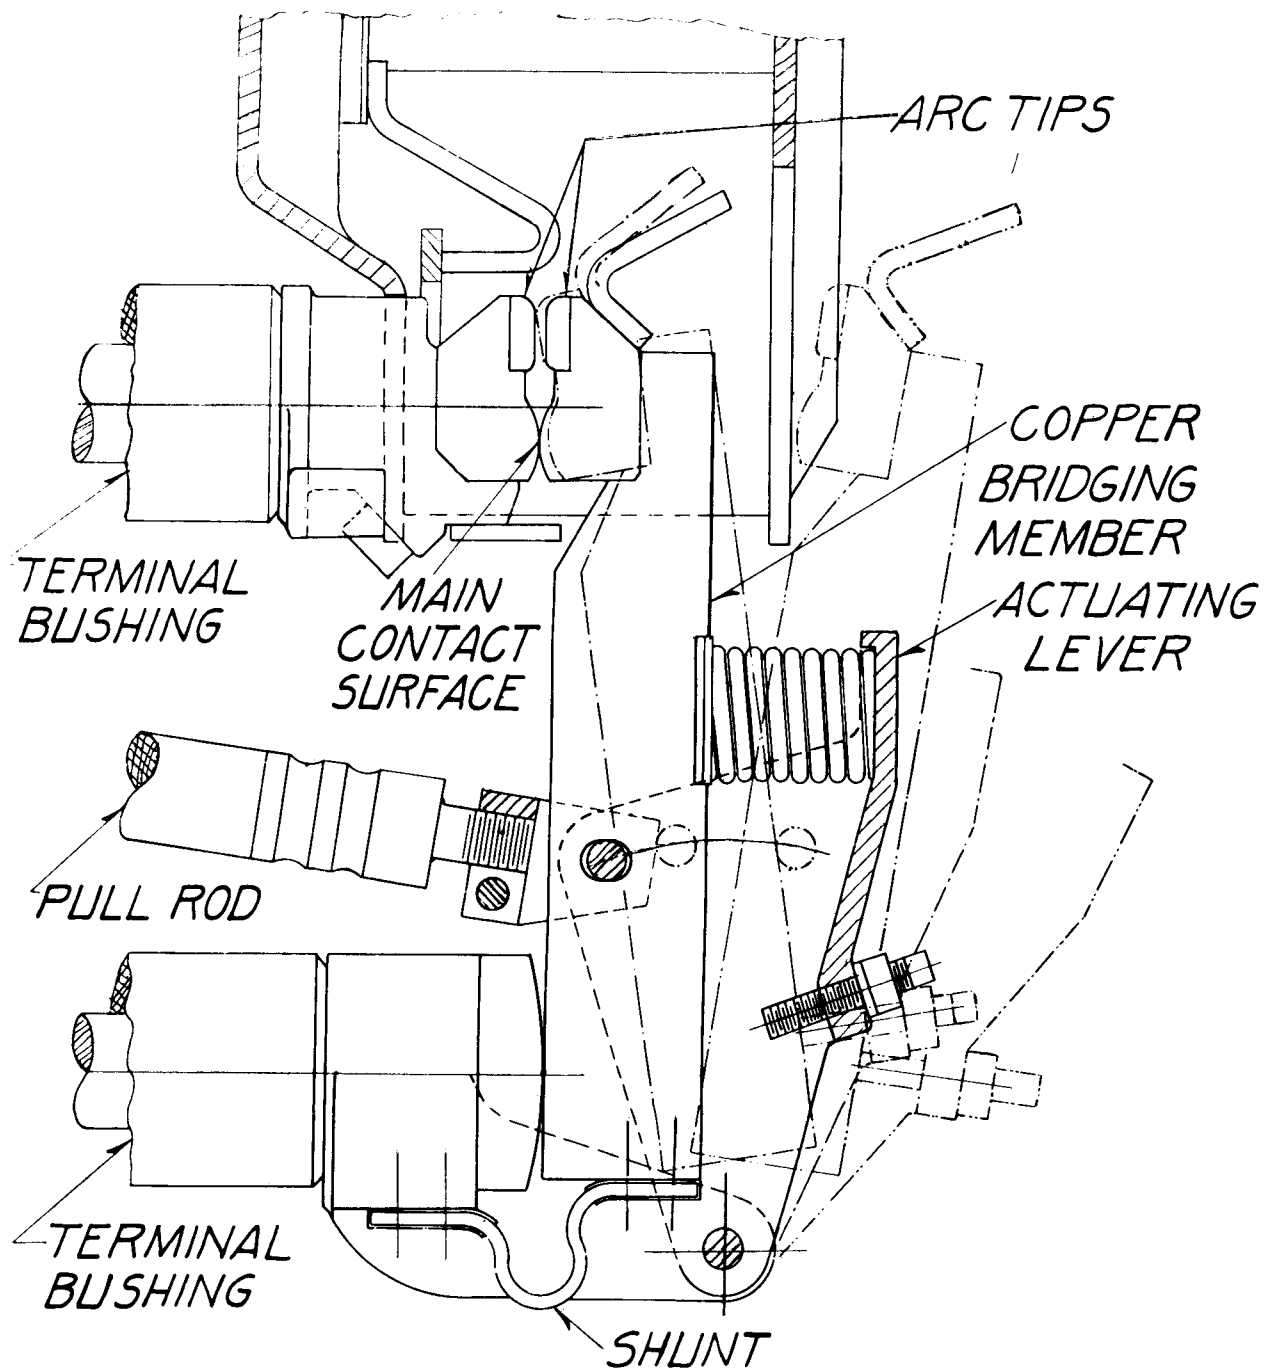


Figure 2  
Contact System of Types 25-U-20, 25-U-25,  
50-U-12 and 50-U-20 "De-Ion" Air Circuit-Breakers

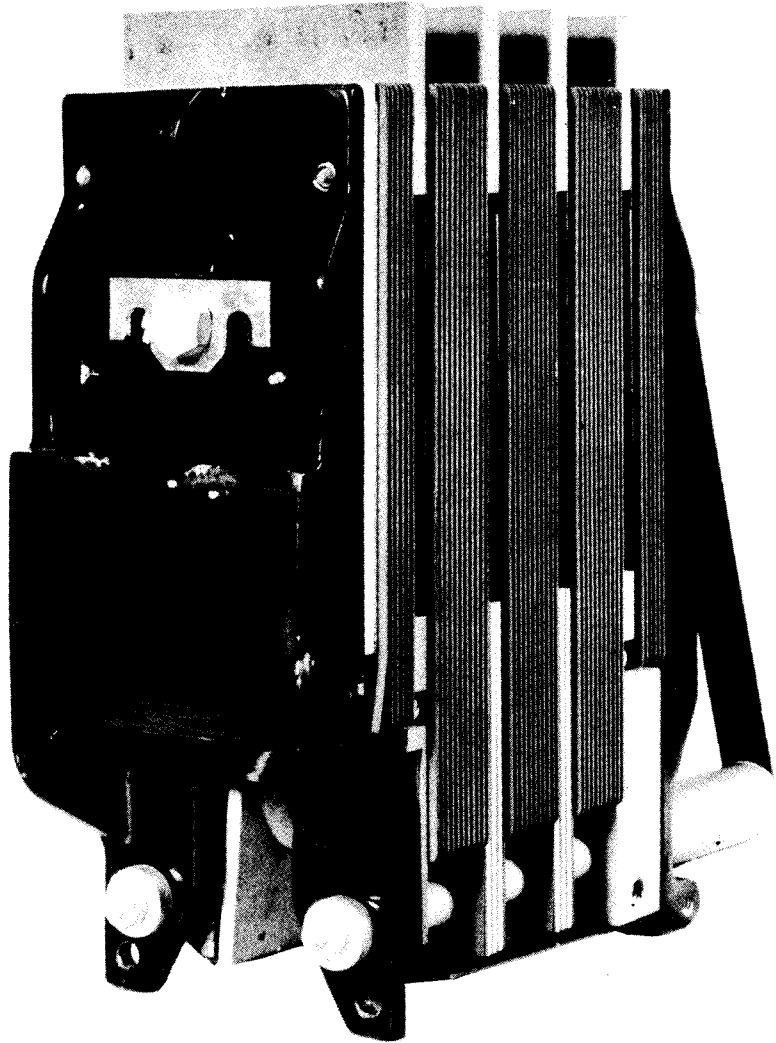


Figure 3  
De-Ionizing Chamber of Type 50-U-20 "De-Ion" Air Circuit-Breaker

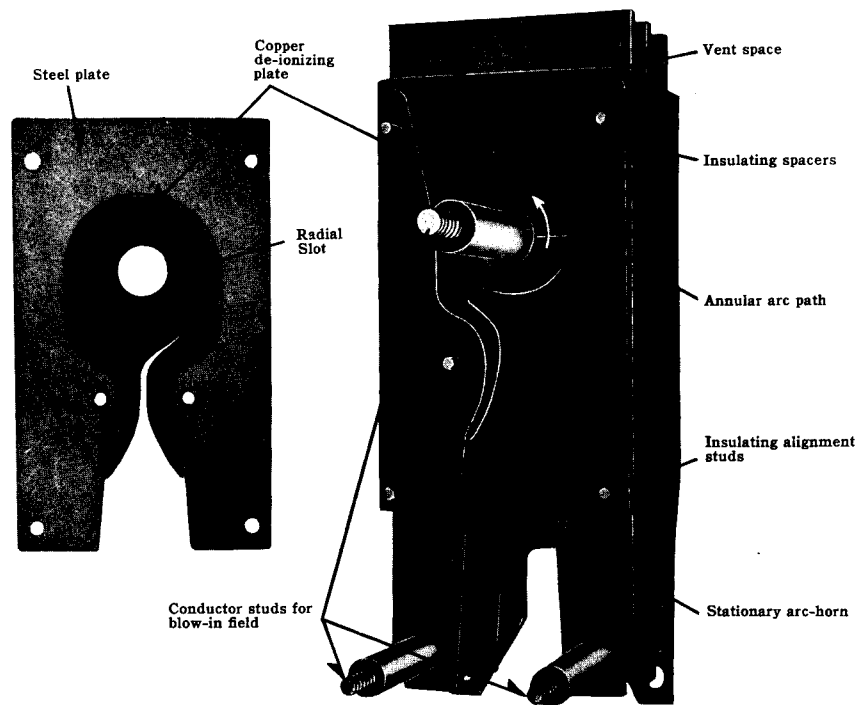


Figure 4  
Partially Assembled De-Ionizing Chamber  
Type 25-U-25 De-Ion Air Circuit-Breaker

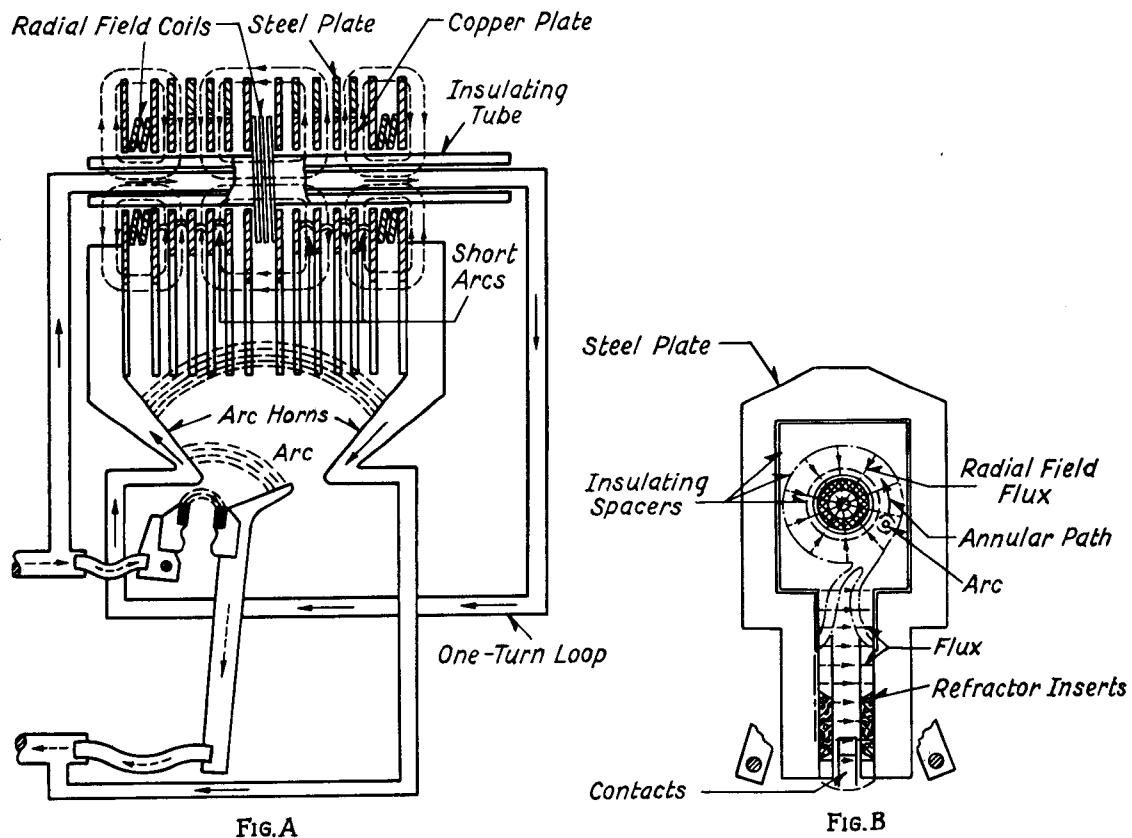


Figure 5  
Typical Arrangement of Component Parts Showing  
Method of Drawing and Extinguishing the Arc in the  
Type U De-Ion Air Circuit-Breaker

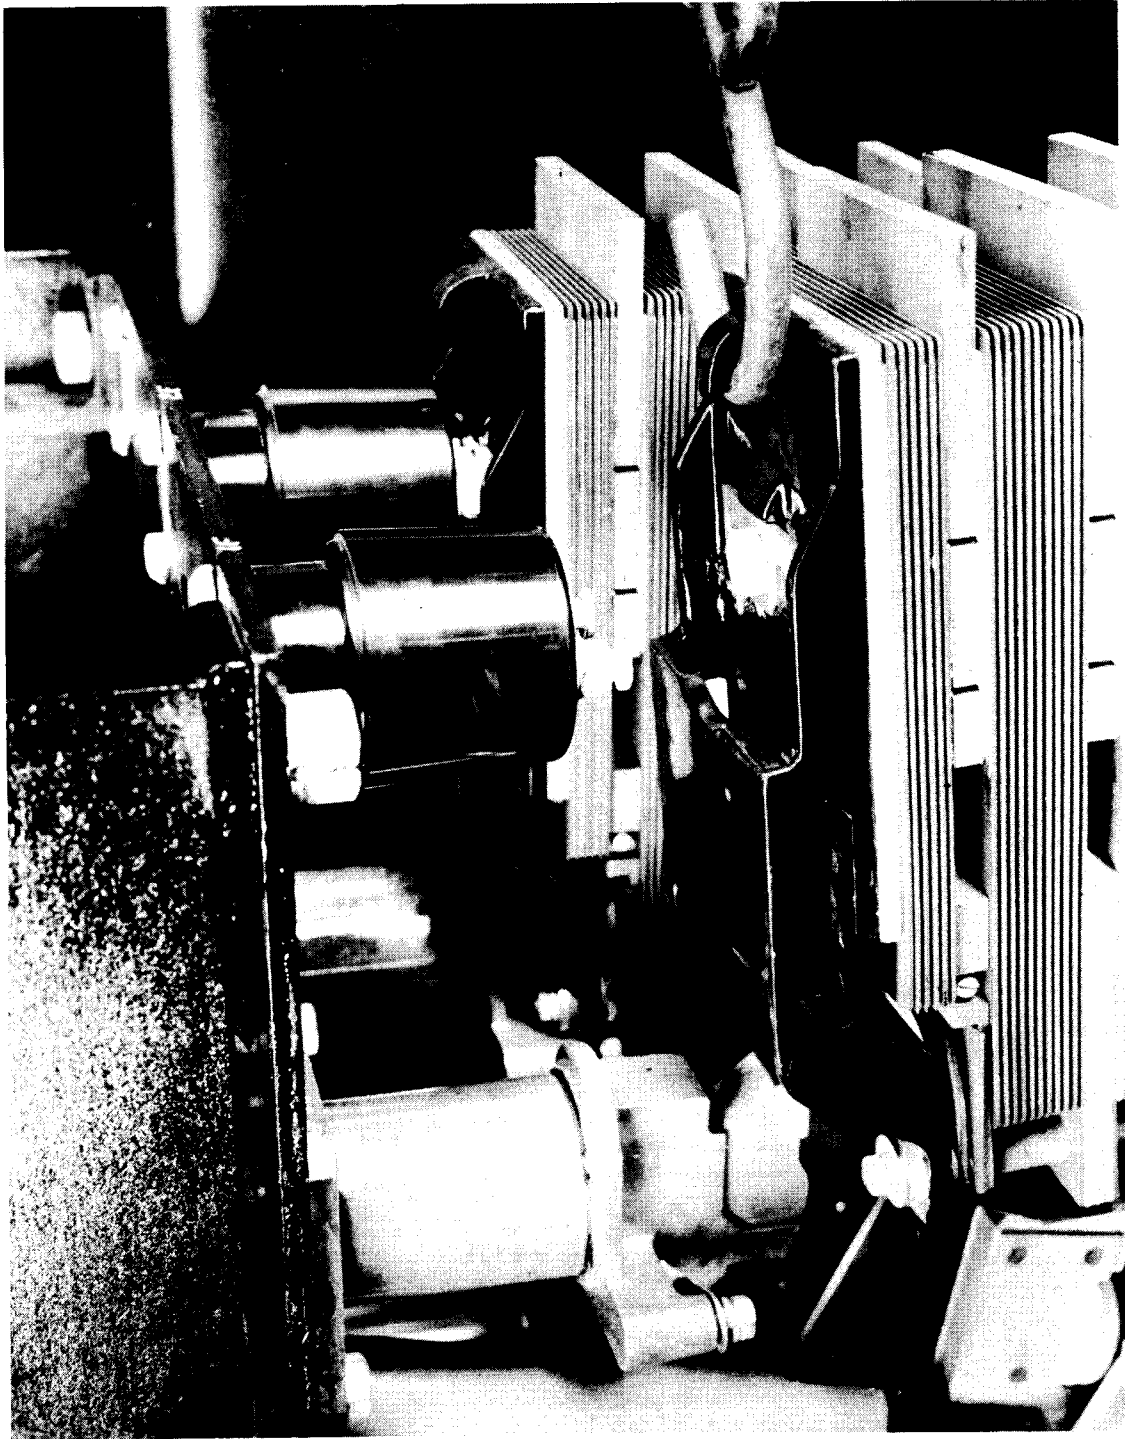


Figure 6  
Installing Arc Chute - Type 50-U-20 "De-Ion" Air Circuit-Breaker

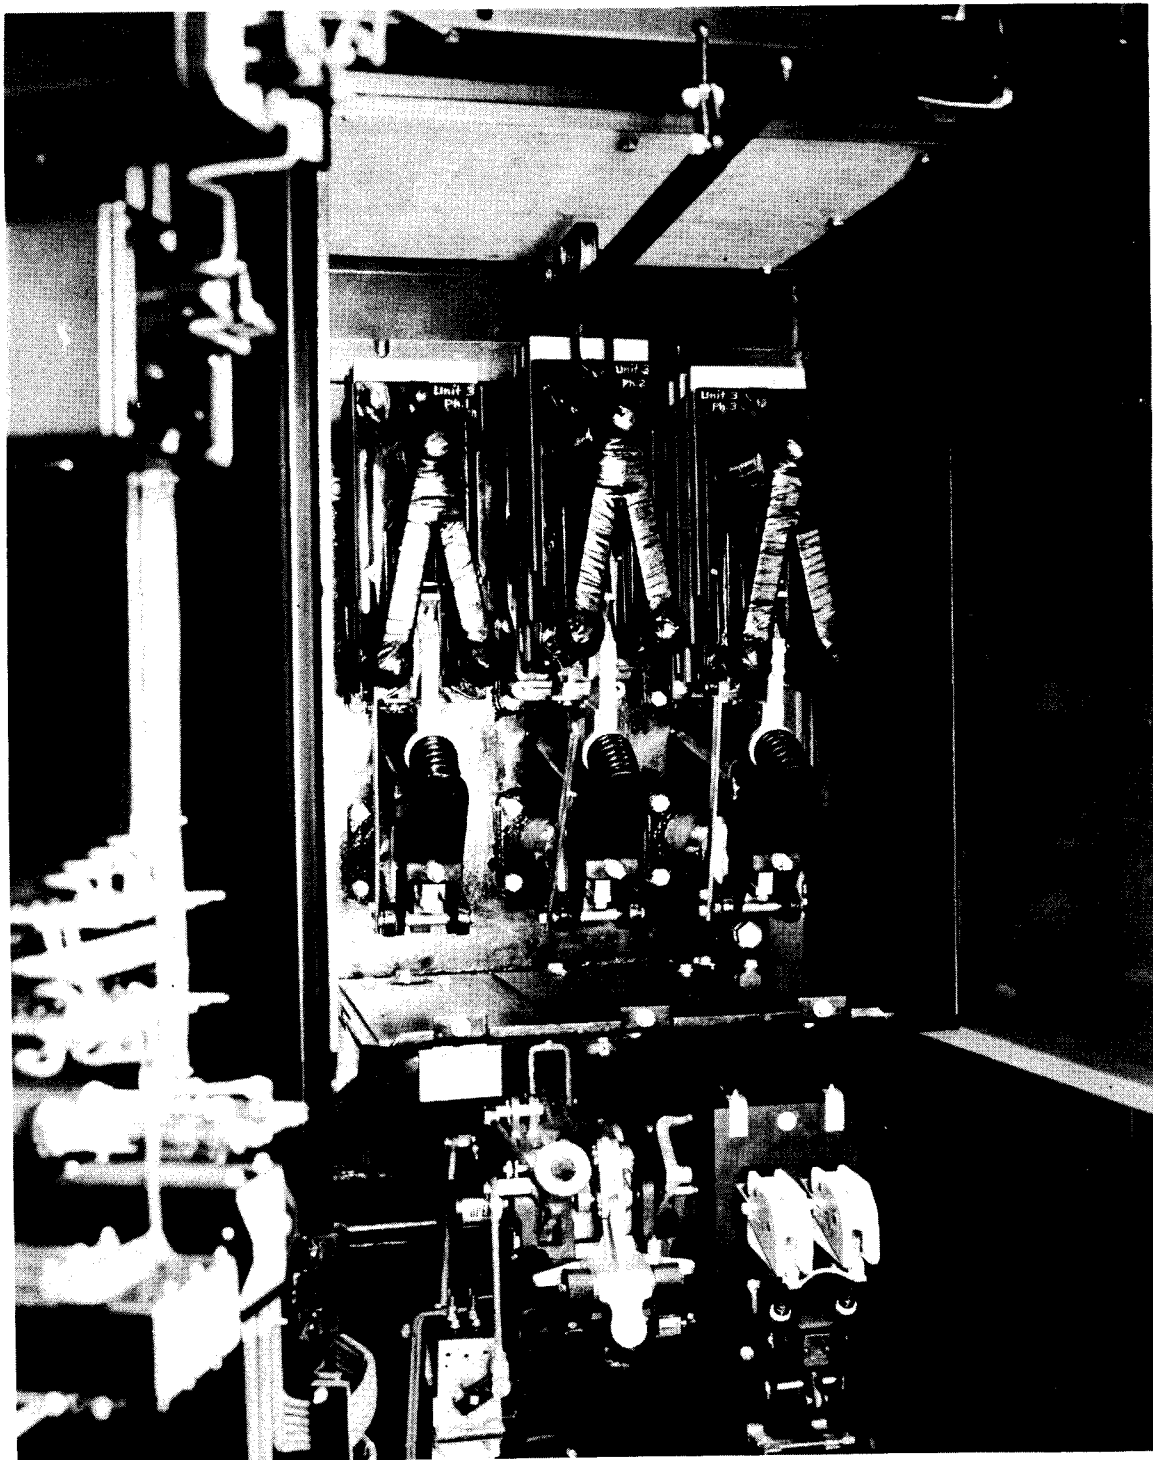


Figure 7  
De-Ion Air Circuit-Breaker in Cubicle, Showing Use of Arc Chute Lifter



# OUTLINE DIMENSIONS IN INCHES

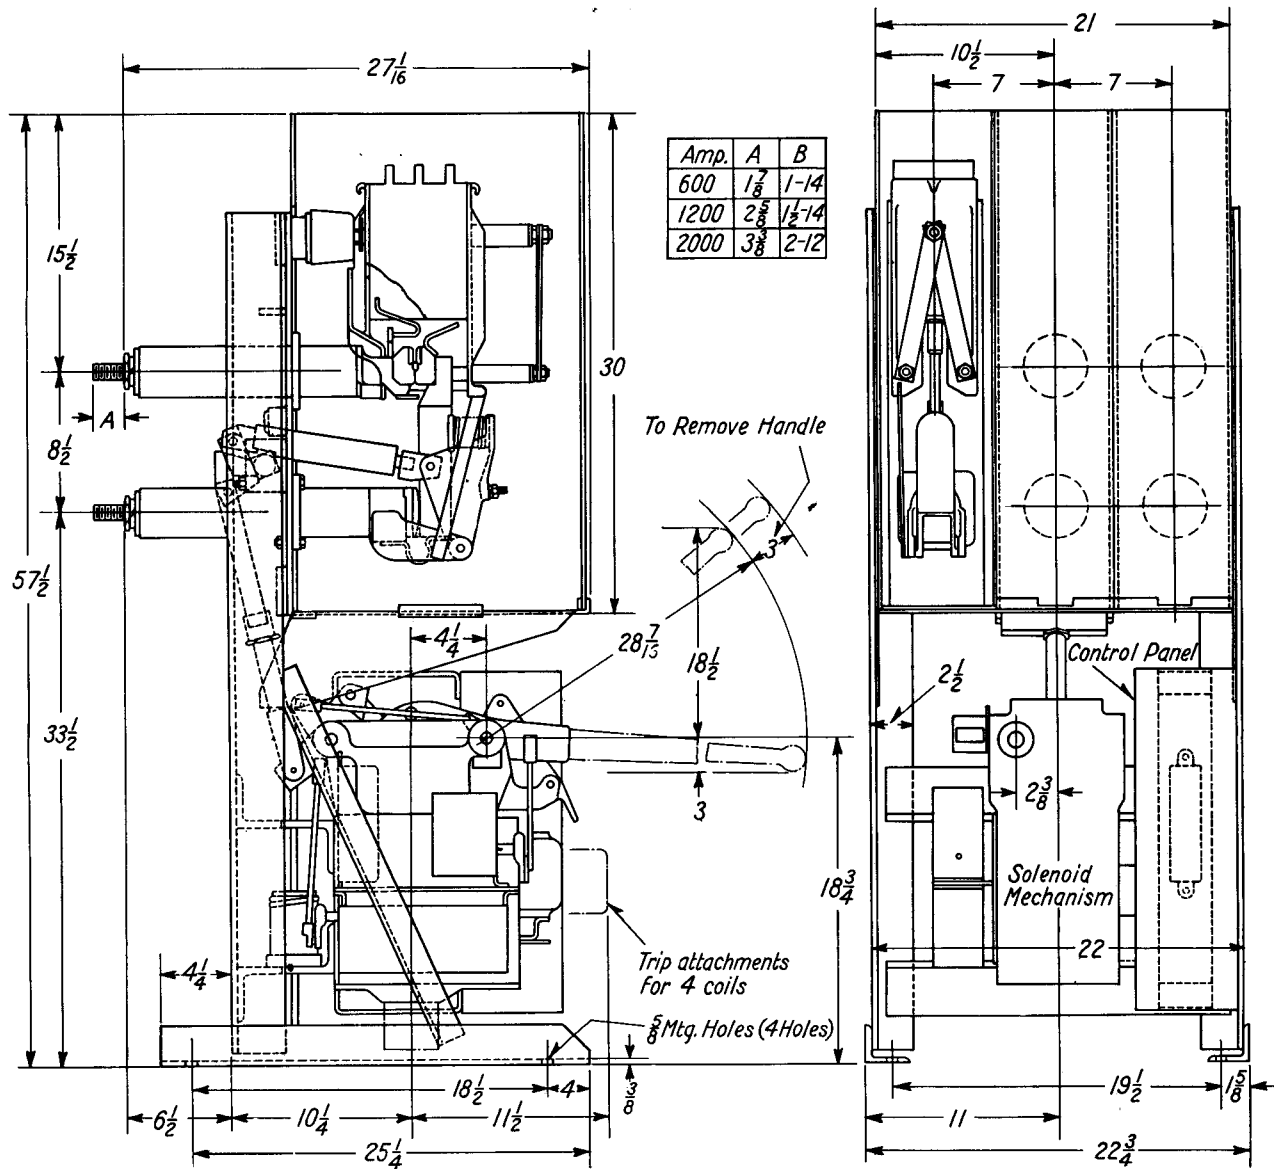


Figure 8  
Outline Drawing - Types 25-U-20, 25-U-25, 50-U-12  
and 50-U-20, 3 Pole "De-Ion" Air Circuit-Breakers

Dimensions are for reference only. For official dimensions refer to nearest district office.

# WESTINGHOUSE ELECTRIC & MANUFACTURING COMPANY

## Business Addresses

### Headquarters, Pittsburgh, Pa.

- \*AKRON, OHIO, 106 South Main St.  
 \*ALBANY, N. Y., 456 No. Pearl St.  
 \*ALEXANDRIA, VA., 121 Frazier Ave.  
 \*ALLEN TOWN, PA., 522 Maple St.  
 \*AMARILLO, TEXAS, 1401-A Fillmore St.  
 \*APPLETON, WISC., 1708 N. Drew St., P.O. Box 206  
 †APPLETON, WISC., 1029 So. Outagamie St.  
 †\*ATLANTA, GA., 426 Marietta St., N. W.  
 \*ATTICA, N. Y.  
 \*BAKERSFIELD, CALIF., 2224 San Emedio St.  
 \*BALTIMORE, MD., 118 E. Lombard St.  
 ①†BALTIMORE, MD., 501 East Preston St.  
 \*BALTIMORE, MD., 40 S. Calvert St.  
 ①xBALTIMORE, MD., 2519 Wilkens Ave.  
 ①\*BEAUMONT, TEXAS, 875 21st St.  
 P. O. Box 2367  
 \*BINGHAMTON, N. Y., Suite 704, Marine Midland Bldg., 86 Court St.  
 \*BIRMINGHAM, ALA., 2030 Second Ave.  
 \*BLUEFIELD, W. VA., 208 Bluefield Avenue  
 \*BOISE, IDAHO, P. O. Box 1597  
 \*BOSTON, MASS., 10 High St.  
 †\*BOSTON, MASS., 235 Old Colony Ave., So. Boston, Mass.  
 †\*BRIDGEPORT, CONN., Bruce Ave. & Seymour St.  
 \*BUFFALO, N. Y., 814 Ellicott Square Bldg.  
 †\*BUFFALO, N. Y., 1132 Seneca St.  
 \*BURLINGTON, VER., 207 Park Ave.  
 \*BUTTE, MONTANA, 129 West Park St.  
 ①\* BUTTE, MONTANA, 742 Bryant Ave.  
 \*CANTON, OHIO, 120 W. Tuscarawas St.  
 \*CEDAR RAPIDS, IOWA, 813 18th St., S.E., P. O. Box 148  
 †\*CHARLOTTE, N. C., 210 East Sixth St.  
 \*CHARLESTON, W. VA., 1415 Oakmont Rd., P. O. Box 865  
 \*CHATTANOOGA, TENN., 536 Marker St.  
 \*CHICAGO, ILL., 20 N. Wacker Drive  
 †\*CHICAGO, ILL., 2211 W. Pershing Road  
 xCHICOPEE FALLS, MASSACHUSETTS  
 †\*CINCINNATI, OHIO, 207 West Third St.  
 †\*CLEVELAND, OHIO, 1216 W. Fifty-Eighth St.  
 †x COLUMBIA, S. C., 912 Lady St.  
 \*COLUMBUS, OHIO, 85 E. Gay St.  
 \*DALLAS, TEXAS, 209 Browder St.  
 \*DALLAS, TEXAS, 1712 Laws St.  
 \*DAVENPORT, IOWA, 206 E. Second St.  
 \*DAYTON, OHIO, 30 North Main St.  
 \*DENVER, COLORADO, 910 Fifteenth St.  
 \*DENVER, COLORADO, 1700 Sixteenth St.  
 †DENVER, COLORADO, 988 Cherokee St.  
 \*DENVER, COLORADO, Gas & Elec. Bldg.  
 xDERRY, PA.  
 \*DES MOINES, IOWA, 1400-1408 Walnut St.  
 †\*DETROIT, MICH., 5757 Trumbull Ave., P.O. Box 828  
 \*DULUTH, MINN., 10 East Superior St.  
 \*EAST PEORIA, ILL., 900 W. Washington St.  
 x\*EAST PITTSBURGH, PA.  
 \*EL PASO, TEXAS, Oregon and Mills Sts.  
 \*EL PASO, TEXAS, 450 Canal St.  
 \*EL PASO, TEX., c/o Zork Hdw. Co., 309 N. El Paso St.  
 \*†EMERYVILLE, CALIF., 1466 Powell St.  
 ① xEMERYVILLE, CALIF., 6121 Green St.  
 \*ERIE, PA., 1003 State St.  
 \*EVANSVILLE, IND., 201 N. W. First St.  
 \*FAIRMONT, W. VA., 602 Cleveland Ave.  
 \*FARGO, N. D., 520—3rd Ave. N.  
 \*FORT WAYNE, IND., 1010 Packard Ave.  
 \*FORT WORTH, TEXAS, 501 Jones St.  
 \*FRESNO, CALIF., 872 Peralta Way, P. O. Box 632  
 \*GARY, IND., 846 Broadway  
 \*GRAND RAPIDS, MICH., 511 Monroe Ave. N. W.  
 ①\*GREENSBORO, N. C., N. Elm St. Apartments Apartment N-1 P. O. Box 1828  
 ①\*GREENVILLE, S. C., 110 W. Tallulah Drive, P. O. Box 1591  
 \*HAMMOND, IND., 235 167th St.  
 \*HARTFORD, CONN., Main & Pearl Sts., P. O. Box 745  
 \*HONOLULU, T. H., Hawaiian Elec. Co. Agt.  
 \*HOUSTON, TEXAS, 1314 Texas Ave.  
 \*HOUSTON, TEXAS, 2313 Commerce Ave.  
 †HOUSTON, TEXAS, 2315 Commerce Ave.  
 \*HOUSTON, TEXAS, 611-15 Petroleum Bldg.  
 †\*HUNTINGTON, W. VA., 1029 Seventh Ave.  
 \*INDIANAPOLIS, IND., 137 S. Penna. Ave.  
 \*INDIANAPOLIS, IND., 551 West Merrill St.  
 \*ISHPEMING, MICH., 433 High St.  
 \*JACKSON, MICH., 212 West Michigan Ave.  
 \*JOHNSTOWN, PA., 107 Station St.  
 \*JOPLIN, MO., 420 School St.  
 \*KANSAS CITY, MO., 101 W. Eleventh St.  
 †\*KANSAS CITY, MO., 2124 Wyandotte St.  
 \*KNOXVILLE, TENN., Gay & Clinch St.  
 xLIMA, OHIO  
 \*LITTLE ROCK, ARK., 1115 West 24th St.  
 \*LITTLE ROCK, ARK., c/o Fones Bros. Hdw. 2nd & Rock Sts.  
 †\*LOS ANGELES, CALIF., 420 So. San Pedro St.  
 ①\*LOUISVILLE, KY., 332 West Broadway  
 ①\*MADISON, WISC., 508 Edgewood Ave. P. O. Box 228  
 ①xMANSFIELD, OHIO, 246 E. Fourth St.  
 \*MARSHALL, TEXAS, 504 Nathan St.  
 \*MEMPHIS, TENN., 130 Madison Ave.  
 \*MIAMI, FLA., 1036 N. Miami Ave.  
 \*MILWAUKEE, WISC., 546 North Broadway  
 †MILWAUKEE, WISC., 1669 N. Water St.  
 †\*MINNEAPOLIS, MINN., 2303 Kennedy St., N. E.  
 \*MONROE, LA., 1301 N. Fourth St.  
 \*NASHVILLE, TENN., 219 Second Ave., N.  
 \*NEWARK, N. J., 1180 Raymond Blvd.  
 †\*NEWARK, N. J., Haynes Ave. & Lincoln Highway  
 xNEWARK, N. J., Plane & Orange St.  
 \*NEW HAVEN, CONN., 42 Church St., P.O. Box 1817  
 \*NEW ORLEANS, LA., 333 St. Charles St.  
 \*NEW ORLEANS, LA., 527 Poydras St.  
 \*NEW YORK, N. Y., 150 Broadway  
 ①NEW YORK, N. Y., 150 Varick St.  
 \*NIAGARA FALLS, N. Y., 205 Falls St.  
 \*NORFOLK, VA., City Hall Ave. & Bank St.  
 \*OKLAHOMA CITY, OKLA., 120 N. Robinson St.  
 \*OKLAHOMA CITY, OKLA., Third & Allie Sts.  
 \*OMAHA, NEB., 409 South Seventeenth St.  
 \*OMAHA, NEB., 117 N. 13th St.  
 \*PEORIA, ILL., 104 E. State St.  
 †\*PHILADELPHIA, PA., 3001 Walnut St.  
 \*PHOENIX, ARIZONA, 11 West Jefferson St.  
 \*PHOENIX, ARIZONA, 425 Jackson St.  
 xPITTSBURGH, PA., Nuttall Works, 200 McCandless Ave.  
 z\*PITTSBURGH, PA., 306 4th Ave., Box 1017  
 †PITTSBURGH, PA., 543 N. Lang Ave.  
 \*PORTLAND, MAINE, 142 High St.  
 \*PORTLAND, OREGON, 309 S. W. Sixth Ave.  
 †PORTLAND, OREGON, 2138 N. Interstate Ave.  
 †PORTLAND, OREGON, 720 N. Thompson St.  
 \*PROVIDENCE, R. I., 16 Elbow St.  
 \*RALEIGH, N. C., 803 North Person St., P. O. Box 2146  
 \*RALEIGH, N. C., P. O. Box 443  
 \*READING, PA., 619 Spruce St.  
 ①\*RICHMOND, VA., 301 S. Fifth St.  
 \*ROANOKE, VA., 726 First St., S.E.  
 †ROCHESTER, N. Y., 410 Atlantic Ave.  
 \*ROCHESTER, N. Y., 1048 University Ave.  
 \*ROCKFORD, ILL., 130 South Second St.  
 \*SACRAMENTO, CALIF., 1805 20th St.  
 ①SALT LAKE CITY, UTAH, 10 West First South St.  
 †SALT LAKE CITY, UTAH, 346 A Pierpont Ave.  
 \*SAN ANTONIO, TEXAS, 115 W. Travis St.  
 \*SAN FRANCISCO, CALIF., 1355 Market St.  
 \*SAN FRANCISCO, CALIF., 1 Montgomery St.  
 \*SEATTLE, WASH., 603 Stewart St.  
 †SEATTLE, WASH., 3451 East Marginal Way  
 xSHARON, PA., 469 Sharpville Ave.  
 \*SIOUX CITY, IOWA, 2311 George St.  
 \*SOUTH BEND, IND., 216 East Wayne St.  
 \*SOUTH BEND, IND., 107 E. Jefferson St.  
 xSOUTH PHILA. WKS., Essington, Pa.  
 \*SOUTH PHILA. WKS., P. O. Box 7348, Philadelphia, Pa.  
 ①\*SPOKANE, WASH., 158 S. Monroe St.  
 \*SPRINGFIELD, ILL., 601 E. Adams St., Box 37  
 \*SPRINGFIELD, MASS., 395 Liberty St.  
 xSPRINGFIELD, MASS., 653 Page Boulevard  
 \*ST. LOUIS, MO., 411 North Seventh St.  
 †ST. LOUIS, MO., 717 South Twelfth St.  
 \*SYRACUSE, N. Y., 420 N. Geddes St.  
 \*TACOMA, WASH., 1023 "A" St.  
 \*TAMPA, FLA., 417 Ellamae Ave., Box 230  
 \*TOLEDO, OHIO, 245 Summit St.  
 ①xTRAFFORD CITY, PA.  
 \*TULSA, OKLA., 303 East Brady St.  
 \*†UTICA, N. Y., 113 N. Genesee St.  
 \*WASHINGTON, D. C., 1434 New York Ave., N. W.  
 ①\*WATERLOO, IOWA, 328 Jefferson St., P. O. Box 719  
 \*WICHITA, KAN., 233 So. St. Francis Ave.  
 †WILKES-BARRE, PA., 267 N. Pennsylvania Ave.  
 \*†WORCESTER, MASS., 32 Southbridge St.  
 \*YORK, PA., 143 So. George St.  
 \*YOUNGSTOWN, OHIO, 25 E. Boardman St.

Where address and P. O. box are both given, send mail to P. O. box, telegrams to address indicated.

## WESTINGHOUSE AGENT JOBBERS

### Westinghouse Electric Supply Company

Fully equipped sales offices and warehouses are maintained at all addresses

ALBANY, N. Y., 454 No. Pearl St.  
 ALLEN TOWN, PA., 522 Maple St.  
 ATLANTA, GA., 96 Poplar St., N. W.  
 AUGUSTA, MAINE, 90 Water St.  
 BALTIMORE, MD., 40 South Calvert St.  
 BANGOR, MAINE, 175 Broad St.  
 BINGHAMTON, N. Y., 87 Chenango St.  
 BOSTON, MASS., 76 Pearl St.  
 BURLINGTON, VT., 208 Flynn Ave.  
 BUTTE, MONTANA, 50 East Broadway  
 CHARLOTTE, N. C., 210 East Sixth St.  
 CHICAGO, ILL., 113 North May St.  
 CLEVELAND, OHIO, 3950 Prospect Ave.  
 COLUMBIA, S. C., 915 Lady St.  
 DALLAS, TEXAS, 409 Browder St.  
 DES MOINES, IOWA, 1400 Walnut St.  
 DETROIT, MICH., 547 Harper Ave.  
 DULUTH, MINN., 308 W. Michigan St.  
 EVANSVILLE, IND., 201 N. W. First St.  
 FLINT, MICH., 1314 N. Saginaw St.  
 FORT WORTH, TEXAS, 501 Jones St.  
 GRAND RAPIDS, MICH., 511 Monroe Ave., N. W.  
 GREENVILLE, S. C., 226 Pendleton St.  
 HOUSTON, TEXAS, 1903 Ruiz St.  
 INDIANAPOLIS, IND., 137 S. Pennsylvania St.

JACKSONVILLE, FLA., 37 South Hogan St.  
 LOS ANGELES, CALIF., 905 East Second St.  
 MADISON, WISC., 1022 E. Washington Ave.  
 MIAMI, FLA., 1036 North Miami Ave.  
 MEMPHIS, TENN., 366 Madison Ave.  
 MILWAUKEE, WISC., 546 N. Broadway  
 MINNEAPOLIS, MINN., 215 South Fourth St.  
 NEWARK, N. J., 49 Liberty St.  
 NEW HAVEN, CONN., 240 Cedar St.  
 zNEW YORK, N. Y., 150 Varick St.  
 NORFOLK, VA., 320 City Hall Ave.  
 OAKLAND, CALIF., Tenth & Alice Sts.  
 OKLAHOMA CITY, OKLA., 10 E. California St.  
 OMAHA, NEB., 117 North Thirteenth St.  
 PEORIA, ILL., 104 East State St.  
 PHILADELPHIA, PA., 1101 Race St.  
 PHOENIX, ARIZONA, 315 West Jackson St.  
 PORTLAND, OREGON, 134 N. W. Eighth Ave.  
 PROVIDENCE, R. I., 66 Ship St.  
 RALEIGH, N. C., 322 S. Harrington St.  
 READING, PA., 619 Spruce St.  
 RICHMOND, VA., 301 South Fifth St.  
 ROANOKE, VA., 726 First St., S. E.  
 ROCHESTER, N. Y., 1048 University Ave.  
 ST. LOUIS, MO., 1011 Spruce St.

ST. PAUL, MINN., 145 East Fifth St.  
 SACRAMENTO, CALIF., 20th and R Sts.  
 SALT LAKE CITY, UTAH, 235 West South Temple St.  
 SAN ANTONIO, TEXAS, 1211 E. Houston St.  
 SAN FRANCISCO, CALIF., 260 Fifth St.  
 SEATTLE, WASH., 558 First Ave., South  
 SIOUX CITY, IOWA, 1005 Dace St.  
 SPOKANE, WASH., 152 So. Monroe St.  
 SPRINGFIELD, MASS., 46 Hampden St.  
 SYRACUSE, N. Y., 961 W. Genesee St.  
 TAMPA, FLA., 417 Ellamae St.  
 \*TERRE HAUTE, IND., 234 S. 3rd St.  
 TOLEDO, OHIO, 812 Lafayette St.  
 TRENTON, N. J., 245 N. Broad St.  
 TULSA, OKLA., 303 East Brady St.  
 UTICA, N. Y., 113 N. Genesee St.  
 WASHINGTON, D. C., 1216 "K" St., N.W.  
 WATERLOO, IOWA, 328 Jefferson St.  
 WICHITA, KANSAS, 233 So. St. Francis Ave.  
 WILMINGTON, DEL., 216 E. Second St.  
 WORCESTER, MASS., 24 Southbridge St.  
 YORK, PA., 143 S. George St.

\* Sales Office † Service Shop x Works # Warehouse \*First Class Mail Only § Merchandising Products Only z Headquarters ‡ Apparatus Products Only  
 ©Changed or added since previous issue  
 HP, DOP, SEP, BA, SP.

July, 1938

## WESTINGHOUSE AGENT JOBBERS—Continued

### Other Agent Jobbers

ABILENE, KAN., Union Electric Co.  
AKRON, OHIO, The Mook Electric Supply Co.  
BIRMINGHAM, ALA., Moore-Handley Hdw. Co.  
BLUEFIELD, W. VA., Superior-Sterling Co.  
BUFFALO, N. Y., McCarthy Bros. & Ford  
CANTON, OHIO, The Mook Electric Supply Co.  
CHATTANOOGA, TENN., Mills & Lupton Supply Co.  
CHICAGO, ILL., Hyland Electrical Supply Co.

CINCINNATI, OHIO, The Johnson Electric Supply Co.  
COLUMBUS, OHIO, Pixley Electric Supply Co.  
DENVER, COL., The Mine & Smelter Supply Co.  
EL PASO, TEX., Mine & Smelter Supply Co.  
ERIE, PA., Star Electrical Co.  
HUNTINGTON, W. VA., Banks-Miller Supply Co.  
KANSAS CITY, MO., Columbian Elec'l Co.  
KANSAS CITY, MO., Continental Elec. Co.

LOUISVILLE, KY., Tafel Electric Co.  
MONROE, LA., Monroe Hardware Co.  
NASHVILLE, TENN., Tafel Electric Co.  
NEW ORLEANS, LA., Electrical Supply Co.  
NEW YORK, N. Y., Times Appliance Co., Inc.  
PITTSBURGH, PA., Iron City Electric Co.  
SAN DIEGO, CALIF., The Electric Supplies Distributing Co.  
SCRANTON, PA., Penn Elec'l Engineering Co.  
YOUNGSTOWN, OHIO, Mook Electric Supply Co.

## WESTINGHOUSE ELECTRIC & MFG. CO., LAMP DIVISION

\*ALBANY, N. Y., 456 N. Pearl St.  
\*ATLANTA, GA., 426 Marietta St.  
\*BALTIMORE, MD., 118 E. Lombard St.  
\*BELLEVILLE, N. J., 720 Washington Ave.  
\*BLOOMFIELD, N. J., Clearfield Ave.  
\*BOSTON, MASS., 10 High St.  
① BOSTON, MASS., 235 Old Colony Ave., S. Boston Mass.  
\*BUFFALO, N. Y., 295 Main St.  
\*CHICAGO, ILL., 20 North Wacker Drive  
\*CHICAGO, ILL., 2211 W. Pershing Road  
\*CINCINNATI, OHIO, Third & Elm Sts.  
\*CLEVELAND, OHIO, 1216 W. 58th St.  
\*COLUMBUS, OHIO, Gay & Third St.  
\*DALLAS, TEXAS, 209 Browder St.  
\*DAVENPORT, IOWA, 206 East Second St.  
\*DENVER, COLO., 910 Fifteenth St.  
\*DES MOINES, IOWA, 218 West Second St.

\*DETROIT, MICH., 5757 Trumbull Ave.  
① EMERYVILLE, CALIF., 5915 Green St.  
\*HOUSTON, TEXAS, 1314 Texas Ave.  
\*HUNTINGTON, W. VA., 1029 Seventh Ave.  
\*INDIANAPOLIS, IND., 137 So. Penna. Ave.  
\*JACKSON, MICH., Consumers Power Bldg.  
\*KANSAS CITY, MO., 101 W. Eleventh St.  
\*LOS ANGELES, CALIF., 420 S. San Pedro St.  
\*LOUISVILLE, KY., 332 West Broadway  
\*MEMPHIS, TENN., 130 Madison St.  
\*MILWAUKEE, WISC., 546 North Broadway  
\*MINNEAPOLIS, MINN., 2303 Kennedy St., N. E.  
\*NEW ORLEANS, LA., 333 St. Charles St.  
\*NEW YORK, N. Y., 150 Broadway  
\*OKLAHOMA CITY, OKLA., 10 E. California St.

\*OMAHA, NEB., 409 So. Seventeenth St.  
\*PHILADELPHIA, PA., 3001 Walnut St.  
\*PITTSBURGH, PA., 306 4th Ave., Box 1017  
\*PITTSBURGH, PA., Try St. Terminal Bldg.  
\*ROCHESTER, N. Y., 1048 University Ave.  
\*SALT LAKE CITY, UTAH, 10 West First South St.  
\*SAN FRANCISCO, CALIF., 1 Montgomery St.  
\*SAN FRANCISCO, CALIF., 60 Federal St.  
\*SEATTLE, WASH., 603 Stewart St.  
\*SEATTLE, WASH., 3451 East Marginal Way  
\*ST. LOUIS, MO., 411 No. Seventh St.  
\*ST. LOUIS, MO., 1219 21 Gratoir St.  
\*SYRACUSE, N. Y., 109 So. Warren Street  
\*TOLEDO, OHIO, 245 Summit St.  
\*TRENTON, N. J., 400 Pennington Ave.  
\*WASHINGTON, D. C., 1434 N. Y. Ave., N. W.

## WESTINGHOUSE ELECTRIC ELEVATOR COMPANY

BALTIMORE, MD., 39 West Lexington Ave.  
① BOSTON, MASS., 164 Stuart St.  
BROOKLYN, N. Y., 528 Bergen St.  
BUFFALO, N. Y., 826 Elliott Sq. Bldg.  
\*CHICAGO, ILL., 1500 North B'nch St.  
\*CHICAGO, ILL., 222 No. Bank Drive  
CINCINNATI, OHIO, Third & Elm Sts.  
CLEVELAND, OHIO, 842 Rockefeller Bldg.  
① COLUMBUS, OHIO, 85 E. Gay St.  
DALLAS, TEXAS, 209 Browder St.

DENVER, COLO., 1052 Gas & Electric Bldg.  
DES MOINES, IOWA, 1408 Walnut St.  
DETROIT, MICH., 5757 Trumbull Ave.  
① DUBUQUE, IOWA, 435 Curtis St.  
HOUSTON, TEXAS, 2315 Commerce St.  
INDIANAPOLIS, IND., 551 W. Merrill St.  
\*JERSEY CITY, N. J., 150 Pacific Ave.  
KANSAS CITY, MO., 101 W. Eleventh St.  
LOS ANGELES, CALIF., 420 So. San Pedro St.

NEWARK, N. J., 14 Bridge St.  
NEW YORK, N. Y., 9 Rockefeller Plaza  
NEW YORK, N. Y., 128 E. 149 St.  
PHILADELPHIA, PA., 3001 Walnut St.  
PITTSBURGH, PA., 435 Seventh Ave.  
PORTLAND, ORE., 415 Terminal Sales Bldg.  
ST. LOUIS, MO., 411 North Seventh St.  
SAN FRANCISCO, CALIF., 1 Montgomery St.  
① STEUBENVILLE, OHIO, 308 Natl. Exch. Bldg.  
WASHINGTON, D. C., 1112 21st St., N. W.

## WESTINGHOUSE ELECTRIC INTERNATIONAL COMPANY

\*NEW YORK CITY, N. Y., 150 Broadway  
\*LONDON, W. C. 2, ENGLAND, 2 Norfolk St., Strand  
\*SYDNEY, AUSTRALIA, Box 2634-EE, G.P.O.  
\*RIO DE JANEIRO, BRAZIL, Caixa Postal 687  
\*SANTIAGO, CHILE, Casilla 1897  
\*MILANO, ITALY, Piazza Crispi 3  
\*WELLINGTON, NEW ZEALAND, 2 Taranaki St.  
\*LIMA, PERU, Edificio Wiese, Esquina Nunez y Filipinas

\*MANILA, P. I., P. O. Box 998  
\*PANAMA, Republic of Panama, P.O. Box 112  
\*SAO PAULO, BRAZIL, Caixa Postal 636  
\*SAN JUAN, Puerto Rico, P. O. Box 1539  
\*CIA. WESTINGHOUSE INTERNACIONAL S. A., Rivadavia 819, Buenos Aires, Argentine  
\*CIA. WESTINGHOUSE ELEC. DE CUBA, Manzana de Gomez, 232-236 Apartado 2289, Havana, Cuba

\*WESTINGHOUSE ELEC. CO. OF INDIA, LTD. Feltham House, Graham Road. Ballard Estate, Bombay, India  
\*CIA. WESTINGHOUSE ELEC. INTERNACIONAL Edificio la Nacional Apartado 78-Bis, Mexico, D. F. Mexico  
\*MEXICO, (West Coast) Mr. John H. Knost, 1248 East Fifth St., Tucson, Arizona  
\*WESTINGHOUSE ELEC. CO. OF SOUTH AFRICA, LTD., P. O. Box 6067, Johannesburg, South Africa

## WESTINGHOUSE X-RAY COMPANY, INC.

\*ATLANTA, GA., 565 W. Peachtree St., N. E.  
\*BALTIMORE, MD., 118 East Lombard St.  
\*BOSTON, MASS., 270 Commonwealth Ave.  
\*CHICAGO, ILL., 512 S. Peoria St.  
\*CLEVELAND, OHIO, 7016 Euclid Ave.  
\*DALLAS, TEXAS, 207 Browder St.

\*DETROIT, MICH., 5757 Trumbull Ave.  
\*LONG ISLAND CITY, N. Y., 21-16 43rd Ave.  
\*LOS ANGELES, CALIF., 420 S. San Pedro St.  
\*MILWAUKEE, WISC., 534 North Broadway  
\*NEW ORLEANS, LA., 608 Commercial Place

\*NEW YORK, N. Y., 173 E. Eighty-Seventh St.  
\*OMAHA, NEB., 117 N. Thirteenth St.  
\*PHILADELPHIA, PA., 3001 Walnut St.  
\*PITTSBURGH, PA., 3702 Fifth Ave.  
\*ROCHESTER, N. Y., 41 Chestnut St.  
\*SAN FRANCISCO, CALIF., 870 Market St.

## BRYANT ELECTRIC COMPANY

\*BOSTON, MASS., 10 High St.  
\*BRIDGEPORT, CONN., Main Plant, 1421 State St.  
\*BRIDGEPORT, CONN., Plastics Division Plant, 1105 Railroad Ave.  
\*CHICAGO, ILL., 844 West Adams St.  
① \*LOS ANGELES CALIF., 420 S. San Pedro St.  
① \*NEW YORK, N. Y., 101 Park Ave.  
\*SAN FRANCISCO, CALIF., 325 Ninth St.

## WESTINGHOUSE RADIO STATIONS

STATION KDKA, 310 Grant St., Pittsburgh, Pa.  
STATION WBZ, 271 Tremont St., Boston, Mass.  
STATION KYW, 1619 Walnut St., Philadelphia, Pa.  
STATION WBZA, Hotel Kimball, Springfield, Mass.  
STATION WOWO, 925 So. Harrison St., Fort Wayne, Ind.  
STATION WGL, 925 So. Harrison St., Fort Wayne, Ind.

## CANADIAN WESTINGHOUSE COMPANY, LIMITED

\*† CALGARY, 320 Eighth Avenue West, Calgary, Alberta, Can.  
\*† EDMONTON, 10127, 104th St., Armstrong Block, Edmonton, Alberta, Can.  
\*† FORT WILLIAM, 112 McVicar St., Fort William, Ontario, Can.  
\*† HALIFAX, 158 Granville St., Halifax, Nova Scotia, Can.  
\*† HAMILTON, Hamilton, Ontario, Can.  
\*† LONDON, 504 Huron & Erie Bldg., London, Ontario, Canada  
\*† MONTREAL, 1135 Beaver Hall Hill, Montreal, Quebec, Can.  
\*† MONTREAL, 400 McGill St., Montreal, Quebec, Can.  
\*† MONTREAL, 1844 William St., Montreal, Quebec, Can.

\*† NELSON, B. C. Can., P. O. Box 1124  
\*† OTTAWA, Ahearn & Soper Limited, P. O. Box 779, Ottawa, Ontario, Can.  
\*† REGINA, 2408 Eleventh Ave., Regina, Saskatchewan, Can.  
\*† SASKATOON, 238 First Ave. N., Saskatchewan, Canada  
\*† SWASTIKA, Childs Ave., Swastika, Ontario, Canada  
\*† TORONTO, 355 King St. West, Toronto, Ontario, Can.  
\*† VANCOUVER, 1418 Marine Bldg., Vancouver, B. C., Can.  
\*† VANCOUVER, 1090 Homer St., Vancouver, B. C., Can.  
\*† WINNIPEG, 158 Portage Ave. East, Winnipeg, Manitoba, Can.

① Changed or added since previous issue.

\* Sales Office † Service Shop x Works # Warehouse z Headquarters y Executive Office § Merchandising Products Only ‡ Apparatus Products Only

R-816

Industrial Relations

July, 1938  
Supersedes Issue dated April, 1938