




UNPACKING • HANDLING • STORING INSTRUCTIONS

OUTDOOR CONDENSER BUSHINGS TYPE "O" SHIPPED IN BOXES

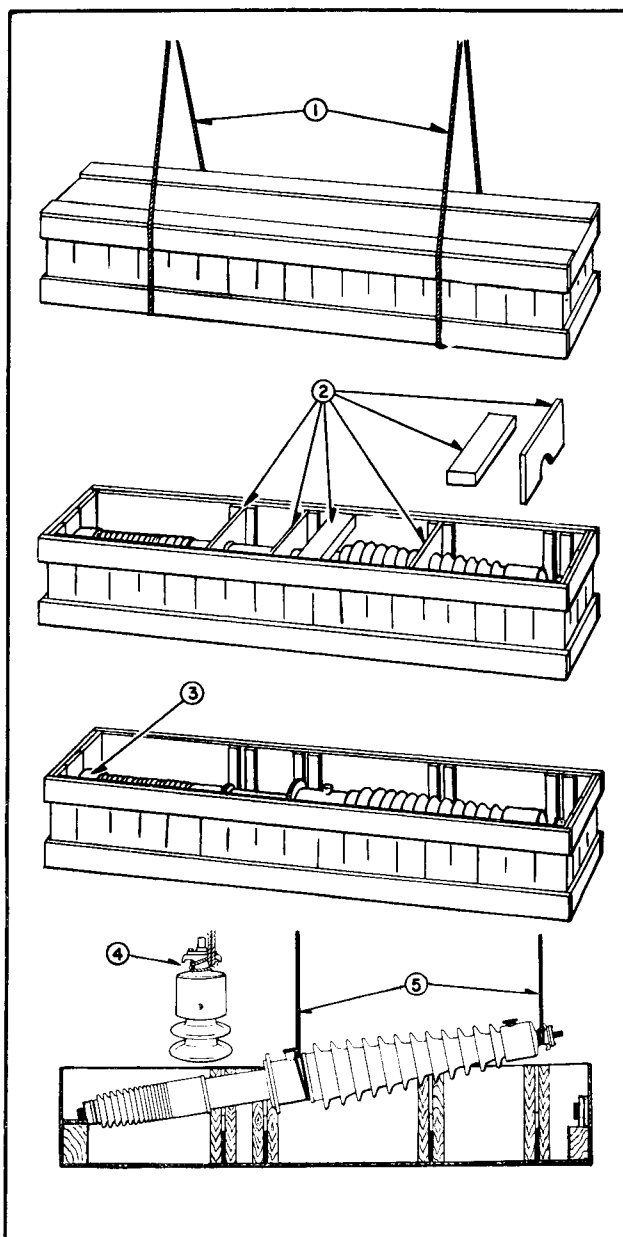

Examine the shipment immediately for damage in transit. If damaged, file claim with the carrier and notify the nearest Westinghouse Sales Office.

UNPACKING AND HANDLING

The following numbered steps refer to the corresponding numbers on the illustration:

1. Lift the box with slings as shown.
2. Remove the cover and spacers from the box. Use a nail puller where possible. Lift out the top halves of the centering collars.
3. Remove the blocking from the ends of the bushing to free the bushing. Do not allow porcelain casings to be struck by tools or against the box while handling as these parts are easily damaged.
4. Attach a rope or steel cable around the top of the bushing under the lifting lugs as shown.
5. When lifting from a horizontal packing case, it is desirable to use a double hoist with one lift at the flange and one looped under the lifting lugs. Do not lift by the porcelain or pivot the bushing on the lower porcelain. Keep the lower end of the bushing on felt or wood, braced to prevent slipping and with porcelain away from the floor.

STORING

The bushing may be removed from the box for inspection and storage in a clean safe place, or it may be stored in the box to avoid damage. The bushing should be stored in a vertical position or with the cap end at least 10 inches higher than the opposite end.

WESTINGHOUSE ELECTRIC CORPORATION

**POWER CIRCUIT BREAKER DEPT.
TRANSFORMER DIVISION**

**TRAFFORD, PA.
SHARON, PA.**

SUPERSEDES I.L. 33-155-5

MARCH, 1961

Printed in U.S.A