



**Westinghouse Electric Corporation**  
Distribution and Control Business Unit  
Assemblies Division  
Greenwood, SC 29646

Descriptive Bulletin  
**32-255**

Page 1

June, 1987  
Supersedes Descriptive Bulletin 32-255,  
pages 1-24, dated October, 1986  
Mailed to: E, D, C/32-000A

Up to 1000 MVA (37 kA) at 15000 Volts  
Up to 350 MVA (41 kA) at 4760 Volts  
1200 and 2000 Amperes  
Indoor and Outdoor

## **VacClad-W Medium Voltage Metal-Clad Switchgear**





## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Description and Application

VacClad-W Metal-Clad Switchgear is an integrated assembly of drawout vacuum circuit breakers, bus, and control devices coordinated electrically and mechanically for medium voltage circuit protection. The Metal-Clad integrity provides maximum circuit separation and safety. Included are isolated grounded metal compartments, complete insulation of all conductors and no live parts exposed by the opening of a door. It is typically used on circuits involving feeder circuits, transmission lines, distribution lines and motors.

All major components are manufactured by Westinghouse, establishing one source of responsibility for the equipment and assuring high standards in quality, coordination, reliability and service.

VacClad-W Switchgear is available in voltage ratings of 4.76kV through 15kV and in nominal interrupting capacities of 250MVA(29kA), 350MVA(41kA), 500MVA (18kA), 500MVA(41kA), 750MVA(28kA), 1000MVA(37kA) and for indoor or outdoor applications.

VacClad-W Switchgear meets or exceeds ANSI C37.20, NEMA SG-5 and IEEE standards as they apply to Metal-Clad Switchgear. The circuit breaker also meets IEC standards.

VacClad-W Switchgear is designed to meet needs in six important areas:


1. Performance
2. Safety
3. Maintenance
4. Space Utilization
5. Application flexibility
6. Reliability

### Features

- ① **Vacuum Interrupter Current Transfer Conductor** (See Pg. 17)  
The Westinghouse "Stiff-Flexible" design eliminates the need for a main conductor sliding contact and its costly maintenance.
- ② **Breaker Rails** (See Pg. 16)  
The breaker and auxiliaries can be withdrawn on rails for inspection and maintenance without the need for a separate lifting device.
- ③ **Front Breaker Mechanism** (See Pg. 16)  
The stored energy mechanism is on the front of the breaker so the inspection or maintenance can be done with the breaker on rails.
- ④ **Horizontal Drawout Circuit Breaker** (See Pg. 10)  
Type VCP-W breaker is a horizontal drawout design, which provides connect, test, and disconnect position.
- ⑤ **Automatic Shutters** (See Pg. 6)  
These steel shutters operate automatically when the circuit breaker is withdrawn, to protect workmen from accidental contact with the stationary primary contacts.
- ⑥ **Main Bus System** (See Pg. 8)  
The main bus has fluidized bed, track-resistant epoxy insulation with plated joints and constant pressure washers.
- ⑦ **Current Transformers** (See Pg. 7)  
There is space for up to four current transformers per phase which are easily accessible from the front.
- ⑧ **Primary and Secondary Contacts** (See Pg. 10)  
All moving breaker contacts are self-aligning, have positive action, and are silver-plated.
- ⑨ **Metal Compartment Barriers**  
All compartments are enclosed by grounded metal barriers.
- ⑩ **Barriers**  
Barriers are breaker mounted.
- ⑪ **Breaker Wheels** (See Pg. 10)  
Breaker can be rolled on floor when removed from the structure.
- ⑫ **Auxiliary Compartment Shutter** (See Pg. 9)  
This shutter operates automatically when the auxiliary drawer is withdrawn to protect workmen from accidental contact with the stationary primary contacts.




## Type VacClad-W Medium Voltage Metal-Clad Switchgear

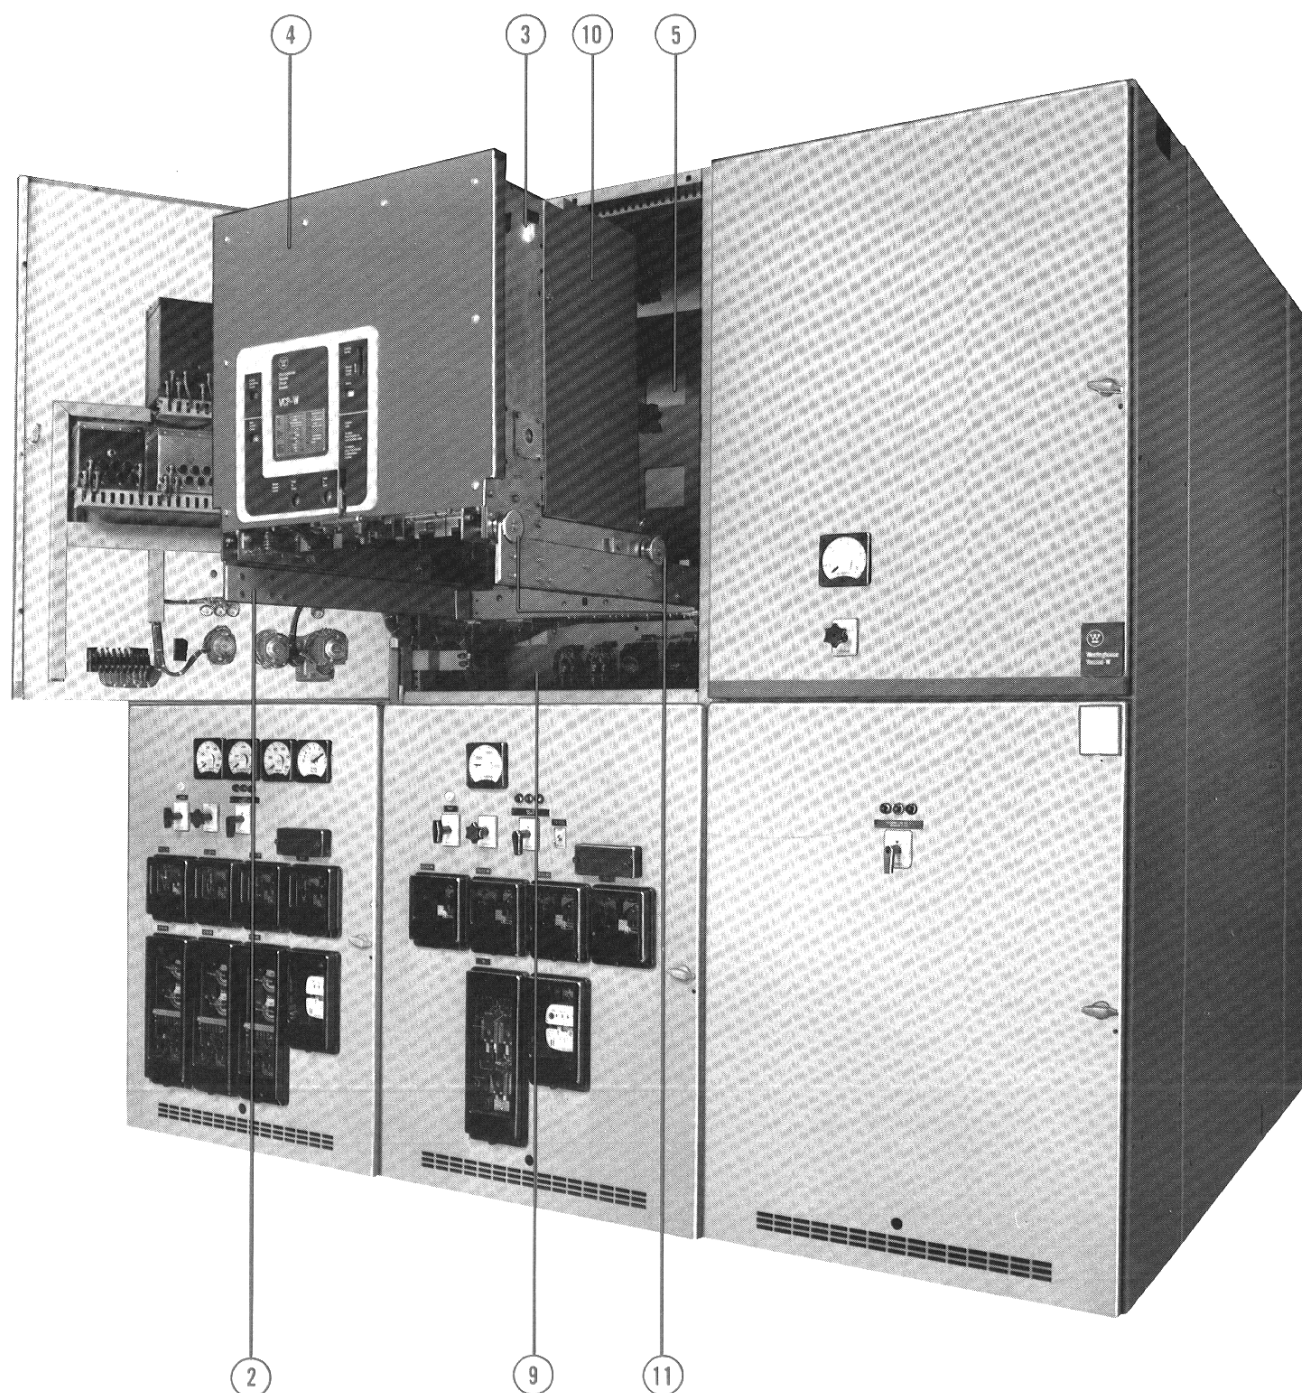



## Type VacClad-W Medium Voltage Metal-Clad Switchgear

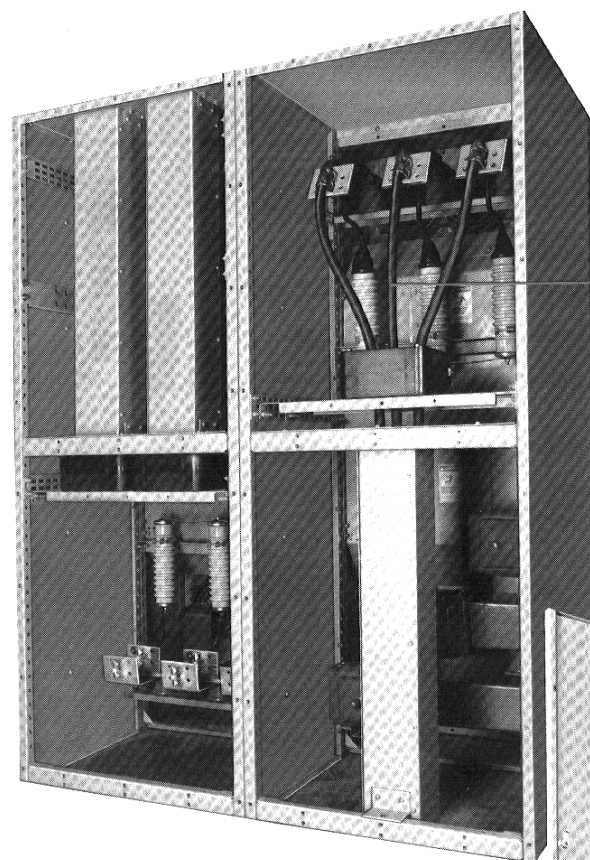

**13 Cable Space**


Ample space is provided for cables, potheads, and other related components. Top or bottom cable entry is available. (See Space Utilization, Page 18, Application Flexibility, Page 19, and Maintenance, Page 15)

**14 Potential Transformers**

Potential transformers are drawer mounted for front accessibility and can be completely withdrawn on rail extensions similar to the breaker. (See Maintenance, Page 15 and Performance Page 9)

**15 Control Power Transformers**


Drawer mounting makes control power transformers accessible, they can be completely withdrawn the same as the potential transformer. (See Maintenance, Page 15 and Performance, Page 9)

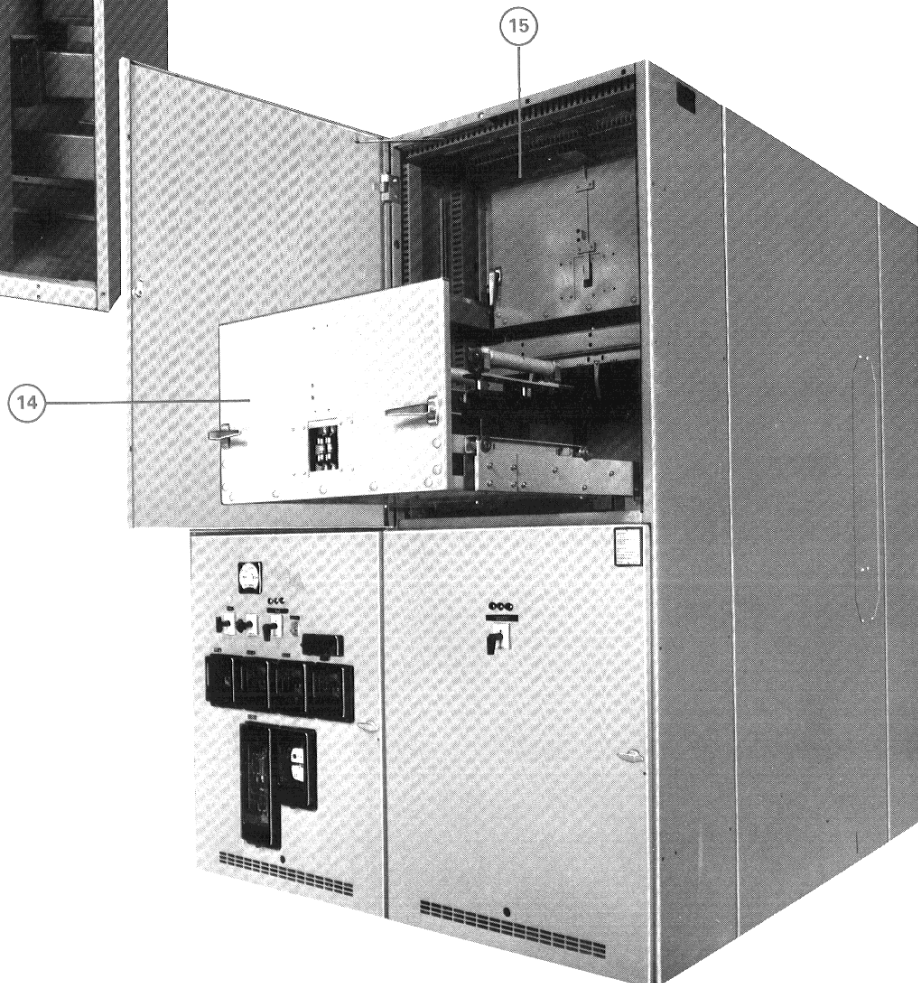





## Type VacClad-W Medium Voltage Metal-Clad Switchgear

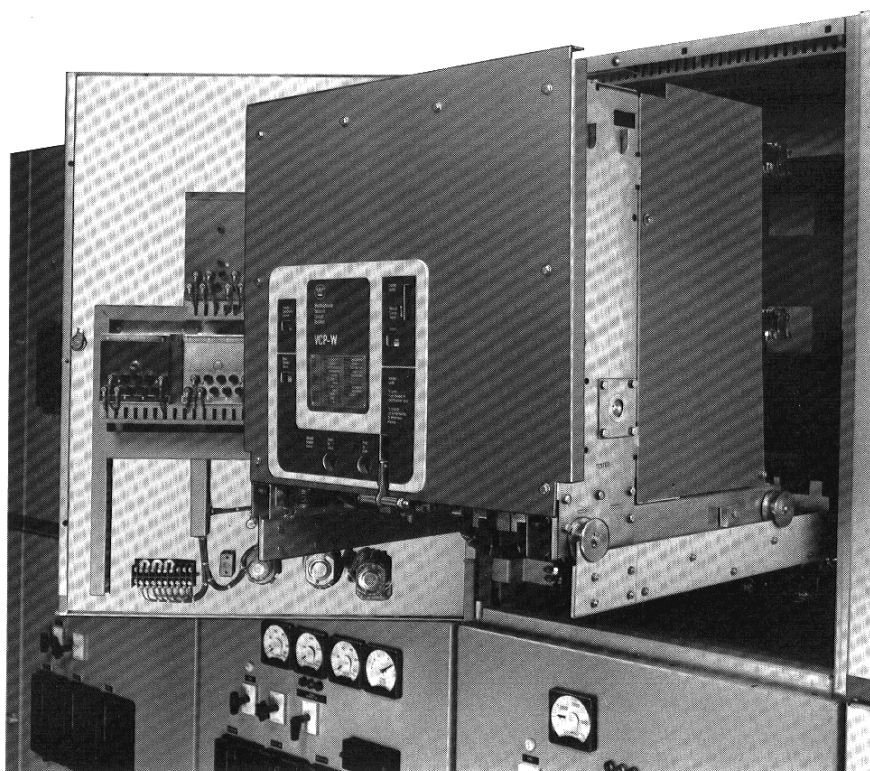

Type VCP-W circuit breaker utilizing vacuum interrupters is available in ANSI and IEC ratings, plus several special ratings to provide maximum application flexibility.

### Performance

VacClad-W Metal-Clad Switchgear offers a total design concept of cell, breaker and auxiliary equipment to meet the user needs. The design criteria was full compliance with ANSI, IEEE, NEMA and IEC standards. Conformance to industry standards assures a high level of performance and permits the specifier with ease and accuracy to define a level of performance developed by the industry for its needs.

The applicable industry standards are:

- |          |  |
|----------|--|
| ANSI     | American National Standards Institute  |
| C37.010  | Application guide for AC high voltage circuit breakers rated on a symmetrical current basis    |
| C37.100  | Definitions for power switchgear   |
| C37.04   | Rating structure for AC high voltage circuit breakers  |
| C37.06   | Preferred ratings for AC high voltage circuit breakers as rated on a symmetrical current basis |
| C37.07   | Factors for reclosing service  |
| C37.09   | Test Procedure for AC high voltage circuit breakers  |
| C37.11   | Power circuit breaker control  |
| C37.20   | Switchgear assemblies including metal-enclosed bus   |
| C37.24   | Guide for evaluating the effect of solar radiation   |
| NEMA     | National Electrical Manufacturers Association  |
| SG-4     | Power Circuit Breakers   |
| SG-5     | Power Switchgear Assemblies  |
| IEC 56.4 | High Voltage AC Circuit Breakers   |




## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Performance, *Continued*

#### Cell Features

Steel shutters which are operated by the circuit breaker prevent accidental contact with live primary voltage parts, when the breaker is withdrawn.

The photo shows the breaker compartment with the breaker and CT barrier removed showing the steel shutters.

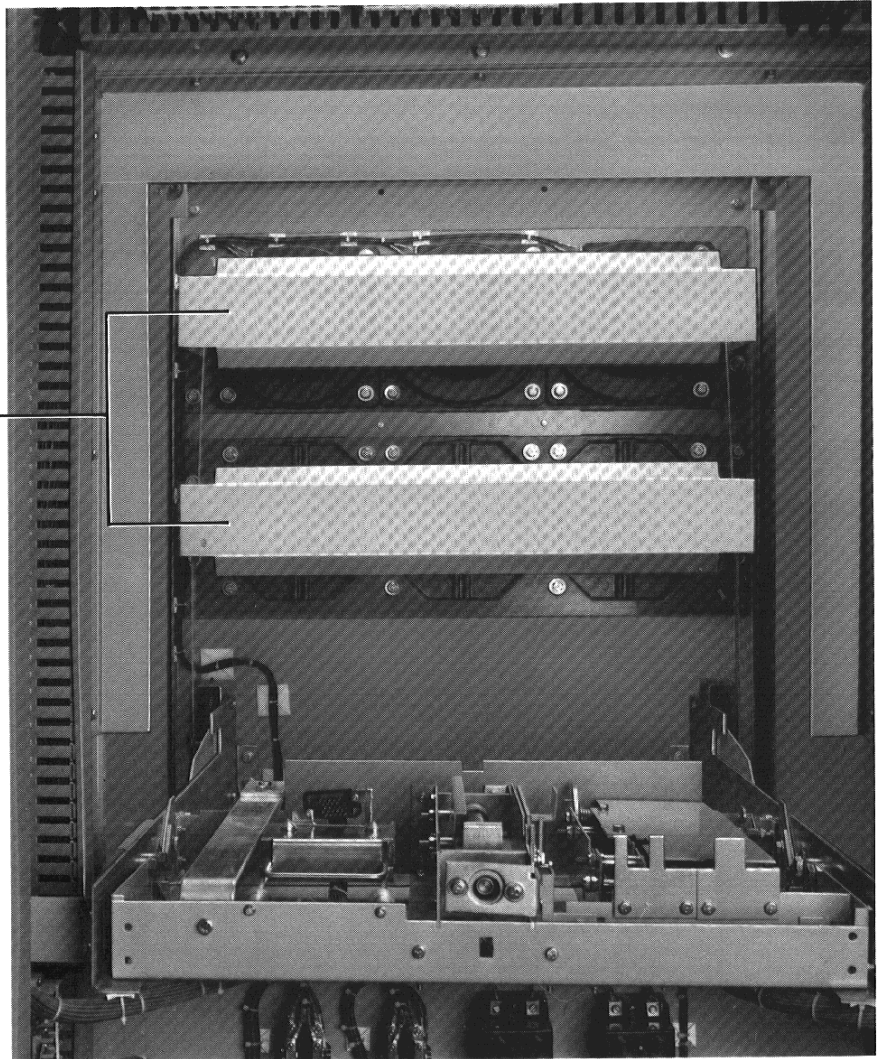




## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Performance, Continued

#### Cell Features

The breaker compartment is shown with the automatic steel shutters forced into the open position, CT barrier removed.


Primary insulating tubes and current transformer location are shown in this view. Primary stationary cell studs are also visible.

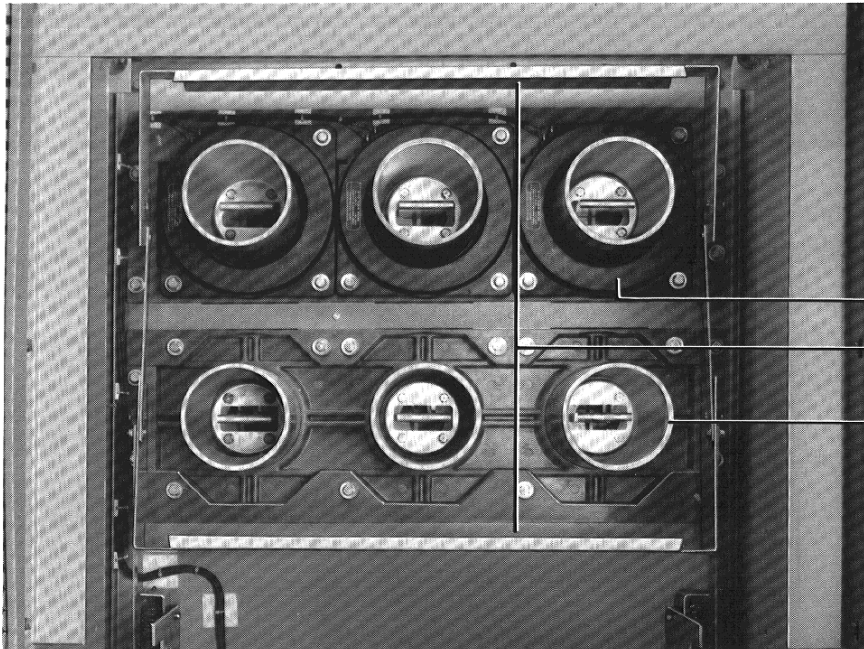

Current Transformers

Automatic Steel Shutters

Primary Insulating Tubes

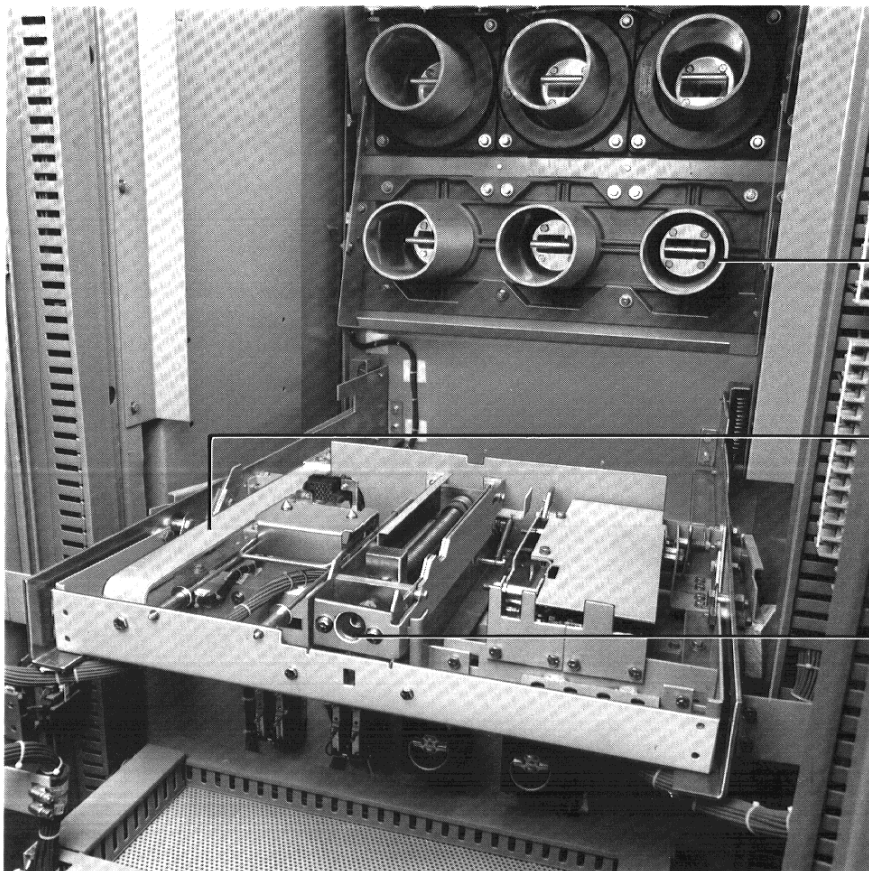

The mechanism for levering the breaker is a unique cell mounted design. This levering system incorporates all the safety interlocks to render the breaker mechanically and electrically trip-free during the levering procedure. Further, the ground bus, visible on the left, is engaged by a ground contact on the breaker, so the breaker is grounded throughout the travel.

Cell Studs

Ground Stab

Levering Mechanism

**Note:** Shutters should be removed or forced into the open position only when the unit is de-energized. Shutters are shown in the open position for illustrative purposes only.



## **Type VacClad-W Medium Voltage Metal-Clad Switchgear**


### **Performance, *Continued***

#### **Cell Features**

##### **Main Bus**

The main bus conductor is copper. All main bus has fluidized bed epoxy flame retardant track resistant insulation. The bolted bus connections are silver plated for positive contact and low resistance, with each joint insulated with easily installed boots.

The main bus supports are shown below.

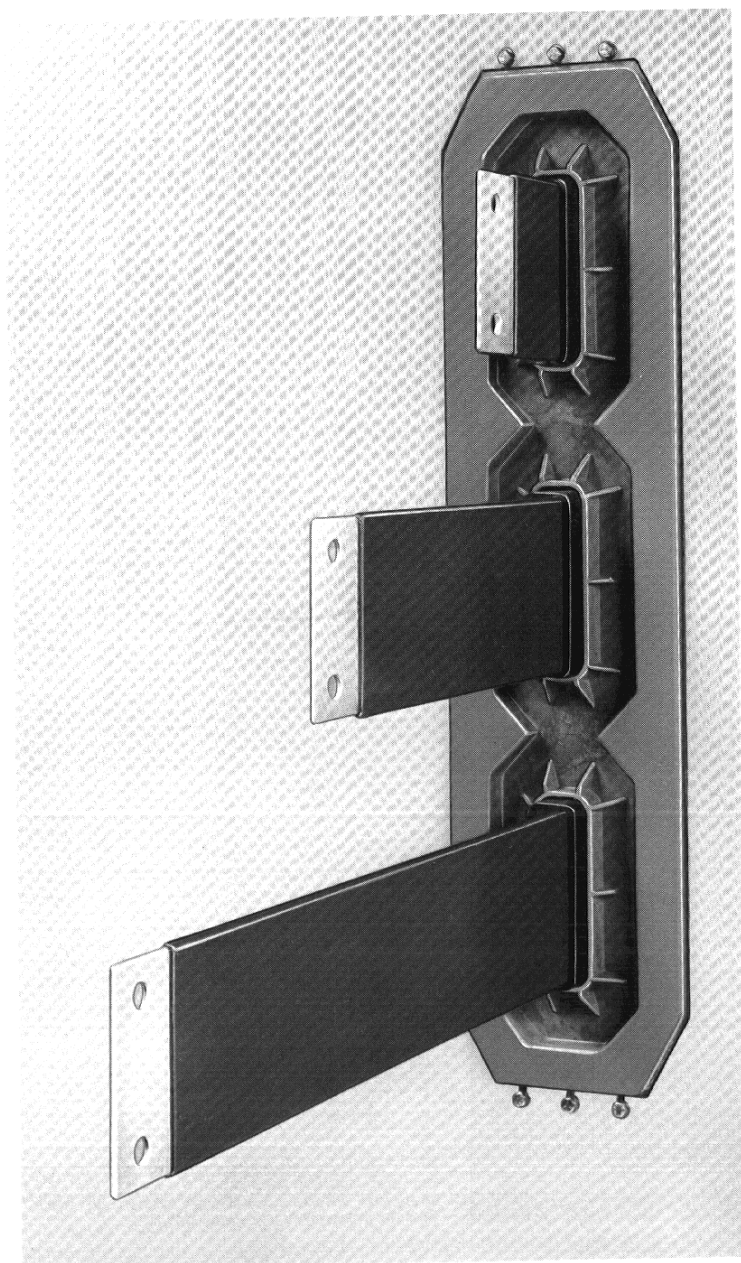






## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Performance, Continued




#### Cell Features

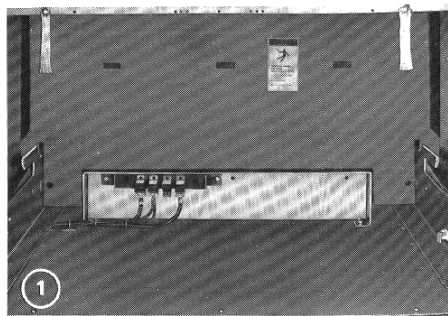

#### Auxiliary Compartments

VacClad-W design permits four auxiliary drawers in one vertical unit (only two shown here). A potential transformer drawer and a control transformer drawer are shown withdrawn on the rail extensions, which permits easy testing and fuse replacement.

- 1 All auxiliaries have automatic shutters.
- 2 The potential transformers meet all industry standards. Up to three potential transformers can be supplied per drawer.
- 3 The control power transformer drawer accommodating up to 15 kVA single phase transformers with protective primary fuses is shown in the withdrawn position.

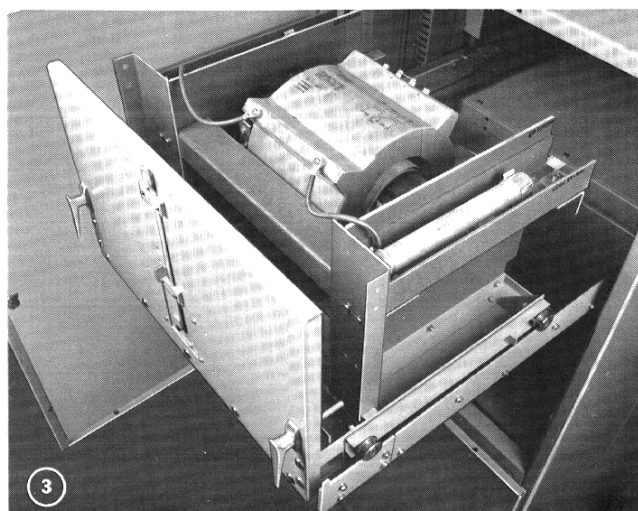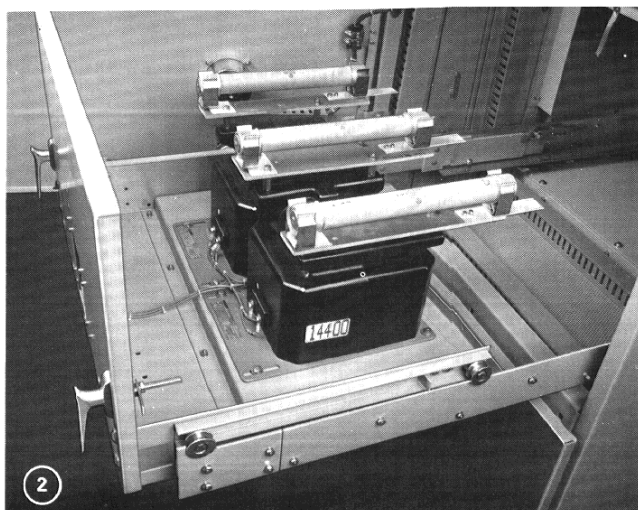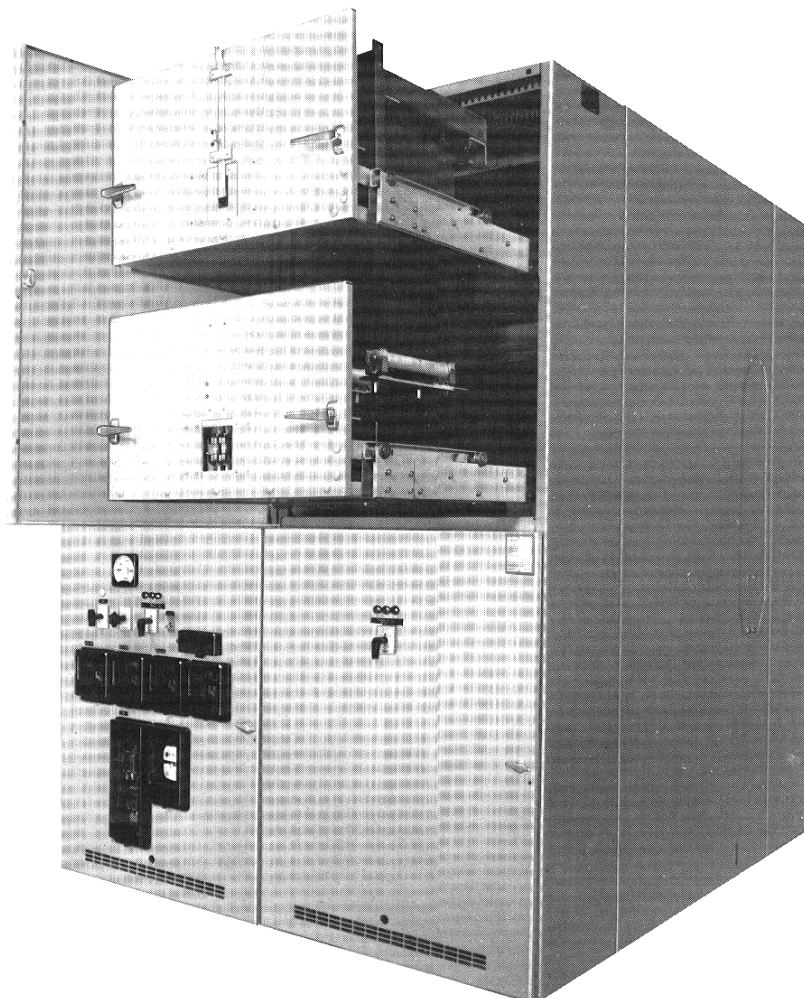



## Type VacClad-W Medium Voltage Metal-Clad Switchgear


### Performance, Continued

#### VCP-W Breaker


The Type VCP-W circuit breaker, utilizing vacuum interrupters, is compact and light weight. The breaker includes six major components:

1. Vacuum interrupter pole units.
2. Stored energy mechanism enclosed in a metal housing.
3. Glass polyester supports for mounting the vacuum interrupter pole unit.
4. Primary disconnecting contacts.
5. Removable insulating barriers.
6. Breaker wheels permit breaker to be rolled on floor.

Stored Energy  
Mechanism

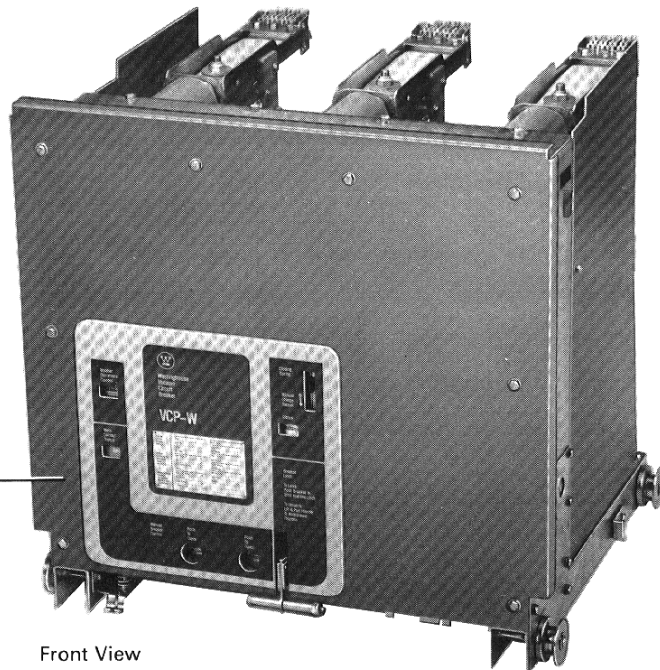


Front View

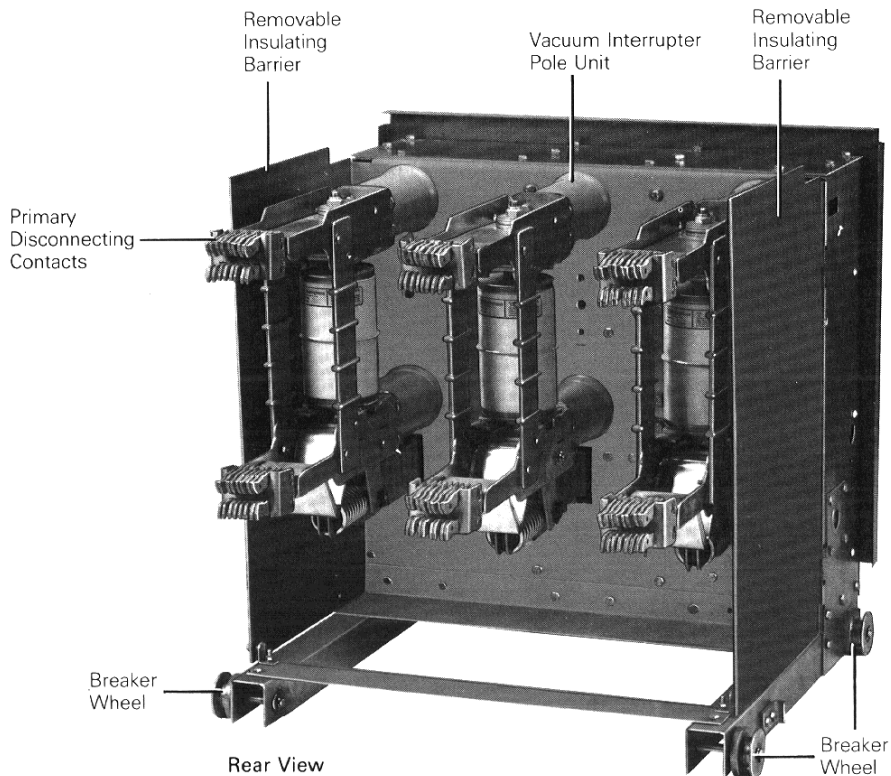

Rear View

## Type Vacclad-W Medium Voltage Metal-Clad Switchgear

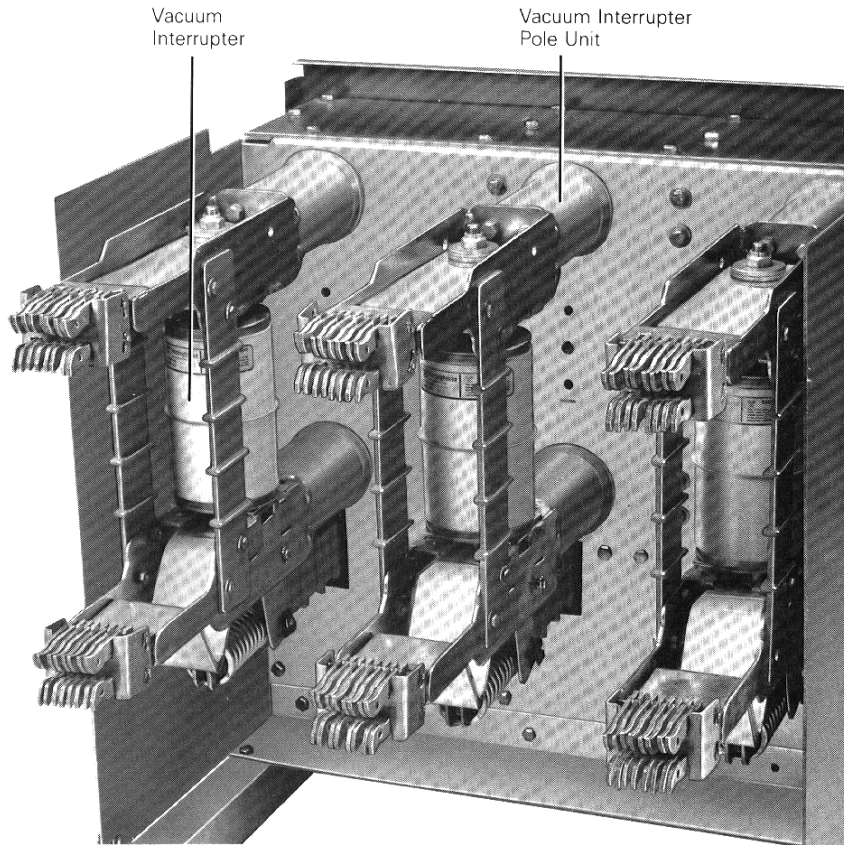



### Performance, Continued

### VCP-W Breaker

Breaker poles are complete units that are easily accessible and removable. Since the support system is self-aligning, no special tools are required for replacement.

### Breaker Front Panel

The steel breaker front panel is designed with the operator in mind. The breaker function indicators and controls are accessible and visible. They are: breaker-open/close, closing spring-charged/discharged, close and trip buttons, operation counter breaker latch, and manual spring charging access.

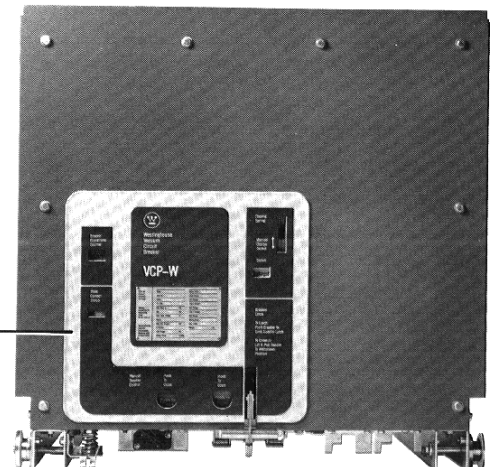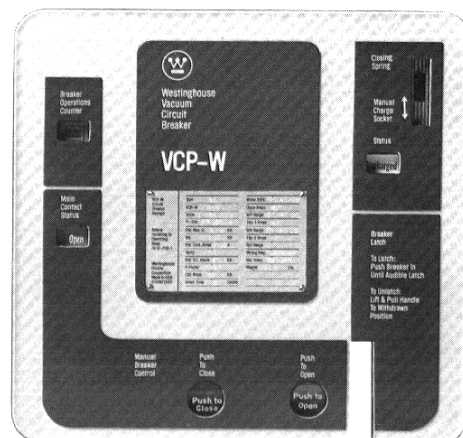



## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Performance, *Continued*


#### VCP-W Breaker

##### Stored Energy Mechanism

Breaker front panel removed exposing the stored energy mechanism.


The stored energy mechanism is vertically mounted on the front of the breaker for easy access. There is one basic mechanism for all ratings and is of rugged fabricated steel construction for reliable operation and long life. It is available for either DC or AC operation.

The stored energy mechanism is mechanically trip-free during breaker levering.

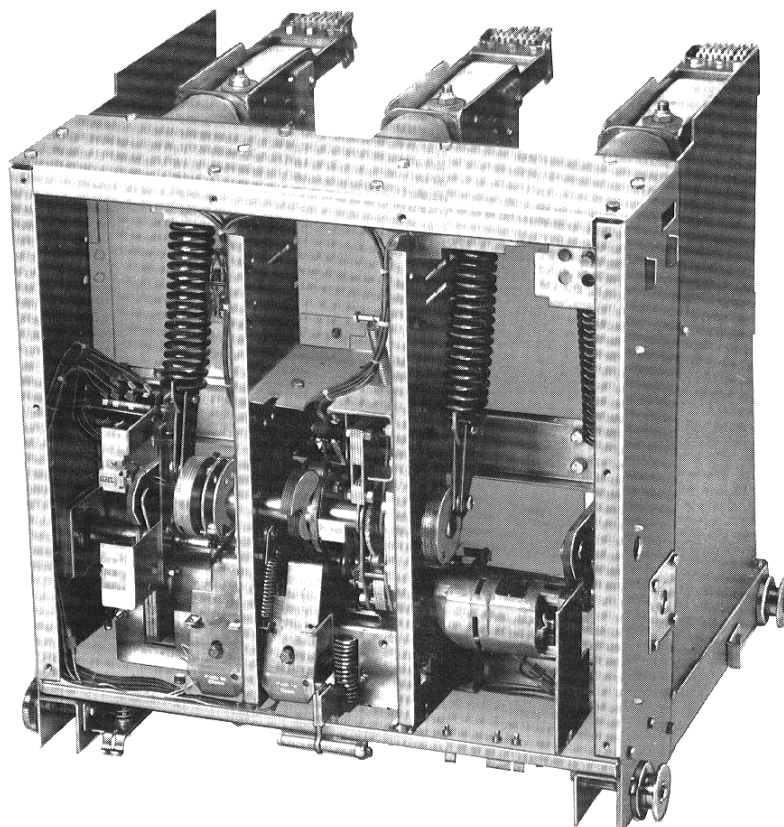

##### Primary Disconnecting Contacts


The primary disconnecting contacts are silver-plated copper-spring biased to maintain contact pressure. The primary contact design of the configuration shown is for 2000 amp continuous and below. The design has a long service life record, having been successfully used on previous designs of Westinghouse breakers.

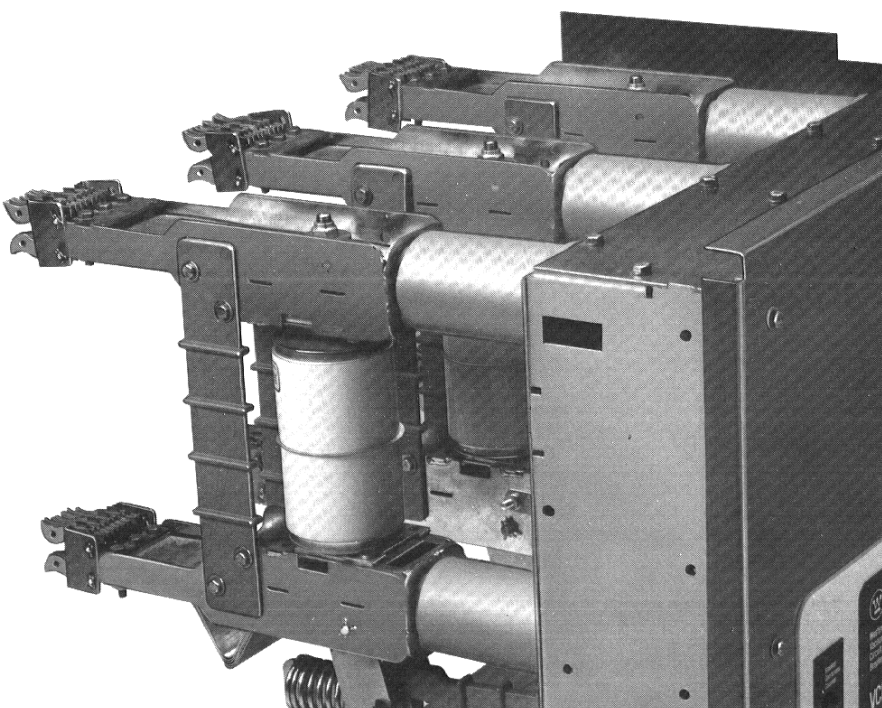





## Type VacClad-W Medium Voltage Metal-Clad Switchgear

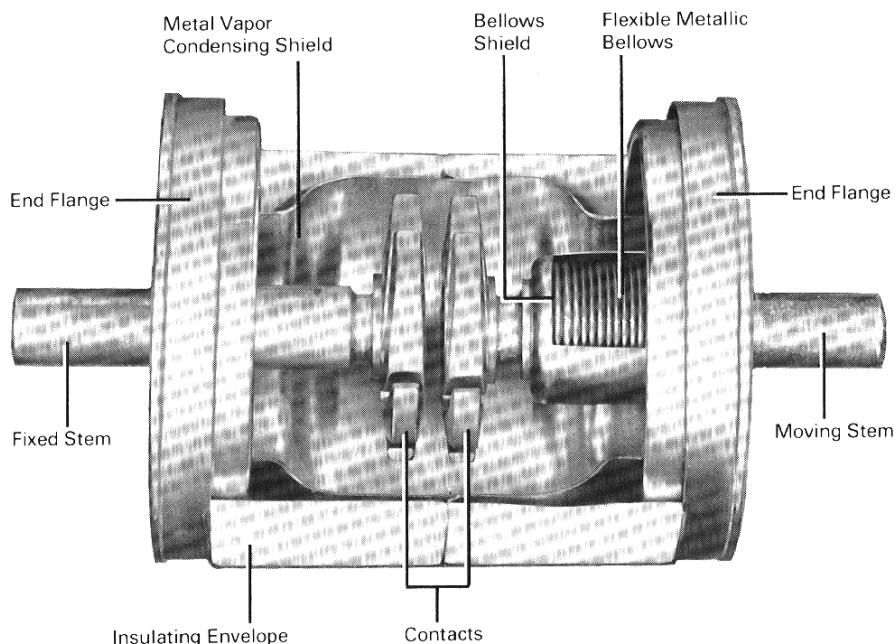

### Performance, Continued


#### VCP-W Breaker

##### Vacuum Interrupter

The Type VCP-W breaker utilizes vacuum interrupters for interruption and switching functions. Vacuum interrupters provide enclosed interrupter, small size and weight, interrupting time (high speed), long life, reduced maintenance, and environmental compatibility (low noise, no arc by-products, and minimum mechanical shock).

Arc interruption is simple and fast. The vacuum interrupter is shown. In the closed position normal current flows thru the interrupter. When a fault occurs and interruption is required, the contacts are quickly separated. An arc is drawn between the contact surfaces and is rapidly moved around the slotted electrode surface by self-induced magnetic effects, which prevents gross electrode erosion and the formation of hot spots on the surface. The arc burns in an ionized metal vapor, which continually leaves the contact area and condenses on the surrounding metal shield.

At current zero, the arc extinguishes, vapor production ceases; and very rapid dispersion, cooling, recombination, and deionization of the metal vapor plasma, together with the fast condensation of metal vapor products, cause the vacuum condition to be quickly restored – hence the separated contacts withstand the transient recovery voltage.

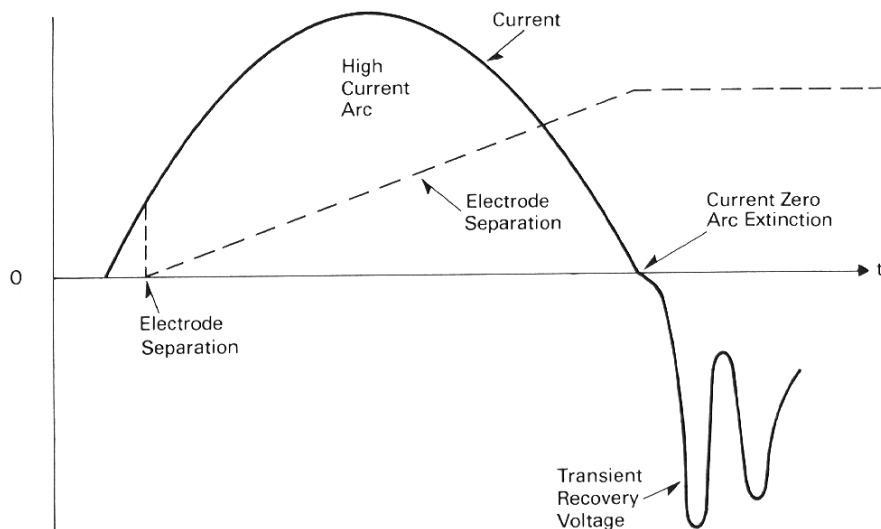

The current, voltage, and contact separation interrelationship is illustrated above.




## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Maintenance

#### Cell Features


##### Auxiliary Equipment

Control power transformers with current-limiting fuses and potential transformers are drawer-mounted in enclosed compartments. These compartments are automatically disconnected and grounded, when the drawer is withdrawn from the compartment on rails. Auxiliaries have automatic glass polyester shutters which are operated by the drawer.

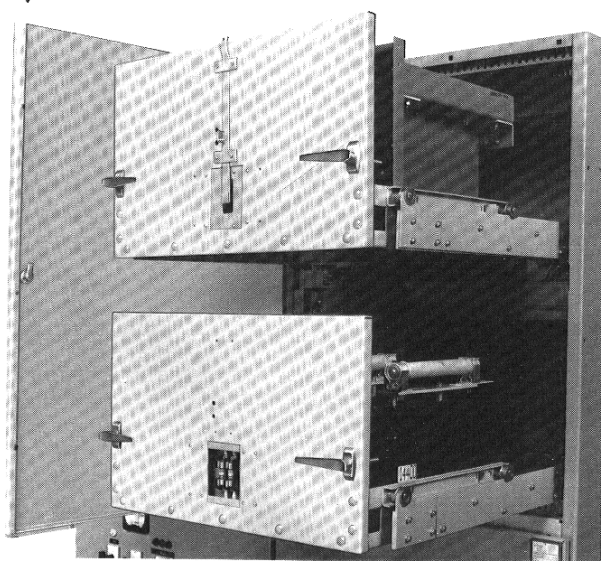


##### Current Transformers

Current transformers are accessible from the front. This design and front accessibility permit adding or changing transformers when the unit is deenergized without breaking high voltage connections and primary insulation.

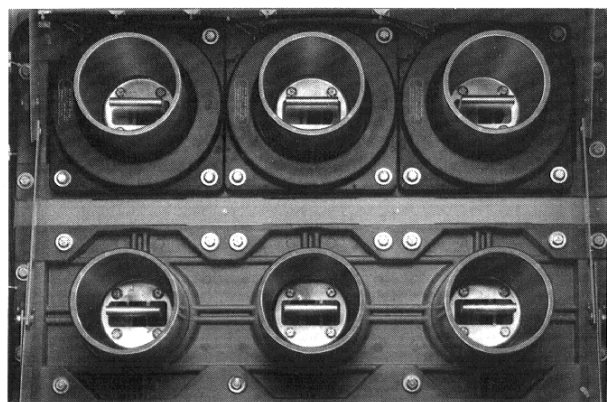

June, 1987

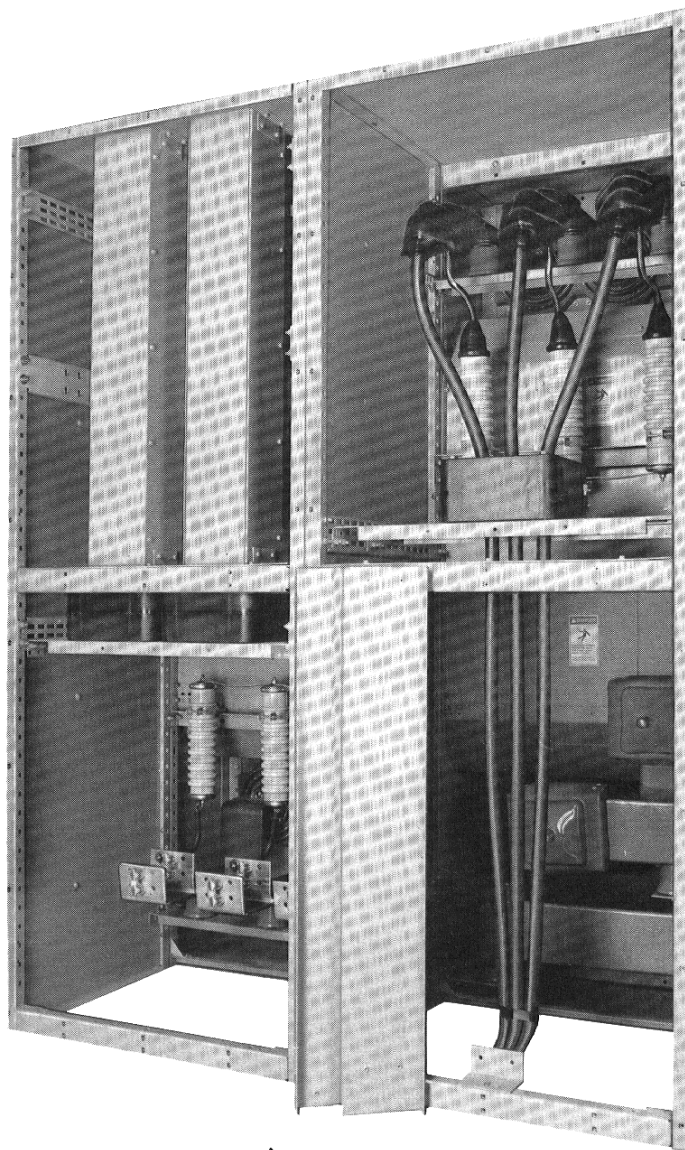

##### Cable Accessibility

The design provides adequate space for cable termination in the two high arrangement with cable for each circuit separated by metal barriers. Barriers are easily removed as shown.

Note: Shutters should be removed or forced into the open position only when the unit is deenergized. Shutters are shown in the open position for illustrative purposes only.




## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Maintenance, *Continued*

#### Breaker Features

- Normal inspection – Breaker can be withdrawn on extendable rails for easy access without requiring separate lifting device.
- Mechanical inspection – Easy inspection and accessibility is afforded by the front mounted stored-energy mechanism. The same basis mechanism is used in all ratings, which requires a minimum investment in spare parts.

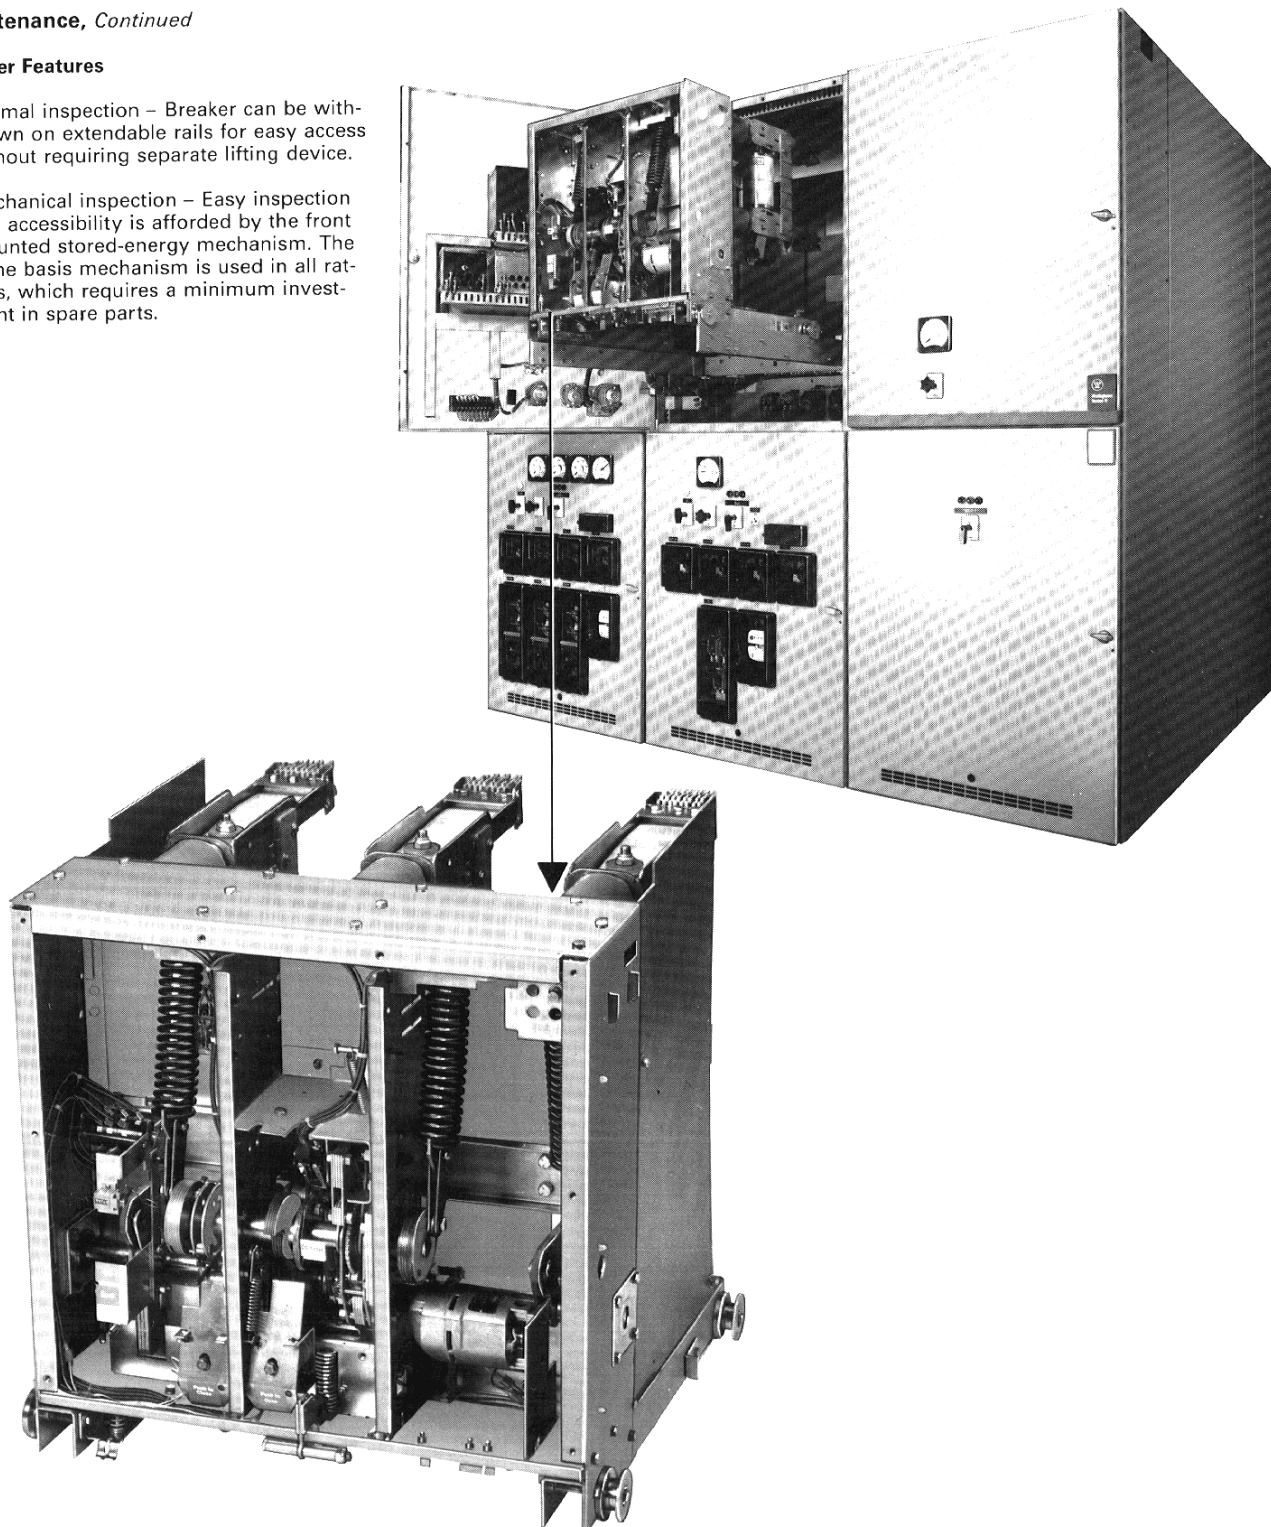




## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Maintenance, Continued

#### Breaker Features

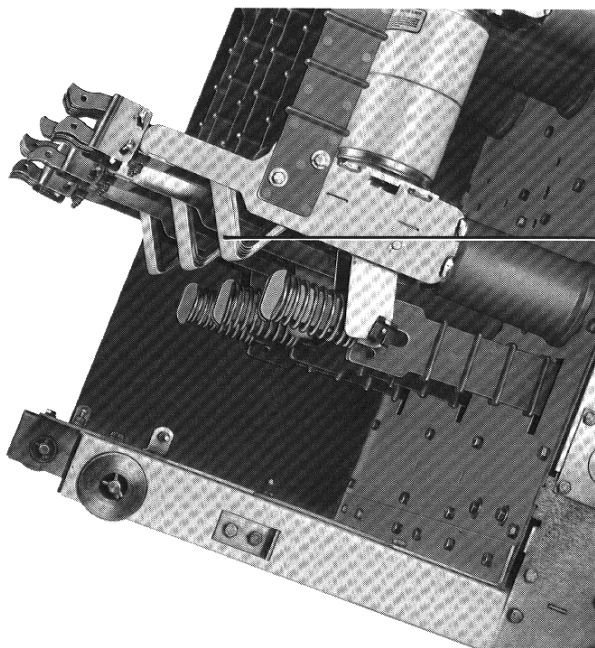


#### Vacuum Interrupter Current Transfer Conductor

The stiff-flexible current transfer from the vacuum interrupter moving stem to the breaker main conductor is a non-sliding design – thus eliminating the maintenance required with sliding type transfer arrangements.

#### Reduced Maintenance

Due to the inherent long life characteristics of the vacuum interrupter and the reliable stored-energy mechanism, the type VCP-W breaker requires minimum maintenance.

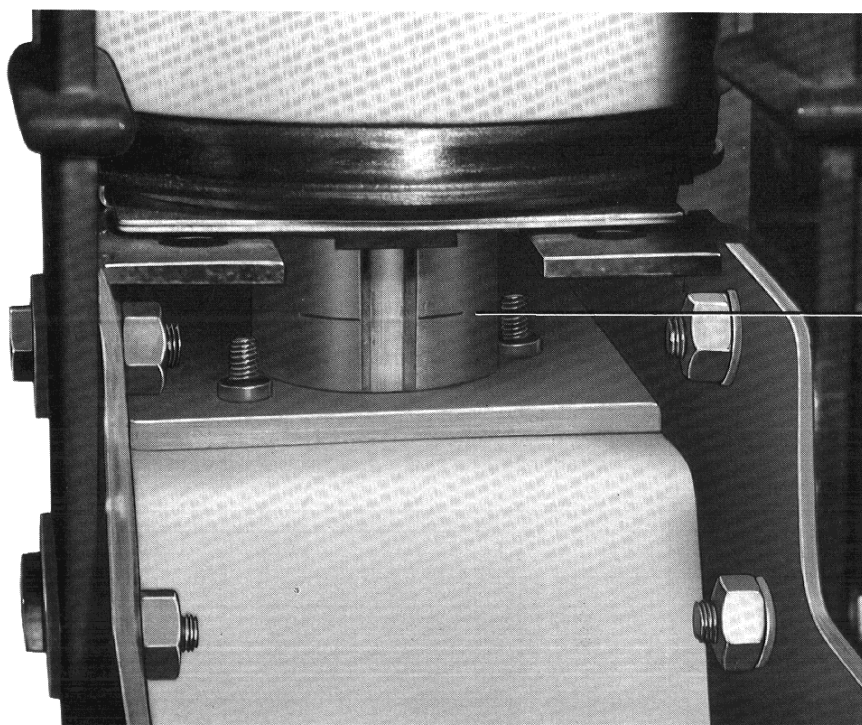

Vacuum interrupter contact wear indicator. Clearly visible, wear-gap (contact erosion) indicators require only an occasional check.






## Type VacClad-W Medium Voltage Metal-Clad Switchgear


### Space Utilization

VacClad-W Switchgear has been designed for efficient use of space. In many situations, total required floor space may be reduced by as much as 50% compared to conventional switchgear.

The rail extension feature for both the circuit breaker and auxiliaries, enable these draw-out devices to be withdrawn for inspection and maintenance without the use of unique lifting devices needed with other designs.

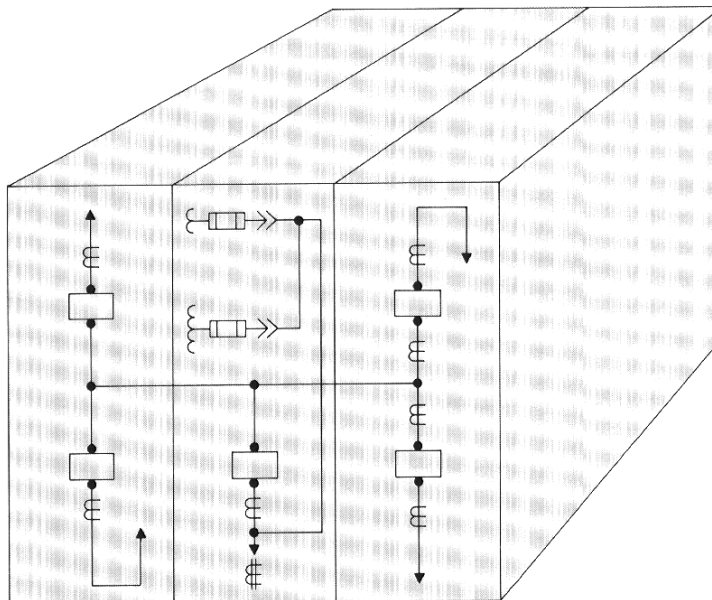

VacClad-W

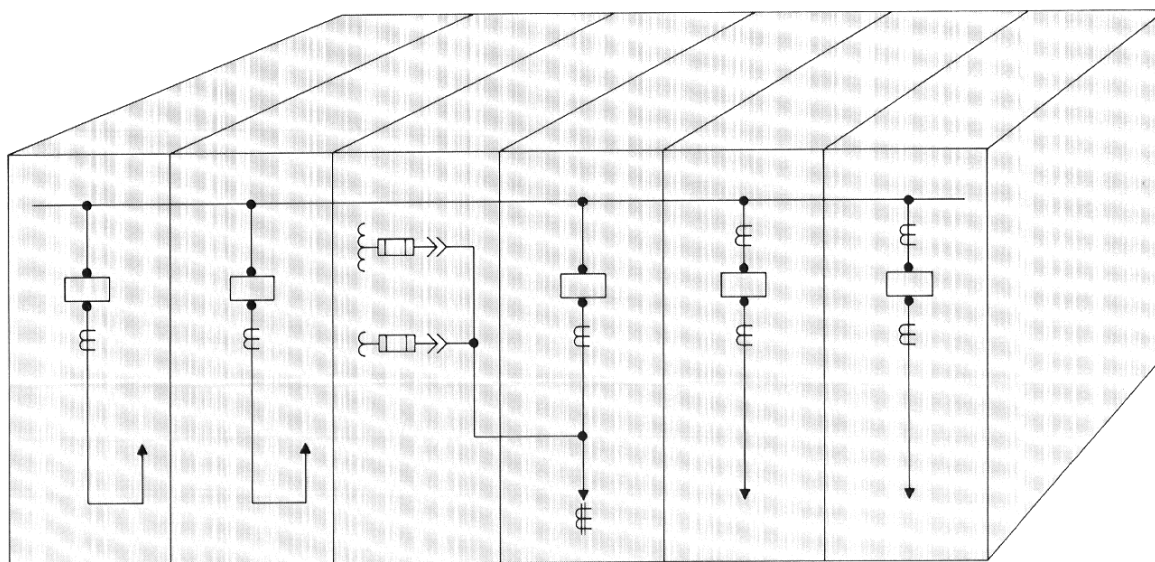

Conventional Switchgear



## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Application Flexibility

VacClad-W Switchgear has the flexibility to meet most installation conditions or requirements.

- One-high combinations can be provided.
- Modular construction provides for ease of assembly, initial flexibility of installation, and future expansion or modification.
- Rear compartments are designed for either top or bottom entry of cable or bus runs.
- Provisions for four current transformers per phase.
- Provisions for as many as four sets of drawout auxiliaries in one vertical section.
- Indoor and outdoor.
- Complete ANSI rating range available, plus several special ratings.
- IEC breaker ratings.

### Reliability

Reliability was the fundamental consideration of engineering design, material selection, use and design of components, manufacturing, test procedures, shipping and handling to assure the user of on-site reliability.

### Design/Proof Tests

VacClad-W Metal-Clad Switchgear meets applicable ANSI, IEEE, NEMA and IEC standards. The design criteria dictated that all tests demonstrate performance above the requirements of the standards. The ANSI test series is basic test criteria and includes interruption, BIL, dielectric, continuous current, mechanical life, and thermal and environmental conditions.

The design/proof testing of VacClad-W Switchgear is the most extensive ever performed by Westinghouse, which has always maintained the highest test standards for its metal-clad equipment.

### Production Tests

#### Circuit Breaker

- Each breaker draw-out unit is checked for alignment with a master cell fixture that verifies all interfaces and interchangeability.
- All circuit breakers are operated over the range of minimum to maximum control voltage.
- Interrupter contact gap is factory set.
- One-minute dielectric test is performed on each breaker per ANSI Standards.
- Final inspection and quality check.

#### Housing

- Master breaker fixture is inserted into each breaker cell to ensure alignment.
- One-minute dielectric test per ANSI Standards is applied to both primary and secondary circuits.
- Operation of wiring, relays, and other devices is verified by an operational sequence test.
- Final inspection and quality check.

#### Supplemental Device

##### Ground and Test Device

The ground and test device is a drawout element that may be inserted into a Metal-Clad Switchgear housing in place of a circuit breaker. It provides access to the primary circuits to permit the temporary connection of grounds or testing equipment to the high voltage circuits. High potential testing of cable or phase checking of circuits are typical tests which may be performed. The devices are insulated to suit the voltage rating of the switchgear and will carry required levels of short circuit current.


Manual ground and test devices are available. These devices include six studs for connection to primary circuits. The manual device selection and grounding are accomplished by cable connection.

#### Notice


**Before using ground and test devices it is recommended that each user develop detailed operating procedures consistent with safe operating practices. Only qualified personnel should be authorized to use ground and test devices.**

#### Standard Accessories

- 1 - Test Jumper
- 1 - Levering Crank
- 1 - Maintenance Tool
- 1 - Lifting Yoke
- 1 - Set Rail Clamps
- 1 - Set of Extension Rails
- 1 - Transport Dolly (Optional)
- 1 - Portable Lifter (Optional)
- 1 - Test Cabinet (Optional)



Universal Breaker  
Lifting Yoke  
For User's  
Lifting Device

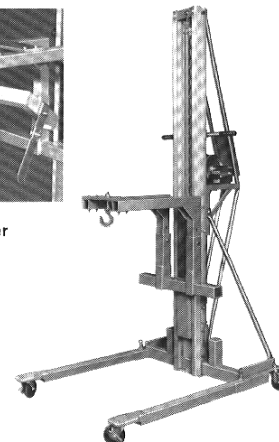

Optional Portable  
Lifter



## Type VacClad-W Medium Voltage Metal-Clad Switchgear


### Weights and Dimensions

#### Typical Weights (Pounds) Assemblies (Less Breakers)


Type of Vertical Section	Main Bus Rating Amps	Indoor	Aisle-Less	Sheltered-Aisle Including Aisle	
				Single Row	Double Row
B/B	1200	2400	3000	4200	7200
	2000	2500	3100	4300	7400
	3000	2600	3200	4400	7600
B/A or A/B	1200	2300	2900	4100	7000
	2000	2400	3000	4200	7200
	3000	2500	3100	4300	7400
A/A	1200	2000	2600	3800	6400
	2000	2100	2700	3900	6600
	3000	2200	2800	4000	6800

#### Breakers

Type of Breaker	Current Rating, Amps.		
	1200	2000	3000
	Approx. Wt., Lbs.		
50 VCP-W 250	350	410	525
50 VCP-W 350	460	490	525
75 VCP-W 500	375	410	525
150 VCP-W 500	350	410	525
150 VCP-W 750	350	410	525
150 VCP-W 1000	460	490	525

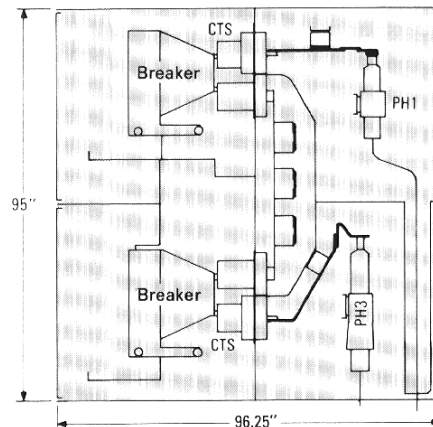

Indoor

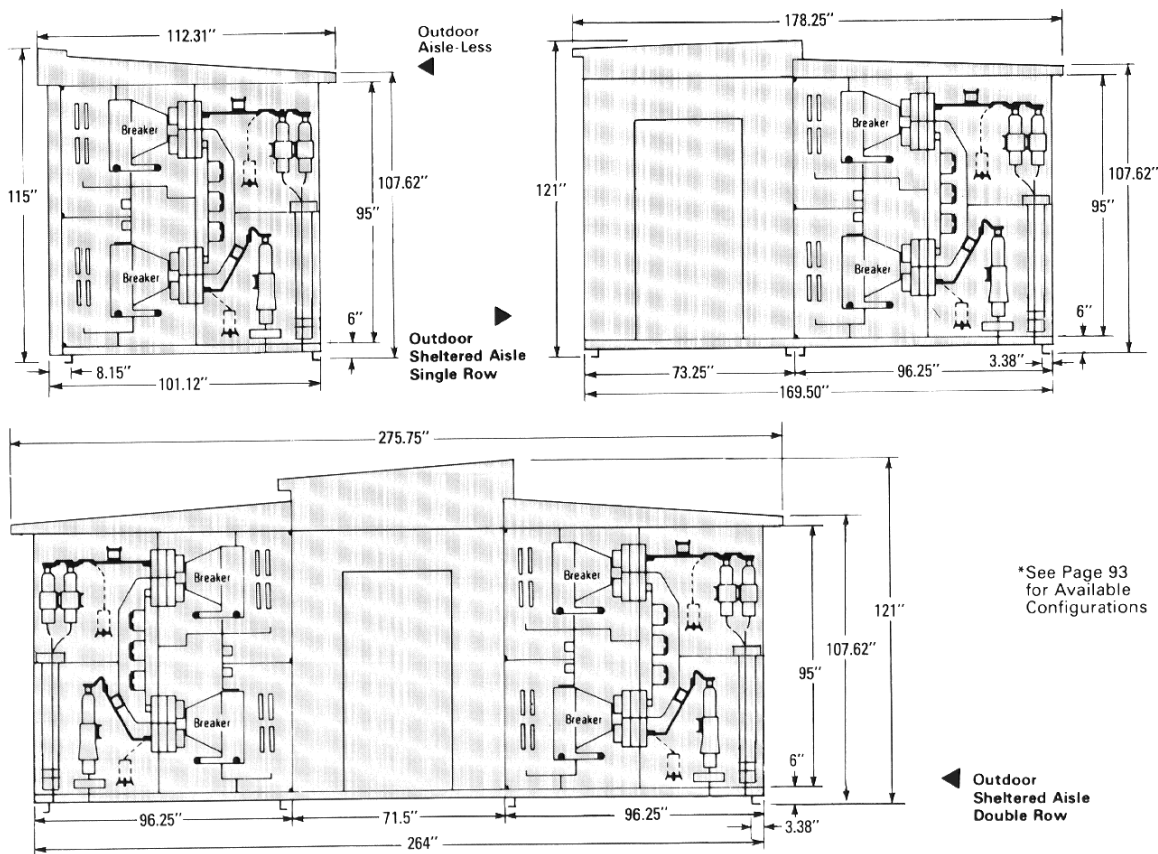

Dimensions, Inches

\*See Page 93  
for Available  
Configurations

Outdoor  
Sheltered Aisle  
Double Row


Note: Dimensions not to be used for construction. These shown are for reference only. Consult Westinghouse for exact dimensions.

June, 1987




## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Typical Units

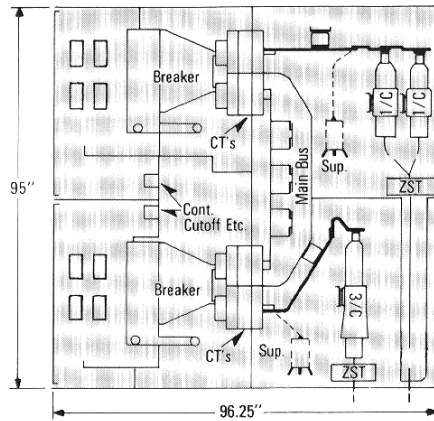

#### 36" Wide Typical Breaker/Breaker Vertical Section


- 1 - 1200/2000/3000 Amp. main bus
- 2 - Type VCP-W breakers 1200/2000 Amp. in 2 - high configuration
- 4 - Current transformers per phase ANSI ratings.
  - Potheads 1/C or 3/C
  - Surge suppressors, if desired.
  - Zero sequence current transformer (ZST)

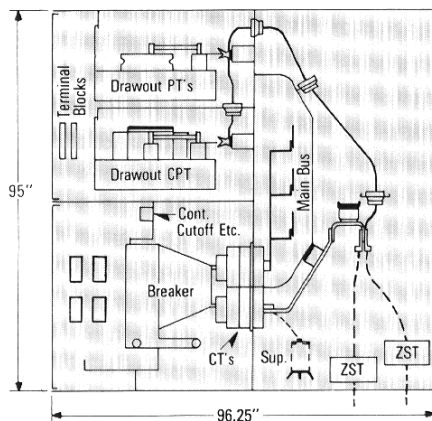

#### 36" Wide Typical Auxiliary/Breaker Vertical Section

- 1 - 1200/2000/3000 Amp. main bus
- 1 - Type VCP breaker 1200/2000 Amp. in lower position
- 1 - Drawout potential transformer drawer
  - 2 - L-L with fuses
  - 3 - L-G with fuses
- 1 - Drawout control power transformer drawer CPT - 15 kVA max. - single phase
  - Zero sequence current transformers (ZST)
  - Surge suppressors, if desired.

### Available Configurations

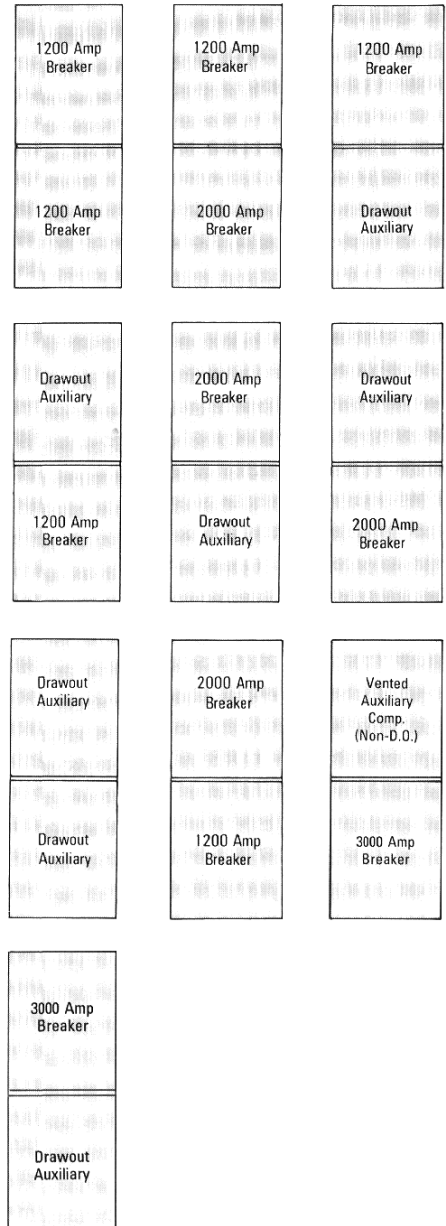





## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Application

**Table 1: Available Breaker Types Rated on Symmetrical Current Rating Basis, per ANSI Standards**

Identification			Rated Values						Related Required Capabilities <sup>③</sup>					
Circuit Breaker Type	Nominal Voltage Class  Kv Class	Nominal 3-Phase MVA Class  MVA Class	Voltage		Insulation Level		Current		Rated Interrupting Time  Cycles	Rated Permissible Tripping Delay  Sec	Rated Max. Voltage Divided By K  E/K	Current Values		
			Rated Max. Voltage  E  Kv rms	Rated Voltage Range Factor  ②  K	Rated Withstand Test Voltage		Rated Continuous Current at 60 Hz  Amperes	Rated Short Circuit Current (at rated Max. Kv) ②  I  KA rms				Maximum Sym. interrupting Capability  K Times Rated Short-Circuit Current <sup>②</sup> KI	3 Sec. Short-Time Current Carrying Capability  1.6 K Times Rated Short-Circuit Current	
					Low Fre- quency	Impulse								
														Kv rms
VCP-W Vacuum Circuit Breaker														
50 VCP-W 250	4.16	250	4.76	1.24	19	60	1200 2000 3000	29	5	2	3.85	36	36	58 78 <sup>①</sup>
50 VCP-W 350	4.16	350	4.76	1.19	19	60	1200 2000 3000	41	5	2	4.0	49	49	78
75 VCP-W 500	7.2	500	8.25	1.25	36	95	1200 2000 3000	33	5	2	6.6	41	41	66
150 VCP-W 500	13.8	500	15	1.30	36	95	1200 2000 3000	18	5	2	11.5	23	23	37 58 <sup>①</sup>
150 VCP-W 750	13.8	750	15	1.30	36	95	1200 2000 3000	28	5	2	11.5	36	36	58 77 <sup>①</sup>
150 VCP-W 1000	13.8	1000	15	1.30	36	95	1200 2000 3000	37	5	2	11.5	48	48	77

**Table 2: Available Breaker Types Rated on Symmetrical Current Rating Basis per IEC Standards**

Circuit Breaker Type	Voltage Class, kV	Insulation Level		Rated Continuous Current, Amps.	Rated Interrupting Current, kA <sup>⑤</sup>	Momentary Current, kA	
		Low Freq., kV	Impulse Withstand kV			3 Sec.	Peak
50 VCP-W 250	3.6	21	45	630 1250 2000	25 25 25	25 25 25	64
50 VCP-W 350	⑥	⑥	⑥	⑥	⑥	⑥	⑥
75 VCP-W 500	7.2	27	60	630 1250 2000	40 40 40	40 40 40	102
150 VCP-W 500	12	35	95	630 1250 2000	25 25 25	25 25 25	64
150 VCP-W 750	12	35	95	630 1250 2000	25 25 25	25 25 25	64
150 VCP-W 1000	⑥	⑥	⑥	⑥	⑥	⑥	⑥

① Non-Standard Breakers with High Momentary Rating available for Special Applications.

② For 3 phase and line to line faults, the sym interrupting capability at a Kv operating voltage

$$= \frac{E}{K_v} \text{ (Rated Short-Circuit Current)}$$

But not to exceed KI.

Single line to ground fault capability at a Kv operating voltage

$$= 1.15 \frac{E}{K_v} \text{ (Rated Short-Circuit Current)}$$

But not to exceed KI.

The above apply on predominately inductive or resistive 3-phase circuits with normal-frequency line to line recovery voltage equal to the operating voltage.

③ For Reclosing Service, the Sym. Interrupting Capability and other related capabilities are modified by the reclosing capability factor obtained from the following formula:

$$R (\%) = 100 - \frac{C}{6} \left[ (n - 2) + \frac{15 - T_1}{15} + \frac{15 - T_2}{15} + \dots \right]$$

Where C = KA Sym. Interrupting Capability at the Operating Voltage but not less than 18.

n = Total No. of Openings.

T<sub>1</sub>, T<sub>2</sub>, etc. = Time interval in seconds except use 15 for time intervals longer than 15 sec.

Note: Reclosing Service with the standard duty cycle 0 + 15s + CO. Does not require breaker capabilities modified since the reclosing capability factor R = 100%.

④ Tripping may be delayed beyond the rated permissible tripping delay at lower values of current in accordance with the following formula:

$$T \text{ (seconds)} = Y \left[ \frac{KI \text{ (K Times Rated Short-Circuit Current)}}{\text{Short-Circuit Current Through Breaker}} \right]^2$$

The aggregate tripping delay on all operations within any 30 minute period must not exceed the time obtained from the above formula.

⑤ Standard duty cycle: 0 - 3 min. - CO - 3 min. - CO

⑥ Not IEC recognized.



## Type VacClad-W Medium Voltage Metal-Clad Switchgear

### Safety

#### Cell and Breaker Features

VacClad-W Metal-Clad Switchgear incorporates many outstanding safety features, which meet or exceed those required by metal-clad standards.

Some of the outstanding features are:

#### Safety Metal Shutters

Steel shutters (breaker driven) rotate automatically into position to cover the insulating tubes to provide metal barriering of the cell stationary studs when the breaker is withdrawn from the connected position.


#### Grounded Metal Barriers

Grounded metal barriers separate all compartments, completely enclosing major parts of the primary circuit, main bus, breaker, potential transformers and control power transformers. These barriers must be removed to gain access to any energized compartment. All control devices are separated from high-voltage circuits by grounded metal barriers.


#### Levering System

Operators and equipment are both protected by a variety of interlocks on the breaker assembly.


1. A breaker cannot be levered unless the interrupter contacts are open.
2. Breaker is mechanically trip-free during levering.
3. Closed door levering is available if specified.

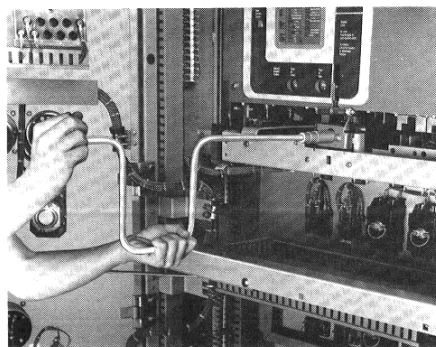

Levering Crank Operation

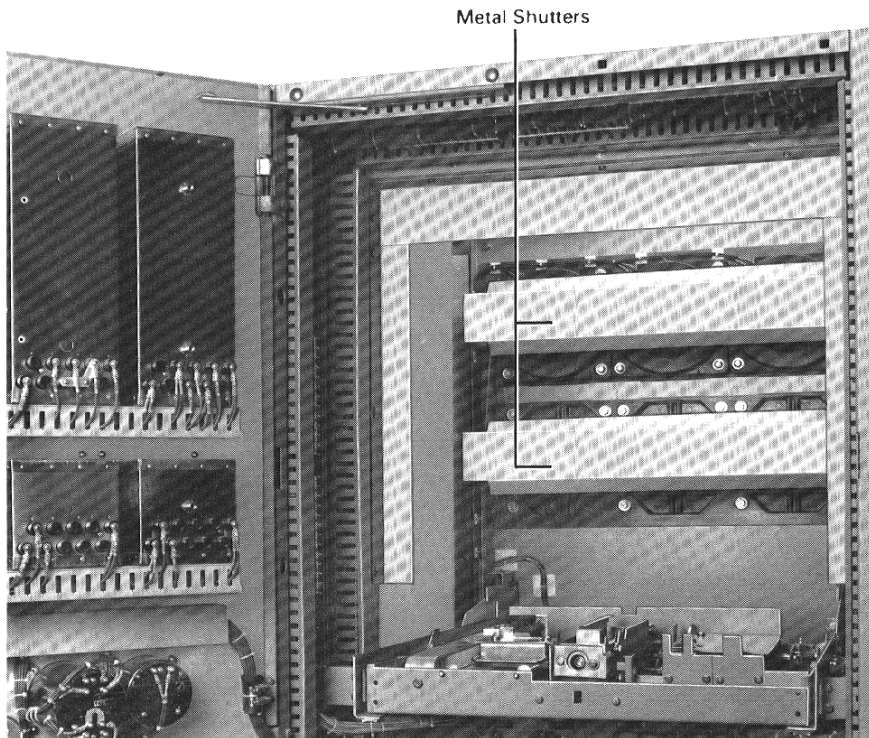

VCP-W Cell (CT Barrier Removed)

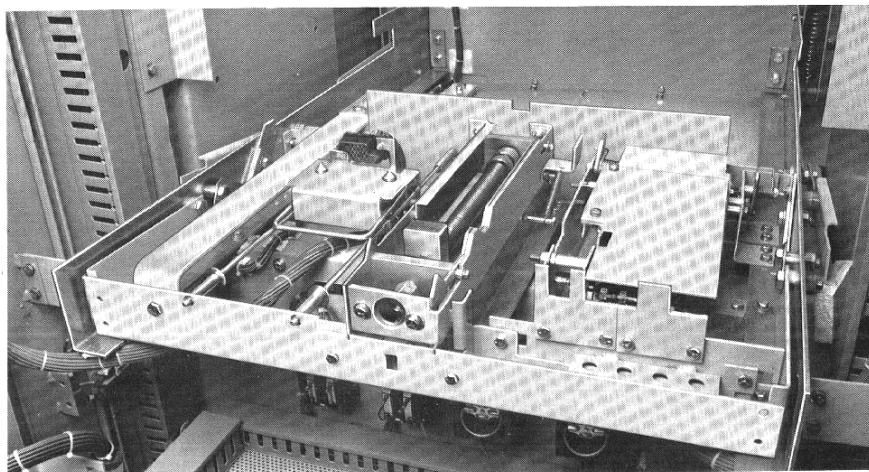

Cell Mounted Levering System

4. Discharge of closing spring as breaker is withdrawn from the cell.
5. A latch secures the breaker in the connected, disconnected or test position.

#### Breaker

- Breaker is grounded during levering and in the connected position.
- Coding plates provide that only correct breaker rating can be installed in cell.
- Front panel – steel barrier.