


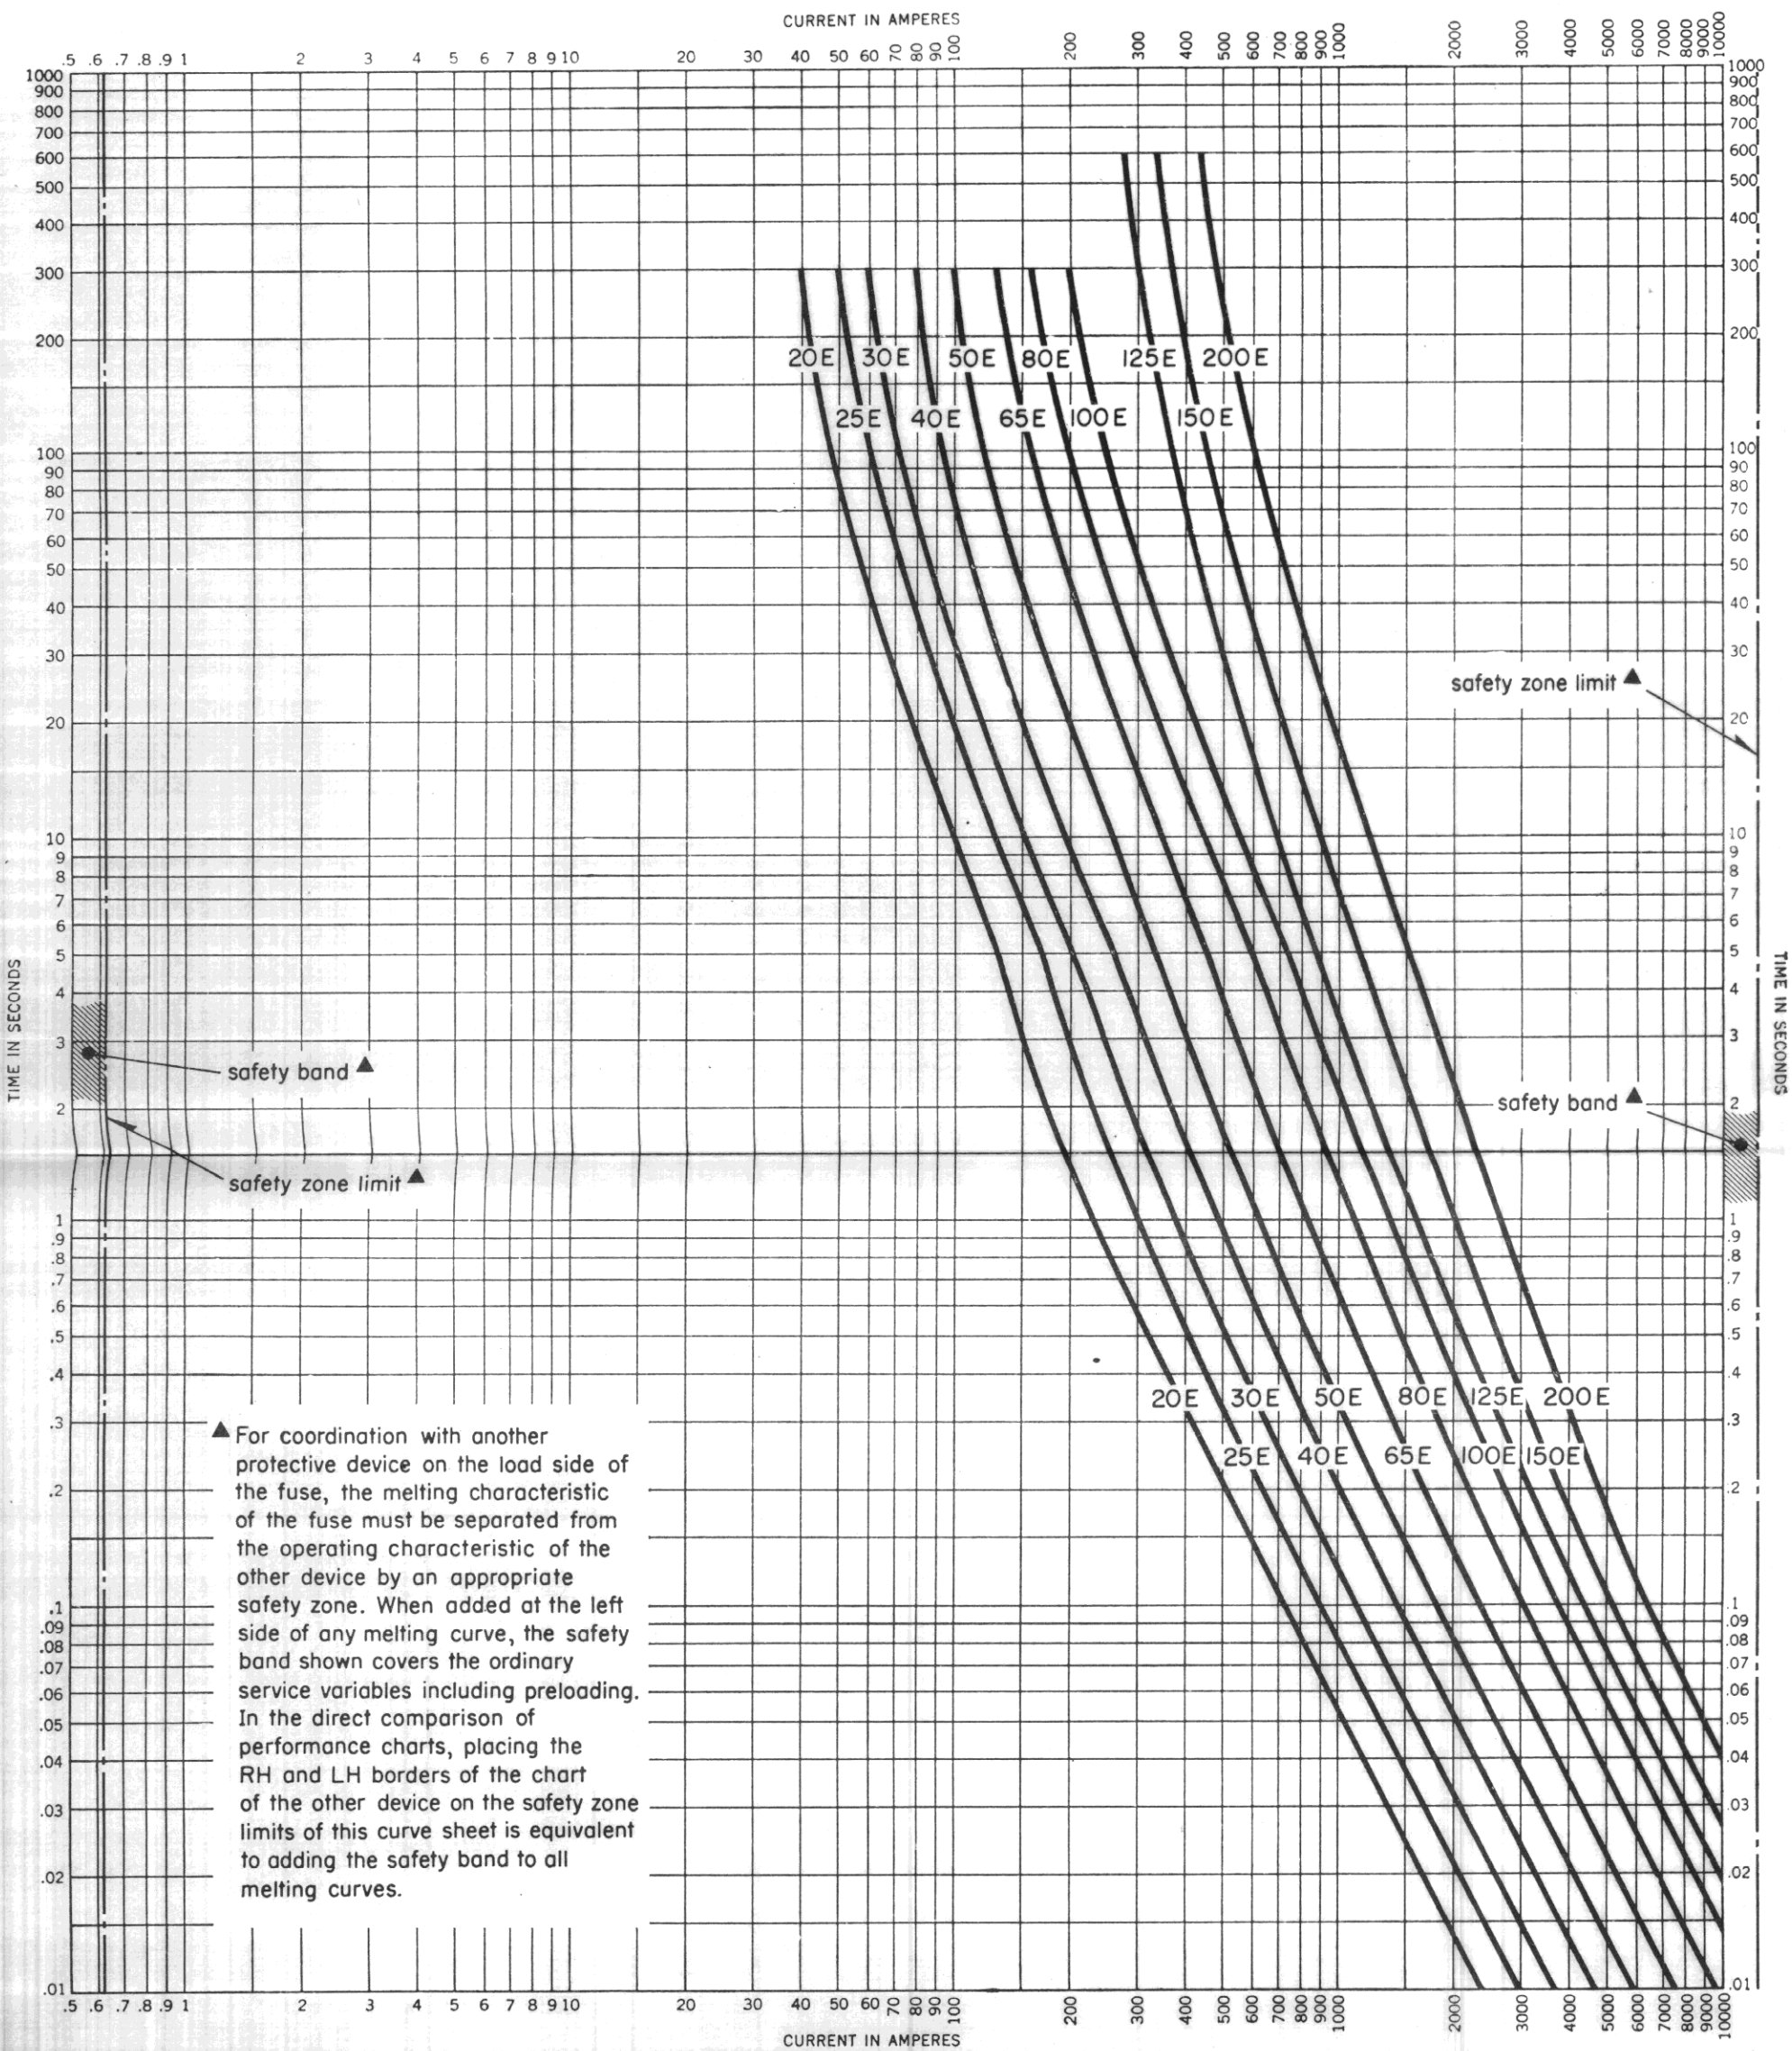

type BA-400 refill power fuses • time lag refills
melting time-current characteristics

Curves are based on tests starting with fuse unit at an ambient temperature of 25°C and without initial load. Curves are plotted to minimum test points so all variations should be positive.

Westinghouse Electric Corporation
Assembled Switchgear and Devices Dept.: East Pittsburgh Division • East Pittsburgh, Pa.
printed in U.S.A.

curve no. **7**
reference no. 369679
January, 1961