


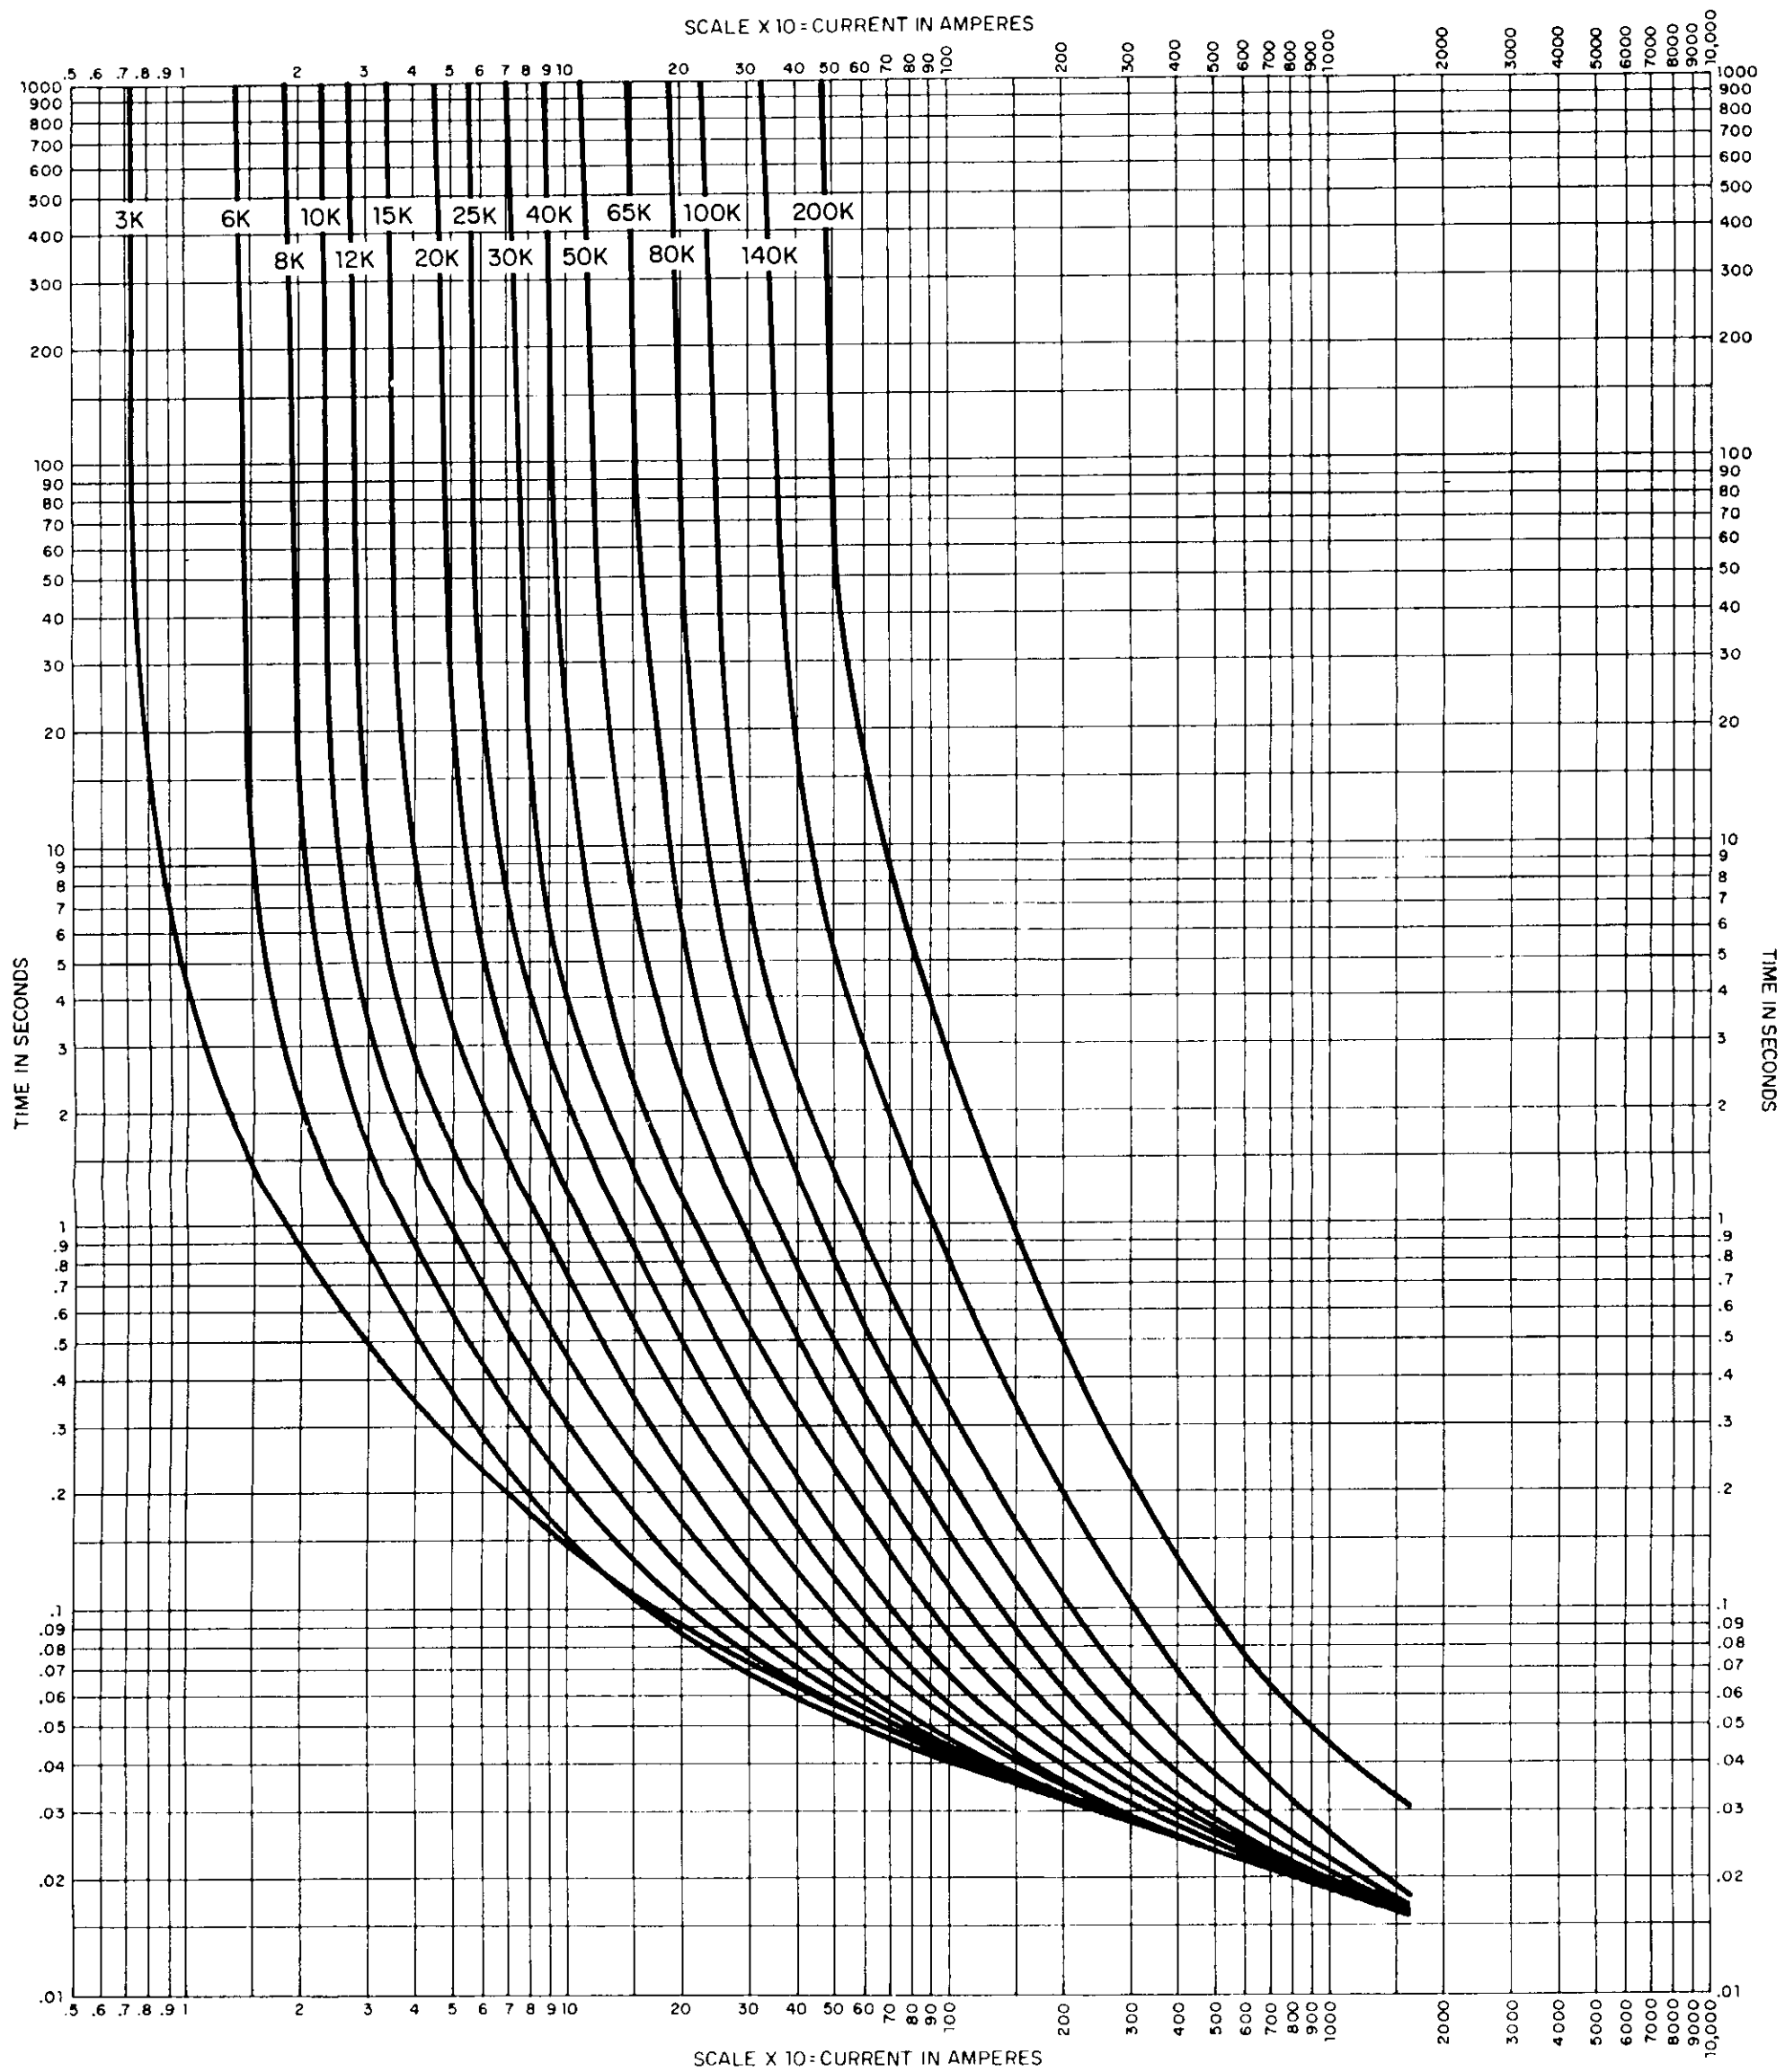

Type DBU® Fuses • Fast “K” Rated Fuse Units

Total Clearing Time-Current Characteristics, 8.3 to 17.1 Kv

Curves are based on tests starting with fuse unit at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so variations should be negative.

Westinghouse Electric Corporation
Distribution and Control Business Unit
Pittsburgh, PA 15220
Printed in USA
Ⓢ Changed since previous issue.

Curve No.

5

Supersedes Curve No. 5 Dated April, 1980

Reference No. 666757

May, 1988