


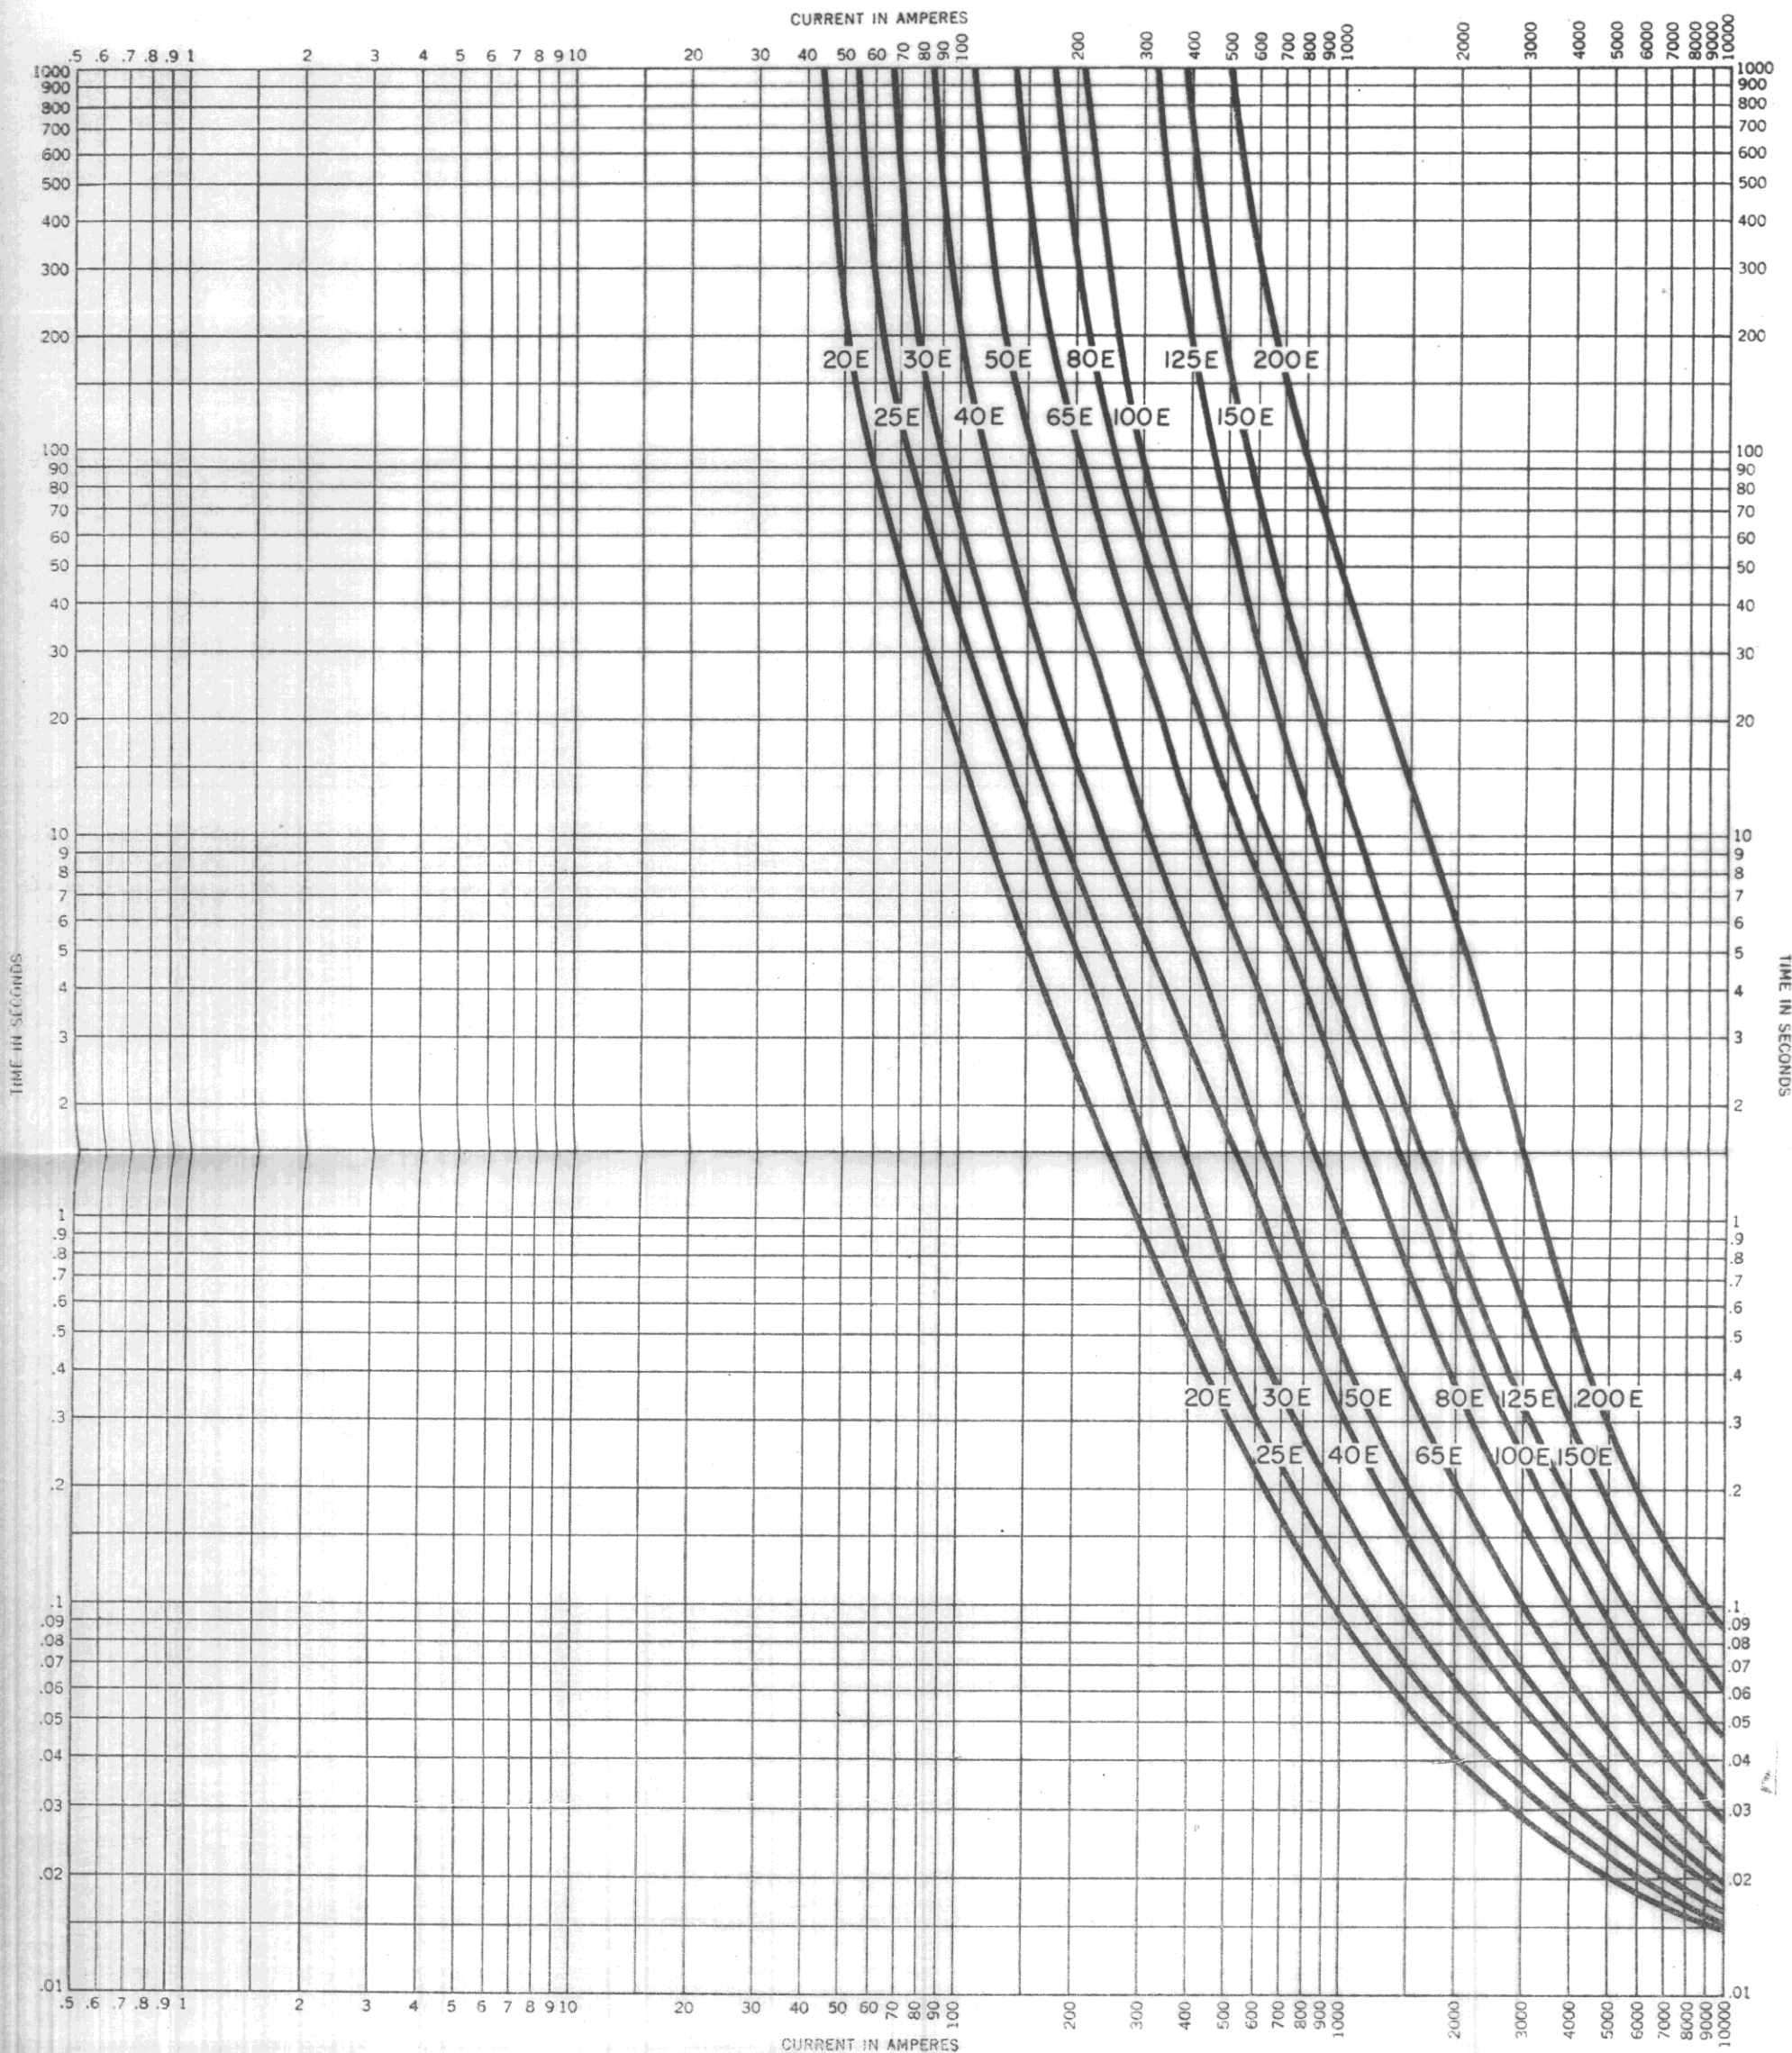

type BA-400 refill power fuses • time lag refills

total clearing time-current characteristics—2.4 to 34.5 kv

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points.

Westinghouse Electric Corporation

Assembled Switchgear and Devices Dept.: East Pittsburgh Division • East Pittsburgh, Pa.

Printed in U.S.A.

curve no.

8

reference no. 369681

January, 1961