


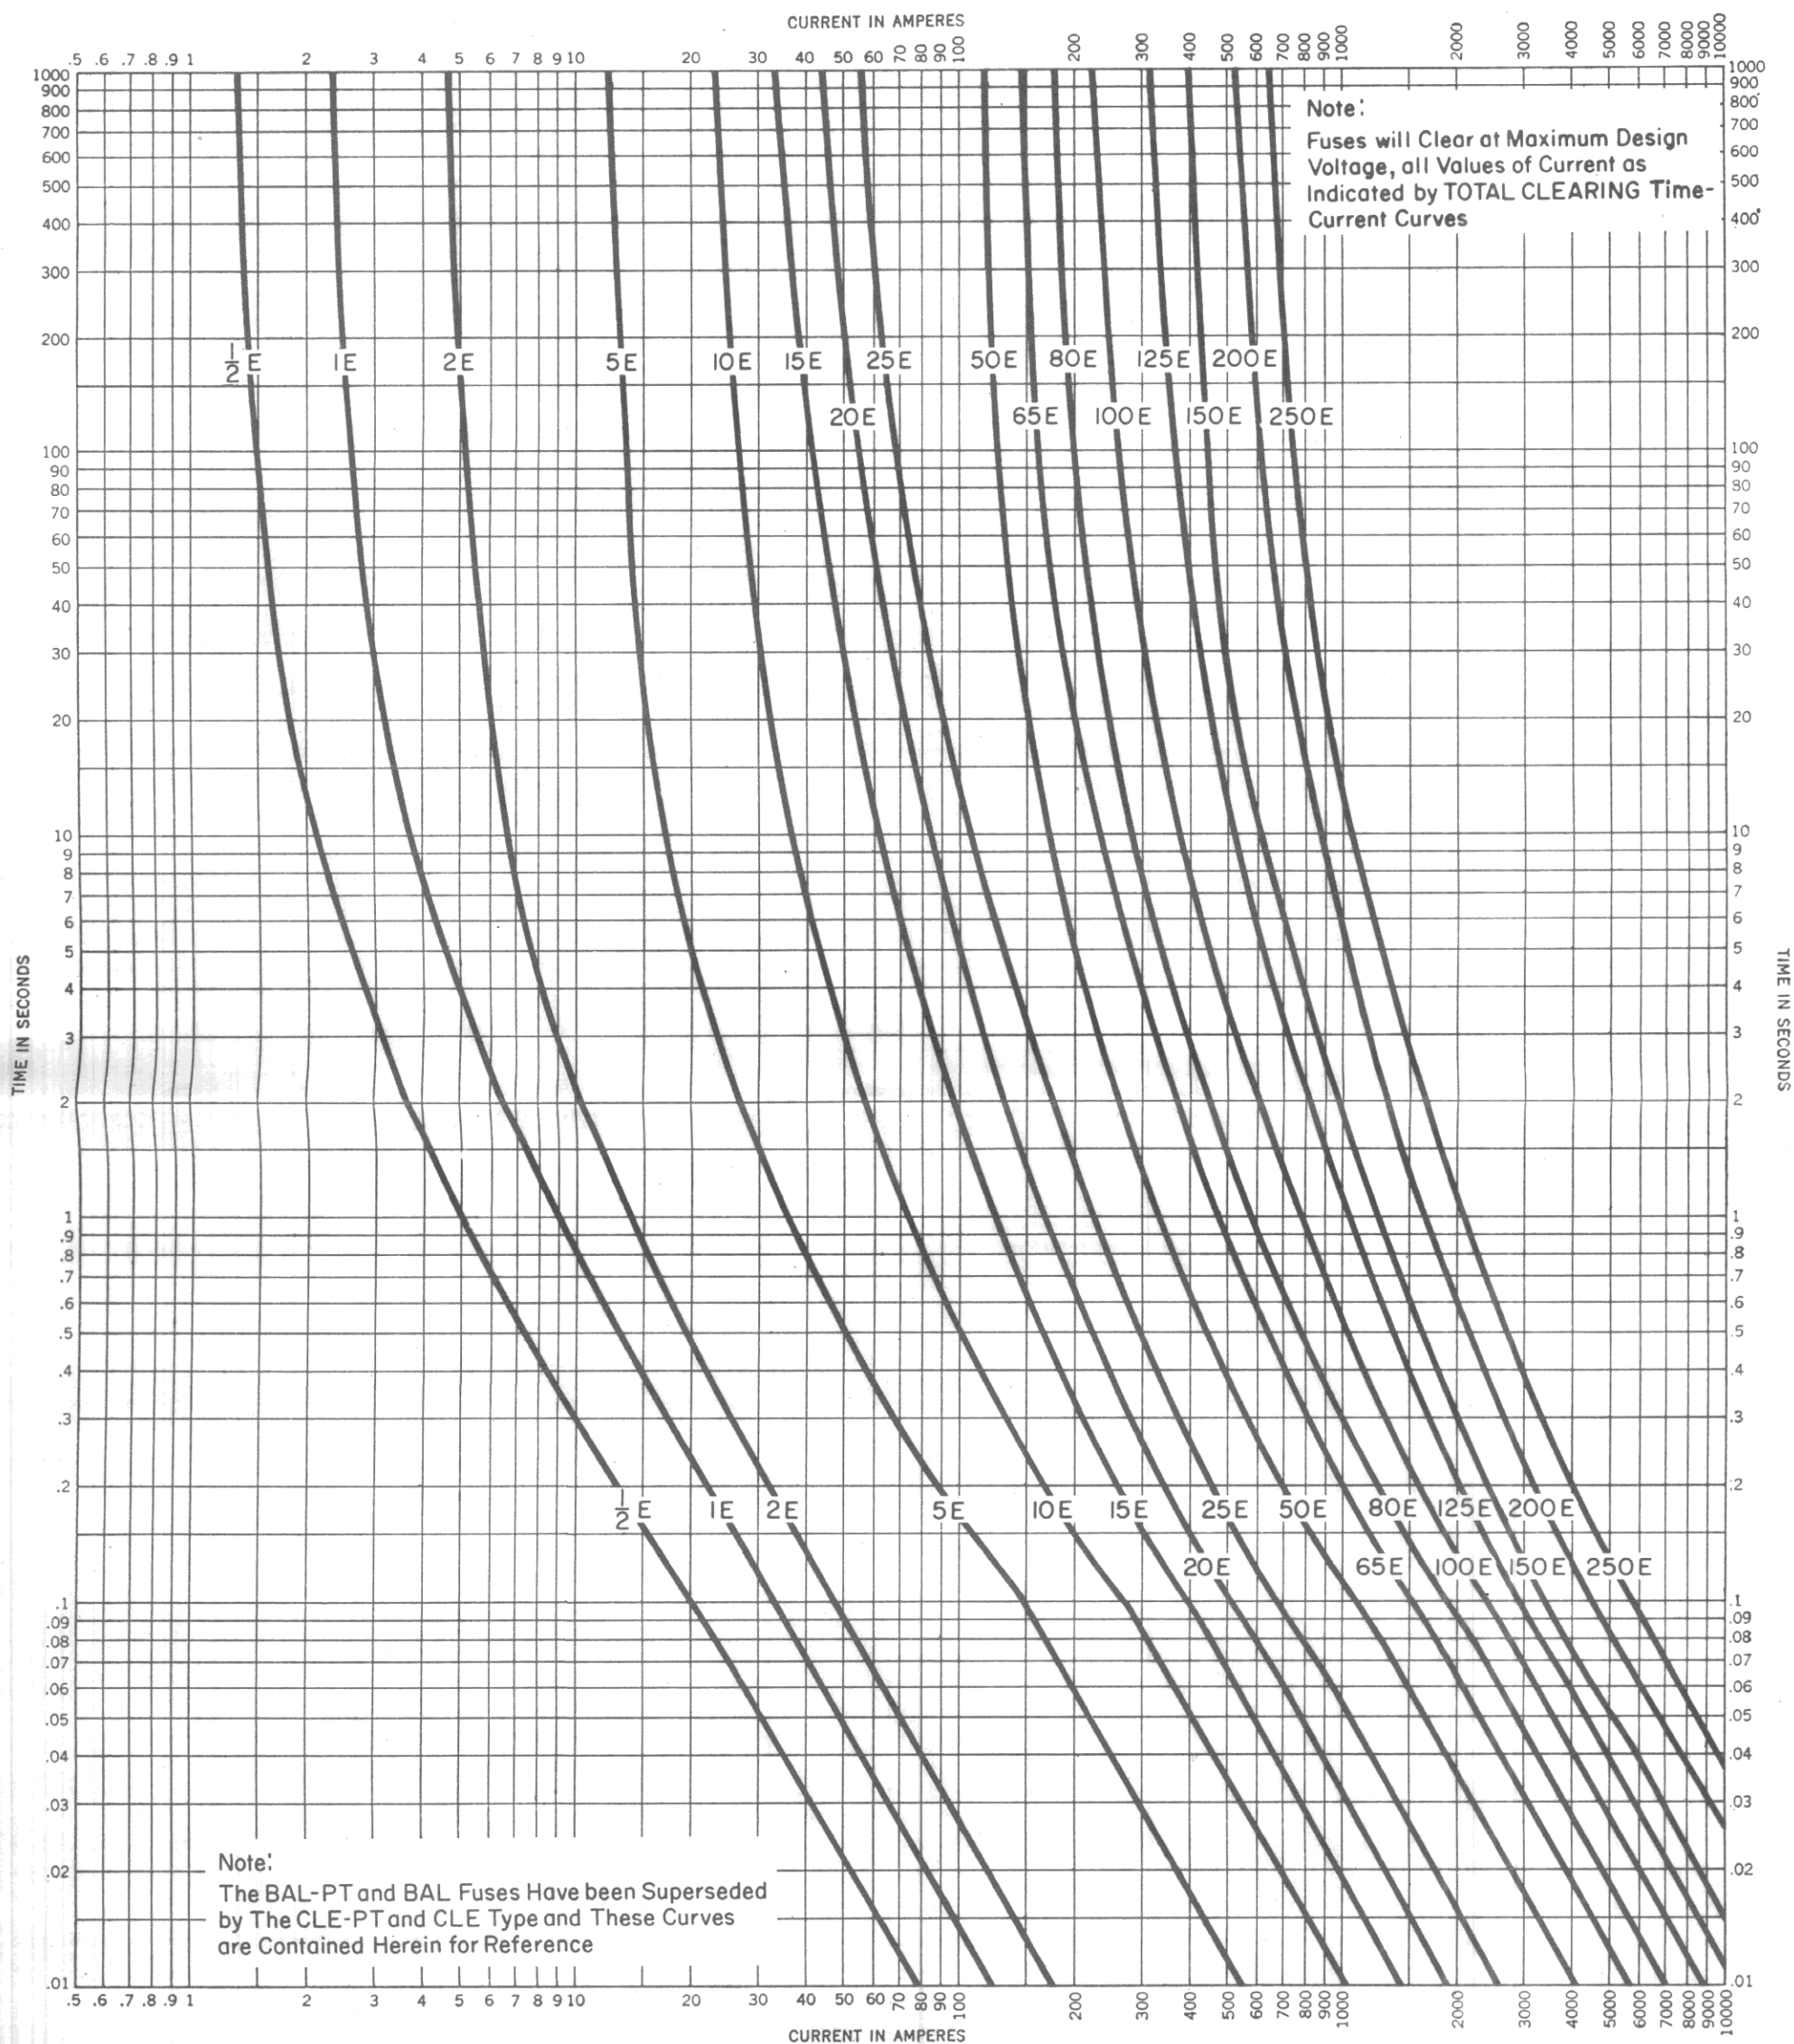

Type BAL-PT, -10, -25, -200 and -300 Current Limiting Power Fuses

Total clearing time-current characteristics, 2.4 to 34.5 Kv

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so variations should be negative.

Westinghouse Electric Corporation
Switchgear Division, Power Switching Equipment, East Pittsburgh, Pa.
Printed in USA

Curve No.

19

Supersedes Curve No. 19, dated January, 1961

Reference No. 459292

May, 1968