


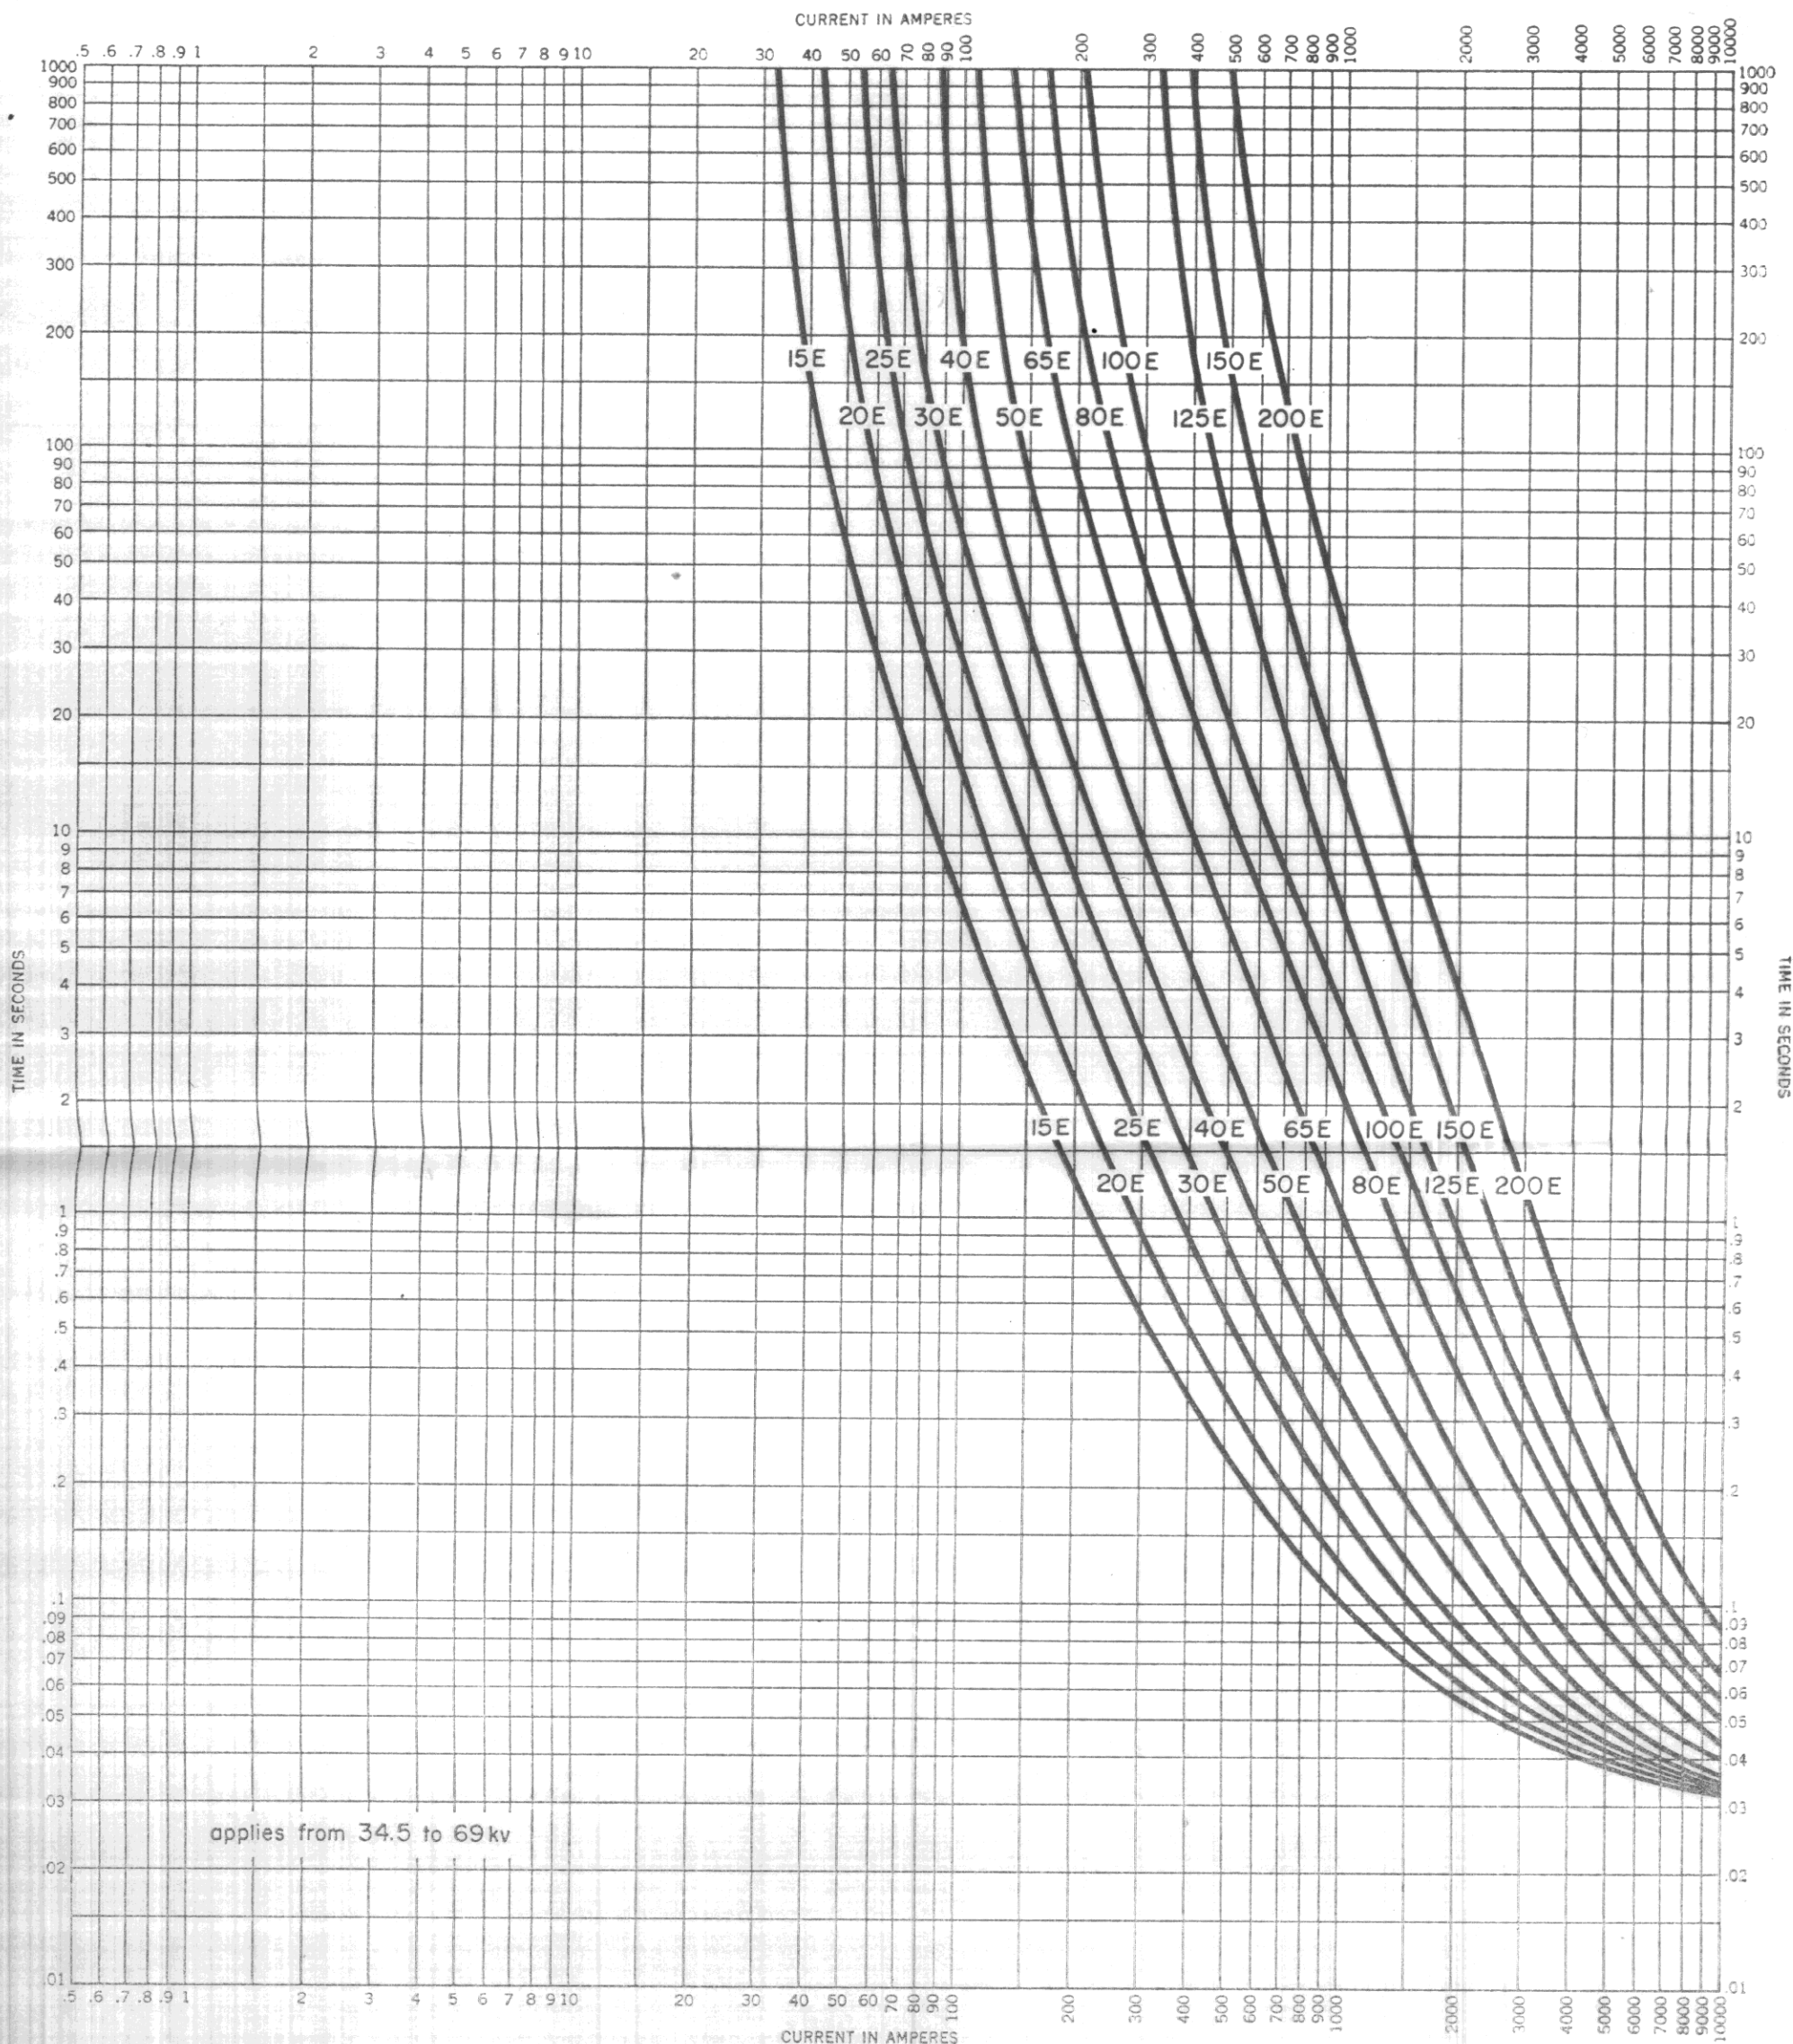

type DBA-1, -2 and -5 dropout power fuses • time lag fuse elements
total clearing time-current characteristics—34.5 to 69 kv

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so all variations should be negative.

Westinghouse Electric Corporation
Assembled Switchgear and Devices Dept.: East Pittsburgh Division • East Pittsburgh, Pa.
 printed in U.S.A.

curve no.

16

reference no. 459357

January, 1961