


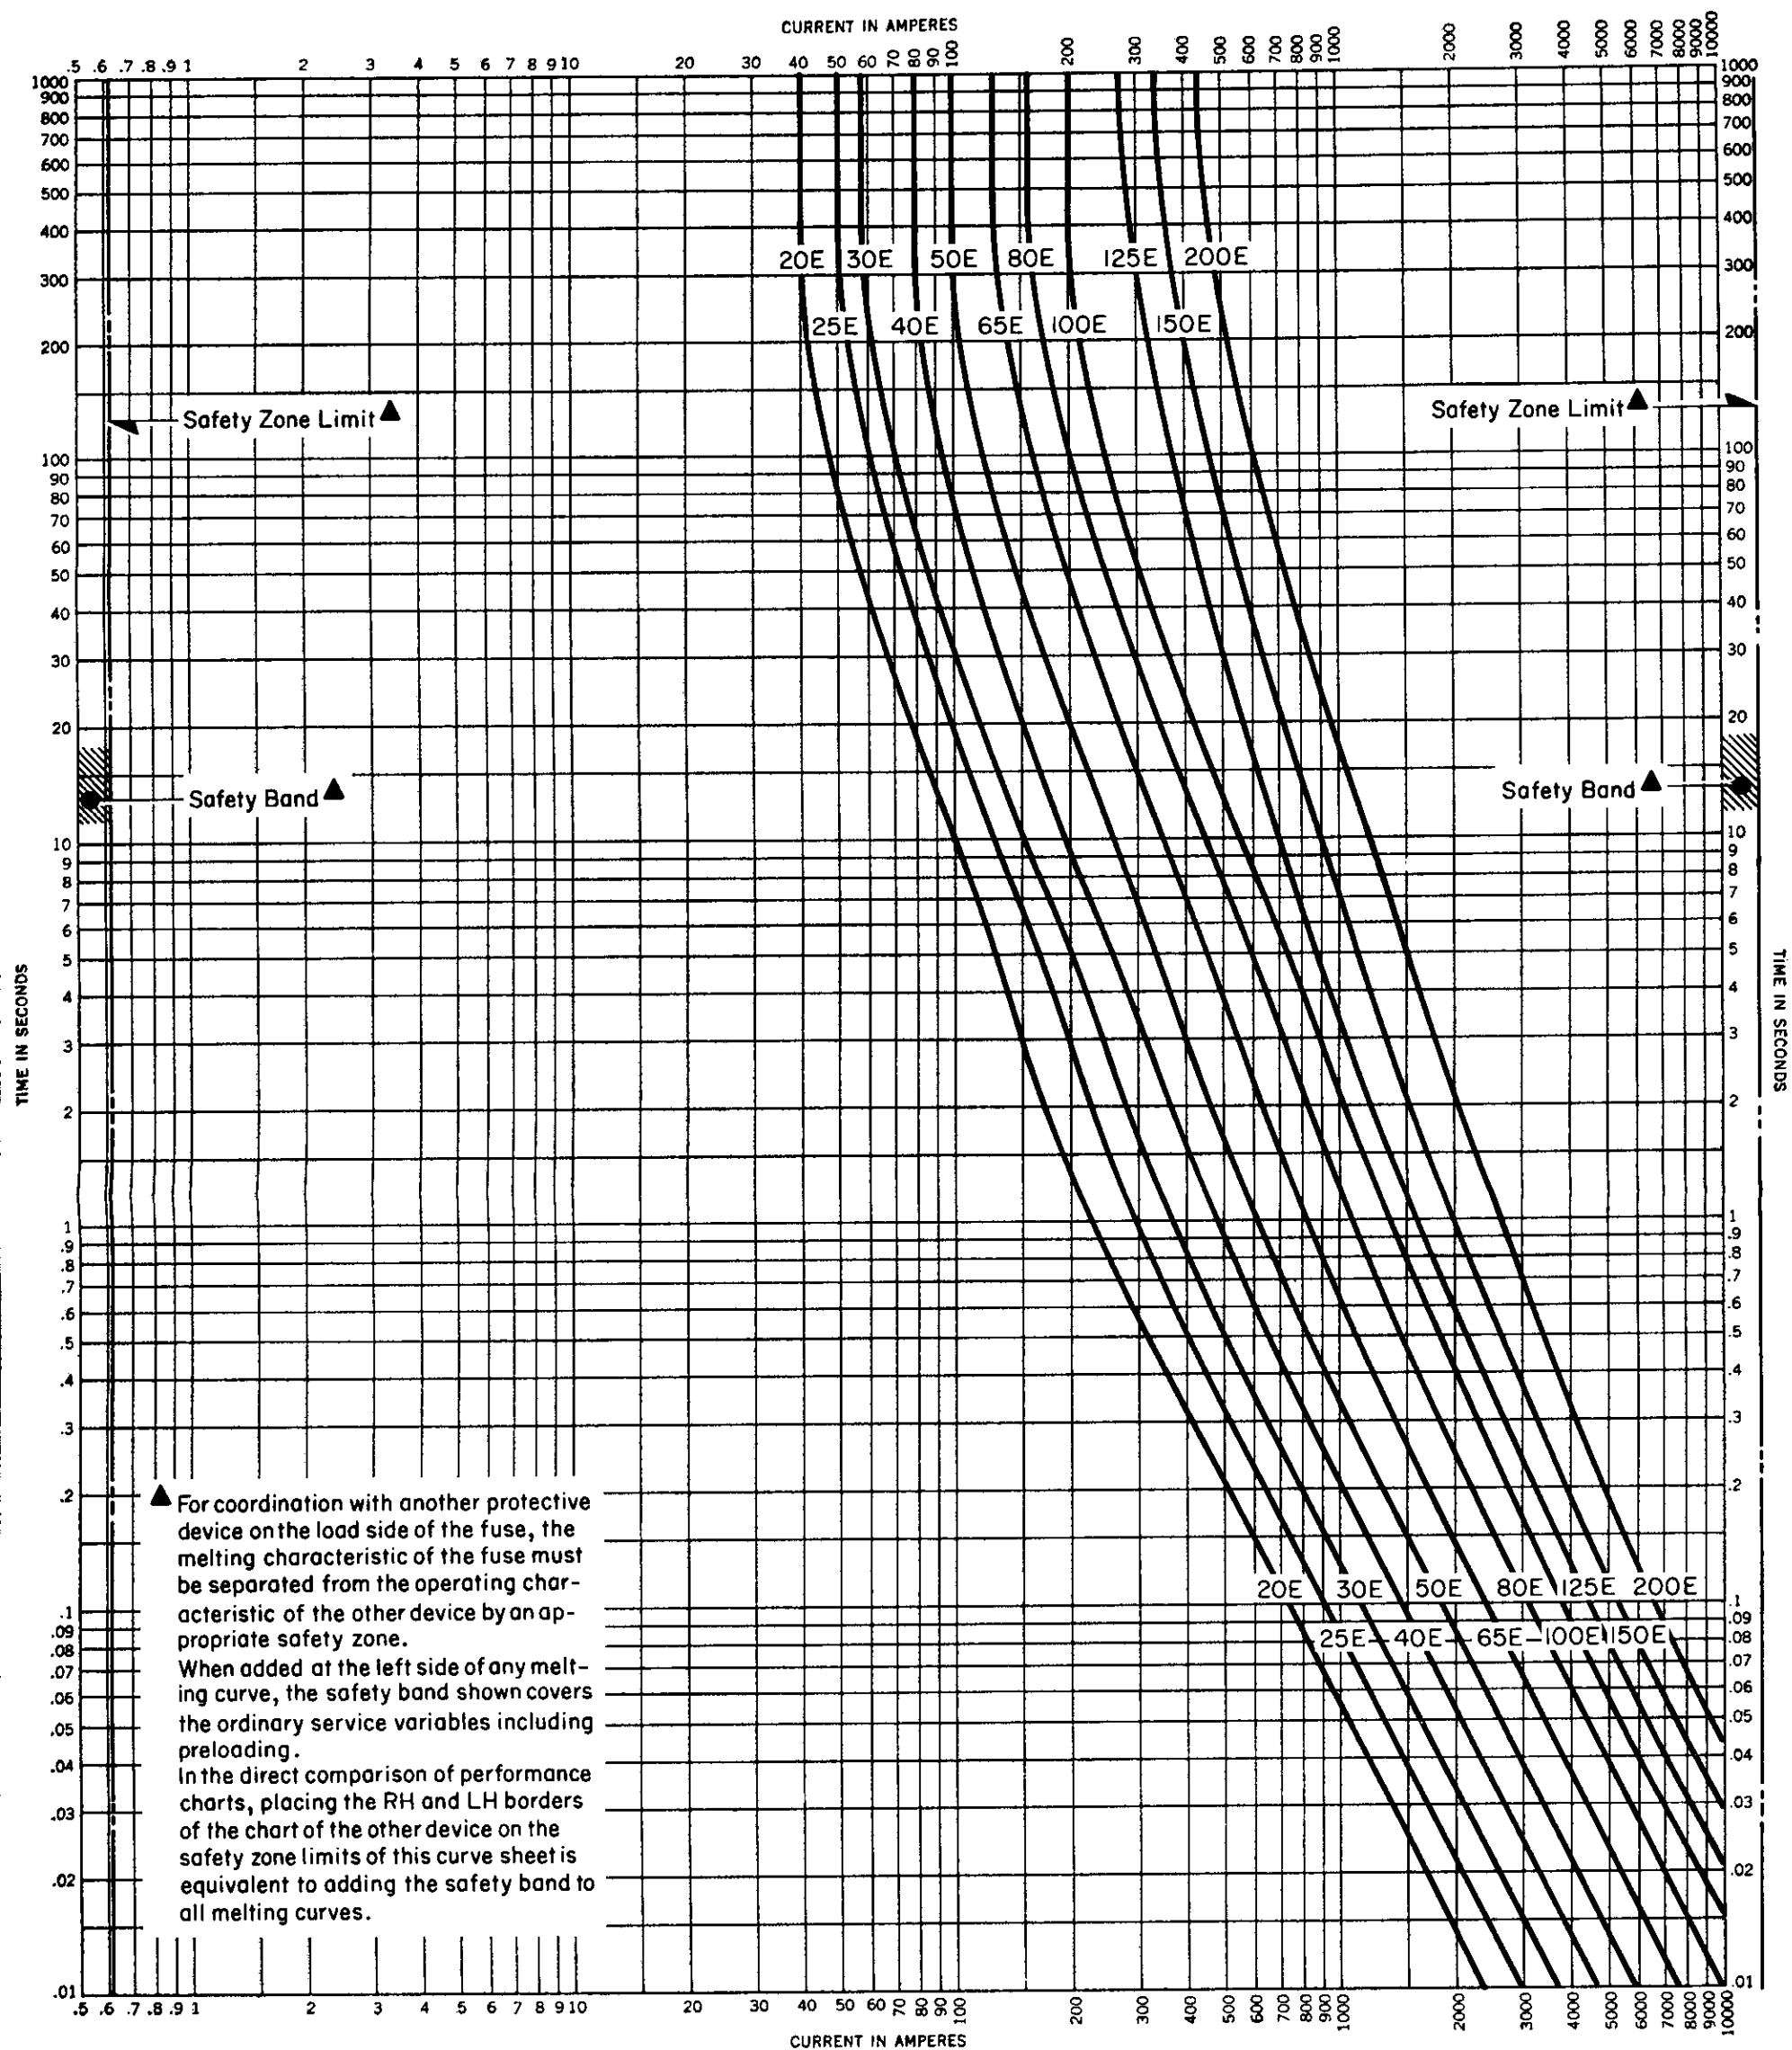

Type RBA-RDB-200 Refill Power Fuses • Time Lag Refills

Melting Time-Current Characteristics – 2.4 to 34.5 Kv

Curves are based on tests starting with fuse unit at an ambient temperature of 25°C and without initial load. Curves are plotted to minimum test points so all variations should be positive.

Westinghouse Electric Corporation
 Distribution and Control Business Unit
 5 Parkway Center
 Greentree, PA 15220
 Printed in USA

Curve No. **3**

Supersedes Curve No. 3
 dated February, 1977

Reference No. 628863

January, 1986