


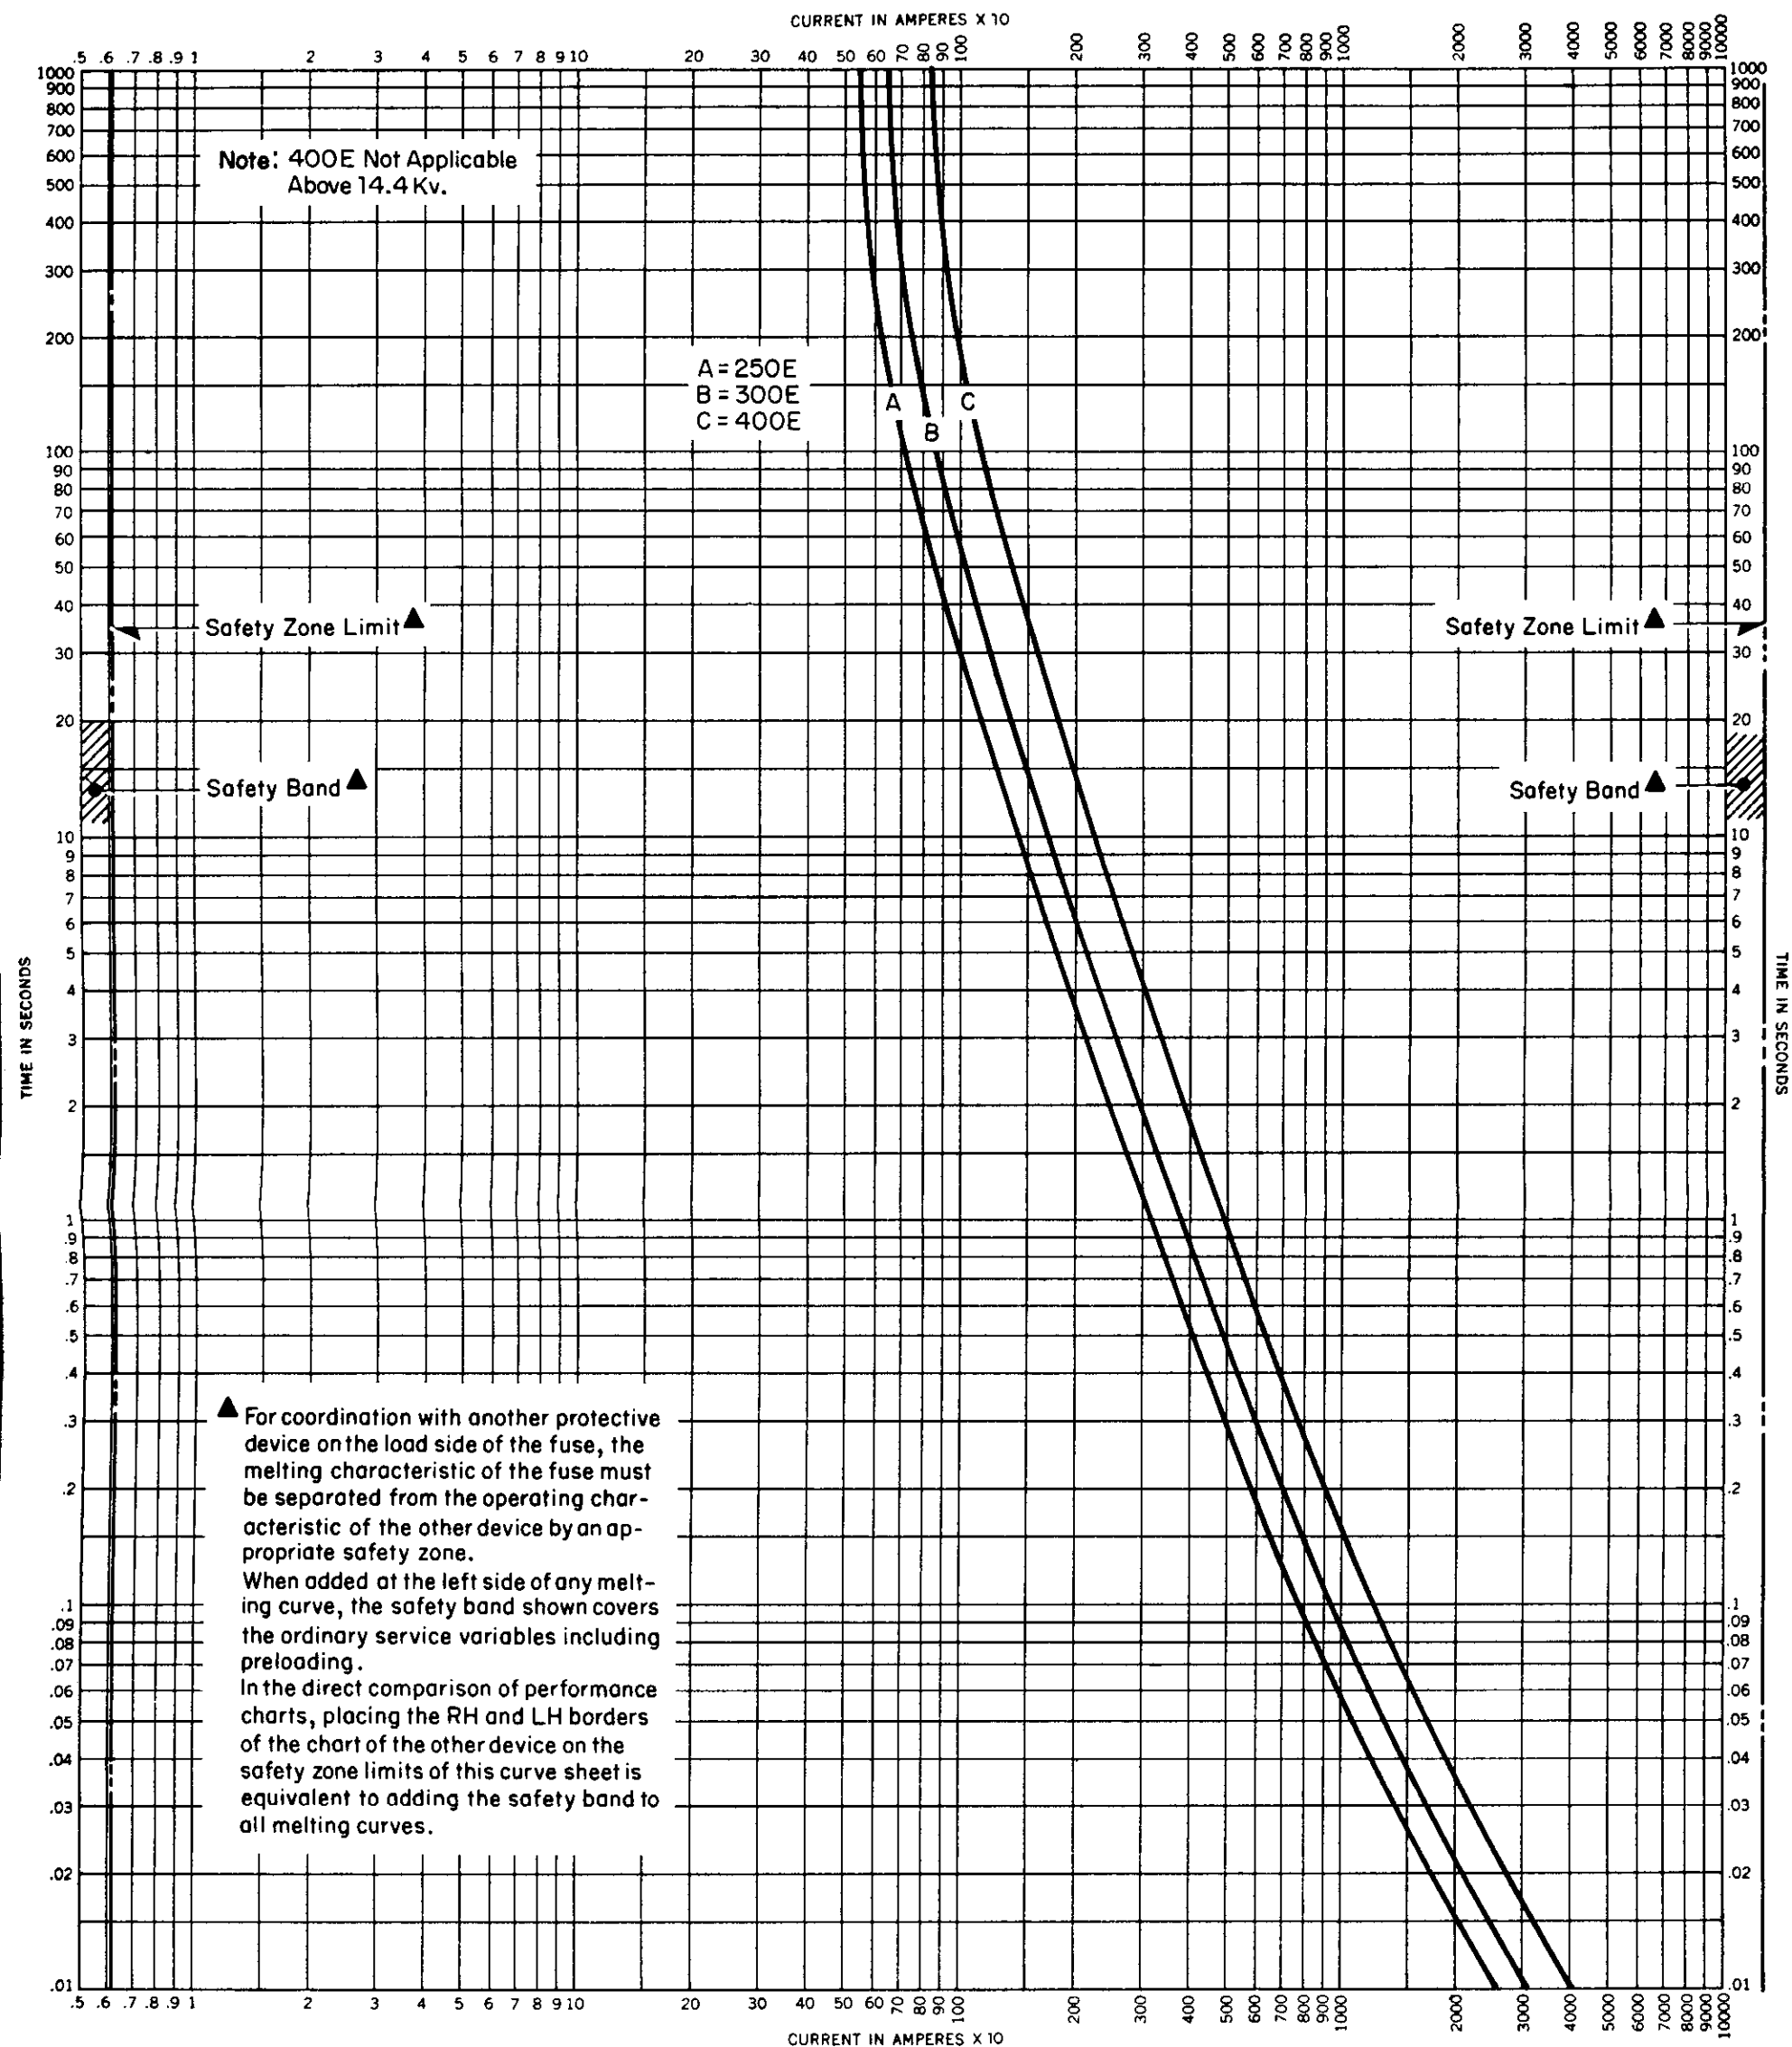

Type RBA-RBD-400 Fuses • Time Lag Refills

Melting Time-Current Characteristics, 2.4 to 34.5 Kv

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to minimum test points so variations should be positive.

Westinghouse Electric Corporation
Distribution and Control Business Unit
5 Parkway Center
Greentree, PA 15220
Printed in USA

Curve No.

10

Supersedes Curve No. 10
dated February, 1977

Reference No. 639435

January, 1986