


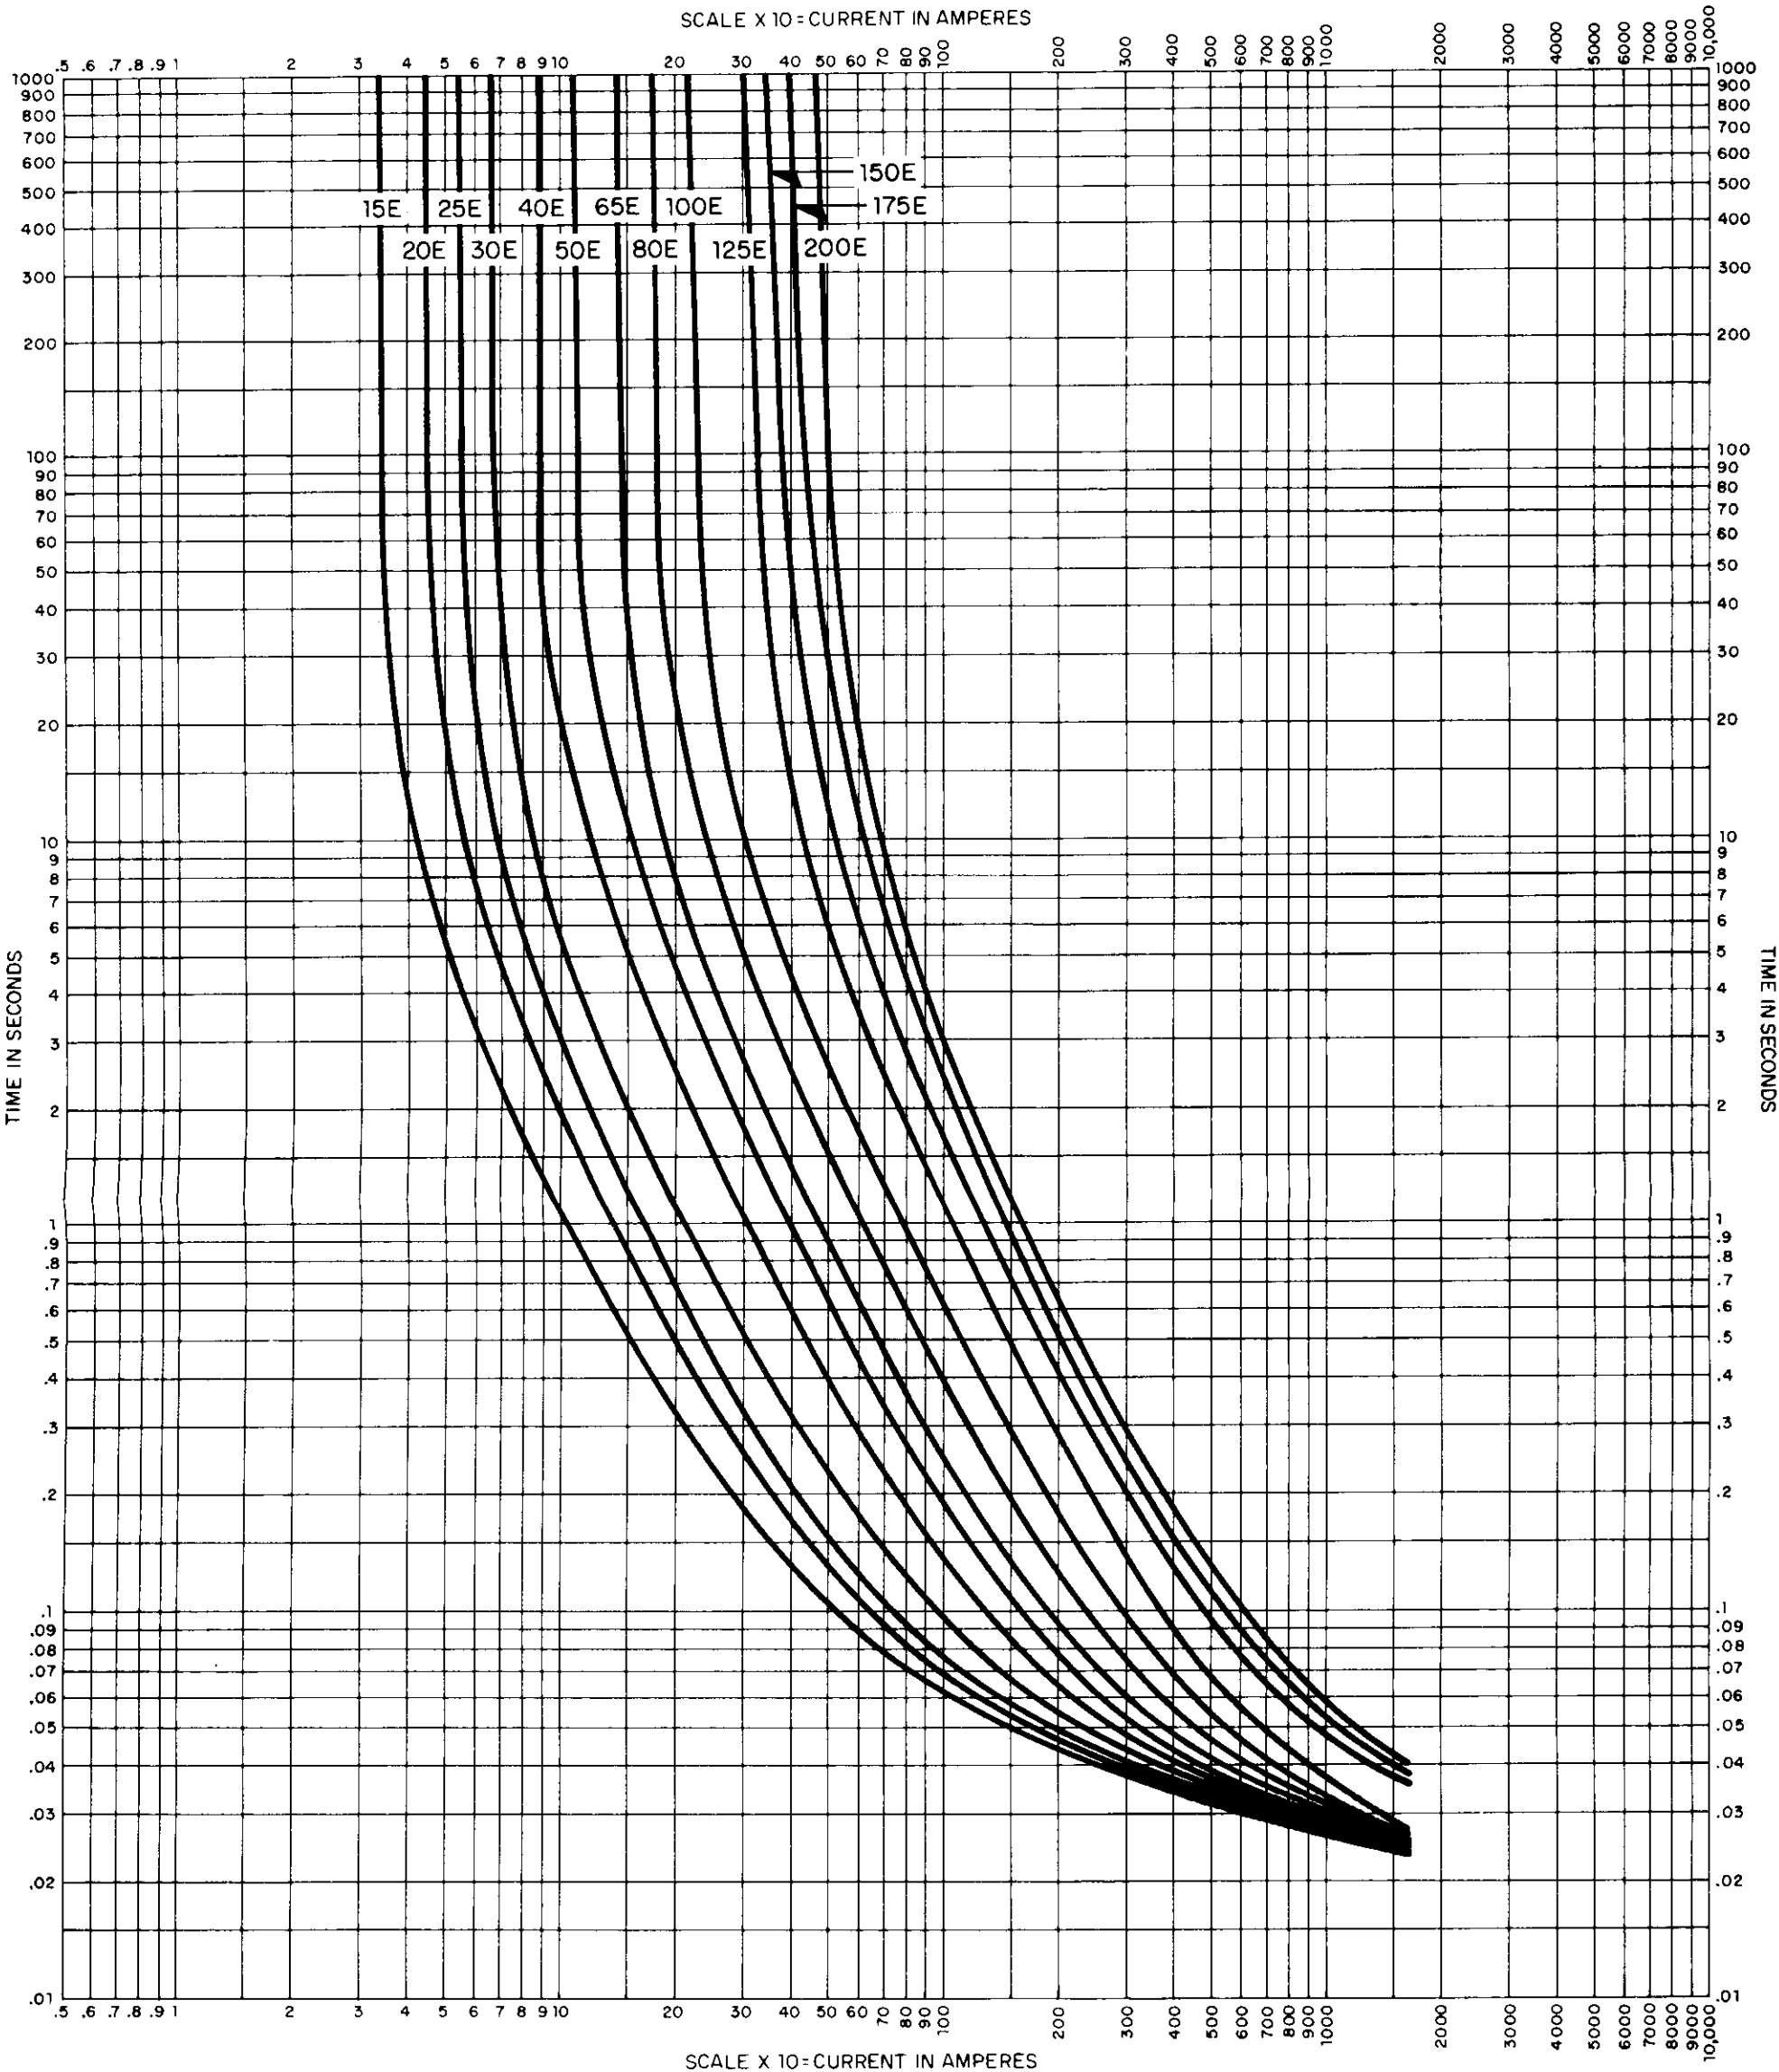

Type DBU® Fuses • Slow “E” Rated Fuse Units

Total Clearing Time-Current Characteristics, 27.0 to 38.0 Kv

Curves are based on tests starting with fuse unit at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so variations should be negative.

Westinghouse Electric Corporation
Distribution and Control Business Unit
Pittsburgh, PA 15220
Printed in USA
© Changed since previous issue.

Curve No.

3

Supersedes Curve No. 3 Dated April, 1980

Reference No. 666791

May, 1988