


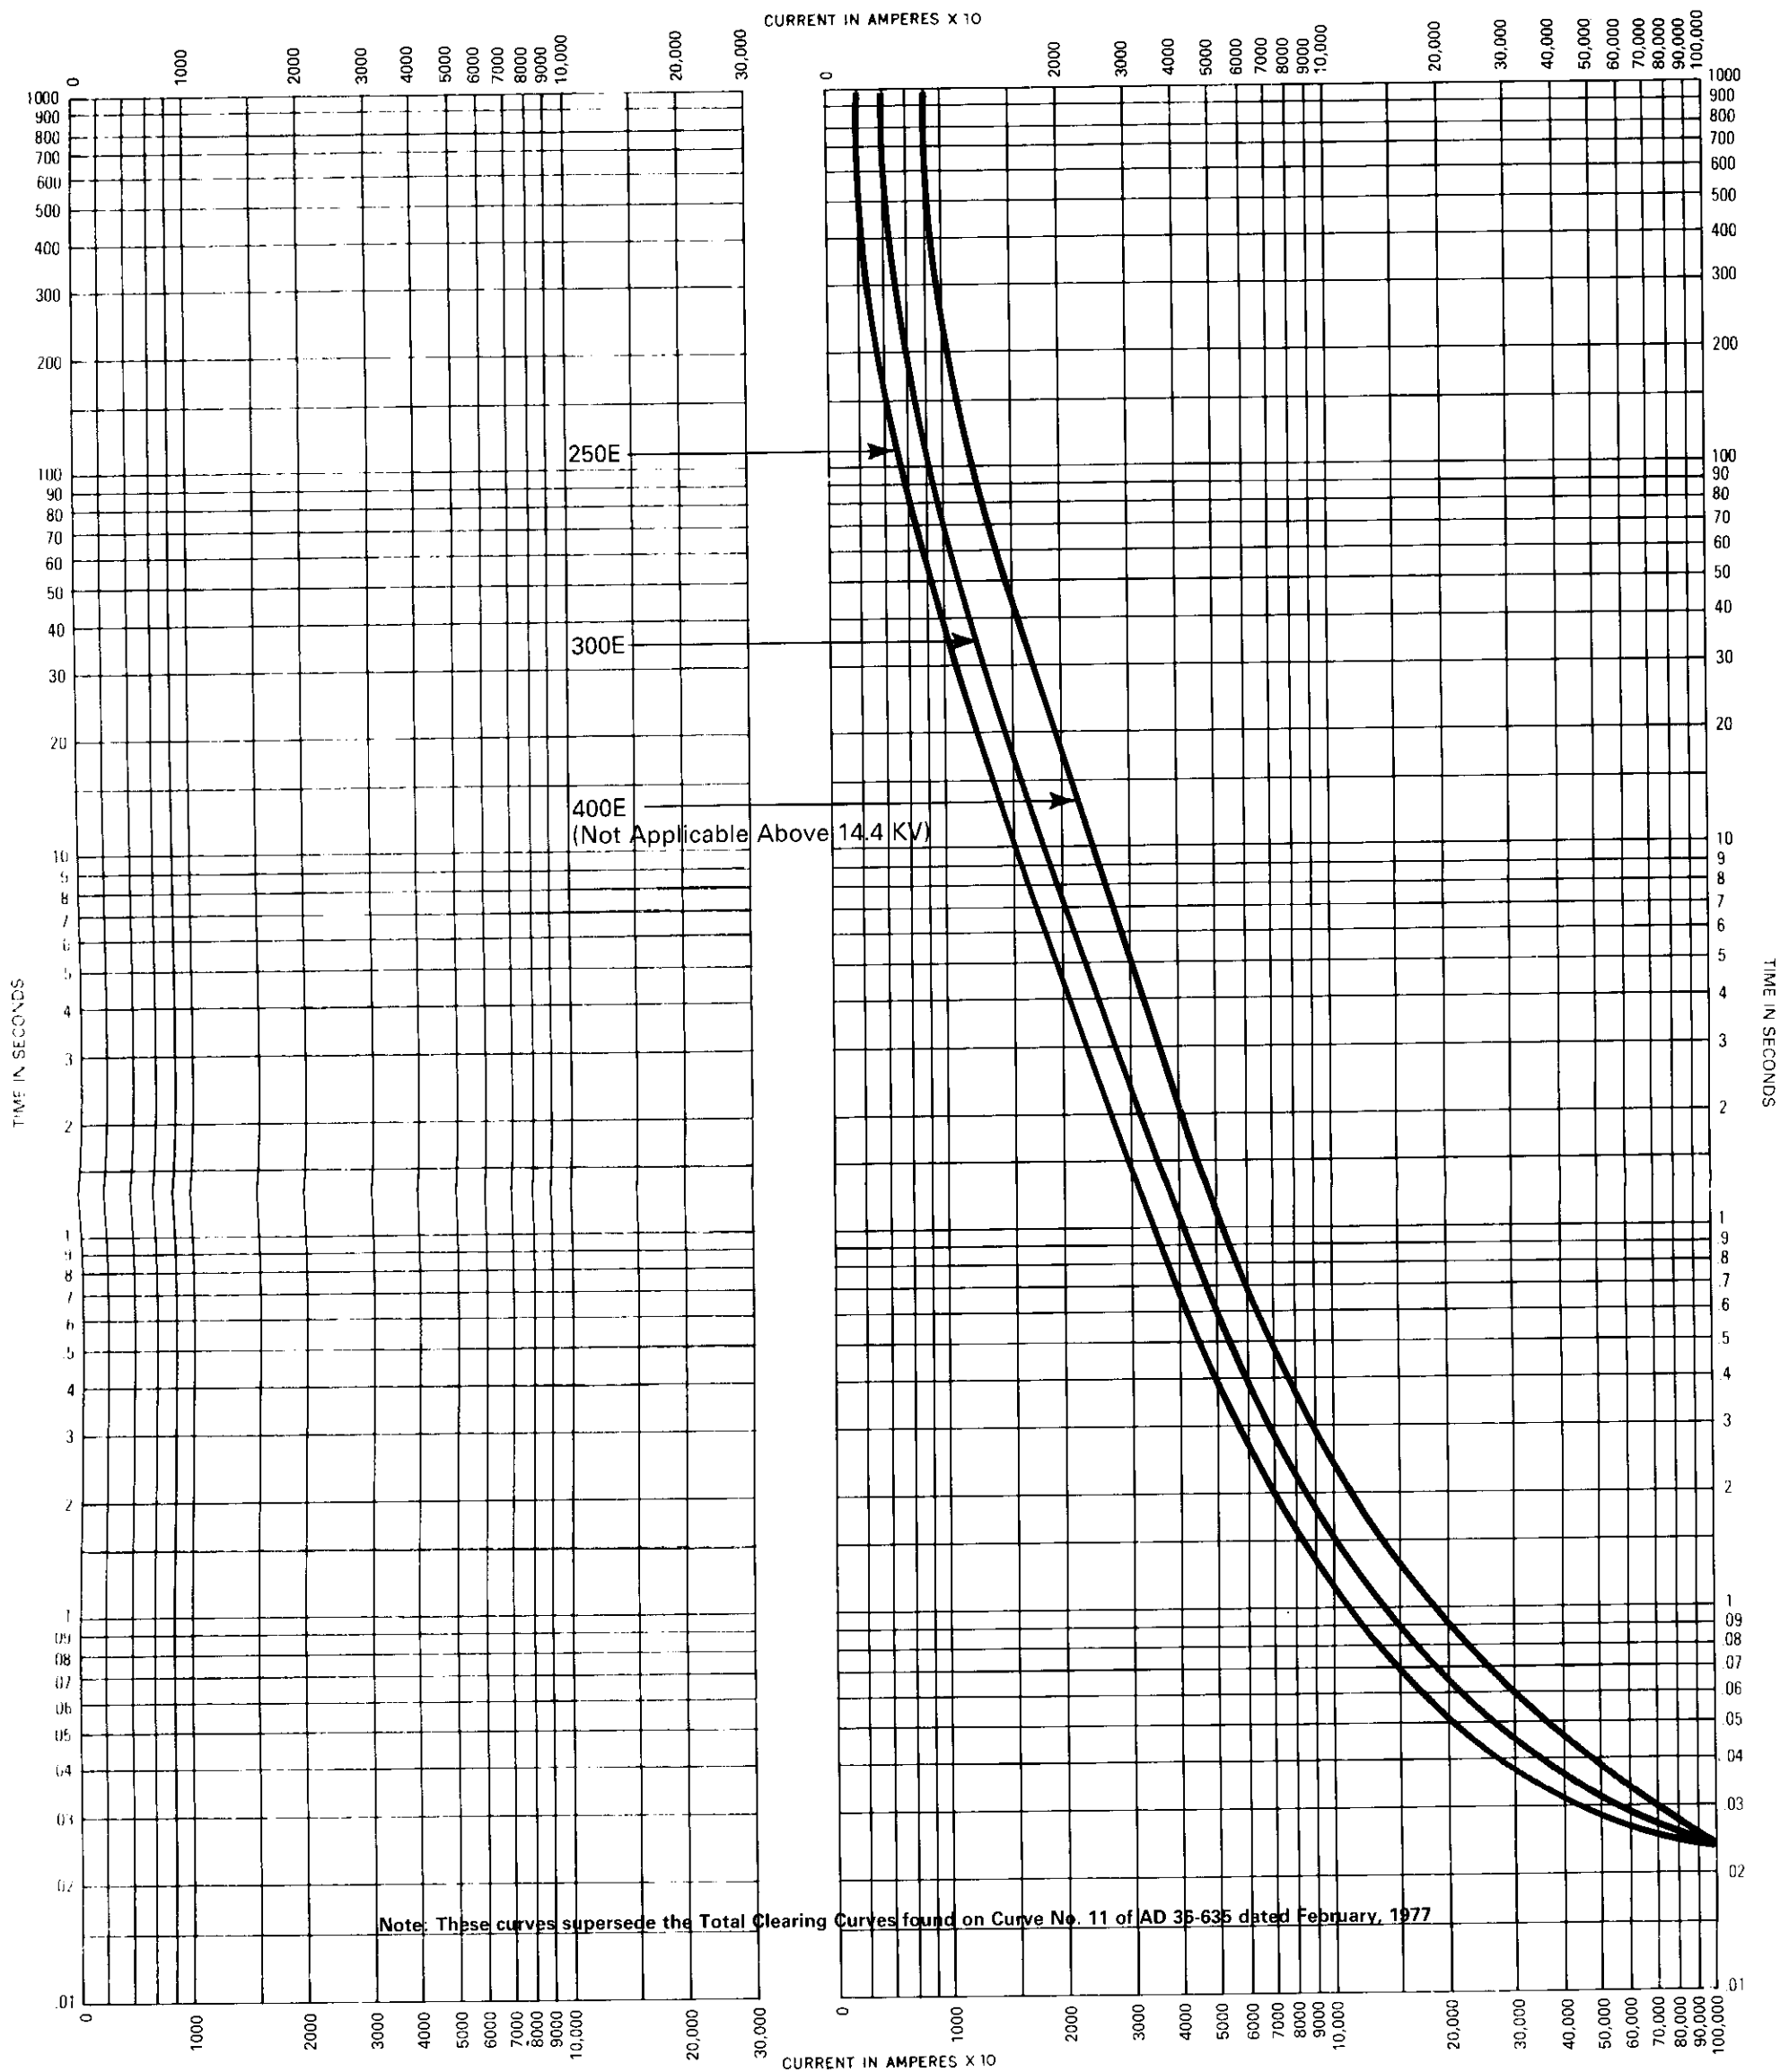

### Type RBA-RBD-400 Fuses • Time Lag Refills Total Clearing Time-Current Characteristics

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so variations should be negative.

**Westinghouse Electric Corporation**  
Distribution and Control Business Unit  
5 Parkway Center  
Greentree, PA 15220  
Printed in USA

Curve No.

11

Supersedes Curve No. 11  
dated February, 1977

Reference No. 667011

January, 1986