


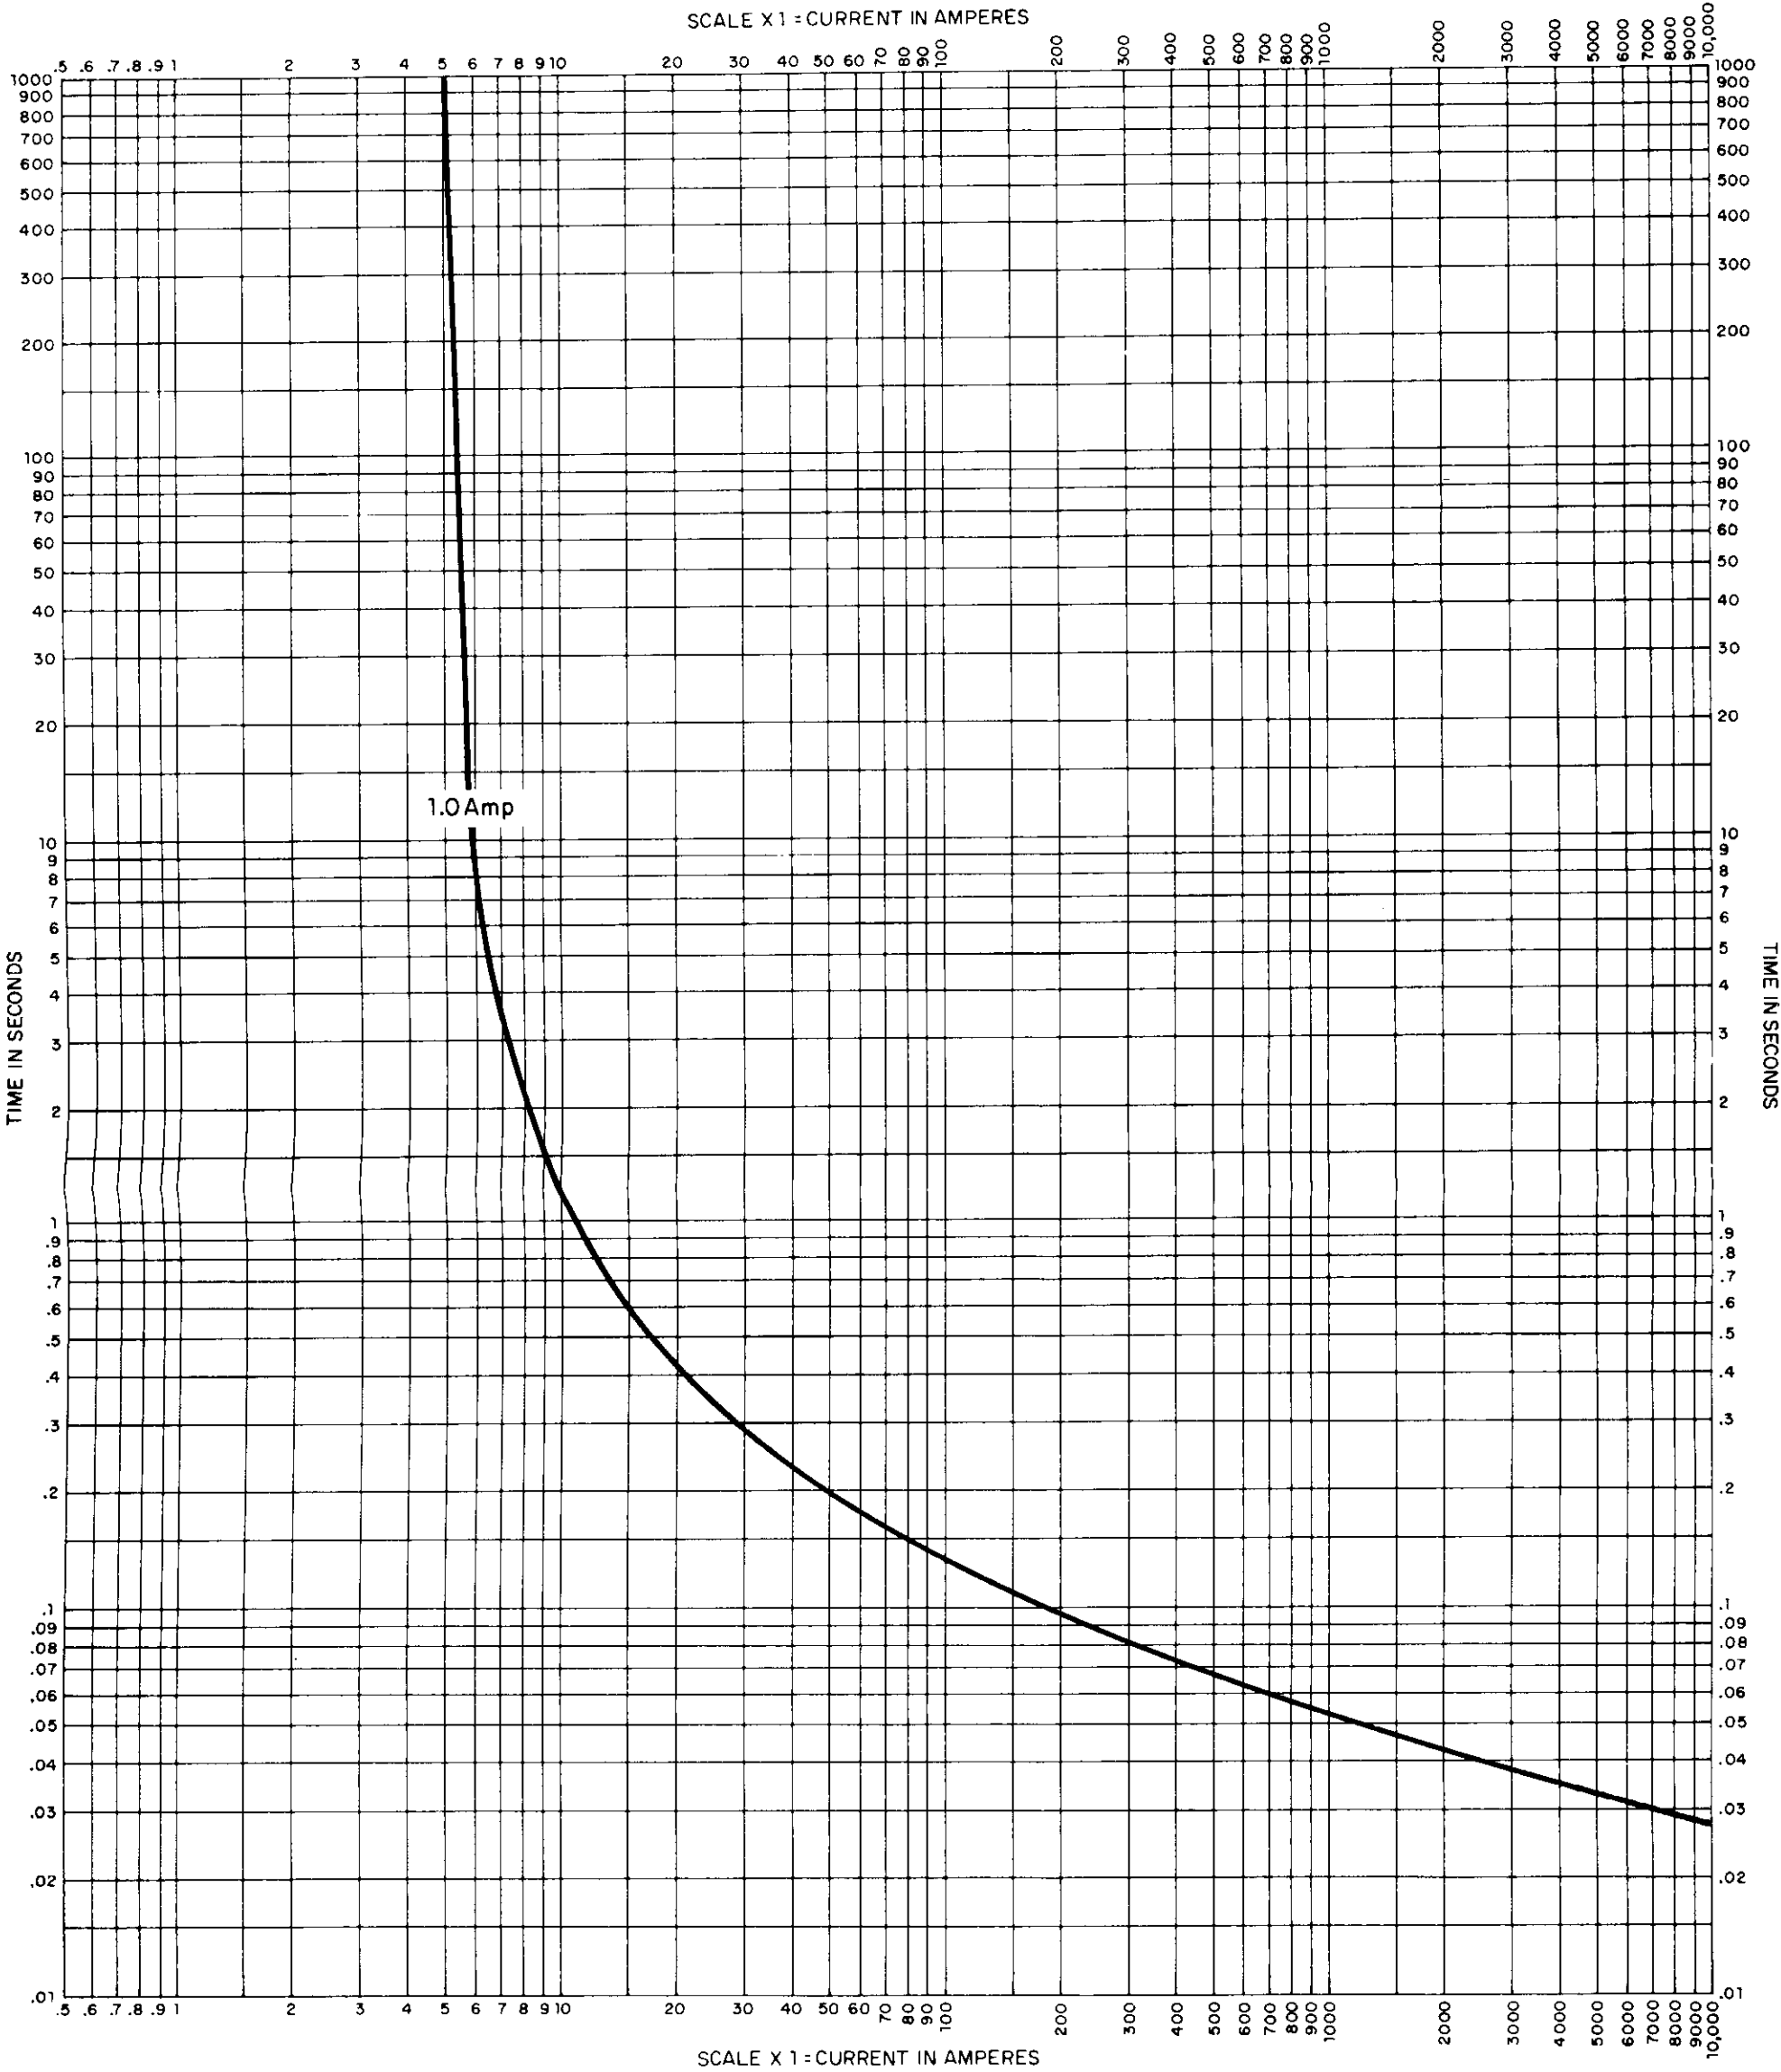

Type DBU® Fuse • 1 Amp Fuse Unit

Total Clearing Time-Current Characteristics, 27.0 to 38.0 Kv

Curves are based on tests starting with fuse unit at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so variations should be negative.

Westinghouse Electric Corporation
Distribution and Control Business Unit
Pittsburgh, PA 15220
Printed in USA
● Changed since previous issue.

Curve No.

9

Supersedes Curve No. 9 Dated April, 1980

Reference No. 705432

May, 1988