


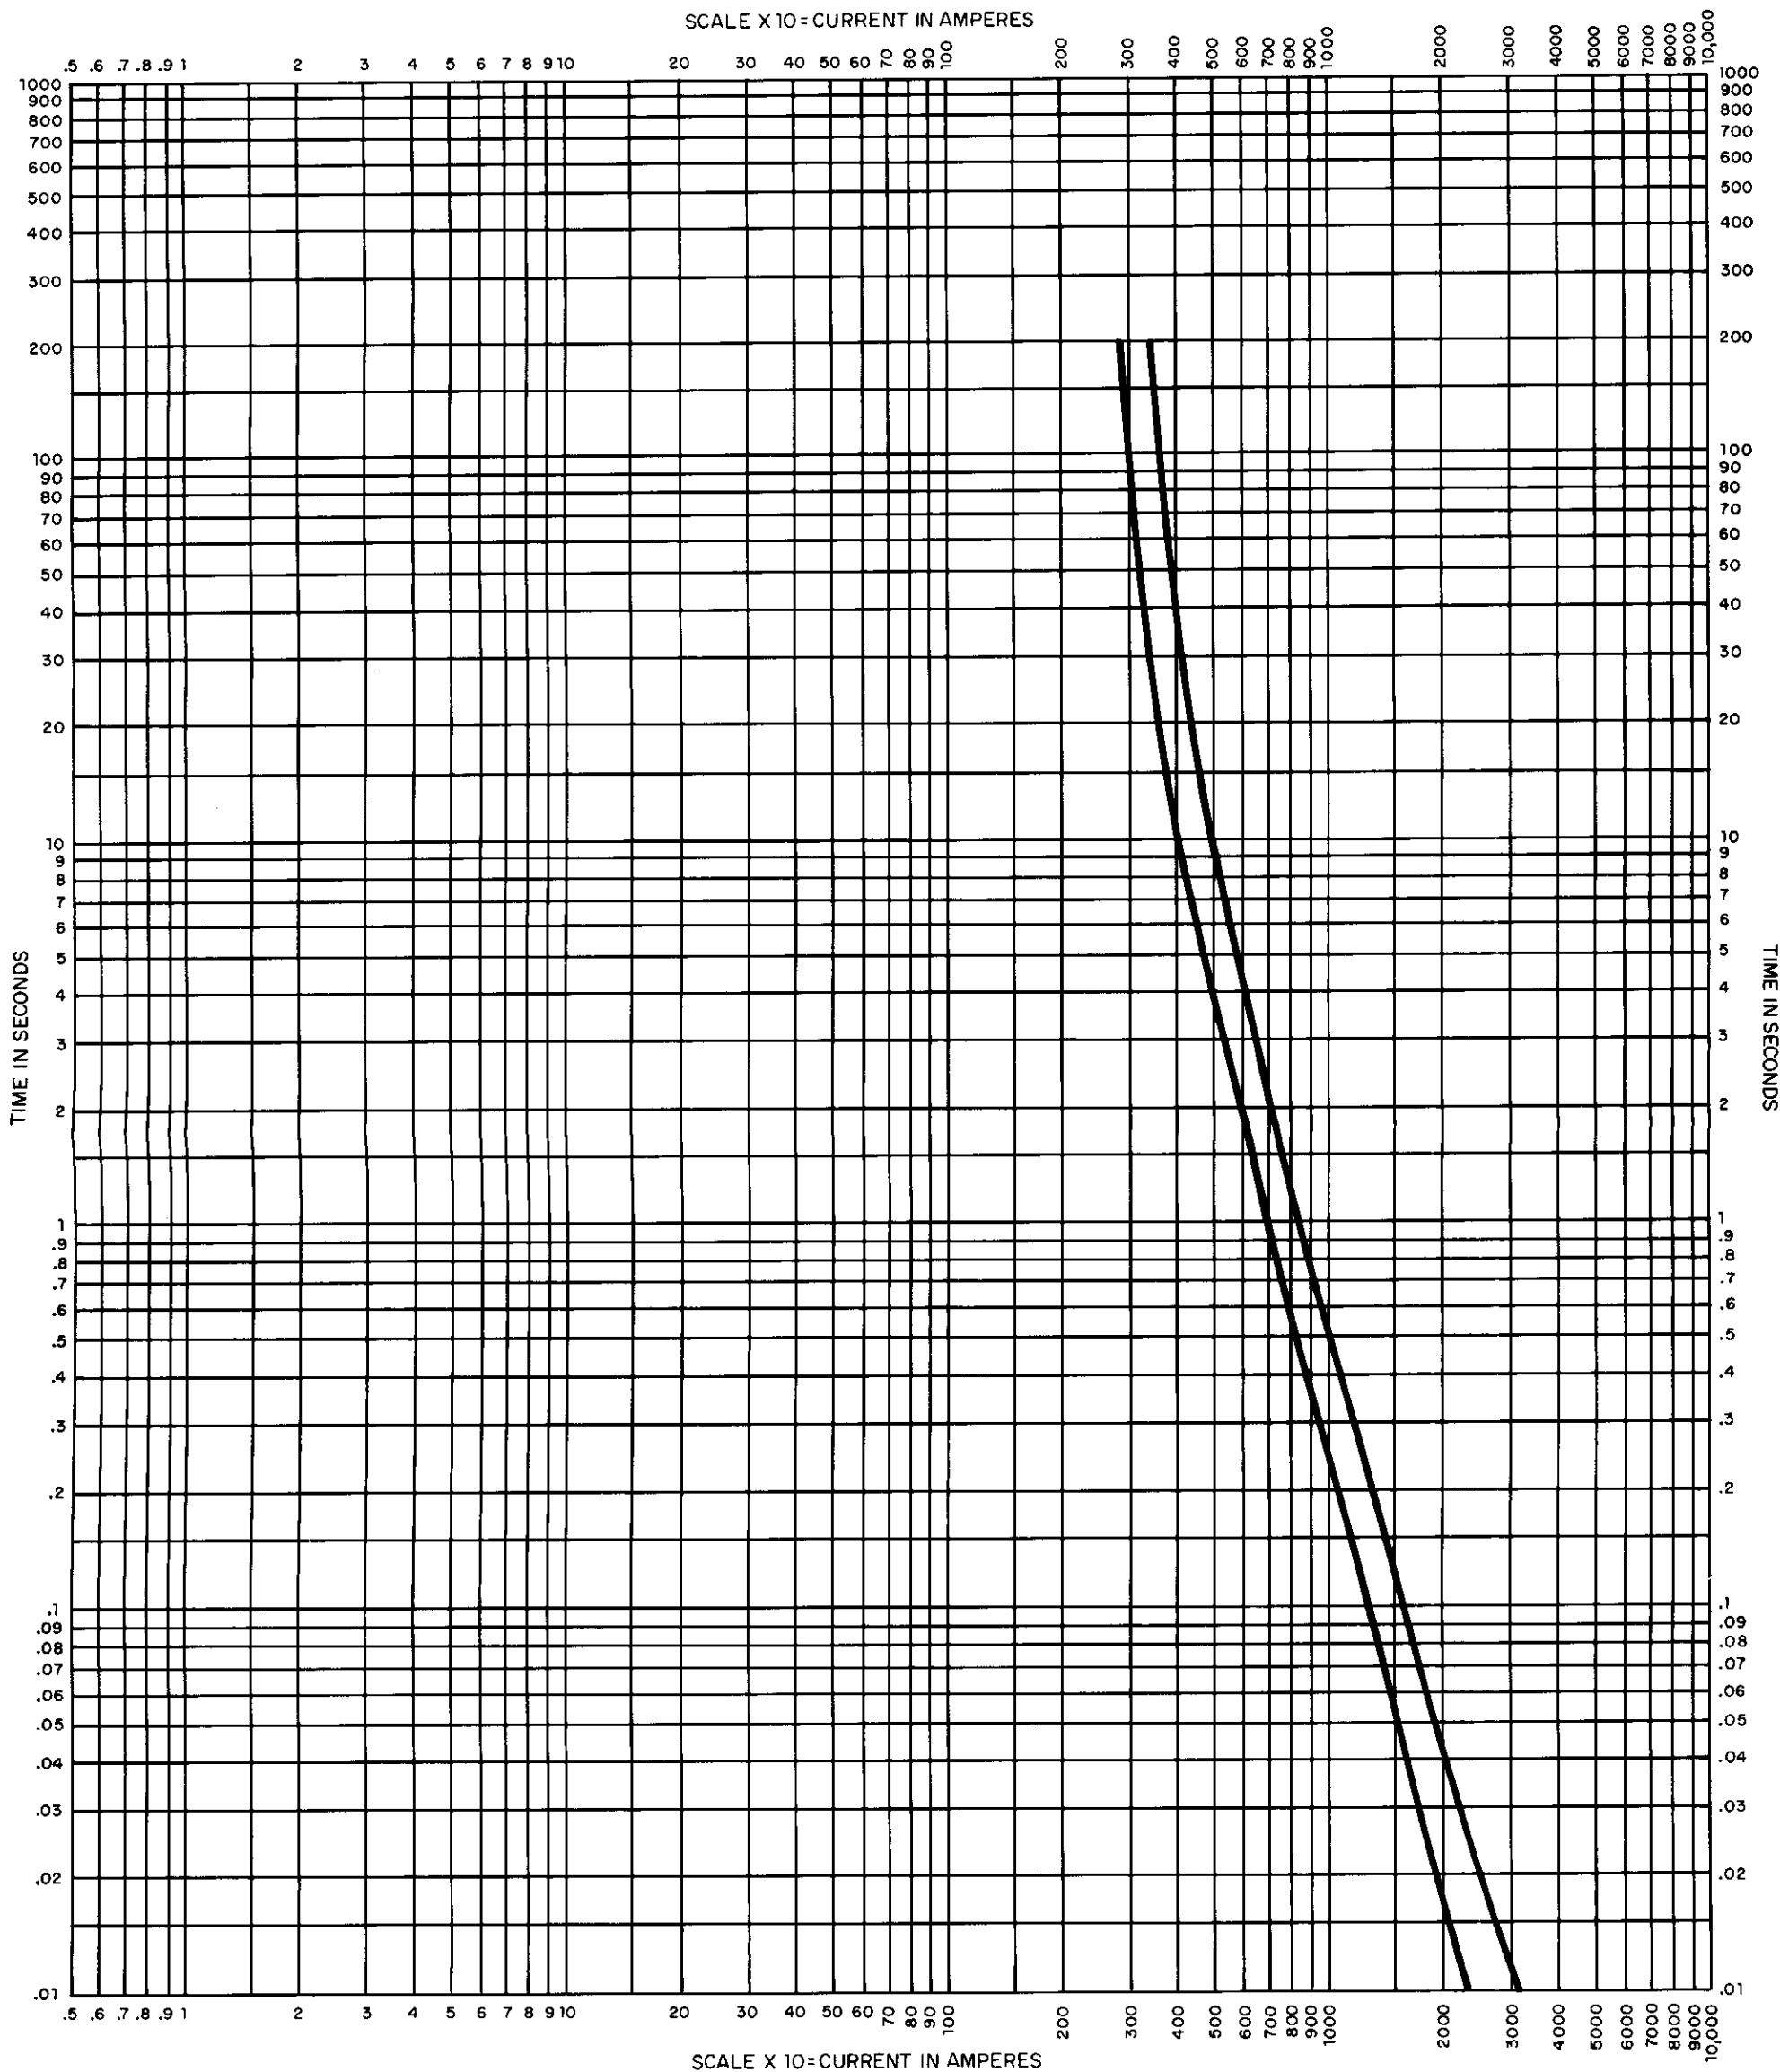

Type CLS-650-3 Motor Starter Fuse
Minimum Melting and Total Clearing Time-Current Characteristics, 7.2 kV

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to minimum test points so variations should be positive.

Westinghouse Electric Corporation
Distribution and Control Business Unit
Greentree, PA 15220
Printed in USA

Curve No.
New Information

16

January, 1986

Reference Data

Ref. Curve No. 705456
Date: 9-1-83