


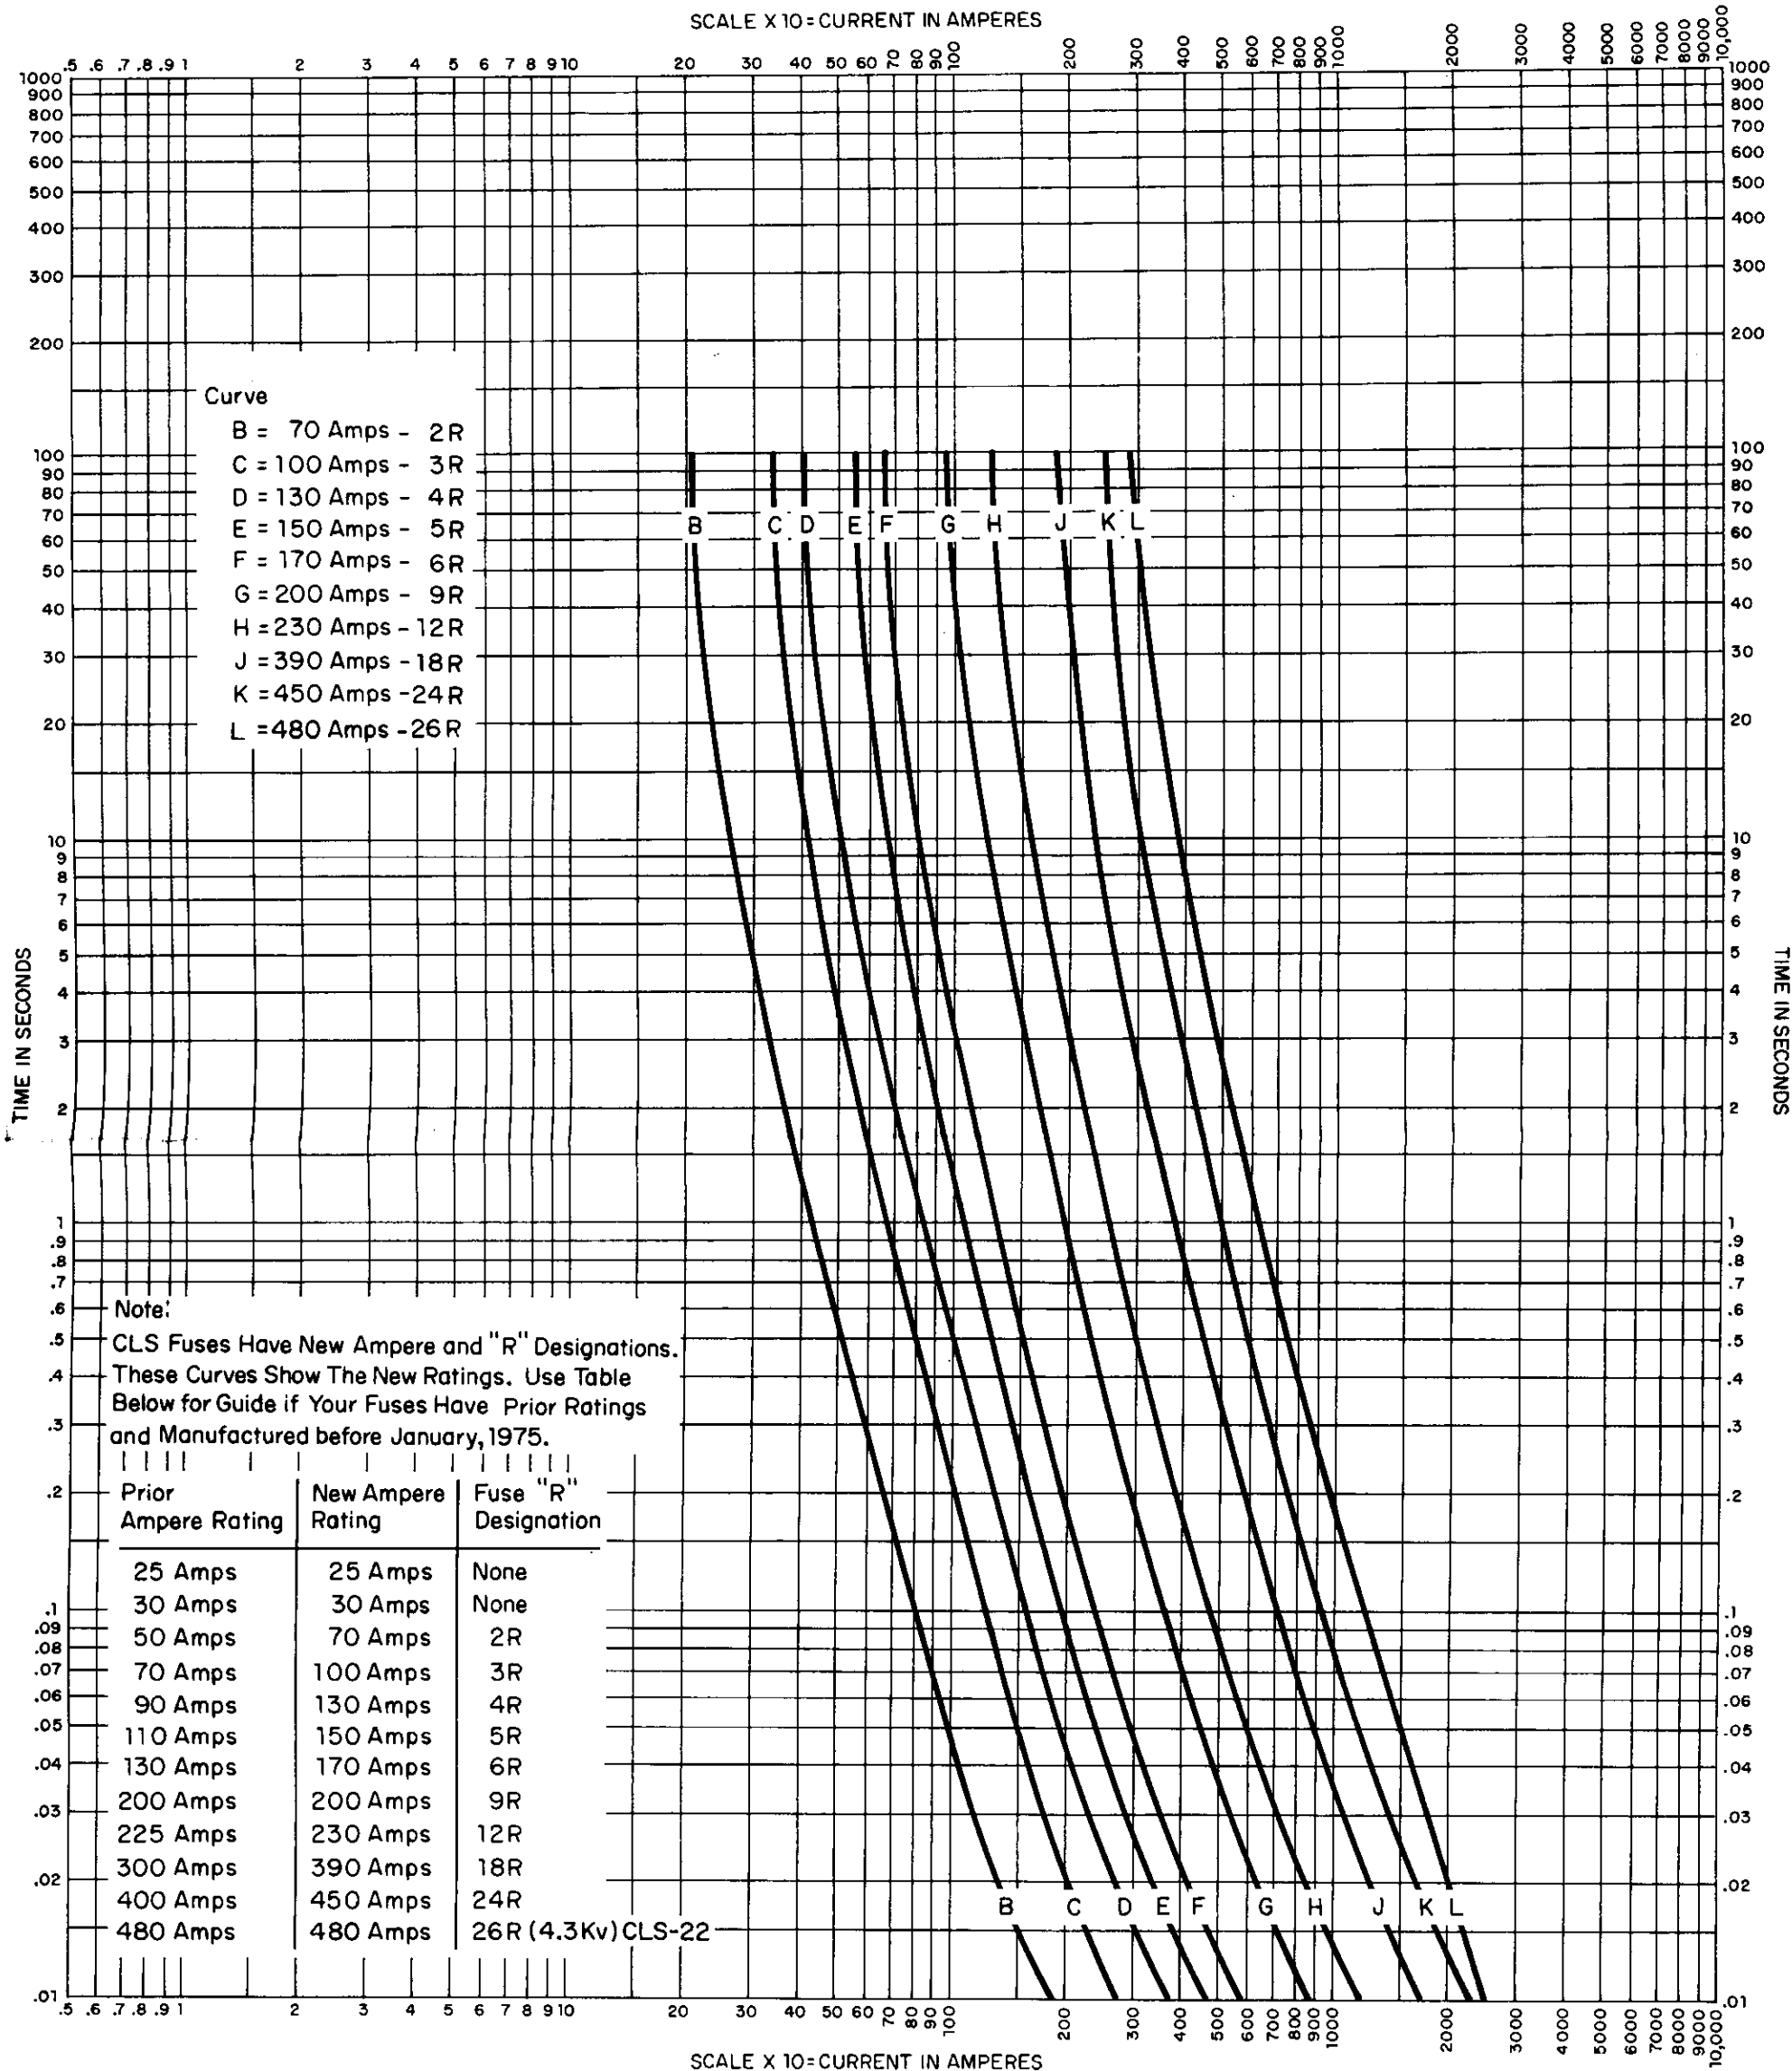

Type CLS-1, CLS-2, CLS-22 Motor Starter Current Limiting Fuses **Total Clearing Time-Current Characteristics, 2.8@ to 5.08@ kV**

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to minimum test points so variations should be negative.

● Changed or added since previous issue.

Westinghouse Electric Corporation
 Distribution and Control Business Unit
 Greentree, PA 15220
 Printed in USA

Supersedes Curve No. 2
 dated January, 1986

July, 1986

2

Reference Data

Curve:	A	B, C, D, E, F, G, H	J, K	L
Ref. Curve No.	666647	512854	536864	639472
Date:	1-29-74	8-60	10-19-61	7-27-72