


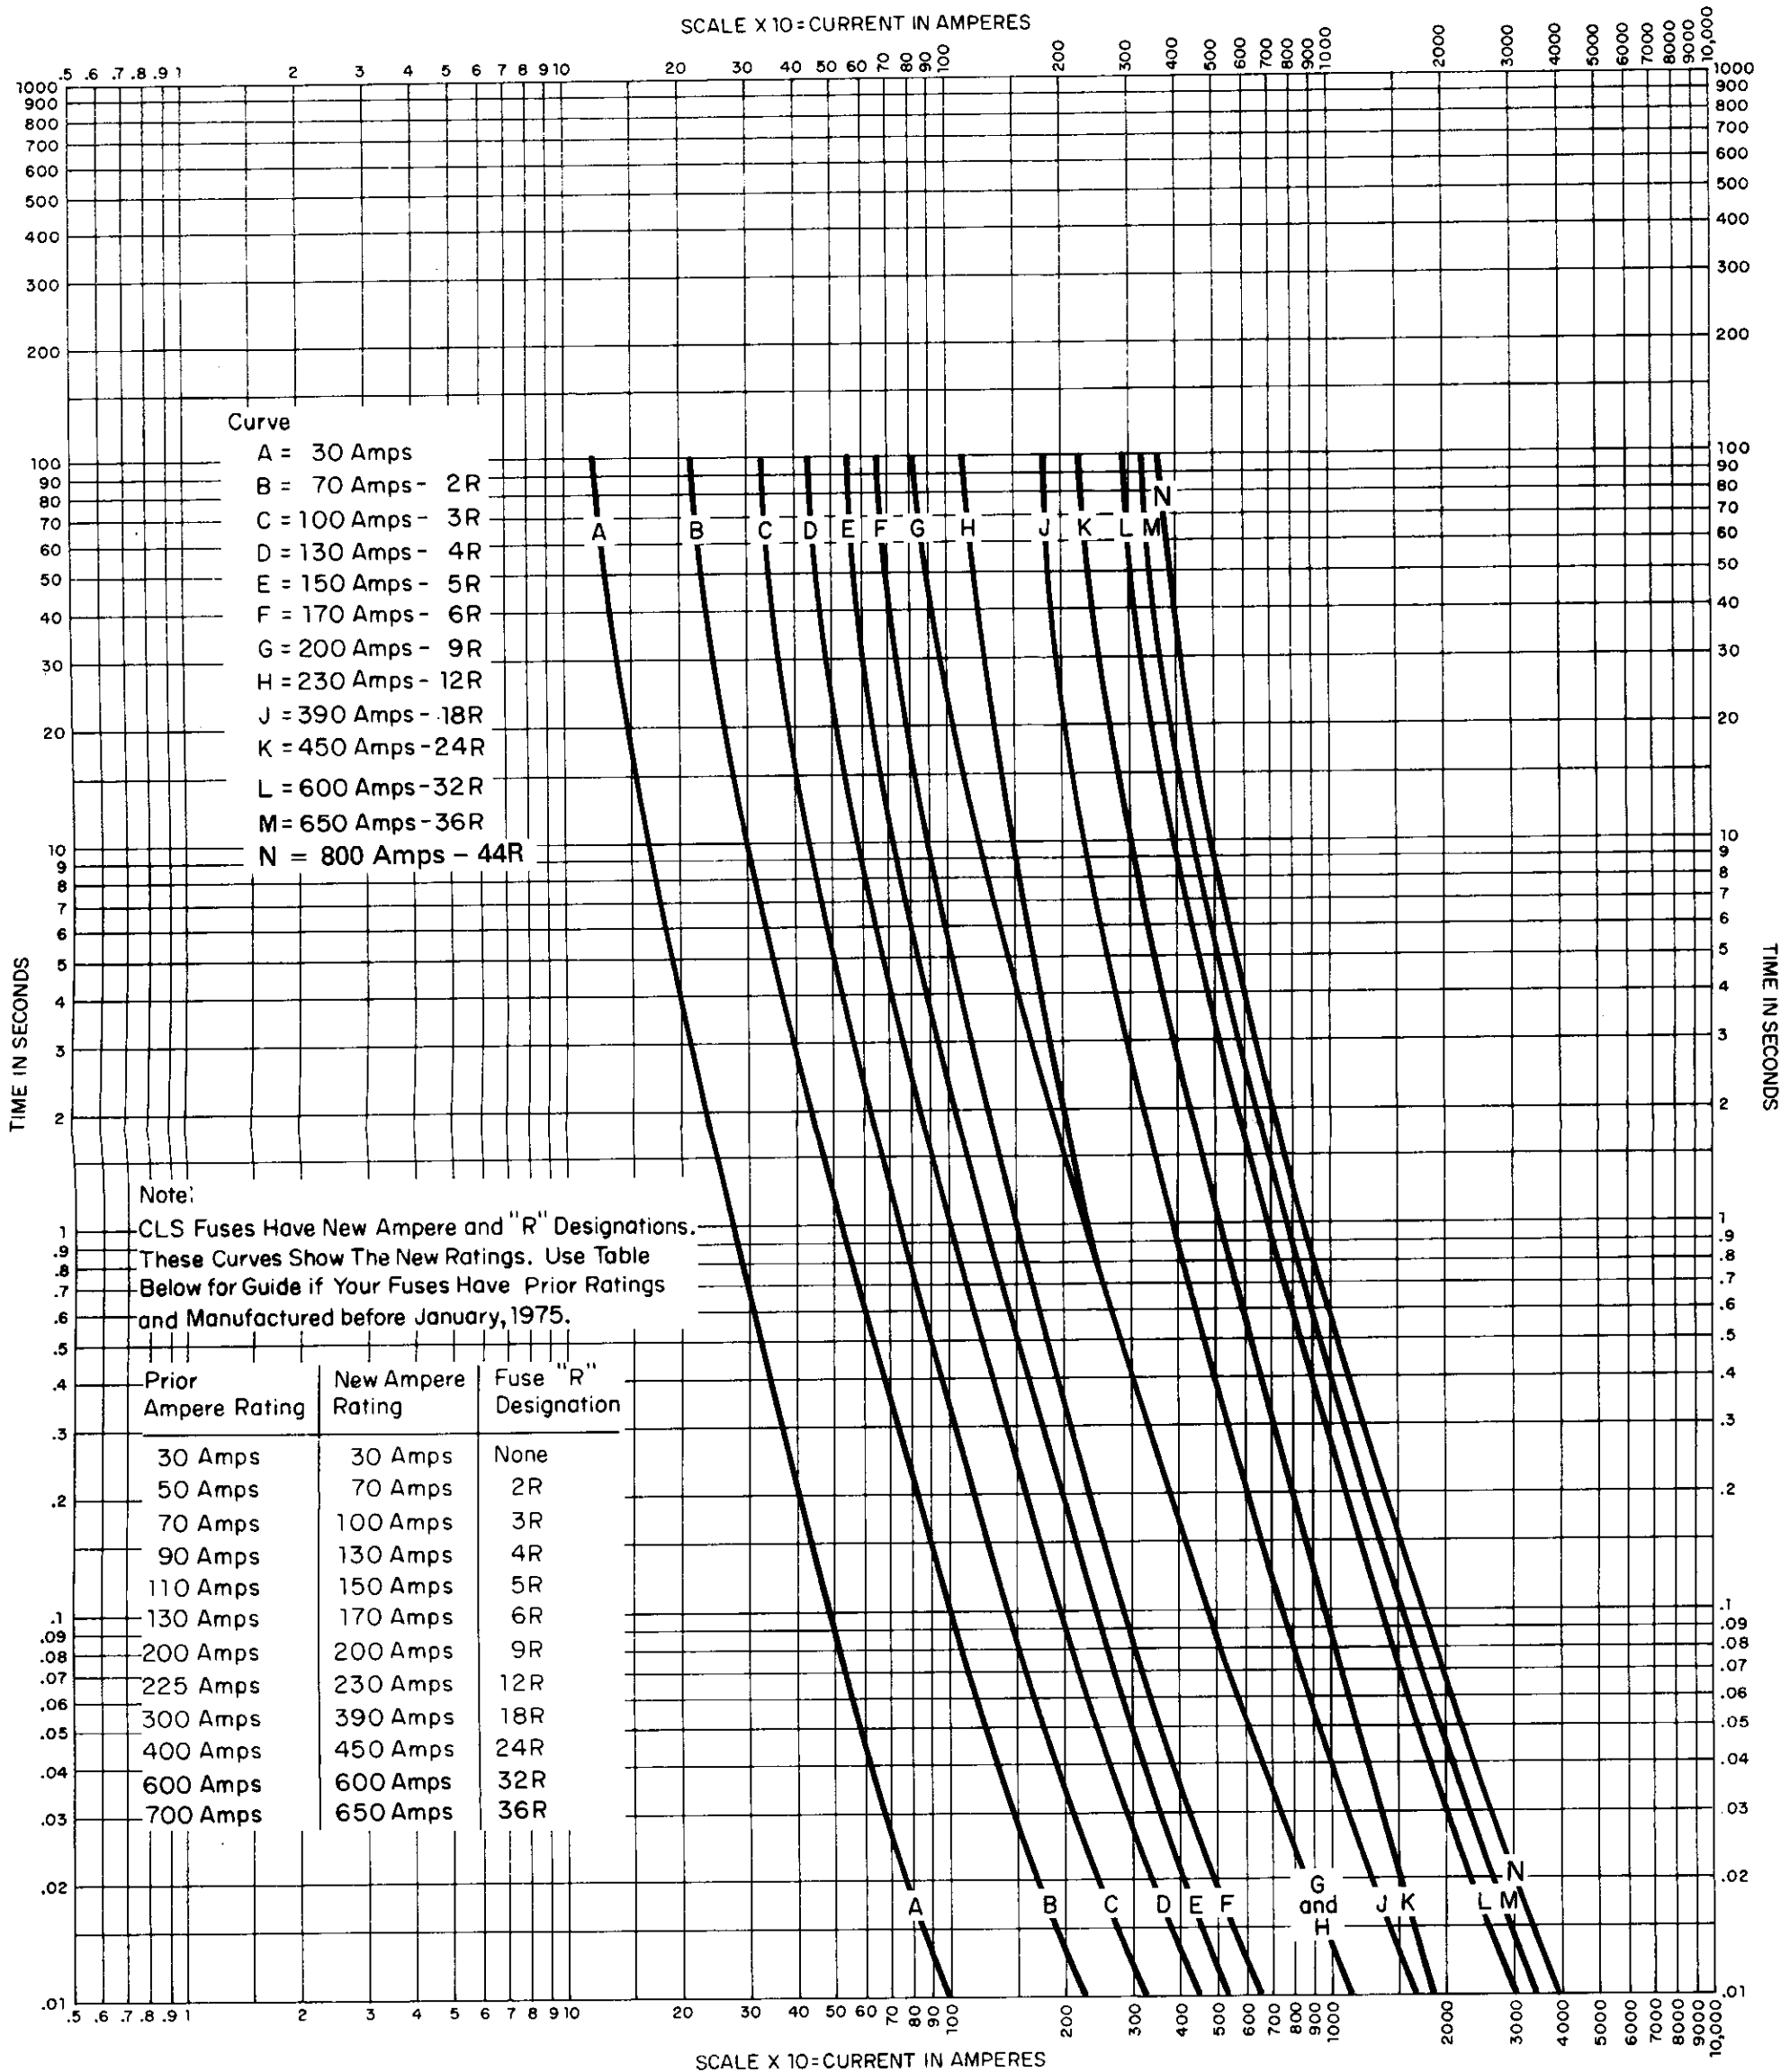

Type CLS-12, CLS-14, CLS-22, CLS-24, CLS-700, HCLS-12 and HCLS-22 Motor Starter Current Limiting Fuses

Total Clearing Time-Current Characteristics, 5.08 kV

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so variations should be negative.

● Changed since previous issue.

Westinghouse Electric Corporation
Distribution and Control Business Unit
Greentree, PA 15220

Printed in USA

Supersedes Curve No. 6
dated January, 1986

July, 1986

6

Reference Data

Curve:	A, B, C, D, E, F, J	G, H	K	L, M
Ref. Curve No.	666907	667004	666910	667001
Date:	2-8-77	6-16-78	9-8-77	6-16-78