


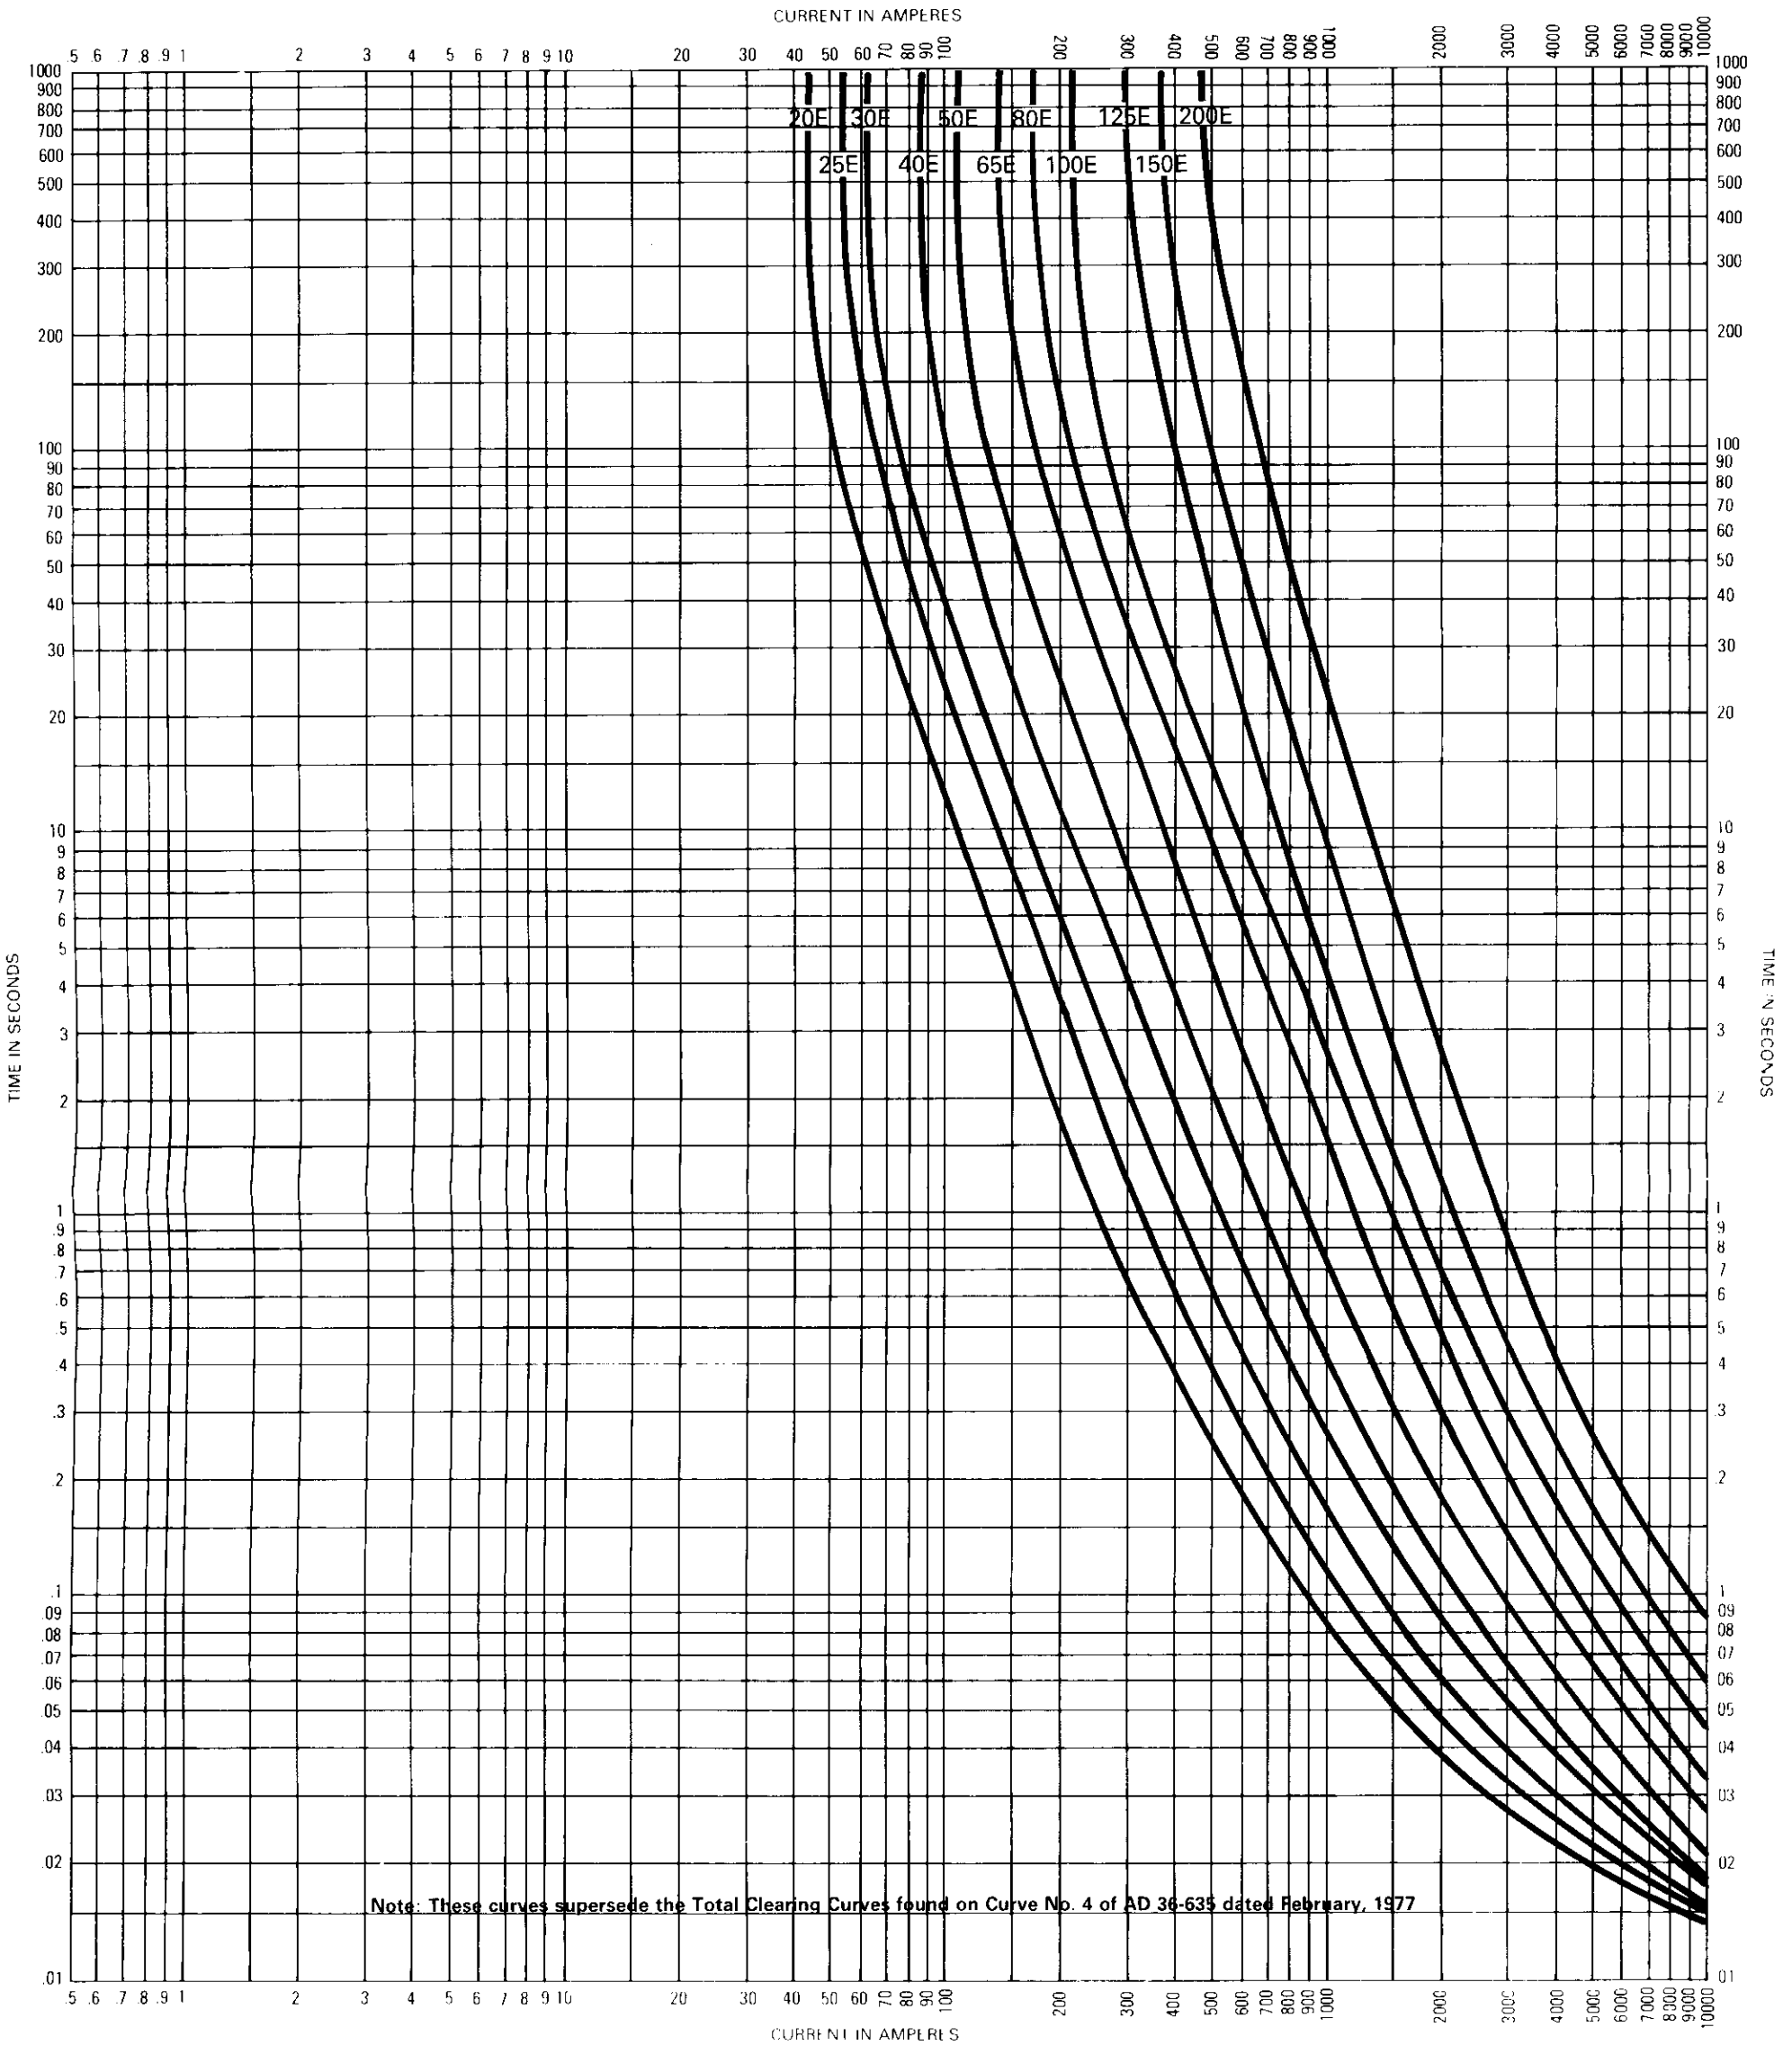

Type RBA-RDB-200 Refill Power Fuses • Time Lag Refills
Total Clearing Time-Current Characteristics – 2.4 to 34.5 Kv

Curves are based on tests starting with fuse unit at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points.

Westinghouse Electric Corporation
Distribution and Control Business Unit
5 Parkway Center
Greentree, PA 15220
Printed in USA

Curve No. **4**

Supersedes Curve No. 4
dated January, 1986

Reference No. 667013

September, 1986