




# Key-Lock Accessory Kit


## For AKR Substructure

Numbers on Drawing Correspond to Numbers on Enclosed Parts List

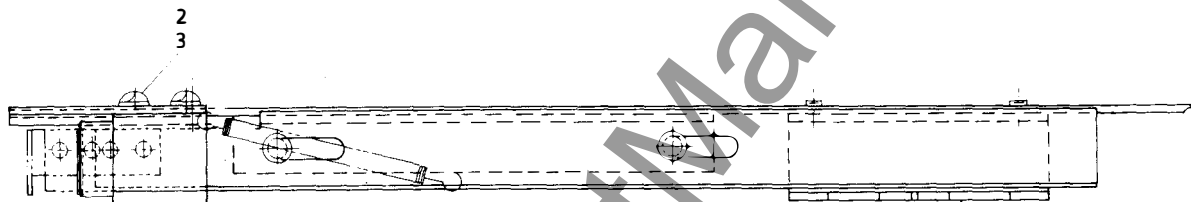

**Note:** K.L. should be assembled to Bracket Item 1 before assembling to substructure.  
K.L. furnished by customer.

Trip Cam

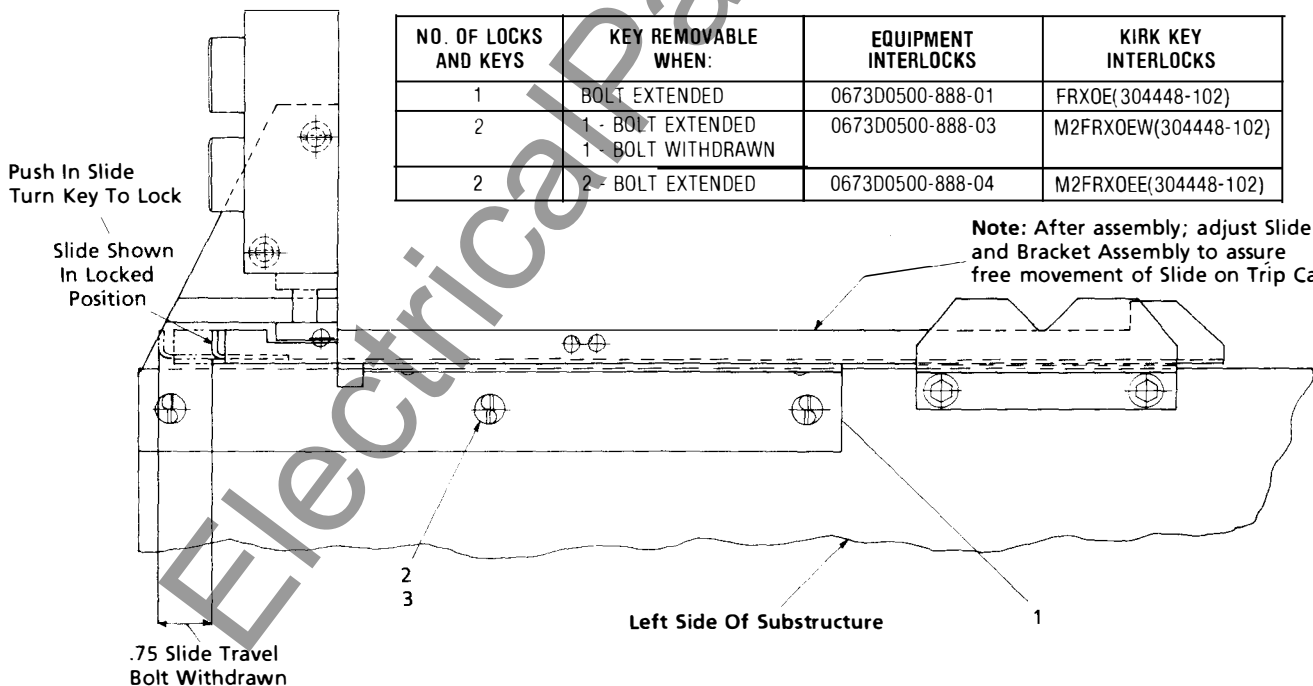

NO. OF LOCKS AND KEYS	KEY REMOVABLE WHEN:	EQUIPMENT INTERLOCKS	KIRK KEY INTERLOCKS
1	BOLT EXTENDED	0673D0500-888-01	FRXOE(304448-102)
2	1 - BOLT EXTENDED 1 - BOLT WITHDRAWN	0673D0500-888-03	M2FRXOEW(304448-102)
2	2 - BOLT EXTENDED	0673D0500-888-04	M2FRXOEE(304448-102)

**Note:** After assembly; adjust Slide and Bracket Assembly to assure free movement of Slide on Trip Cam.

*These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company.*

For further information  
call or write your local  
General Electric  
Sales Office or . . .

Construction Equipment  
Business Operations  
41 Woodford Avenue  
Plainville, CT 06062 U.S.A.

[www.ElectricalPartManuals.com](http://www.ElectricalPartManuals.com)