

SIEMENS

SIPROTEC® 7SJ602 v3.5x

Supplementary Note

Order-No.: C53000-X5676-C110-3

Annunciations to the Serial System Interface according to IEC 60 870-5-103

Associated Manual: C53000-G1176-C125

Annunciations 7SJ602 V3.5 for LSA (according to IEC 60870-5-103)Legend of abbreviations:

FNo. - Function number for IEC interface
 Op/Ft - Operation / Fault annunciation
 C/CG : Coming/Coming and Going annunciation
 MW : Measurand

According to IEC 60870-5-103:

CA - Compatible annunciation
 GI - Annunciation for General Interrogation
 BT - Binary Trace for fault recordings
 Type - Function type (p: according to the configured "Function Type")
 Inf - Information number

Operation and Fault Annunciations:

FNr.	Text	Meaning	Control direction	Annunc.		IEC 60870-5-103				
				Op	Ft	CA	GI	BT	Type	Inf
3	>Ti.syn	>Time synchronization	yes						135	48
5	>LED r.	>Reset LED indicators							135	50
11	>Annu.1	>User defined annunciation 1		CG		CA	GI	BT	p	27
12	>Annu.2	>User defined annunciation 2		CG		CA	GI	BT	p	28
13	>Annu.3	>User defined annunciation 3		CG		CA	GI	BT	p	29
14	>Annu.4	>User defined annunciation 4		CG		CA	GI	BT	p	30
16	>SysMMb	>Block. of monitoring dir. via sys.-int		CG*					135	54
52	operat.	Any protection operative		CG		CA	GI		p	18
53	Res.FCB	Reset frame count bit				CA			p	2
54	ResetKE	Reset communication unit				CA			p	3
56	Init.st	Initial start of processor system				CA			p	5
57	GI-end	End of general interrogation				CA			255	0
58	Time sy	Time synchronization				CA			255	0
60	LED res	LED Reset	C			CA			0	19
61	Meas.BI	Logging and measuring functions blocked	CG			CA			0	20
63	PCviaSy	PC operation via system interface				CA			135	83
80	SigStör	For internal use only							135	110
81	SigBef.	For internal use only							135	111
83	SigTest	For internal use only							135	113
110	ANNlost	Annunciations lost (buffer overflow)	C						135	130
111	PCannLT	Annunciations for PC lost	C						135	129
112	LSAanLT	Annunciations for LSA lost							135	131
113	TAGlost	Fault tag lost						BT	135	136
115	ANNovfl	Fault annunciation buffer overflow		C					135	132
129	VDstINV	VDEW state invalid							135	149
159	LSAdist	LSA (system interface) disrupted							135	44
162	FailSI	Failure: Current summation supervision	CG				GI		135	182
177	BatFail	Failure: Battery	CG						135	193
203	REC del	Fault recording data deleted	C						135	203
235	RemBlk	Remote is blocked	CG						135	159
284	IL< al	IL< alarm	CG						135	244
356	>mCLOSE	>Manual close	CG						150	6
415	>ResMax	Reset min/max of measured data	yes	CG					150	84
416	iResMax	Int. reset min/max of measured data		C					150	85
417	ResMax	Min/max of measured data has been reset		C					150	86
501	FT det	General fault detection of device			CG	CA	GI	BT	p	84
511	DEV.Trp	General trip of device			C	CA		BT	p	68
521	IL1	Interrupted current: Phase L1(I/I _n)			C				150	171
522	IL2	Interrupted current: Phase L2(I/I _n)			C				150	172
523	IL3	Interrupted current: Phase L3(I/I _n)			C				150	173
537	IE=	Switched off current IE I/I _n			C				150	182
538	IEE=	Switched off current IEE I/I _n			C				150	183
563	CBA sup	CB alarm suppressed							150	199
1157	>CB 3pC	>CB aux. contact:3poles closed (series)		CG			GI		151	57

FnR.	Text	Meaning	Control direction	Annunc.		IEC 60870-5-103				
				Op	Ft	CA	GI	BT	Type	Inf
1174	CBtest	Circuit breaker test in progress		CG			GI		151	74
1185	CBtpTST	Circuit breaker test: Trip 3pole		CG			GI		151	85
1188	CBTwAR	Circuit breaker test: Trip w. reclosure		CG			GI		151	89
1201	>UE bl	>Block UE stage of sensitive E/F prot.	yes	CG					151	101
1215	FD UE	Earth flt. det. by displacement voltage		CG	CG		GI		151	115
1217	Trip UE	Trip by displacement voltage stage		C	C				151	117
1276	EFfor	Earth fault (isol./comp.) forward dir.		CG	C	CA			p	51
1277	EFrev	Earth fault (isol./comp.) reverse dir.		CG	C	CA			p	52
1278	EFundef	Earth fault (isol./comp.) undef. dir.		CG	C				151	178
1403	>BF blo	>Block breaker fail protection	yes	CG					166	103
1431	>BF St	>ext. start breaker failure protection	yes		CG				166	104
1451	BF off	Breaker fail protection is switched off		CG					166	151
1452	BF bloc	Breaker failure protection is blocked			CG				166	152
1453	BF act	Breaker failure protection is active		CG					166	153
1456	BF fflt	Breaker fail(int): fault detection			CG				166	156
1457	BF fltE	Breaker(ext): fault detection			CG				166	157
1471	BF off	Breaker fail protection is switched off		C	CA				p	85
1501	>O/L on	>Switch on thermal overload protection	yes			GI			167	1
1502	>O/Loff	>Switch off thermal overload protection	yes			GI			167	2
1503	>O/Lblk	>Block thermal overload protection	yes			GI			167	3
1511	O/L off	Thermal overload prot. is switched off		CG		GI			167	11
1512	O/L blk	Thermal overload protection is blocked		CG		GI			167	12
1513	O/L act	Thermal overload protection is active		CG		GI			167	13
1516	O/L wrn	Thermal overload prot.: Thermal warning		CG	CG	GI			167	16
1518	O/L p/u	Thermal overload prot.: Pick-up		CG	CG	GI			167	18
1521	O/L Trp	Thermal overload protection trip			C		BT		167	21
1530	THETA =	Operating temperature =		MW					167	30
1531	t Trp =	O/L: estimated time to trip		MW					167	31
1532	t Trp =	O/L: estimated time to trip		MW					167	32
1533	t rel =	O/L: estimated time to release closing		MW					167	33
1534	t rel =	O/L: estimated time to release closing		MW					167	34
1701	>O/Cpon	>Switch on O/C protection phase	yes						60	12
1702	>O/Cpof	>Switch off O/C protection phase	yes						60	13
1704	>O/Cpbk	>Block overcurrent protection phases	yes						60	14
1711	>O/Ceon	>Switch on overcurrent protection earth	yes						60	15
1712	>O/Ceof	>Switch off overcurrent protec. earth	yes						60	19
1714	>O/Cebk	>Block overcurrent protection earth	yes						60	20
1721	>l>>blk	>Overcurrent protection:block stage l>>	yes	CG					60	1
1722	>l> blk	>Overcurrent protection:block stage l>	yes	CG					60	2
1723	>lp blk	>Overcurrent protection:block stage lp	yes	CG					60	3
1724	>IE>>bk	>Overcurrent protec.: block stage IE>>	yes	CG					60	4
1725	>IE> bk	>Overcurrent protection:block stage IE>	yes	CG					60	5
1726	>IEp bk	>Overcurrent protection:block stage IEp	yes	CG					60	6
1727	>C/O	>C/O of overcurrent fault detec. level	yes						60	73
1751	O/Cpoff	Overcurrent prot. phase is switched off		CG		GI			60	21
1752	O/Cpblk	Overcurrent prot. phase is blocked		CG		GI			60	22
1753	O/Cpact	Overcurrent prot. phase is active		CG		GI			60	23
1756	O/Ceoff	O/C protection earth is switched off		CG		GI			60	26
1757	O/Ceblk	O/C protection earth is blocked		CG		GI			60	27
1758	O/Ceact	O/C protection earth is active		CG		GI			60	28
1762	O/C L1	O/C fault detection phase L1			CA	GI	BT	p	64	
1763	O/C L2	O/C fault detection phase L2			CA	GI	BT	p	65	
1764	O/C L3	O/C fault detection phase L3			CA	GI	BT	p	66	
1765	O/C E	O/C fault detection earth			CA	GI	BT	p	67	
1771	FD L1	O/C fault detection L1 only		C					60	31
1772	FD L1E	O/C fault detection L1-E		C					60	32
1773	FD L2	O/C fault detection L2 only		C					60	33
1774	FD L2E	O/C fault detection L2-E		C					60	34
1775	FD L12	O/C fault detection L1-L2		C					60	35
1776	FD L12E	O/C fault detection L1-L2-E		C					60	36
1777	FD L3	O/C fault detection L3 only		C					60	37
1778	FD L3E	O/C fault detection L3-E		C					60	38
1779	FD L13	O/C fault detection L1-L3		C					60	39
1780	FD L13E	O/C fault detection L1-L3-E		C					60	40
1781	FD L23	O/C fault detection L2-L3		C					60	41
1782	FD L23E	O/C fault detection L2-L3-E		C					60	42
1783	FD L123	O/C fault detection L1-L2-L3		C					60	43
1784	FDL123E	O/C fault detection L1-L2-L3-E		C					60	44
1785	FD E	O/C fault detection E only		C		GI			60	45

FnR.	Text	Meaning	Control direction	Annunc.	IEC 60870-5-103				
					Op	Ft	CA	GI	BT
1800	FD I>>	O/C fault detection stage I>>		CG			GI		60 75
1805	Trp I>>	O/C protection I>> phase trip		C	CA			BT p	91
1810	FD I>	O/C fault detection stage I>		CG			GI		60 76
1815	Trip I>	O/C protection I> phase trip		C	CA			BT p	90
1820	FD Ip	O/C fault detection Ip		CG			GI		60 77
1825	Trip Ip	O/C protection Ip phase trip		C				BT 60	58
1831	FD IE>>	O/C fault detection IE>> earth		CG			GI		60 59
1833	TrpIE>>	O/C protection IE>> earth trip		C	CA			BT p	93
1834	FD IE>>	O/C fault detection IE>> earth		CG			GI		60 62
1836	TrpIE>>	O/C protection IE>> earth trip		C	CA			BT p	92
1837	FD IEp	O/C fault detection IEp earth		CG			GI		60 64
1839	Trp IEp	O/C protection IEp earth trip		C				BT 60	66
1850	FD dyn	O/C prot. : dynamic parameters active		CG				60	74
2701	>AR on	>AR: Switch on auto-reclose function	yes					40	1
2702	>AR off	>AR: Switch off auto-reclose function	yes					40	2
2732	>AR St.	>AR: Start external	yes	CG	CG			40	23
2733	>ARBSt	>AR: External Blocking of Start	yes	CG	CG			40	24
2734	>ARBICl	>AR: External Blocking of reclosure	yes	CG	CG			40	25
2736	AR act.	AR: Auto reclosure is active		CG			GI		40 26
2781	AR off	AR: Auto-reclose is switched off		CG			GI		40 81
2801	AR i pg	AR: Auto-reclose in progress		CG			GI		40 101
2851	AR CICm	AR: Close command from auto-reclose		CG	CA	GI		p	128
2863	AR dTrp	AR: Definitive trip		CG			GI		40 163
2872	AR Strt	AR: Start		CG			GI		40 50
2873	AR bISt	AR: blocked		CG			GI		40 51
2874	AR bICl	AR: Reclosure blocked		CG			GI		40 52
2875	AR bIMC	AR: Blocked by manual close		CG			GI		40 53
2876	AR DT	AR: Dead time		C	C			40	182
4632	>SWblo.	>Switching authorization: blocked					GI		101 32
4640	Q0 Clo.	Control-Close-Command CB-Q0		C					101 33
4641	Q0 Trp.	Control-Trip-Command CB-Q0		C					101 34
4642	Q0 Ctr.	Control-Command CB-Q0	yes	C					101 35
4822	>MSP bl	>Block motor start protection	yes	CG					168 56
4823	>MSP em	>Motor start protection emergency start	yes	CG					168 51
4824	MSP off	Motor start protection is switched off		CG					168 52
4825	MSP blk	Motor start protection is blocked		CG	CG				168 53
4826	MSP act	Motor start protection is active		CG					168 54
4827	MSP tri	Trip by motor start protection		C					168 55
4828	>MSPRTI	Reset Thermal Image	yes	CG					168 57
4829	MSP RTI	Thermal Image reseted		CG					168 50
5143	>I2 blk	>Block unbalanced load protection	yes					70	126
5144	>revPhR	>Reversed phase rotation	yes	CG			GI		70 125
5151	I2 off	Unbalanced load prot. is switched off		CG			GI		70 131
5152	I2 blk	Unbalanced load protection is blocked		CG			GI		70 132
5153	I2 act	Unbalanced load protection is active		CG			GI		70 133
5159	FD I2>>	Unbalanced load: Fault detec. I2>>				CG	GI		70 138
5165	FD I2>	Fault detection neg. seq. I (I2>)				CG	GI		70 150
5170	Trp I2	neg. seq. I. (I2) prot.: Trip				C		BT	70 149
6757	Trpl>>	O/C protection I>> phase trip				CG	GI	BT	231 69
6758	>>>bk	>inst. high set prot.: block stage I>>>	yes	CG			GI		231 70
6801	>SRT bk	>Block starting time supervision	yes						169 57
6811	SRT off	Starting time supervision off		CG			GI		169 51
6812	SRT blk	Starting time supervision blocked		CG			GI		169 52
6813	SRT act	Starting time supervision active		CG			GI		169 53
6821	SRT Trp	Trip by supervision of starting time		CG	C			BT	169 54
6851	>SUP bk	>Blocking trip circuit supervision	yes						170 57
6852	>TrpRel	>Trip circuit supervision: Trip relay	yes	CG			GI		170 51
6853	>CBAux	>Trip circuit supervision: CB aux.	yes	CG			GI		170 52
6861	SUP off	Trip circuit supervision off		CG			GI		170 53
6862	SUP blk	Trip circuit supervision blocked		CG			GI		153 16
6863	SUP act	Trip circuit supervision active		CG			GI		153 17
6864	SUPnoBI	TC superv. blocked: BI not marshalled		CG			GI		170 54
6865	CIR int	Trip circuit interrupted		CG			GI		170 55

* = Function number 16 is announced only "Coming" to LSA.


Measured Values:

Compatible Mode:

Type	Inf	FNo.	Meaning	Position in Telegram
p	144	602	Current in phase IL2 [%] =	1

Extended Mode:

Type	Inf	FNo.	Meaning	Position in Telegram
134	125	601	Current in phase IL1 [%] =	1
		602	Current in phase IL2 [%] =	2
		603	Current in phase IL3 [%] =	3
		604	IE[%]=	4
		621	UL1E [%]=	5
		627	UE[%]=	6
		641	Active power Pa [%] =	7
		642	Reactive power Pr [%] =	8
		645	Apparent power S[%]=	9
		713	lea=	10
		714	ler=	11
		830	Sensitive earth current	12
		901	Maximum power factor cos phi	13

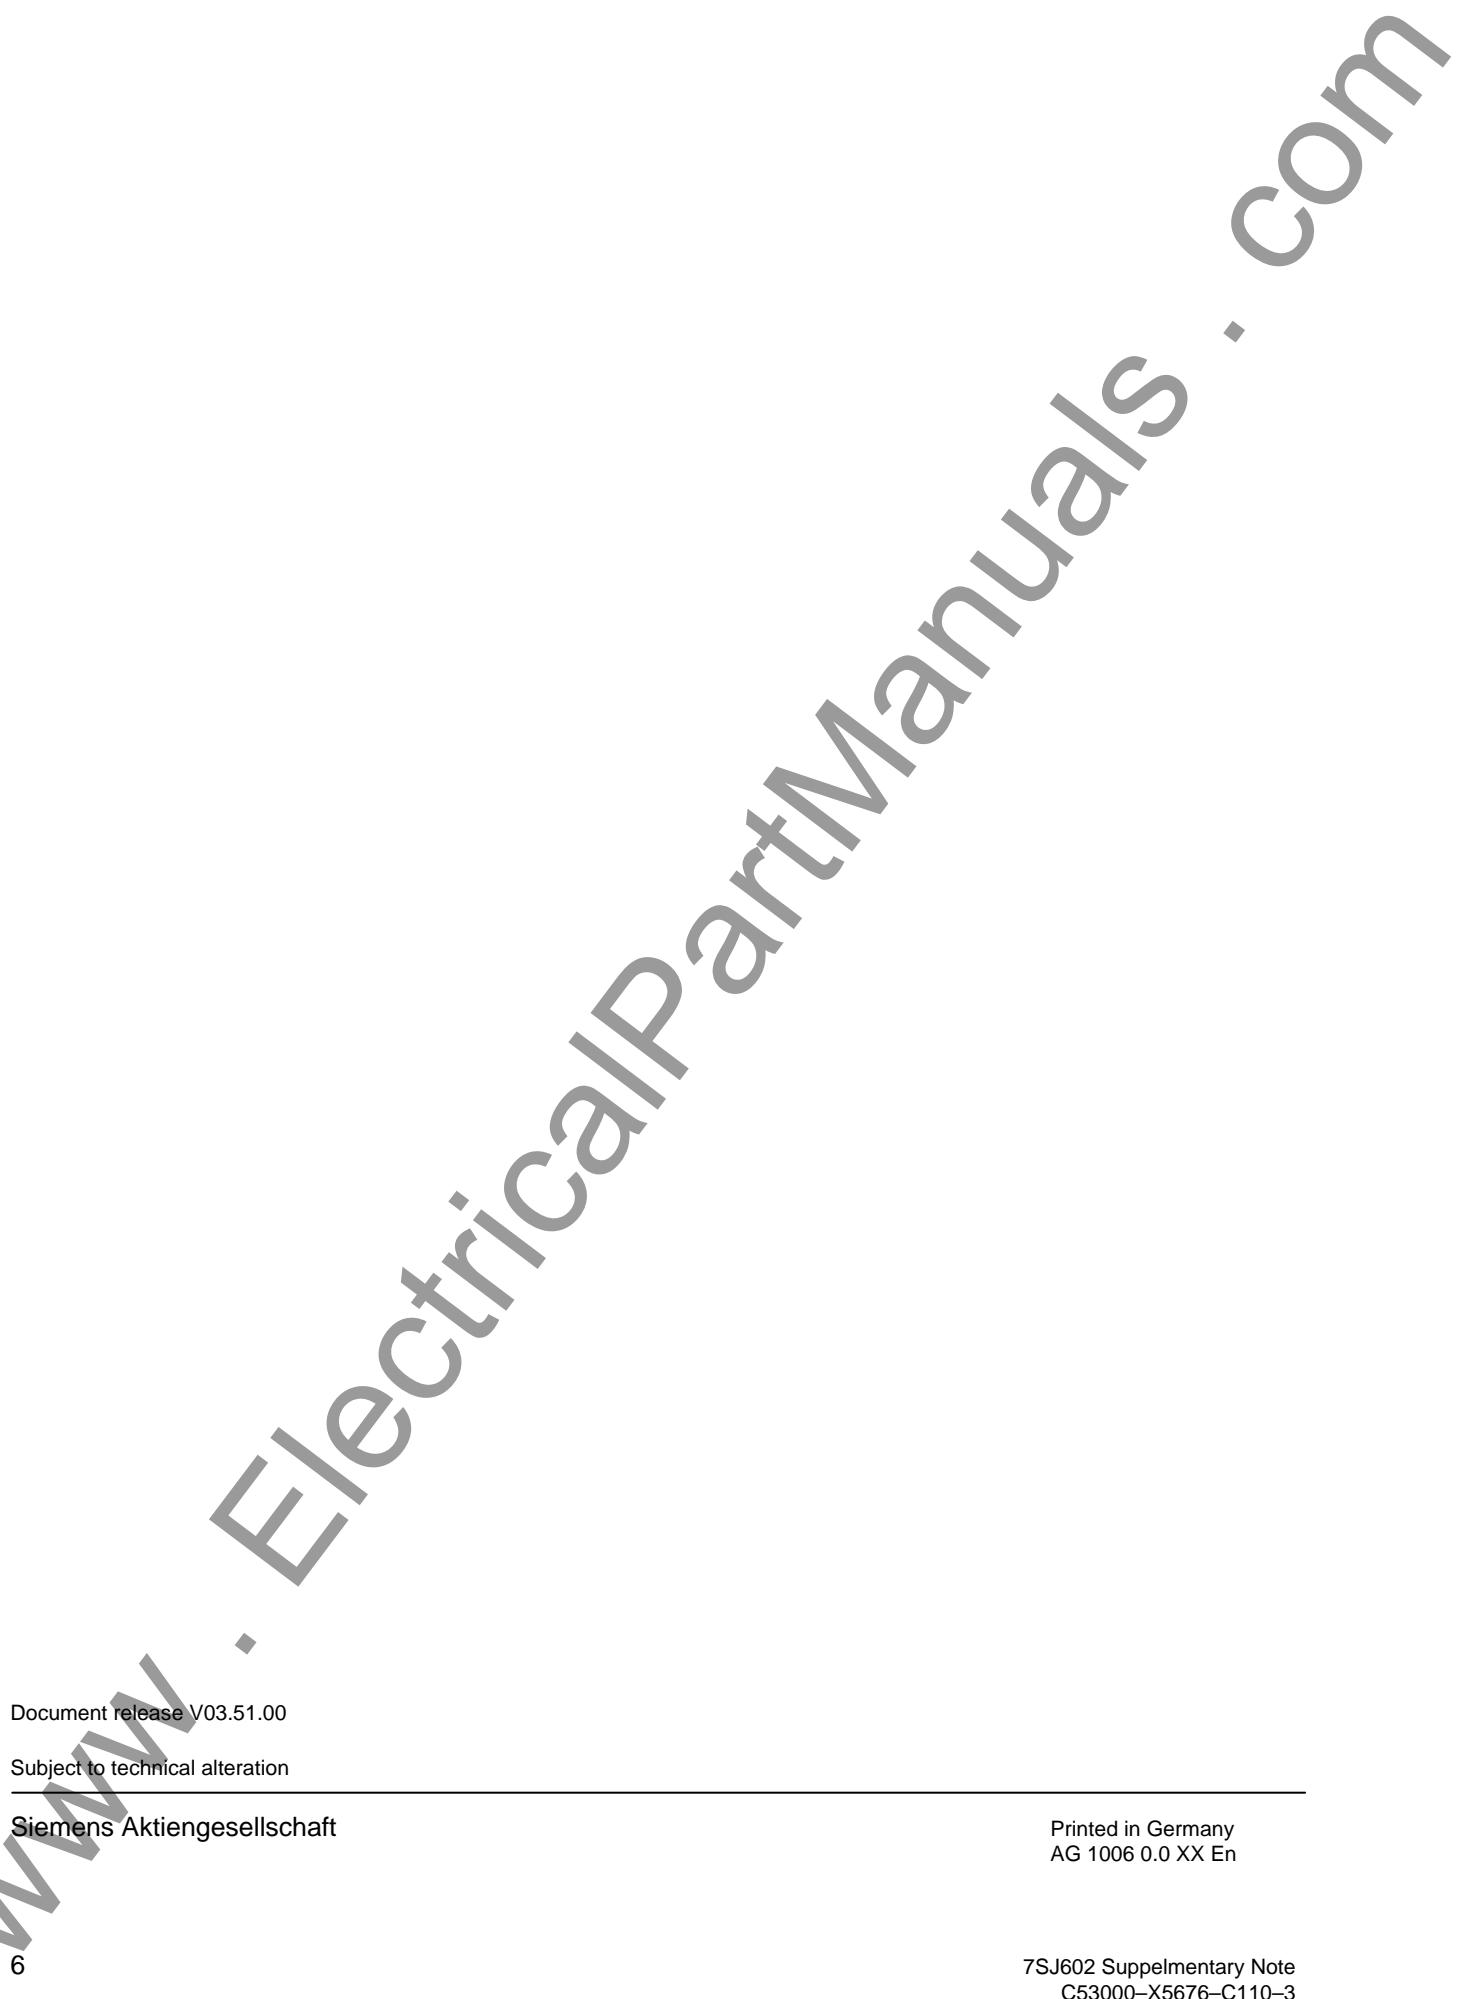

Document release V03.51.00

Subject to technical alteration

Siemens Aktiengesellschaft

Printed in Germany
AG 1006 0.0 XX En