

**Westinghouse**  
**Turbine-Generator Units**

**INSTRUCTION BOOK**

for

**The Care and Operation**

of

**05 EHNC Turbine**

**Westinghouse Electric & Manufacturing Company**

**South Philadelphia Works**

**Philadelphia, Pa.**

**I. B. 5484-A**

## Index

	Page
Adjustments.....	3-4
Assembling.....	3
Automatic Stop Governor.....	8
Bearings.....	4
Care of Generator.....	13
Cylinder Drainage.....	14
Description (General).....	3
Dismantling.....	3
Gear Wheel.....	4-8
Governor.....	8
Governor Valve.....	8
Governor Valve Setting.....	8
Maintenance.....	3-4
Nozzle and Reversing Chamber.....	4
Oil Pump.....	11
Oiling System.....	11
Operation	
Turbine.....	11
To Start.....	11-13
To Shut Down.....	13
Generator.....	13
To Start.....	13
To Parallel.....	13
To Shut Down.....	13
Precautions (General).....	13
Removal of Armature.....	13
Removal of Poles.....	13
Repairs.....	11
Repair Parts.....	15
Reseating Governor Valve.....	8
Spindle Glands.....	8-11
Turbine Wheel and Pinion.....	4
Throttle Valve.....	8
Figure 1.....	5
Figure 2.....	6
Figure 3.....	7
Figure 4.....	9
Figure 5.....	10
Figure 6.....	12

# Westinghouse

## TURBINE-GENERATOR UNITS

### 25 to 50 Kw.

### Instructions for the Care and Operation

### of

### 05-EHNC Turbine

#### General Description

The unit described herein consists of a turbine of the Westinghouse impulse re-entry type and a gear connected to a direct-current or alternating-current generator, the turbine rotor being mounted on the pinion shaft.

Steam enters the turbine through the throttle valve, which is of the quick closing type and is controlled by the automatic stop governor in such a manner that it will close instantaneously if the turbine overspeeds a predetermined amount. The steam next passes through the governor valve into the nozzle chamber from which it expands through the nozzles to the exhaust pressure and impinges upon the blades which are mounted around the periphery of the turbine wheel. After passing through the blades, the steam is received in a reversing chamber which changes its direction of flow and again directs it upon the turbine blades. After having passed through the blades twice practically all of the energy obtained by the expansion of the steam through the nozzles has been transformed by the turbine wheel into mechanical work and the steam flows into the turbine casing and passes out through the exhaust line.

#### Dismantling:

This unit was designed with the purpose of obtaining a compact unit, and facility of dismantling and assembling was sacrificed somewhat in order to shorten the overall length of the unit.

To inspect the reduction gear and the turbine rotor, first remove the upper half of the generator distance piece "83" Figure 2. Next disconnect the governor lever "107" from the lever connecting link "108" Fig. 3. Remove the governor case cover "94" and reach down and remove the two trunnion bolts "106" which are held in place by cotter wire. Remove the governor lever rock shaft bracket "112" with the levers "104" and "107" and connecting mechanism.

After disconnecting the oil pipe to the strainer, the gear housing cover may be lifted. Care should be taken not to bend the governor spindle in this operation.

The turbine cylinder cover "52" may be removed after the gear housing cover has been removed.

Upon removal of the gear housing cover, the governor bracket may be unbolted and the governor, bracket and oil pump, lifted out as a unit.

With the turbine cylinder, gear housing, turbine bearing covers, and the governor removed, the turbine and pinion shaft may be lifted out with its bearings. The bearings may then be slipped off the ends, or they can be removed without displacement of the shaft by removing the end cover plates and rotating the bearings in the housings until the dowels are free of their grooves. This should always be done before removal of generator with gear, as subsequently described under "Removal of Armature", in order not to injure the gear teeth. If the gear teeth are jammed, they should be re-dressed carefully by scraping to remove any high spots.

If the governor valve stem is to be disconnected, markings or measurements should be made previously in order to preserve the setting.

#### Assembling:

Before replacing turbine or gear case covers, thoroughly clean all interior parts and surfaces using gasoline and cloths (not waste) freely to remove all dirt. Clean the flange joint and paint with shellac, bolting the covers in place before the shellac hardens. A very light cotton thread used as a gasket with shellac makes a good joint. No other gasket should be used.

#### Maintenance

##### Adjustments:

All alignments, adjustments, settings, etc., are properly made before shipping

and should not under any ordinary circumstances be changed.

Clearances as shown on the Figures contained in this book should be maintained. Pinion and turbine bearings should have between .008 and .012 inch, gear and generator bearings between .008 and .012 inch and gear thrust between .005 and .010 inch. This latter may be adjusted by changing the number of liners behind the thrust collars.

If it is necessary to change the speed slightly, the governor spring adjusting nut "120" (Figure 3) may be screwed down to increase the speed or in the opposite direction to decrease the speed. The location of this nut is evident upon removal of the small cap "95" on top of the governor case. **DO NOT ATTEMPT SPEED ADJUSTMENTS BY MANIPULATION OF THE GOVERNOR VALVE STEM LINK.**

The sensitiveness of the governor may be increased, that is, the percentage regulation decreased, by screwing the nut "122", which holds the upper coils of the governor spring, out of the coils a turn or so and thus weakening the spring scale by adding to the number of active coils. When this is done care must be taken so as not to get too great a degree of sensitiveness, thus approaching isochronism, a condition which will cause the governor to "hunt".

One of the most important adjustments on the unit is the proper setting of the governor valve in order that the valve will be on its seat before the governor sleeve has reached the end of its travel. To obtain this setting, remove the governor housing, mark the position of the governor spring nut so as to return it to its original position, and slack up on the nut until the weights can be pulled outward by hand. Insert a piece of steel or any handy object, at least  $\frac{3}{8}$ " thick, between the governor sleeve "115" (Figure 3) and the thrust ring "128" holding or wedging the weights outward. Now adjust the gov-

error valve stem in its head "145" until the valve is just on its seat and tighten the lock nut in this position. This same setting may be checked in a simpler manner by merely removing the valve stem pin and measuring the distance the valve drops to its seat. This should not be more than  $\frac{1}{16}$ ". This simple method of checking the governor setting can be tried occasionally to insure that nothing has disturbed the setting. In connection with the valve setting, any excessive lost motion of the governor levers and links should be noted and eliminated. The levers must be a tight fit with their keys on the rock shaft and if looseness is evident new keys should be fitted.

If the governor valve is replaced be very careful to see that the new valve is properly pinned to the stem, and that the setting is as given in the preceding paragraph.

If any unsteadiness of voltage is noticed during the operation of the unit, it may indicate that the governor valve stem is sticking. The unit should be shut down at the first opportunity and the trouble corrected by moving this valve stem up and down by hand until free.

When any change is made in the adjustment of the throttle valve stem packing, the valve should be opened and tripped by hand to be sure that it will be closed quickly by the pressure of the spring.

When overhauling the gear, it is well to check the alignment of the gear and pinion in the horizontal plane (center distance) by means of the gauges furnished. These gauges should just fit between the aligning collars at the ends of the pinion and gear shafts. Be sure to place the gauge properly, as stamped upon it. The axial play or freedom of the pinion shaft relative to the gear should be from .012 to .020 inch when set to the gauge. The alignment in the vertical plane is indicated by the contact marks on the teeth. These marks should be distributed over the length of the teeth, and not concentrated at the ends. The setting of the pinion shaft has been done in the shop by experienced men, and a change is warranted only in case the operation of the unit has been seriously affected by extraordinary circumstances. If it is necessary to change the setting of the pinion shaft, it may be done by shifting the liners under the bearing pads. The total number of liners under opposite pads should not be altered, but the

liners shifted from one pad to the opposite one. Care must be taken not to interchange the pinion and turbine bearings, and to replace them in their proper positions, making sure that the oil hole in the top is unobstructed.

#### Nozzle and Reversing Chamber:

These parts require practically no attention unless it is necessary to renew the nozzle after considerable use on account of erosion which is due to the use of very wet steam. In setting a new nozzle, care must be taken in making the joint. Anneal the copper liner by heating to a red color and quenching in water. All surfaces entering into the joint must be cleaned carefully and should be given a light coat of thin shellac just before bolting the nozzle down. Inasmuch as leakage through this joint is wasted steam, care cannot be over-emphasized in properly replacing the nozzle.

The reversing chamber does not require a joint of this kind since there is no change in pressure between the inside and the outside. The clearance between the nozzle and the blades, and between the reversing chamber and the blades should be nominally  $\frac{1}{16}$ " and should not be less than .020 or more than .050 inch. This clearance can be determined by the use of a feeler gauge with the rotor in its central position, as determined by the mesh of pinion teeth.

#### Bearings:

The pinion and turbine bearings consist of solid shells lined with babbitt. One bearing or both may have pads with liners underneath for adjustment of the pinion relative to the gear, as covered in another part of this book. The screws holding the pads in place should be set up tight and the shell with its pads should fit nicely in its housing. The clearance between the journal and bearing should be .008 or .012 of an inch. More than .014 is excessive. The bearing contains but one oil groove, which is located lengthwise on the top, oil being admitted to the center of the groove. If it is necessary to rebabbit a bearing, the utmost care should be exercised to re-bore or ream centrally and parallel with the surface of the pads.

The gear bearing is made in halves, obtaining its oil along the horizontal centerline on either side, through the oil grooves cut lengthwise in the shell. The clearance of this bearing should be between .008 and .012 of an inch. More than .014 is excessive and should be corrected. In re-babbiting this

bearing, care must also be taken to bore it centrally. This bearing also serves as a thrust bearing to limit the axial play of both the gear and pinion shafts. The thrust clearance should be from .005 to .010 of an inch. In re-babbiting care must be taken to chamfer and groove the thrust faces properly. The axial position of both shafts may be adjusted by changing the number of liners behind the thrust collars.

#### Turbine Wheel and Pinion:

The turbine wheel is pressed and keyed on the pinion shaft along with the gland runners and collars. The wheel should not be removed from the shaft except in very special cases. If this is done, the utmost care must be exercised to prevent springing of the shaft and injury of the fit. The shaft and rotor must run true within .002 of an inch. In adjusting the thrust bearing for proper position of the rotor, attention must also be given to the proper position of the gland runners. The proper clearance between the blades and the nozzles is given under the heading "Nozzle and Reversing Chamber." The clearance on each side of the gland runners is normally  $\frac{1}{16}$  inch and should be between .015 and .045 of an inch.

The rotor must be in balance for smooth operation. If unbalance is indicated by vibration, check rotor and shaft on parallels. A good static balance is sufficient. Balancing can be best effected by chipping metal off both sides of the rotor equally at the inner shoulder of the rim. Do not chip further back than  $\frac{3}{8}$  of an inch and take off the edge by bevelling. Vibration is not necessarily caused by unbalance, but may be due to parts rubbing or misalignment.

#### Gear Wheel:

The gear wheel, shown in Figures 1 and 2, consists of a cast iron center upon which is shrunk a steel ring in which the gear teeth are cut. This rim should never be removed, unless it is necessary to have a new gear, in which case the old one should be sent to the factory for repair.

To determine the proper relative location of the pinion to the gear in the horizontal plane, two aligning gauges properly marked are furnished with the unit. These gauges should fit nicely between the aligning collars at the ends of the gear and pinion teeth, as indicated on the plan view in Figure 1. The pinion and turbine bearings may be adjusted to secure this fit. The object of



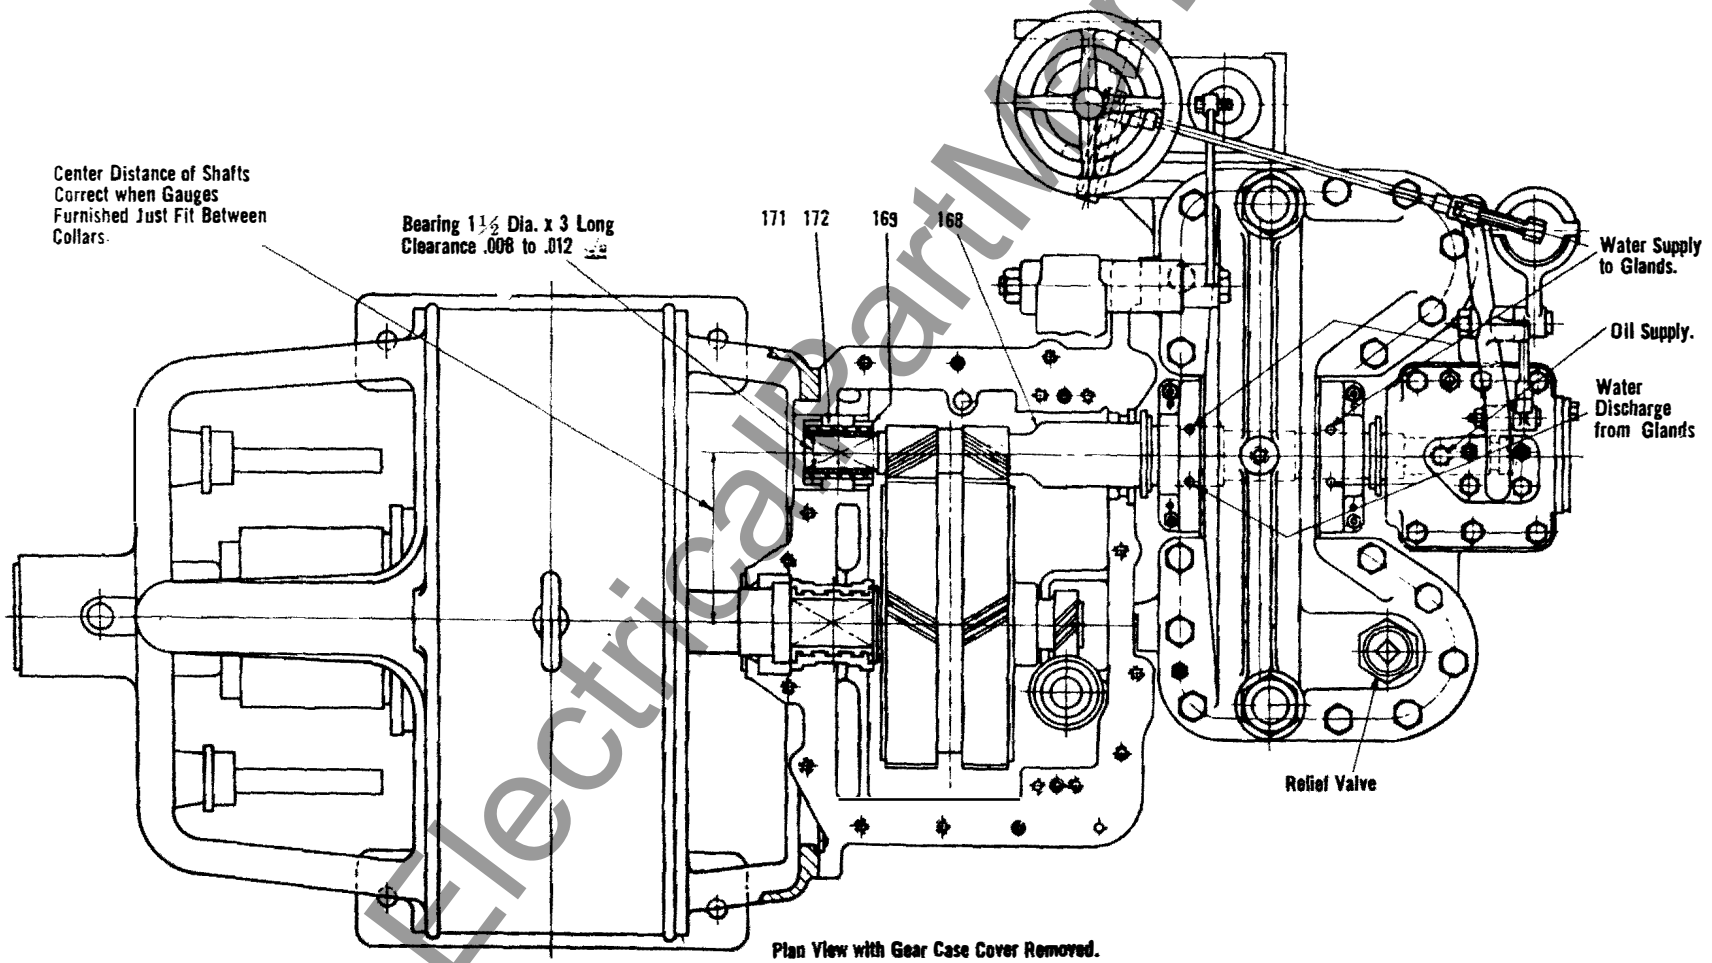


Fig. 1

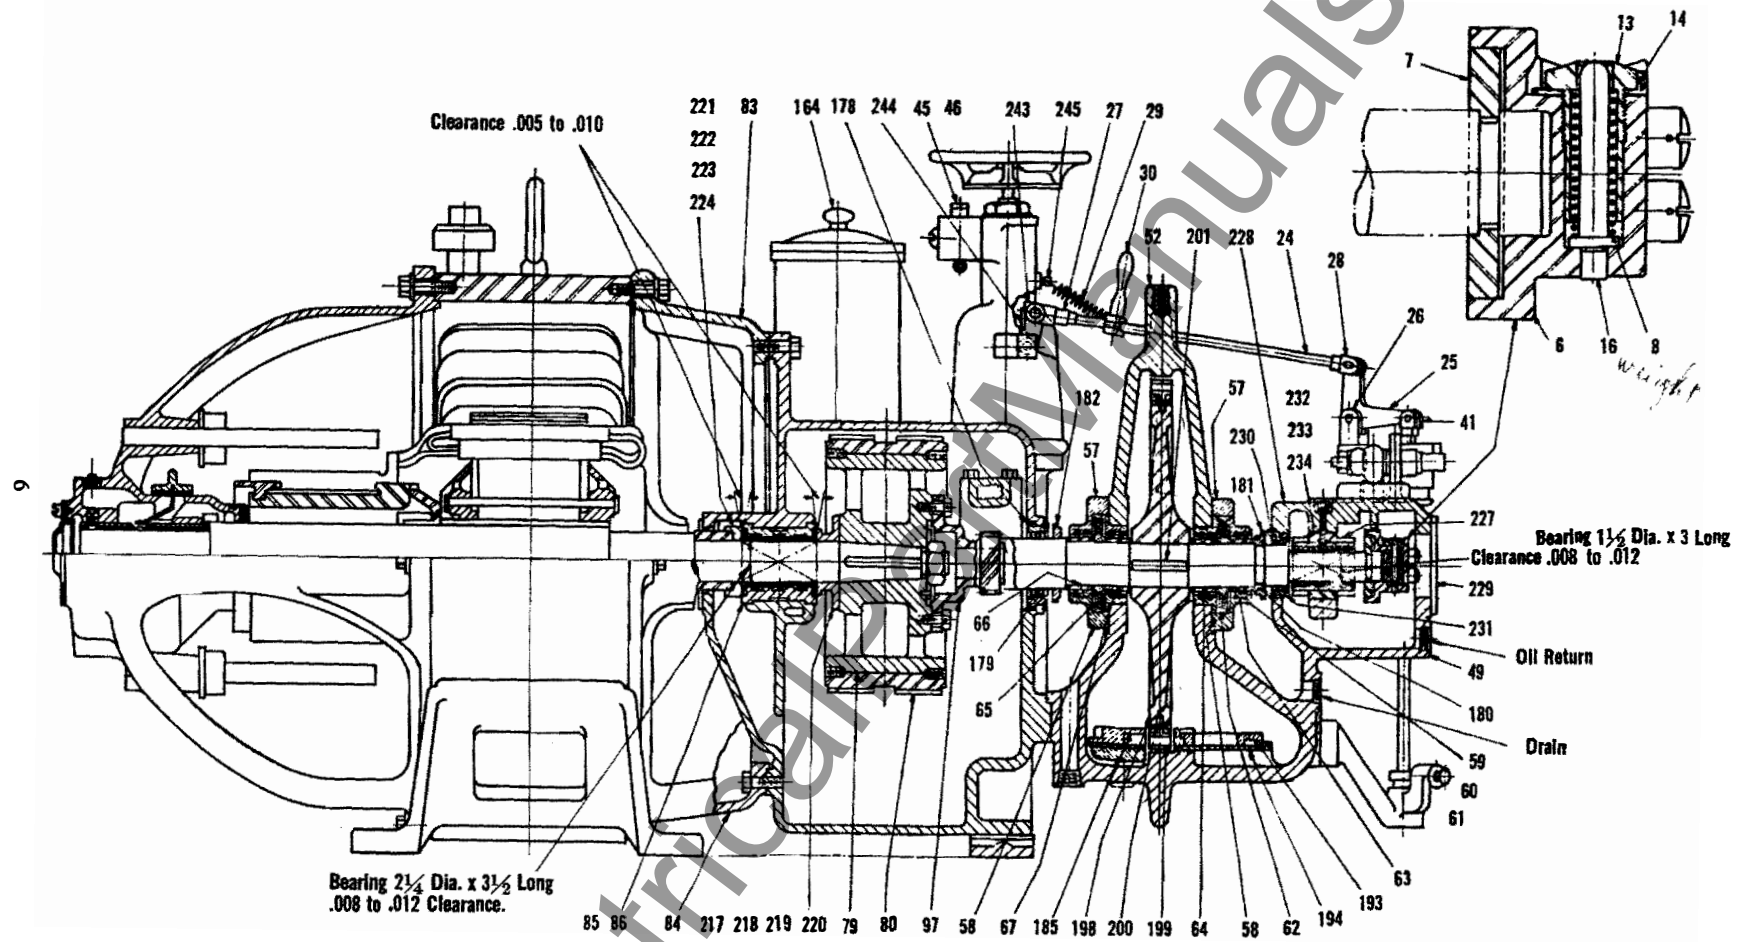

Westinghouse Turbine-Generator Unit Type 05 EHNC

Westinghouse Turbine-Generator Units Type 05 EHNC

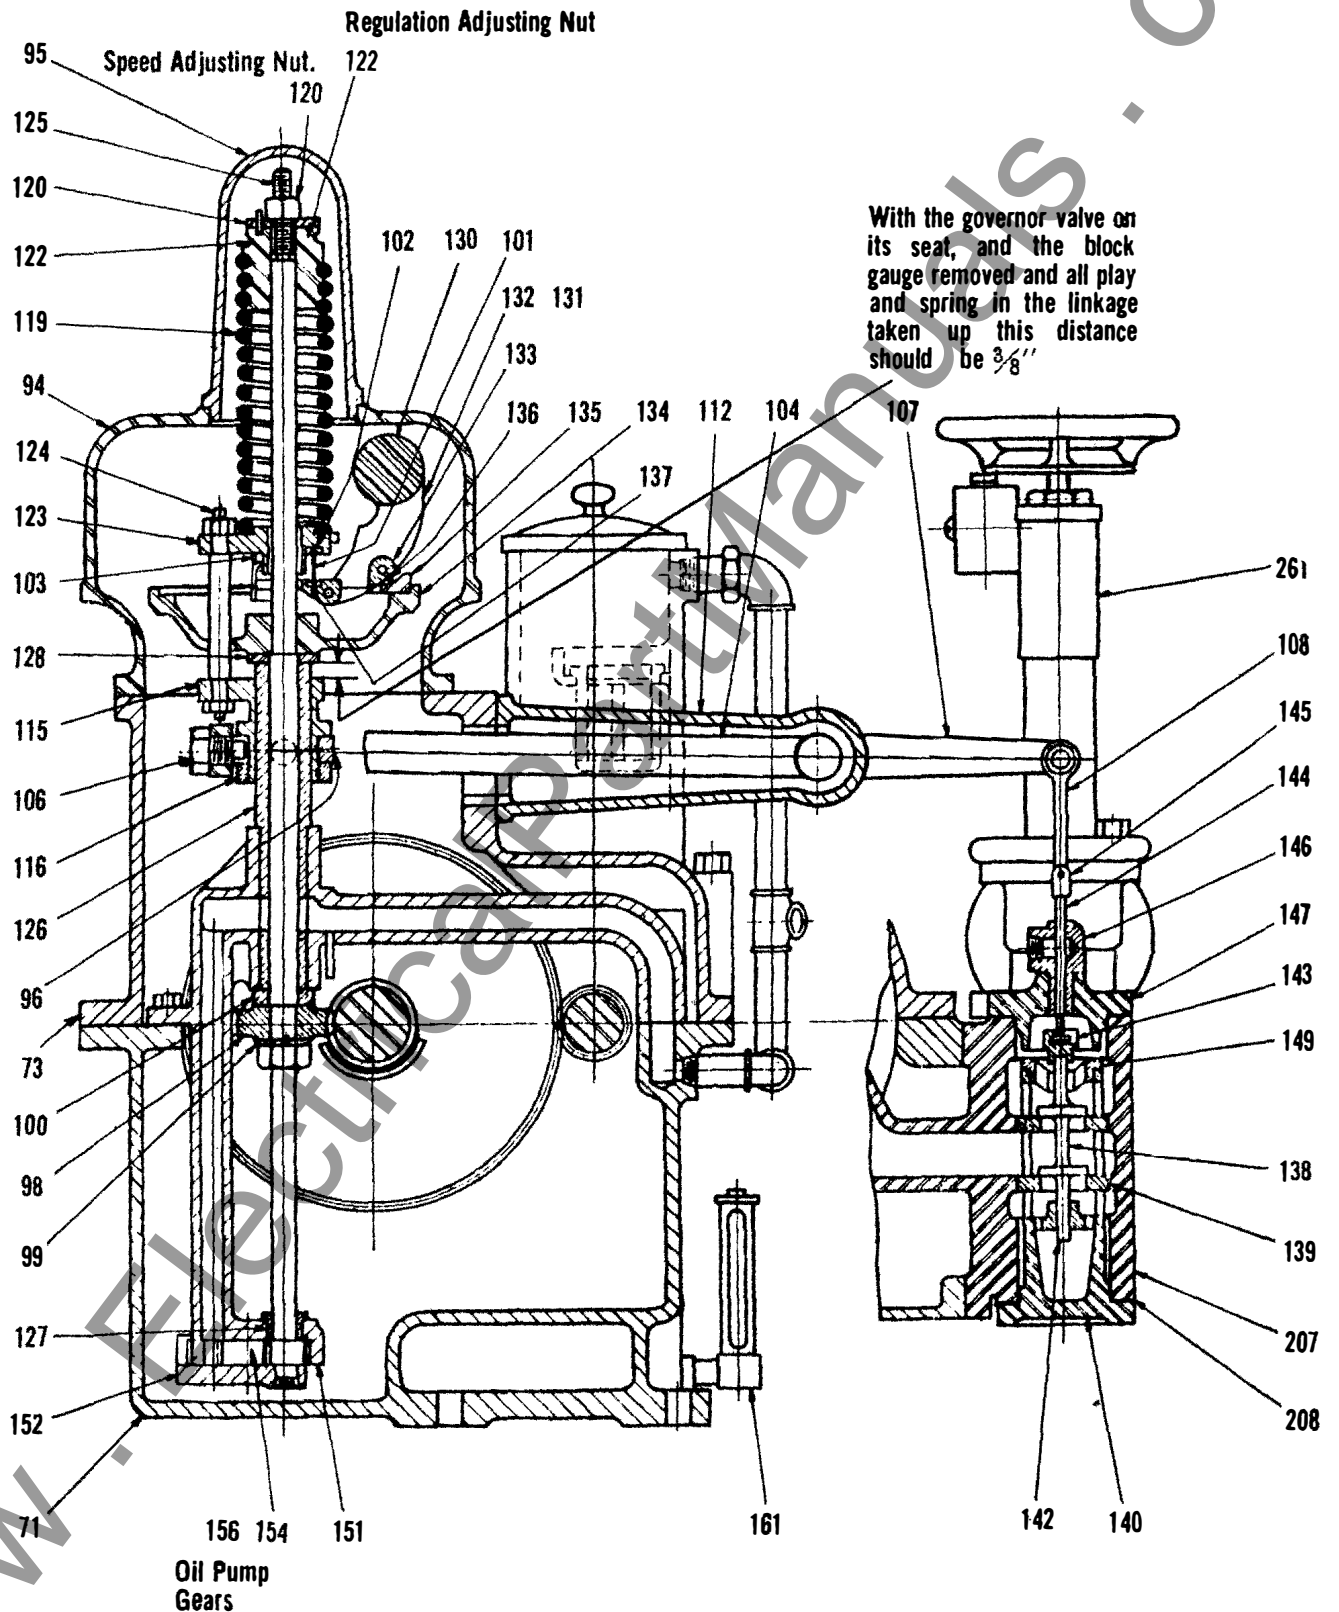

these gauges is to make the pinion shaft parallel to the gear shaft and in case of loss of the gauges this may be done by such other means as may be devised. The proper center distance is such as will allow the pinion to be moved axially relative to the gear wheel between .012 and .020 of an inch. In determining this it is well to wedge the gear wheel over against one face of the thrust bearing and use a feeler gauge at any convenient place on the pinion shaft, as for instance, between a gland runner and case. Care must be taken in determining this movement to see that the rotor or glands do not rub against their adjacent parts. If this is the case, the thrust bearing should be adjusted so that the rotor or gland runner will not touch at either limit of the axial movement, as determined by the meshing of the teeth.

The alignment in the vertical plane can be properly determined only by the operation of the machine under approximately full load and examination of the teeth for distribution of contact marks.

The gear and pinion teeth should show no signs of wear over a long period. Slight pitting about the pitch line may occur but is not serious. Cutting or flaking of the teeth indicates poor alignment or poor lubrication. Check the alignment and examine the oil pan under the pinion to make sure that the pinion is dipping in oil.

#### Governor:

The construction of the governor is shown in Figure 3. Any troubles that occur with this mechanism can usually be traced to improper seating of the knife edges, a sprung spindle, or incorrect alignment of the sleeve "115" with the spring sleeve "123" so that the sleeve binds on the bushing.

In assembling the trunnion bolts "106" care must be taken to see that they are properly replaced according to marking and that they enter the clutch freely and without binding, also that the clutch does not bear upon the spindle or bind. These trunnion bolts must be thoroughly wired to the lever. See that the knife edges "101" and fulcrum knife edges "136" are in the proper position in their blocks and that the spring is over its spigot on the sleeve.

#### Governor Valve:

The governor valve is shown in Figure 3 and consists of a spool doweled on

the stem and working within a cage, which is pressed into the steam chest. The valve should be tested occasionally to insure against excessive leakage. The leakage is only excessive when, with the valve pressed on its seat and a full head of steam upon it, the turbine will continue to rotate. This valve is not susceptible to grinding on its seat, since this results in unbalancing the valve, causing irregular governing. The cage should be tight in the steam chest when hot.

#### Reseating Governor Valve:

If this is necessary, face off the lower disc in a lathe, facing back the level on the upper disc the same amount. Bore the cage in the same manner, facing off the upper seat and turning back the bevel on the lower seat. The object of reseating can plainly be seen from the fact that the contact between the two parts must be a line rather than a surface, in order to keep the two diameters to practically the same dimension and maintain the balance.

#### Automatic Stop Governor:

The automatic overspeed stop is shown in Figure 2. It consists of a plunger or weight "16" set transversely in the pinion shaft and held in place by the spring "8" and retainer "13". At the proper speed, between 8 and 12% above normal, for which it is set, the centrifugal force of the plunger overcomes the resistance of the spring and flies outward about  $\frac{1}{8}$  of an inch, striking the lever "20" (Figure 6). The movement of this lever releases the engagement of the release lever "31" allowing, through the connecting linkage, the weight "35" to fall. This weight is guided by the rod "40" so as to strike the collar at the lower end, the blow tripping the throttle valve latch whereupon the throttle valve is forced to its seat by a heavy spring "249" (Figure 4). The stop may be reset by turning the throttle valve handwheel in the closing direction to its stop and returning the weight "35" to its upper position.

To change the setting of the auto stop, that is, the tripping speed, insert thin liners or washers (.005 or .010 thick) between the spring retainer "13" (Figure 2) and the end of the spring so as to increase the spring compression and hence the tripping speed or remove washers to reduce the tripping speed. In case no washers are present grind the end of the spring off squarely. Be very careful to place the liners between the retainer and the spring and not between the

spring and the collar on the end of the plunger.

There is only one other important adjustment to the stop linkage; that being the clearance between the cam lever and the shaft. This clearance should be between  $\frac{1}{32}$  and  $\frac{1}{16}$  of an inch.

The plunger must work freely. It may be pushed outward with a rod in order to determine whether or not it is free. There should be ample clearance in the pins and shafts comprising the linkage since there is no call for close fitting and inasmuch as looseness, guards against sticking. A few drops of oil occasionally will help to prevent rust and consequent sticking.

The action of this governor should be checked occasionally, to make sure that the weight flies out and trips the valve at the proper speed. This can be done most conveniently by disconnecting the link "108" (Fig. 3) from the governor lever "107" and holding the valve up off its seat while the turbine is overspeeded by slowly opening the throttle valve. Another method is to mark the position of the governor spring nut "120" (Fig. 3) so that it can be reset to its original position, and then screwing it down sufficiently to permit the turbine speed to be increased to the tripping point by opening the throttle valve. In either case, a direct reading tachometer should be used to guard against excessive speed in case the automatic stop governor should fail to function.

Do not overspeed the turbine by pulling up on the governor lever "107" (Fig. 3). Such procedure is apt to damage the keys in the inner and outer governor levers "104" and "107", after which the governor may fail to control the speed properly.

#### Throttle Valve:

The construction of this valve is shown in Figure 4. The stem screws through a nut "246" which is kept from turning by a pin. A hardened steel washer "247" on the bottom of the nut engages the latch "243" (Figure 2) to hold the nut in its uppermost position. When this latch is tripped out by the auto-stop or by hand, the spring "249" forces the valve to its seat. Resetting is accomplished by turning the handwheel in the closing direction, which screws the nut upward, until engagement of the latch "243" and plate "244" is effected.

No special attention is required other than, after tightening the gland nut "258", to test the free working of the stem by tripping the auto stop by hand.



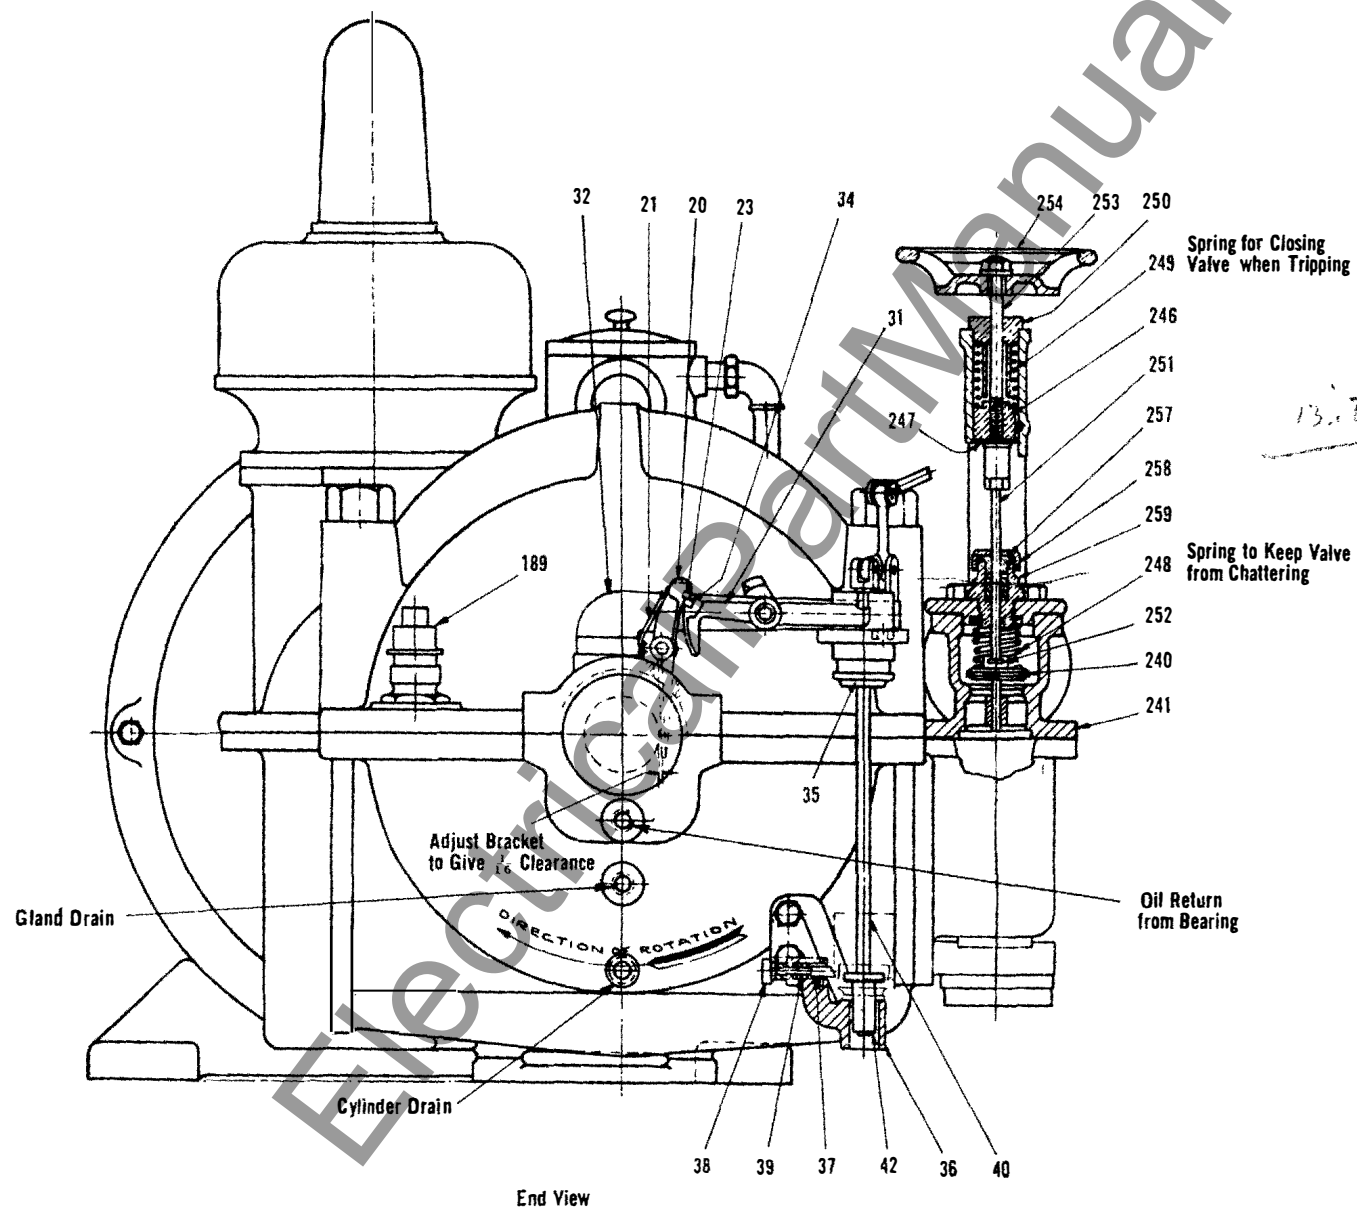


Fig. 4

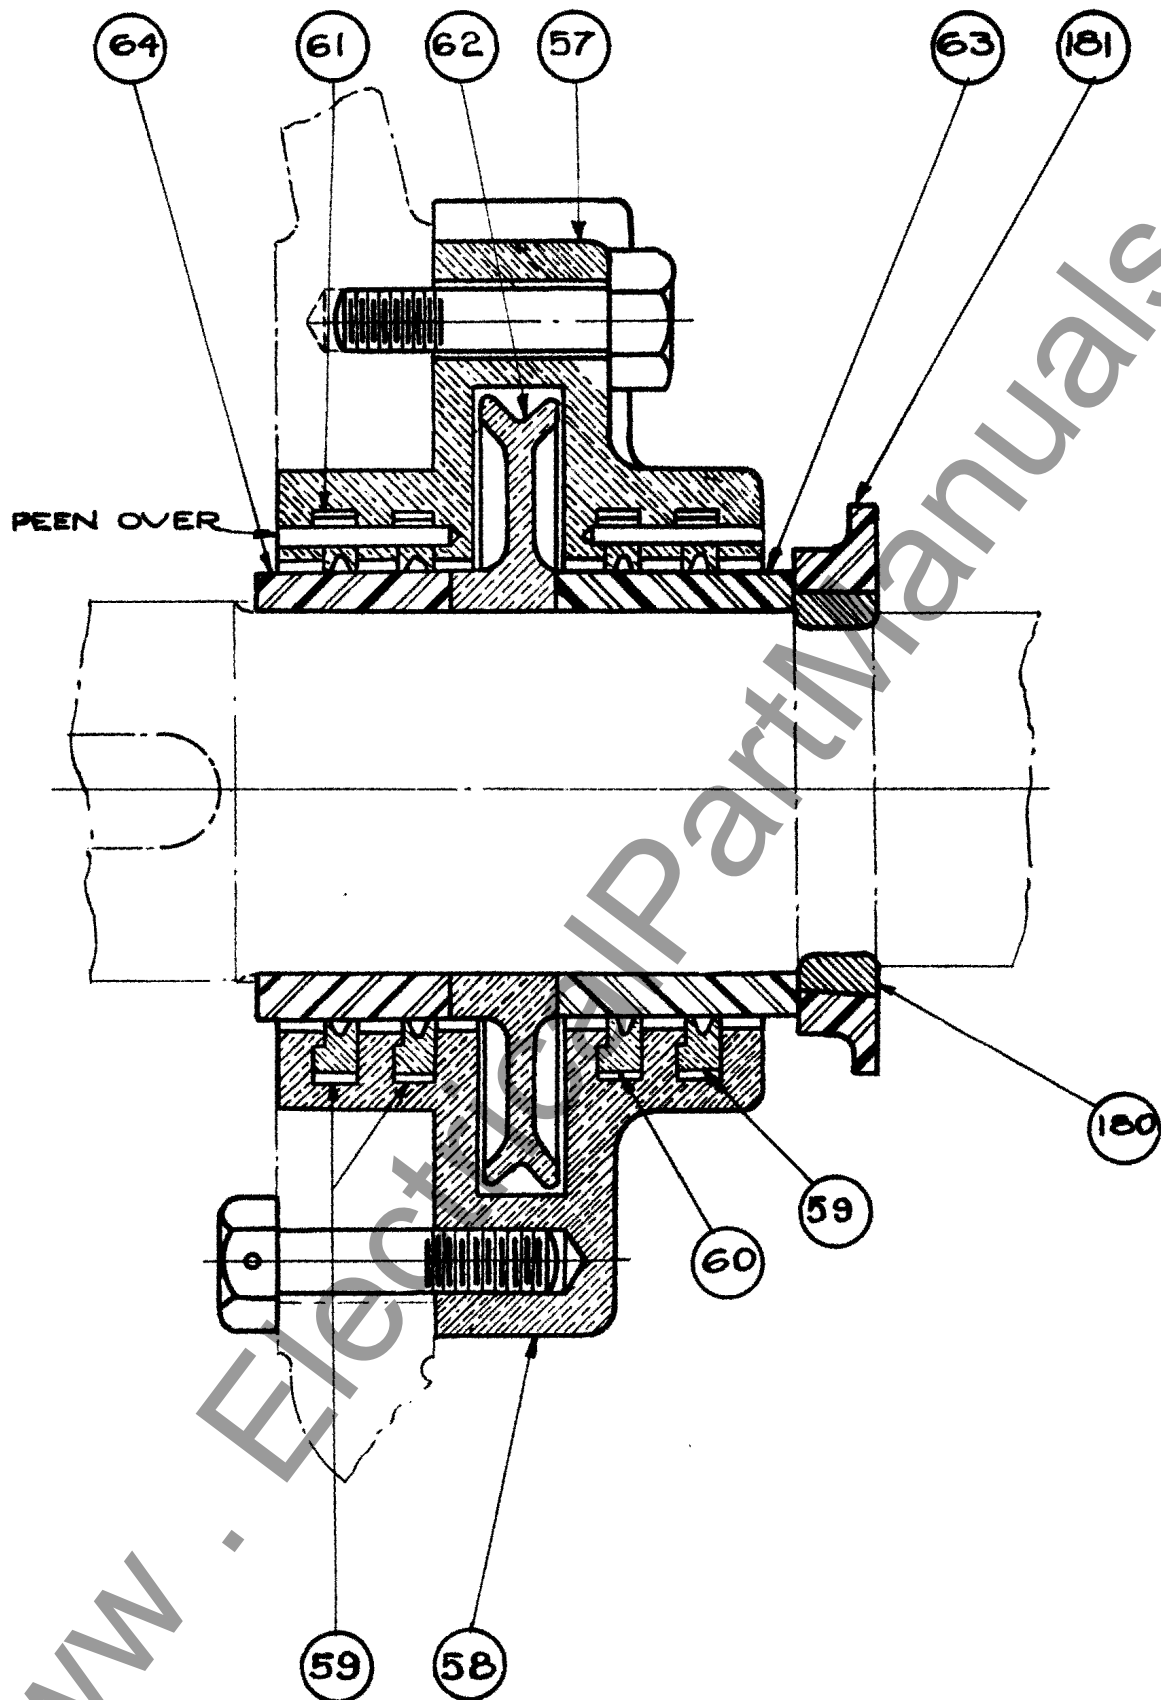


Fig. 5

The valve disc may be ground on its seat after removing the bonnet and stem.

#### Spindle Glands:

The glands used on this turbine to prevent the leakage of steam out of, or air into the turbine cylinder, are of the water seal type. The gland is shown in Figure 5. A runner shrunk on the shaft acts as a centrifugal pump impeller, building up an annulus of water at its periphery having sufficient pressure to prevent steam forcing its way past. The pressure built up by the gland runner is dependent upon the pressure of the sealing water supplied, which should be three or four pounds in excess of the back pressure sealed against. It is necessary to circulate water through the gland in order to prevent boiling, except when the turbine is operating condensing. The water outlet should, therefore, always be open when operating non-condensing. It should be noted that the water seal is not effective when the runner is stationary or rotating at low speeds. Therefore, if the turbine exhausts into a high vacuum, it is necessary to provide a steam connection so that steam can be admitted to the glands for sealing during the starting periods. Both openings in the gland case connect into the water chamber at the periphery of the runner. The relative position of these connections is shown in Figure 1 for a clock-wise rotation of the rotor, viewed from the auto-stop governor end of the turbine.

These glands are also equipped with an auxiliary packing of the labyrinth type. The packing ring is made up of four segments, each of which is held in place against the shoulder of the groove in the gland case with its ends just touching those of the adjacent segments, and its thinned edges barely touching the rotating shaft.

The glands require no adjustments. The proper clearances of the runners are given under "Turbine Wheel and Pinion" as  $\frac{1}{32}$  of an inch or from .015 to .045 of an inch. The labyrinth packing rings should have a sidewise clearance in the grooves of from .004 to .007 of an inch. The springs should press the strips firmly against their shoulders and the ends of the segments should just touch. Bear this in mind when inserting new strips. The inside diameter of the new strips should be about .010 less than the shaft diameter, this amount being left to wear off during the first few minutes of operation.

The water chambers may become filled with scale or other deposits if impure water is used. This will result in rubbing, vibration and wear. If it is impossible to obtain pure water for use in the glands it will be necessary to open and clean them periodically. If leakage from the glands seems excessive examine the horizontal joint, scraping the halves together if necessary, taking especial care to have a fit all around the water chamber. See that the halves of the gland fit properly and that there is no roughness or irregularity in the water passage, such as would be caused by the water outlet or inlet pipe extending downward into the passage or by a formation of scale. See that the water pressure on the glands is steady and does not exceed 20 pounds gauge. Runner clearances beyond the limits given will result in excessive leakage.

#### Oil Pump:

The oil pump is located in the base of the governor bracket and is shown in Figure 3. This pump must be nicely fitted in order to pump sufficient oil. If the amount of oil pumped is insufficient, as indicated by the level falling too near the bottom of the oil strainer case, the pump should be re-fitted by scraping the joint to reduce the clearance of the gear faces which should be .002 to .006 of an inch. Likewise the clearance at the tooth ends should not exceed these figures.

#### Oiling System:

The oil level in the reservoir should be maintained near the center of the sight glass. The oil level should, of course, in no case be so low as to prohibit its being seen in the glass, nor should it be above the glass (that is, within 7 inches of the horizontal centerline), for if it is, the gear wheel will dip in the oil, causing a loss of power and heating of the oil. The reservoir may be drained through the cock, and filled through the oil strainer. In so doing, only the oil necessary to fill the passages to the bearings will pass through the strainer, the bulk flowing to the reservoir through the overflow. The oil should be kept clean and renewed when necessary. The oil strainer should be cleaned occasionally. It may be removed while the unit is in operation. The cooling water should be in circulation whenever the turbine is in operation.

The oiling system should be filled with a pure mineral oil having about 130 seconds Saybolt viscosity at 130 degrees

F. The importance of using high grade oil, free from animal or vegetable oil compounds, cannot be over-emphasized.

#### Repairs

Re-blading the rotor is the main point in repairing the turbine. To replace a few blades, not over 6 or 8 consecutive ones, drive out old pins and insert blades, fitting the last one so that all blades will press together tightly.

The holes for blade pins should be drilled with the blades in place. Diameter of pins and reamer sizes are given below. In place of a reamer a new drill of the reamer size indicated may be used.

Pin Dia.	Reamer Dia.
.1875	.1850
.1910	.1890
.1935	.1910
.1990	.1960
.2031	.2010
.2188	.2165
.2344	.2323
.2420	.2401
.2500	.2480


In selecting the new size of pin, take the smallest one for which the proper reamer or reaming drill cleans up the holes. Turn shroud and pins off flush. If the rotor is to be completely bladed extreme care must be taken to drill the holes in the shanks of the blades in the proper position. To have these pins incorrectly located results in a dangerous condition. Pin 12 blades equally distant, making sure that pins are correctly located in the shanks of the blades. From each of these, work either way, fitting last blades so that all blades will be tight against each other. Pin as before. Turn shrouds and pin ends flush. The diameter of the wheel with blades in place must be  $17\frac{3}{4}$  inches.

#### Operation

##### Turbine:

##### To Start:

1. Drain the steam inlet and exhaust pipes.
2. After making sure that the exhaust is free, open throttle valve slightly, bringing the turbine up to speed and be sure that the speed is being controlled by the governor before further opening of the throttle valve.
3. Close drains.
4. Open the gland water inlet valve.

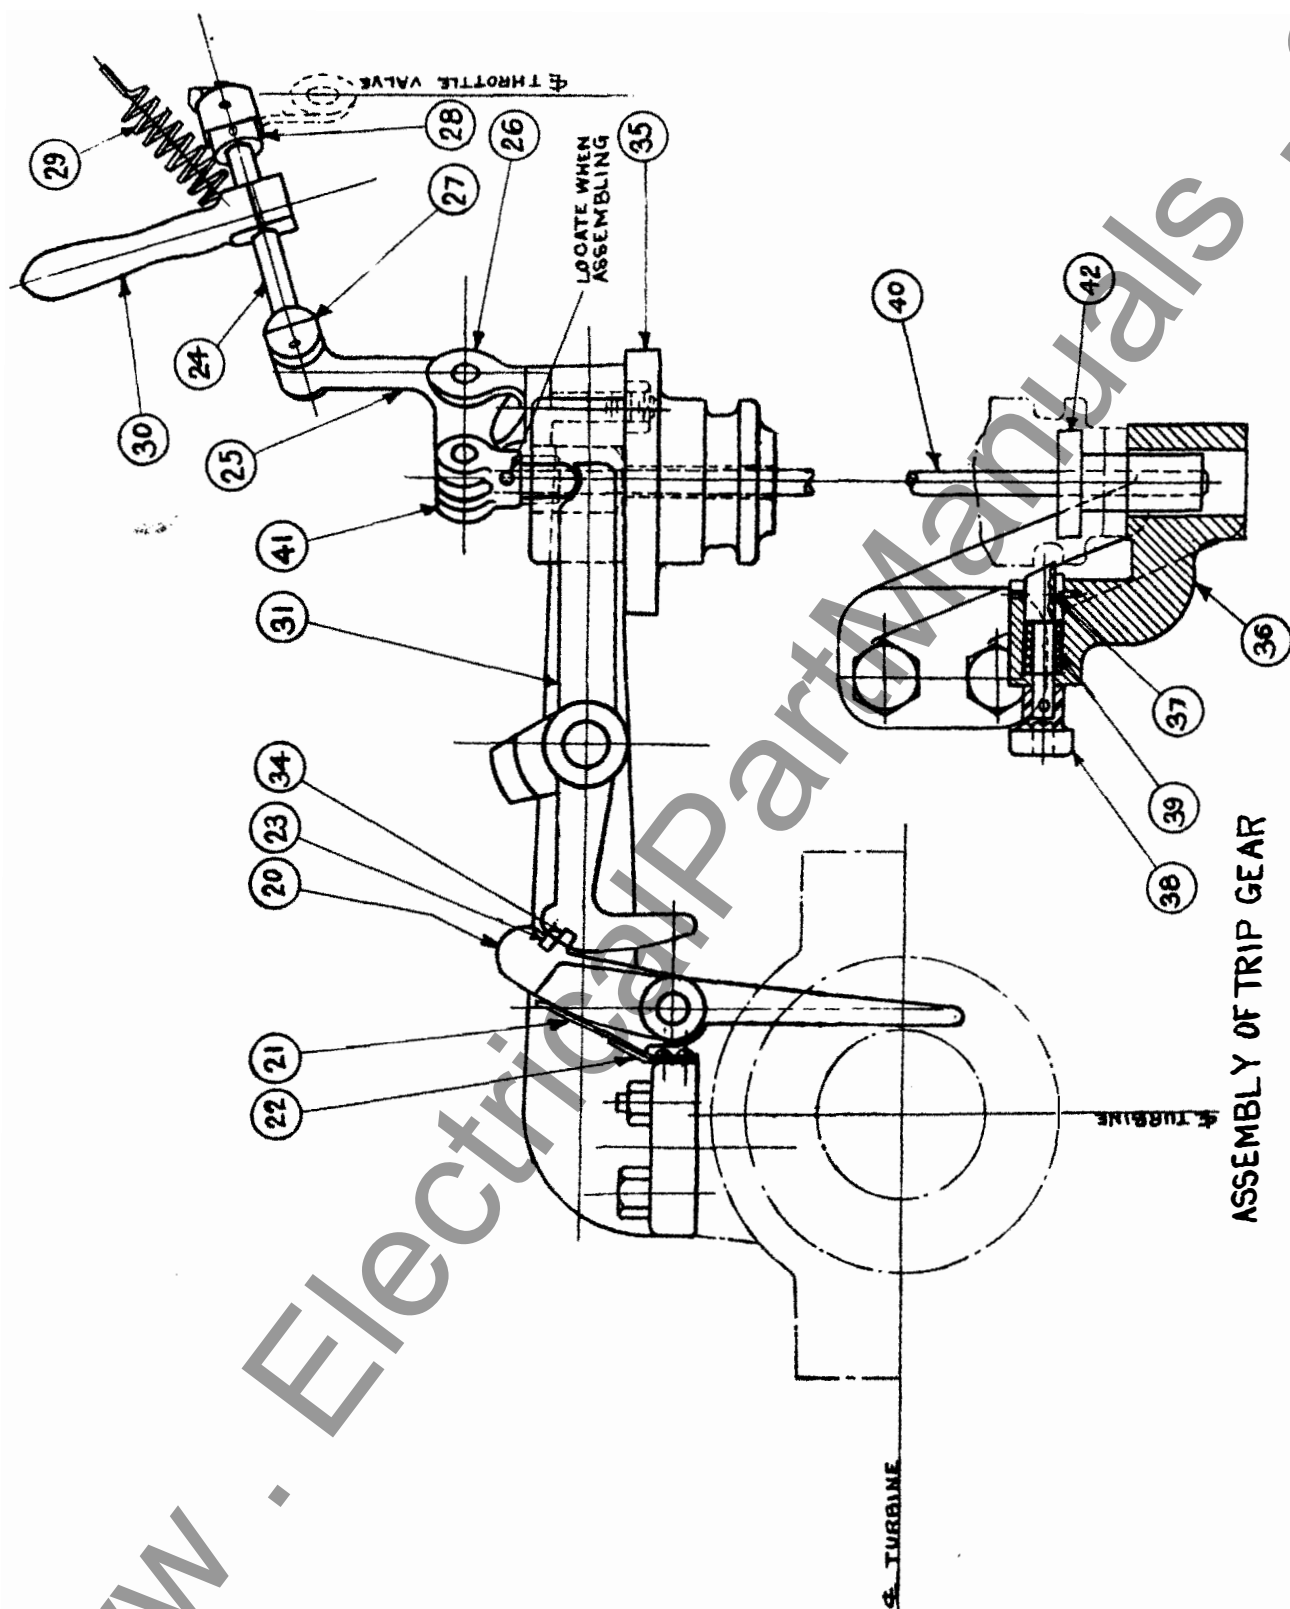

5. Open gland water outlets, adjusting the valves to pass just sufficient water to keep the temperature of the water in the glands below the vaporization point. This point will be reached when no vapor can be observed coming from the glands.
  6. Test action of the overspeed stop linkage and throttle valve by releasing the auto-stop governor trip lever "20" by hand, which will allow the weight to fall and close the throttle valve.
  7. To reset the throttle valve the handwheel should be turned in the closing direction to its stop, the hammer weight "35" lifted, and its supporting lever "31" replaced in position. Then the valve can be re-opened as before.
  8. The gland water pressure should be about 5 pounds plus the pressure of the exhaust. It must never exceed 20 pounds.
  9. When operating condensing or exhausting to the atmosphere the gland water pressure may be reduced to 5 pounds. Circulation is unnecessary if running condensing.
  10. Throw off load by opening the machine circuit-breaker.
  11. Open equalizer switch.
  12. Open main line switch.
  13. Shut down steam end as described previously.
  14. Wipe off all the oil and dirt and clean the machine thoroughly, thus putting it in good order for the next run.
- Care:**
1. The generator should be kept clean by blowing out with compressed air, or by some other means, if compressed air is not available.
  2. Care should be taken not to destroy the balance of the rotor by bending shaft or by any other means.
  3. Keep small pieces of iron, bolts, and any other material of that nature away from the frame. Any such fragment attached to the field magnet of a machine may jam between the armature and pole, thus causing damage.
- Removal of Armature:**
1. Remove turbine rotor, pinion shaft and governor bracket as described under "Dismantling".
  2. Take out bolts which fasten lower half of generator frame extension or distance piece to gear casing after blocking up end of gear case to secure it against tilting.
  3. Slide complete frame and bracket away from steam end about 3 inches (or just enough so that the frame extension clears the gear casing when the frame is raised) so that the gear can be taken out of the case. Frame and bracket should not be shifted far enough so that the shaft will come out of the bearing at the commutator end.
  4. Generator should then be raised as a whole, allowing armature to rest on the poles at the rear end. It should be raised just high enough for the reduction gear to be lifted out of the case.
  5. The complete generator should be swung around and placed on the floor.
  6. The armature can then be removed from the frame by sliding it out at the rear end. When replacing, lift the oil ring in bearing, to clear the shaft.
  7. Extreme care should be taken not to injure the commutator or the gear by supporting the armature on

them, either when blocking or using a rope sling.

**Removal of Poles:**

1. Disconnect field winding.
2. Remove the two bolts which hold the pole to the frame.
3. Slide out the pole with its winding.
4. Poles can then be removed without removing the armature.
5. When the pole is replaced, care should be taken that the same thickness of liners or shims is placed under the pole as were there when the pole was removed.
6. The air gap should be the same at all four main poles and at the auxiliary poles. The gap is not necessarily the same for the main poles as for the auxiliary poles.
7. The air gap under main and auxiliary poles should be checked carefully with a feeler gauge before removal and again after assembly in order to be sure that the same length of air gap is obtained.

**General Precautions:**

1. Be sure that all parts are clean, noting the condition of the oil and any deposits indicating deterioration or breaking down of the lubricant.
2. Examine for strains from piping or holding down bolts, also for even support of feet.
3. When unit is open, observe conditions of blades, nozzles and valves with respect to steam erosion or other wear.
4. Examine blades carefully to see that they are tight and down in place. If any indication of loose blades is observed, repair as noted under "Repairs", or replace previous to further operation.
5. Observe wear or deterioration in bearings, governor knife edges, bushings and sleeves, main governor and oil pump gears, auto-stop cam lever and plunger, etc.
6. Note any considerable lost motion in governor linkage due to wear or poor adjustments.
7. Examine glands for scale deposits, leaks at flanges, condition of labyrinth rings and springs. If any discrepancies are found they should be corrected in order to prolong the life of the unit. Continuous operation for years without replacement of any major parts at least, is to be expected if the unit is properly installed and given the proper care as set forth herein.

**To Shut Down:**

1. Close throttle valve.
2. Open steam and exhaust drains.
3. Close exhaust valve.
4. Turn off gland water.

**Generator:**

**To Start:**

1. Cut in all resistance in the field rheostat.
2. Start up steam end as previously described.
3. Adjust rheostat for normal voltage, bringing voltage up slowly.

**To Parallel:**

1. To parallel one generator with another generator, bring it up to normal speed.
2. With a voltmeter connected to its terminals, gradually bring up the voltage by cutting out resistance in the rheostat until approximately the voltage of the other generator is reached.
3. Throw in equalizer switch.
4. Throw in main switches.
5. Adjust rheostat until generator takes its proportion of the load.

**To Shut Down:**

1. Reduce the load on the generator as much as possible by throwing in the resistance in the shunt field rheostat.

**Cylinder Drainage**

Water standing in any part of the turbine causes rapid deterioration and it is, therefore, of utmost importance that the cylinder be kept clear of water while the unit is shut down. As stated above, the cylinder drains into the exhaust chamber and this chamber

should be drained, through an open funnel if possible, so that the operator can observe that the drain is functioning properly.

This drain should be opened immediately after shutting down and remain open throughout the shut-down period. Daily inspections should be

made to be assured that the drain is free and that water is not accumulating in the cylinder.

Before starting up, the steam inlet line should be drained and both drains left open until steam blows freely indicating that all parts are clear of water. ♦

# Westinghouse Turbine-Generator Units Type 05 EHNC

The following list has been compiled to facilitate ordering repair parts by name and number together with the serial number of the turbine:

Item	Name	Fig.	Item	Name	Fig.
6	Auto stop governor body.....	2	131	Governor weight arm (l. h.).....	3
7	Auto stop governor retainer.....	2	132	Governor weight arm (r. h.).....	3
8	Auto stop governor spring.....	2	133	Governor weight arm block.....	3
13	Auto stop governor spring retainer.....	2	134	Governor weight disc.....	3
14	Auto stop governor spring retainer lock washer.....	2	135	Governor weight disc fulcrum block.....	3
16	Auto stop governor spring weight.....	2	136	Governor weight disc fulcrum knife edge.....	3
20	Auto stop governor trip lever.....	4-6	137	Governor weight knife edge block.....	3
21	Auto stop governor trip lever spring.....	4-6	138	Governor valve.....	3
22	Auto stop governor trip lever spring leaf.....	6	139	Governor valve cage.....	3
23	Auto stop governor trip lever tip.....	2-6	140	Governor valve cage cover (bottom).....	3
24	Auto stop governor trip latch rod.....	2-6	142	Governor valve stem.....	3
25	Auto stop governor trip latch rod bell crank.....	2-6	143	Governor valve stem coupling.....	3
26	Auto stop governor trip latch rod bell crank clevis.....	2-6	144	Governor valve stem extension.....	3
27	Auto stop governor trip latch rod end.....	2-6	145	Governor valve stem extension head.....	3
28	Auto stop governor trip latch rod end.....	2-6	146	Governor valve stem gland.....	3
29	Auto stop governor trip latch rod spring.....	2-6	147	Governor valve stem stuffing box.....	3
30	Auto stop governor trip latch rod spring block.....	2-6	149	Governor valve stem cage cover (upper).....	3
31	Auto stop governor trip release lever.....	4-6	151	Oil pump body.....	3
32	Auto stop governor trip release lever bracket.....	4	152	Oil pump body cover (bottom).....	3
34	Auto stop governor trip release lever tip.....	4-6	154	Oil pump gear (driver).....	3
35	Auto stop governor trip weight.....	4-6	156	Oil pump gear (driver).....	3
36	Auto stop governor trip weight bracket.....	4-6	161	Oil reservoir oil level gauge.....	3
37	Auto stop governor body weight latch.....	4-6	164	Oil strainer cover.....	2
38	Auto stop governor trip weight latch handle.....	4-6	168	Pinion shaft and rotor shaft.....	1
39	Auto stop governor trip weight latch spring.....	4-6	169	Pinion shaft bearing.....	1
40	Auto stop governor trip weight rod.....	4-6	171	Pinion shaft bearing key.....	1
41	Auto stop governor weight rod end.....	2-6	172	Pinion shaft bearing key.....	1
42	Auto stop governor trip weight sleeve.....	4-6	178	Pinion shaft oil ring (upper half).....	2
49	Cylinder base.....	2	179	Pinion shaft oil ring (lower half).....	2
52	Cylinder cover.....	2	180	Pinion shaft split collar.....	2-5
57	Gland case (upper half).....	2-5	181	Pinion shaft shrink collar (bearing end).....	2-5
58	Gland case (lower half).....	2-5	182	Pinion shaft shrink collar (gear end).....	2
59	Gland packing ring.....	2-5	185	Nozzle block.....	2
60	Gland packing ring.....	2-5	189	Relief valve.....	4
61	Gland packing ring spring.....	2-5	193	Reversing chamber.....	2
62	Gland runner (bearing end).....	2-5	194	Reversing chamber liner.....	2
63	Gland runner (bearing end) sleeve.....	2-5	198	Rotor.....	2
64	Gland runner (bearing end) sleeve.....	2-5	199	Rotor blade.....	2
65	Gland runner (gear end).....	2	200	Rotor blade pin.....	2
66	Gland runner (gear end) sleeve.....	2	201	Rotor key.....	3
67	Gland runner (gear end) sleeve.....	2	207	Steam chest body.....	3
71	Gear case base.....	3	208	Steam chest body gasket.....	3
73	Gear case cover.....	3	217	Thrust bearing collar (gear end).....	2
79	Gear wheel center.....	2	218	Thrust bearing liner.....	2
80	Gear wheel rim.....	2	219	Thrust bearing liner.....	2
83	Generator distance piece (upper).....	2	220	Thrust bearing liner.....	2
84	Generator distance piece (lower).....	2	221	Thrust bearing collar (gen. end).....	2
85	Generator shaft bearing (upper half).....	2	222	Thrust bearing liner.....	2
86	Generator shaft bearing (lower half).....	2	223	Thrust bearing liner.....	2
94	Governor case cover.....	3	224	Thrust bearing liner.....	2
95	Governor case cover cap.....	3	227	Turbine bearing.....	2
96	Governor clutch.....	3	228	Turbine bearing cover.....	2
97	Governor gear (driver).....	2	229	Turbine bearing cover end plate.....	2
98	Governor gear (driven).....	3	230	Turbine bearing cover oil ring (upper half).....	2
99	Governor gear lock washer.....	3	231	Turbine bearing cover oil ring (lower half).....	2
100	Governor gear thrust washer.....	3	232	Turbine bearing key.....	2
101	Governor knife edge.....	3	233	Turbine bearing key.....	2
102	Governor knife edge block.....	3	234	Turbine bearing key.....	2
103	Governor knife edge retainer.....	3	240	Throttle valve.....	4
104	Governor lever (inner).....	3	241	Throttle valve body.....	4
106	Governor lever trunnion bolt.....	3	243	Throttle valve latch.....	2
107	Governor lever (outer).....	3	244	Throttle valve latch plate.....	2
108	Governor lever connecting link.....	3	245	Throttle valve latch spring stud.....	2
112	Governor lever rock shaft bracket.....	3	246	Throttle valve nut.....	4
115	Governor sleeve.....	3	247	Throttle valve nut washer.....	4
116	Governor sleeve nut.....	3	248	Throttle valve spring (lower).....	4
119	Governor spring.....	3	249	Throttle valve spring (upper).....	4
120	Governor spring adjusting nut.....	3	250	Throttle valve spring retainer.....	4
122	Governor spring nut.....	3	251	Throttle valve stem (lower).....	4
123	Governor spring sleeve.....	3	252	Throttle valve stem (lower) collar.....	4
124	Governor spring sleeve bolt.....	3	253	Throttle valve stem (upper).....	4
125	Governor spindle.....	3	254	Throttle valve stem handwheel.....	4
126	Governor spindle bushing.....	3	257	Throttle valve stem packing gland.....	4
127	Governor spindle bushing (oil pump gear).....	3	258	Throttle valve stem packing nut.....	4
128	Governor spindle thrust collar.....	3	259	Throttle valve stem stuffing box.....	4
130	Governor weight.....	3	261	Throttle valve yoke.....	3

# WESTINGHOUSE ELECTRIC & MANUFACTURING COMPANY

## Business Addresses

### Headquarters, Pittsburgh, Pa.

- \*AKRON, OHIO, 106 South Main St.  
 \*ALBANY, N. Y., 456 No. Pearl St.  
 \*ALEXANDRIA, VA., 121 Frazer Ave.  
 \*ALLENTOWN, PA., 522 Maple St.  
 \*APPLETON, WISC., 1708 N. Drew St., P.O. Box 206  
 †APPLETON, WISC., 1029 So. Outagamie St.  
 †\*ATLANTA, GA., 426 Marietta St., N. W.  
 \*ATTICA, N. Y.  
 \*BAKERSFIELD, CALIF., 2224 San Emedeo St.  
 \*BALTIMORE, MD., 118 E. Lombard St.  
 †BALTIMORE, MD., 501 East Preston Road  
 †BALTIMORE, MD., 40 S. Calvert St.  
 \*BEAUMONT, TEXAS, 2293 Broadway Ave., P. O. Box 2367  
 \*BINGHAMTON, N. Y., Suite 704, Marine Midland Bldg., 86 Court St.  
 \*BIRMINGHAM, ALA., 2030 Second Ave.  
 \*BLUEFIELD, W. VA., 208 Bluefield Avenue  
 \*BOISE, IDAHO, P. O. Box 1597  
 \*BOSTON, MASS., 10 High St.  
 †\*BOSTON, MASS., 12 Farnsworth St.  
 †\*BRIDGEPORT, CONN., Bruce Ave. & Seymour St.  
 \*BUFFALO, N. Y., 814 Ellicott Square Bldg.  
 †\*BUFFALO, N. Y., 1132 Seneca St.  
 \*BURLINGTON, IOWA, 1708 River St.  
 \*BURLINGTON, VER., 207 Park Ave.  
 \*BUTTE, MONTANA, 129 West Park St.  
 \*BUTTE, MONTANA, 742 Bryant Ave.  
 ①\*CANTON, OHIO, 120 W. Tuscarawas St.  
 \*CEDAR RAPIDS, IOWA, 813 18th St., S.E., P. O. Box 148  
 †\*CHARLOTTE, N. C., 210 East Sixth St.  
 ①\*CHARLESTON, W. VA., 1415 Oakmont Rd., P. O. Box 865  
 \*CHATTANOOGA, TENN., 536 Market St.  
 CHICAGO, ILL., 20 N. Wacker Drive  
 †CHICAGO, ILL., 2211 W. Pershing Road  
 \*CHICOPEE FALLS, MASSACHUSETTS  
 †\*CINCINNATI, OHIO, 207 West Third St.  
 †\*CLEVELAND, OHIO, 1216 West Fifty-Eighth St.  
 \*COLUMBIA, S. C., 912 Lady St.  
 ①\*COLUMBUS, OHIO, 85 E. Gay St.  
 \*DALLAS, TEXAS, 209 Browder St.  
 \*DALLAS, TEXAS, 1712 Carter St.  
 \*DAVENPORT, IOWA, 206 E. Second St.  
 \*DAYTON, OHIO, 30 North Main St.  
 \*DENVER, COLORADO, 910 Fifteenth St.  
 \*DENVER, COLORADO, 1700 Sixteenth St.  
 \*DENVER, COLORADO, 988 Cherokee St.  
 \*DENVER, COLORADO, Gas & Elec. Bldg.  
 \*DERRY, PA.  
 \*DES MOINES, IOWA, 523 Sixth Ave.  
 †\*DETROIT, MICH., 5757 Trumbull Ave.  
 \*DULUTH, MINN., 10 East Superior St.  
 ①EAST PEORIA, ILL., 900 W. Washington St.  
 \*EAST PITTSBURGH, PA.  
 \*EL PASO, TEXAS, Oregon and Mills Sts.  
 \*EL PASO, TEXAS, 450 Canal St.  
 \*EL PASO, TEX., c/o Zork Hdw. Co., 309 N. El Paso St.  
 \*EMERYVILLE, CALIF., 1466 Powell St.  
 \*EMERYVILLE, CALIF., 6161 Green St.  
 \*ERIE, PA., 1003 State St.  
 \*EVANSVILLE, IND., 201 N. W. First St.  
 †FAIRMONT, W. VA., 602 Cleveland Ave.  
 †FARGO, N. D., 520—3rd Ave. N.  
 \*FORT WAYNE, IND., 1010 Packard Ave.  
 \*FORT WORTH, TEXAS, 501 Jones St.  
 \*FRESNO, CALIF., 872 Peralta Way, P. O. Box 632  
 \*GARY, IND., 701 Washington St.  
 ①\*GRAND RAPIDS, MICH., 511 Monroe Ave., N. W.  
 \*GREENSBORO, N. C., 108 S. Park Drive, P. O. Box 1828.  
 \*GREENVILLE, S. C., West Earle St.  
 \*HAMMOND, IND., 235 167th St.  
 \*HARTFORD, CONN., Main & Pearl Sts., P. O. Box 745  
 \*HONOLULU, T. H., Hawaiian Elec. Co. Agt.  
 \*HOUSTON, TEXAS, 1314 Texas Ave.  
 \*HOUSTON, TEXAS, 2313 Commerce Ave.  
 \*HOUSTON, TEXAS, 2315 Commerce Ave.  
 \*HOUSTON, TEXAS, 611-15 Petroleum Bldg.  
 †\*HUNTINGTON, W. VA., 1029 Seventh Ave.  
 \*INDIANAPOLIS, IND., 137 S. Penna. Ave.  
 \*INDIANAPOLIS, IND., 551 West Merrill St.  
 \*ISHPEMING, MICH., 433 High St.  
 †\*JACKSON, MICH., 212 West Michigan Ave.  
 ①\*JOHNSTOWN, PA., 107 Station St.  
 \*JOPLIN, MO., 420 School St.  
 \*KANSAS CITY, MO., 101 W. Eleventh St.  
 \*KANSAS CITY, MO., 2124 Wyandotte St.  
 \*KNOXVILLE, TENN., Gay & Clinch St.  
 \*LIMA, OHIO  
 \*LITTLE ROCK, ARK., 1115 West 24th St.  
 \*LITTLE ROCK, ARK., 1/2 Fones Bros. Hdw. 2nd & Rock Sts.  
 †\*LOS ANGELES, CALIF., 420 So. San Pedro St.  
 \*LOUISVILLE, KY., 322 West Broadway  
 \*MADISON, WISC., 508 Edgewood Ave.  
 \*MANSFIELD, OHIO, 200 East Fifth St.  
 \*MARSHALL, TEXAS, 504 Nathan St.  
 \*MEMPHIS, TENN., 130 Madison Ave.  
 \*MIAMI, FLA., 1036 N. Miami Ave.  
 \*MILWAUKEE, WISC., 546 North Broadway  
 \*MILWAUKEE, WISC., 1669 N. Water St.  
 †\*MINNEAPOLIS, MINN., 2303 Kennedy St., N. E.  
 \*MONROE, LA., 1301 N. Fourth St.  
 \*NASHVILLE, TENN., 219 Second Ave., N.  
 \*NEWARK, N. J., 1180 Raymond Blvd.  
 †\*NEWARK, N. J., Haynes Ave. & Lincoln Highway  
 \*NEWARK, N. J., Plane & Orange St.  
 ①\*NEW HAVEN, CONN., 42 Church St., P. O. Box 1817  
 ①\*NEW ORLEANS, LA., 333 St. Charles St.  
 \*NEW ORLEANS, LA., 527 Poydras St.  
 \*NEW YORK, N. Y., 150 Broadway  
 \*NEW YORK, N. Y., 460 West Thirty-Fourth St.  
 \*NIAGARA FALLS, N. Y., 205 Falls St.  
 ①\*NORFOLK, VA., City Hall Ave. & Bank St.  
 \*OKLAHOMA CITY, OKLA., 120 N. Robinson St.  
 \*OKLAHOMA CITY, OKLA., Third & Alie Sts.  
 \*OMAHA, NEB., 409 South Seventeenth St.  
 \*OMAHA, NEB., 117 N. 13th St.  
 \*PEORIA, ILL., 104 E. State St.  
 †\*PHILADELPHIA, PA., 3001 Walnut St.  
 \*PHOENIX, ARIZONA, 11 West Jefferson St.  
 \*PITTSBURGH, PA., Nuttall Works, 200 McCandless Ave.  
 \*PITTSBURGH, PA., 306 4th Ave., Box 1017  
 †\*PITTSBURGH, PA., 543 N. Lang Ave.  
 \*PORTLAND, MAINE, 142 High St.  
 \*PORTLAND, OREGON, 309 S. W. Sixth Ave.  
 \*PORTLAND, OREGON, 2138 N. Interstate Ave.  
 \*PORTLAND, OREGON, 720 N. Thompson St.  
 †\*PROVIDENCE, R. I., 16 Elbow St.  
 ①\*RALEIGH, N. C., 803 North Person St., P. O. Box 1134  
 \*RALEIGH, N. C., P. O. Box 443.  
 \*READING, PA., 619 Spruce St.  
 \*RICHMOND, VA., Fifth & Byrd  
 \*ROANOKE, VA., 726 First St., S. E.  
 †\*ROCHESTER, N. Y., 410 Atlantic Ave.  
 \*ROCKFORD, ILL., 130 South Second St.  
 \*SACRAMENTO, CALIF., 1805 20th St.  
 \*SALT LAKE CITY, UTAH, 10 West First South St.  
 †\*SALT LAKE CITY, UTAH, 346 A Pierpont Ave.  
 \*SALT LAKE CITY, UTAH, McCormick Bldg.  
 \*SAN ANTONIO, TEXAS, 115 W. Travis St.  
 \*SAN FRANCISCO, CALIF., 1355 Market St.  
 \*SAN FRANCISCO, CALIF., 1 Montgomery St.  
 \*SEATTLE, WASH., 603 Stewart St.  
 †\*SEATTLE, WASH., 3451 East Marginal Way  
 \*SHARON, PA., 469 Sharpville Ave.  
 \*SIOUX CITY, IOWA, 2311 George St.  
 \*SOUTH BEND, IND., 216 East Wayne St.  
 \*SOUTH BEND, IND., 107 E. Jefferson St.  
 \*SOUTH PHILA. WKS., Essington, Pa.  
 \*SOUTH PHILA. WKS., P. O. Box 7348, Philadelphia, Pa.  
 \*SPOKANE, WASH., So. 158 Monroe St.  
 \*SPRINGFIELD, ILL., 601 E. Adams St., Box 37  
 †\*SPRINGFIELD, MASS., 395 Liberty St.  
 \*SPRINGFIELD, MASS., 653 Page Boulevard  
 \*ST. LOUIS, MO., 411 North Seventh St.  
 †\*ST. LOUIS, MO., 717 South Twelfth St.  
 \*SYRACUSE, N. Y., 420 N. Geddes St.  
 \*TACOMA, WASH., 1023 "A" St.  
 \*TAMPA, FLA., 417 Ellamae Ave., Box 230  
 \*TOLEDO, OHIO, 245 Summit St.  
 \*TULSA, OKLA., 303 East Brady St.  
 †\*TUTICA, N. Y., 113 N. Genesee St.  
 \*WASHINGTON, D. C., 1434 New York Ave., N. W.  
 \*WATERLOO, IOWA, 328 Jefferson St., P. O. Box 598.  
 \*WICHITA, KAN., 233 So. St. Francis Ave.  
 †\*WILKES-BARRE, PA., 267 N. Pennsylvania Ave.  
 †\*WORCESTER, MASS., 32 Southbridge St.  
 \*YORK, PA., 143 So. George St.  
 \*YOUNGSTOWN, OHIO, 25 E. Boardman St.

Where address and P. O. box are both given, send mail to P. O. box, telegrams to address indicated.

## WESTINGHOUSE ELECTRIC SUPPLY COMPANY

Fully equipped sales offices and warehouses are maintained at all addresses

- ALBANY, N. Y., 454 No. Pearl St.  
 ALLENTOWN, PA., 522 Maple St.  
 ATLANTA, GA., 96 Poplar St., N. W.  
 AUGUSTA, MAINE, 90 Water St.  
 BALTIMORE, MD., 40 South Calvert St.  
 BANGOR, MAINE, 175 Broad St.  
 BINGHAMTON, N. Y., 87 Chenango St.  
 BOSTON, MASS., 76 Pearl St.  
 BURLINGTON, VT., 208 Flynn Ave.  
 BUTTE, MONTANA, 50 East Broadway  
 CHARLOTTE, N. C., 210 East Sixth St.  
 CHICAGO, ILL., 113 North May St.  
 CLEVELAND, OHIO, 3950 Prospect Ave.  
 COLUMBIA, S. C., 915 Lady St.  
 DALLAS, TEXAS, 409 Browder St.  
 ①DES MOINES, IOWA, 1400 Walnut St.  
 DETROIT, MICH., 547 Harper Ave.  
 DULUTH, MINN., 308 W. Michigan St.  
 EVANSVILLE, IND., 201 N. W. First St.  
 FLINT, MICH., 1314 N. Saginaw St.  
 FORT WORTH, TEXAS, 501 Jones St.  
 ①GRAND RAPIDS, MICH., 511 Monroe Ave., N. W.  
 GREENVILLE, S. C., 200 River St.  
 HOUSTON, TEXAS, 1903 Ruiz St.  
 INDIANAPOLIS, IND., 137 S. Pennsylvania St.  
 JACKSONVILLE, FLA., 37 South Hogan St.  
 LOS ANGELES, CALIF., 905 East Second St.  
 MADISON, WISC., 1022 E. Washington Ave.  
 MIAMI, FLA., 1036 North Miami Ave.  
 MEMPHIS, TENN., 366 Madison Ave.  
 MILWAUKEE, WISC., 546 N. Broadway  
 MINNEAPOLIS, MINN., 215 South Fourth St.  
 NEWARK, N. J., 49 Liberty St.  
 NEW HAVEN, CONN., 240 Cedar St.  
 \*NEW YORK, N. Y., 150 Varick St.  
 ①NORFOLK, VA., 320 City Hall Ave.  
 OAKLAND, CALIF., Tenth & Alice Sts.  
 OKLAHOMA CITY, OKLA., 10 E. California St.  
 OMAHA, NEB., 117 North Thirteenth St.  
 PEORIA, ILL., 104 East State St.  
 PHILADELPHIA, PA., 1101 Race St.  
 PHOENIX, ARIZONA, 315 West Jackson St.  
 PORTLAND, OREGON, 134 N. W. Eighth Ave.  
 PROVIDENCE, R. I., 66 Ship St.  
 RALEIGH, N. C., 322 S. Harrington St.  
 READING, PA., 619 Spruce St.  
 RICHMOND, VA., 301 South Fifth St.  
 ROANOKE, VA., 726 First St., S. E.  
 ①ROCHESTER, N. Y., 1048 University Ave.  
 ST. LOUIS, MO., 1011 Spruce St.  
 ST. PAUL, MINN., 145 East Fifth St.  
 SACRAMENTO, CALIF., 20th and R Sts.  
 SALT LAKE CITY, UTAH, 235 West South Temple St.  
 SAN ANTONIO, TEXAS, 1201 E. Houston St.  
 SAN FRANCISCO, CALIF., 260 Fifth St.  
 SEATTLE, WASH., 558 First Ave., South  
 SIOUX CITY, IOWA, 1005 Dace St.  
 SPOKANE, WASH., 152 So. Monroe St.  
 SPRINGFIELD, MASS., 46 Hampden St.  
 SYRACUSE, N. Y., 961 W. Genesee St.  
 TAMPA, FLA., 417 Ellamae St.  
 TOLEDO, OHIO, 812 Lafayette St.  
 TRENTON, N. J., 245 N. Broad St.  
 TULSA, OKLA., 303 East Brady St.  
 UTICA, N. Y., 113 N. Genesee St.  
 WASHINGTON, D. C., 1216 "K" St., N.W.  
 WATERLOO, IOWA, 328 Jefferson St.  
 WICHITA, KANSAS, 233 So. St. Francis Ave.  
 WILMINGTON, DEL., 216 E. Second St.  
 WORCESTER, MASS., 24 Southbridge St.  
 YORK, PA., 143 S. George St.

\* Sales Office † Service Shop x Works § Warehouse • First Class Mail Only § Merchandising Products Only z Headquarters ‡ Apparatus Products Only  
 ① Changed or added since previous issue. January, 1938