



INSTRUCTIONS

GEI-90806C

Supersedes GEI-90806B

UNDervOLTAGE RELAY

NGV15A

NGV15B



GENERAL ELECTRIC

CONTENTS

| | PAGE |
|--|------|
| DESCRIPTION | 3 |
| APPLICATION..... | 3 |
| RATINGS..... | 3 |
| CHARACTERISTICS..... | 4 |
| BURDENS..... | 5 |
| CONSTRUCTION..... | 5 |
| RECEIVING, HANDLING AND STORAGE..... | 5 |
| ACCEPTANCE TESTS..... | 5 |
| INSTALLATION PROCEDURE..... | 7 |
| PERIODIC CHECKS AND ROUTINE MAINTENANCE..... | 7 |
| SERVICING..... | 7 |
| RENEWAL PARTS..... | 8 |

(COVER PHOTO 8031288)

UNDervOLTAGE RELAYS

TYPE NGV15A, NGV15B

DESCRIPTION

The Type NGV15 relays are high-speed AC undervoltage relays. The relays are designed to be continuously operated in the picked-up position. They are calibrated on dropout voltage so as to accurately detect an undervoltage condition. The relays each have a single undervoltage element, mounted in a small molded case. The NGV15A is a back-connected relay suitable for surface or semi-flush mounting, as shown in Figures 1 and 2 respectively. The NGV15B is a front-connected relay, suitable for surface mounting only, as shown in Figure 3. The undervoltage element consists of a telephone-type relay in series with a zener diode voltage regulator connected across a full-wave diode bridge rectifier. The relay internal connections are shown in Figures 4 through 7. Two transfer contact outputs are provided for each relay, but no target is provided. Either one, two or three relays may be required, depending upon the specific application.

APPLICATION

The NGV15 relays are intended for general applications wherever instantaneous undervoltage detection is required. Some specific applications are described as follows:

- a. Instantaneous single-phase undervoltage detection for preferred emergency throwover control equipment; requires one relay, usually connected to one of the phase-to-phase voltages.
- b. Ground fault detection for faulted phase selection on ungrounded system; requires three relays, connected to the three line-to-neutral voltages.
- c. Phase fault detection for stopping all blocking carrier at a line terminal with weak backfeed; requires three relays, connected to the three line-to-line voltages.

RATINGS

The NGV15A (back connected) available ratings are given in Table I. The NGV 15B (front connected) available ratings are given in Table II.

TABLE I

| Continuous Volts | Frequency Hz |
|---------------------|-----------------|
| 69 | 50, 60 |
| 120 | 50, 60, 420 |
| 208 | 50, 60 |
| 240 | 50, 60 |
| 480 | 50, 60 |

TABLE II

| Continuous Volts | Frequency Hz |
|---------------------|-----------------|
| 69 | 60 |
| 120 | 50, 60 |
| 208 | 60 |
| 240 | 60 |
| 480* | 50, 60 |

* Used with external resistor (Figure 5)

These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation, operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company.

To the extent required the products described herein meet applicable ANSI, IEEE and NEMA standards; but no such assurance is given with respect to local codes and ordinances because they vary greatly.

CONTACT RATING

The contacts will make and carry 30 amperes for tripping duty and carry 3 amperes continuously. The interrupting capabilities for each contact for repetitive protective duty are given in Table III.

TABLE III

| Volts | Contact Interrupting Capability (Amps) Inductive* |
|-----------|---|
| 48 DC | 1.0 |
| 125 DC | 0.5 |
| 250 DC | 0.25 |
| 115 60 Hz | 0.75 |
| 230 60 Hz | 0.5 |
| 480 60 Hz | 0.2 |

* The non-inductive interrupting ratings for repetitive protective duty are approximately 2-1/2 times the ratings shown in Table III.

CHARACTERISTICS

The NGV voltage unit is a hinged armature unit that drops out when the magnetic pull created by the ampere turns in the operating coil is less than the force of the opening spring. The dropout voltage can be changed by adjusting the rheostat. This dropout voltage range is given in Table IV.

TABLE IV

| Rated Volts | Range of Dropout Adjustment |
|-------------|-----------------------------|
| 69 | 40- 58 |
| 120 | 70-100 |
| 208 | 121-173 |
| 240 | 140-200 |
| 480 | 280-400 |

On any dropout operation, there is a 1%-of-rated-voltage decrease from beginning to end, due to the non-linearity of the zener diode.

PICKUP VOLTAGE

The pickup voltage is 110% or less of the dropout voltage.

TIME CHARACTERISTICS

The relay pickup time is approximately 2 cycles, 60 cycle basis. The dropout time characteristic (voltage versus time) is shown in Figure 8.

BURDENS

The burden of the voltage unit is at unity power factor, and the values are given in Table V.

TABLE V

| Volts | Maximum Burden, Watts |
|-------|-----------------------|
| 69 | 4.0 |
| 120 | 4.2 |
| 208 | 4.75 |
| 240 | 4.5 |
| 480 | 4.7 |

CONSTRUCTION

The NGV15 is available in a moulded case, front or back connected. Figure 9 shows an NGV15A relay removed from the case.

The telephone-type voltage unit, the fixed and variable resistors and the zener regulator are mounted on a compound base. The cover is attached to the front of this base.

The relay case is suitable for either semi-flush or surface mounting on all panels up to two inches thick, and appropriate hardware is available. However, panel thickness must be indicated on relay orders to ensure that proper hardware will be included.

RECEIVING, HANDLING AND STORAGE

These relays, when not included as part of a control panel, will be shipped in cartons designed to protect them against damage. Immediately upon receipt of a relay, examine it for any damage sustained in transit. If injury or damage resulting from rough handling is evident, file a damage claim at once with the transportation company and promptly notify the nearest General Electric Sales Office.

Reasonable care should be exercised in unpacking the relay in order that none of the parts are injured or the adjustments disturbed.

If the relays are not to be installed immediately, they should be stored in their original cartons in a place that is free from moisture, dust and metallic chips. Foreign matter collected on the outside of the case may find its way inside when the cover is removed, and cause trouble in the operation of the relay.

ACCEPTANCE TESTS

Immediately upon receipt of the relay an INSPECTION AND ACCEPTANCE TEST should be made to make sure that no damage has been sustained in shipment and that the relay calibrations have not been disturbed. If the examination or test indicate that readjustment is necessary, refer to the section on **SERVICING**.

VISUAL INSPECTION

Check the nameplate stamping, to make sure that the model number and rating of the relay agree with the requisition. Remove the relay from its case and check that there are no broken or cracked molded parts or other signs of physical damage, and that all screws are tight.

MECHANICAL CHECK

Before installation, the relay should be checked mechanically to see that it operates smoothly and that the contacts are correctly adjusted.

With the relay de-energized, each normally-open contact should have a gap of 0.015" or greater.

The wipe on each normally-open contact should be approximately .005". This can be checked by inserting a .005" shim between the residual screw and the pole piece, and operating the armature by hand. The normally-open contacts should make before the residual screw strikes the shim.

Observe the wipe on each normally-closed contact by deflecting the stationary contact member towards the frame. Wipe should be approximately .005".

ELECTRICAL TESTS

Power Requirements, General

All alternating-current-operated devices are affected by frequency. Since non-sinusoidal waveforms can be analyzed as a fundamental frequency plus harmonics of the fundamental frequency, it follows that alternating-current (AC) devices (relays) will be affected by the applied waveform.

Therefore, in order to properly test alternating current relays it is essential to use a sine wave of current and/or voltage. The purity of the sine wave (i.e., its freedom from harmonics) cannot be expressed as a finite number for any particular relay; however, any relay using tuned circuits, RL or RC networks, or saturating electromagnets (such as time overcurrent relays), would be essentially affected by non-sinusoidal waveforms.

Similarly, relays requiring DC control power should be tested using DC and not full-wave rectified power. Unless the rectified supply is well filtered, many relays will not operate properly, due to the dips in the rectified power. Zener diodes, for example, can turn off during these dips. As a general rule, the DC source should not contain more than 5% ripple.

The relay should be tested before installation, and periodically thereafter, by connecting a variable source of voltage at rated frequency to the coil studs and checking the pickup and dropout voltages. The relay should be adjusted, by means of the variable rheostat and if necessary the residual screw, to the values required at its final location. Adjustment of the ratio of pickup to dropout voltage is made, if necessary, by means of the residual screw; in most applications, no adjustment of this ratio is required.

INSTALLATION PROCEDURE

LOCATION AND MOUNTING

The location should be clean and dry, free from dust and excessive vibration, and well lighted to facilitated inspection and testing.

The relay should be mounted on a vertical surface. The Outline and Panel Drilling dimensions are shown in Figures 1 to 3.

CONNECTIONS

The internal connections diagrams are shown in Figures 4 through 7.

ELECTRICAL TESTS

After the relay is properly mounted, repeat the **ACCEPTANCE TESTS**.

PERIODIC CHECKS AND ROUTINE MAINTENANCE

In view of the vital role of protective relays in the operation of a power system, it is important that a periodic test program be followed. It is recognized that the interval between periodic checks will vary depending upon environment, type of relay and the user's experience with periodic testing. Until the user has accumulated enough experience to select the test interval best suited to his individual requirements, it is suggested that the points listed under **INSTALLATION PROCEDURE** be checked at an interval of from one to two years.

CONTACT CLEANING

For cleaning relay contacts, a flexible burnishing tool should be used. This consists of a flexible strip of metal with an etched-roughened surface, resembling in effect a superfine file. The polishing action is so delicate that no scratches are left, yet it will clean off any corrosion thoroughly and rapidly. The flexibility of the tool ensures the cleaning of the actual points of contact. Do not use knives, files, abrasive paper or cloth of any kind to clean relay contacts. (Knives or files may leave scratches that increase arcing and deterioration of the contacts; abrasive paper or cloth may leave minute particles of insulating abrasive material in the contacts, and thus prevent closing.)

SERVICING

If it is found during installation or periodic testing that the telephone relay (see Figure 10) is out of limits, the unit may be recalibrated as follows:

INSPECTION

Inspect the condition and finish of all parts; any cracked or broken parts should be replaced.

MECHANICAL

The telephone relays should be checked for contact gap, wipe, and residual screw projection before any electrical adjustments are made. In the unexcited position, all normally-open contacts should have a gap of 0.015" minimum. All normally-closed contacts should make good contact at full wipe of 0.005". The armature should be operated by hand and the contacts checked again. Circuit-closing contacts should make good contact at 0.005" wipe and circuit-opening contacts should have 0.015" minimum gap. Check that the residual screw projection is 0.003" minimum.

WIRING

Make complete check of all wiring and resistance values, referring to internal connections diagrams in Figures 4 through 7.

ELECTRICAL

Voltage: To decrease the percentage of rated voltage at which the relay picks up, decrease the spacing of the armature from the pole face by bending the contact operating arm stop. After this adjustment, it will be necessary to readjust the wipe of the "a" and "b" contact to 0.005" and the gaps to 0.015" minimum. Lessening "b" contact pressure also decreases percentage pickup.

To increase the percentage of rated voltage at which the relay picks up, reverse the above procedure.

Pickup Time: To decrease the pickup time, reduce the pressure of the "b" contacts by bending the moving flexible contact arm. To increase pickup time, reverse this procedure.

Dropout Time: The dropout time may be adjusted by means of the residual screw in the armature. The more the residual screw is turned in, the shorter the dropout time. More pressure in the flexible contact arm also decreases dropout time.



Note:

Any change in the residual screw setting must be accompanied by readjustment for correct contact wipes. This can most easily be accomplished by bending the contact-operating arm, which extends from the side of the armature.

RENEWAL PARTS

Sufficient quantities of renewal parts should be kept in stock for the prompt replacement of any that are worn, broken or damaged.

When ordering renewal parts, address the nearest Sales Office of the General Electric Company. Specify the name of the part wanted, quantity required, and complete nameplate data, including the serial number, of the relay.

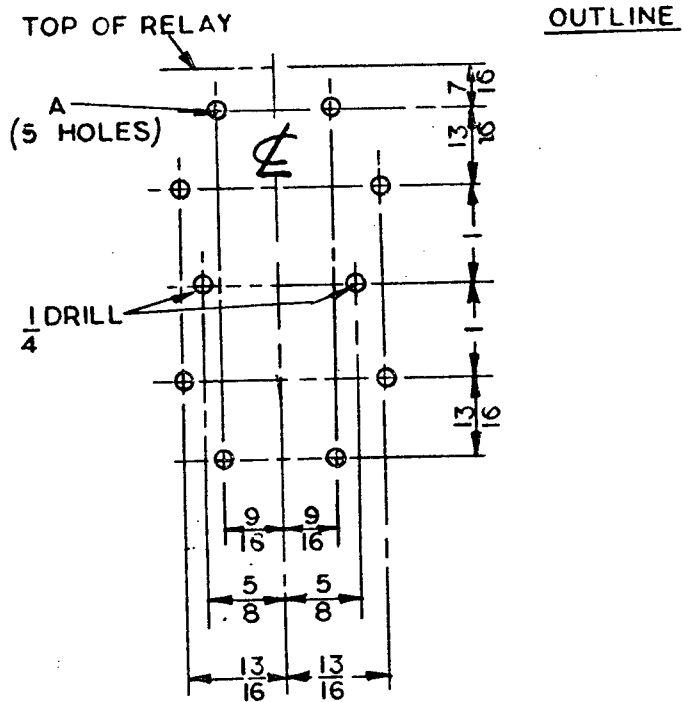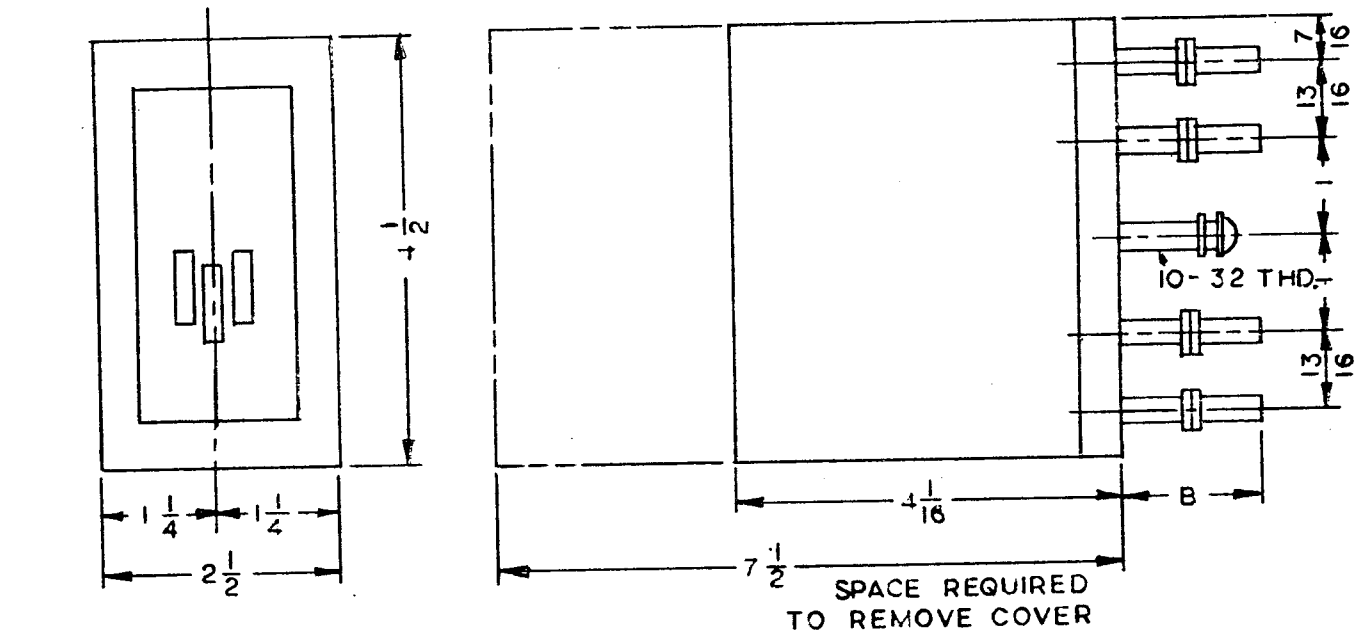


| TYPE OF PANEL | A | B |
|---------------|--------|-----------|
| INSULATING | $7/16$ | $2-13/16$ |
| STEEL | $9/16$ | $1-3/8$ |

PANEL DRILL (FRONT VIEW)

Figure 1 (0148A3979-6) Outline and Panel Drilling Dimensions for the Surface-Mounted NGV15A Relay

GEI-90806

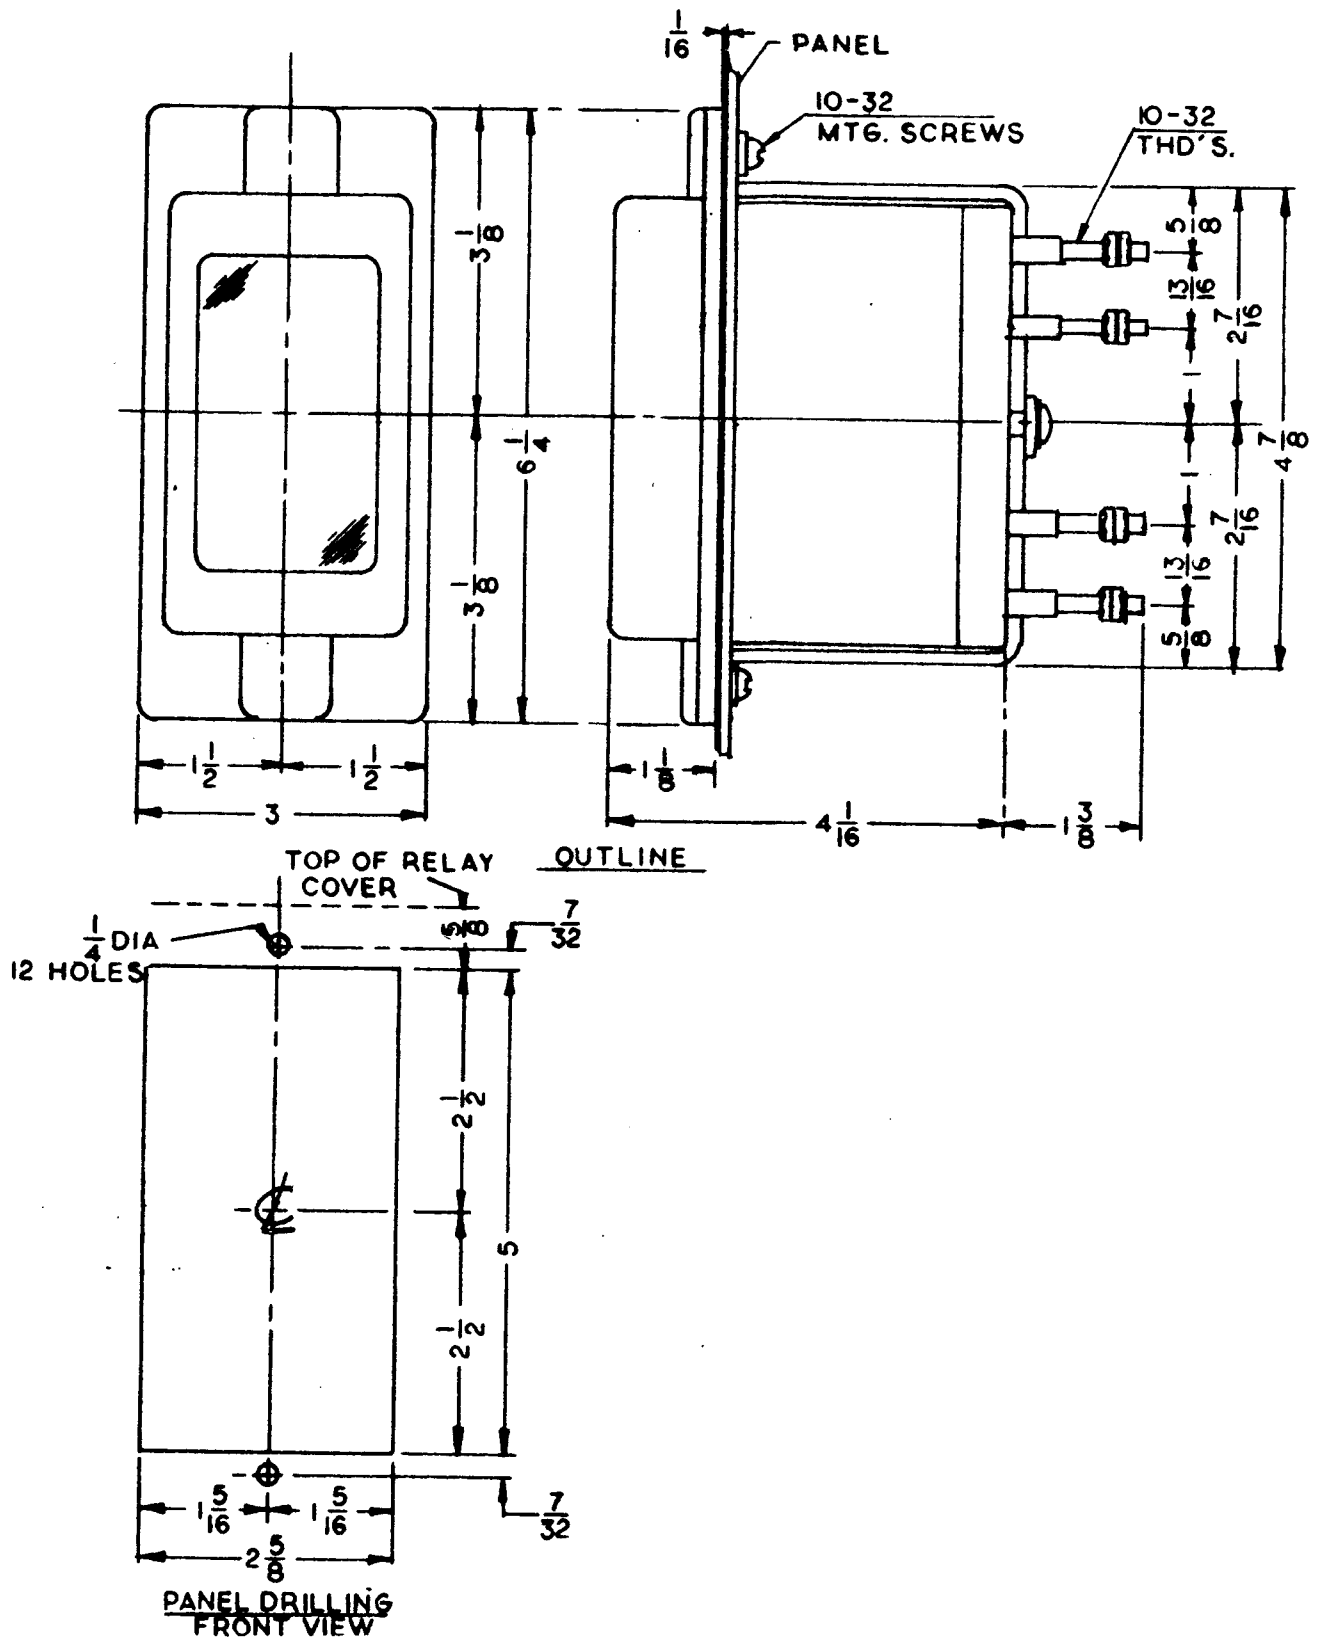

* Figure 2 (0148A3978-7) Outline and Panel Drilling Dimensions for the Semi-Flush-Mounted NGV15A Relay

* Revised since last issue


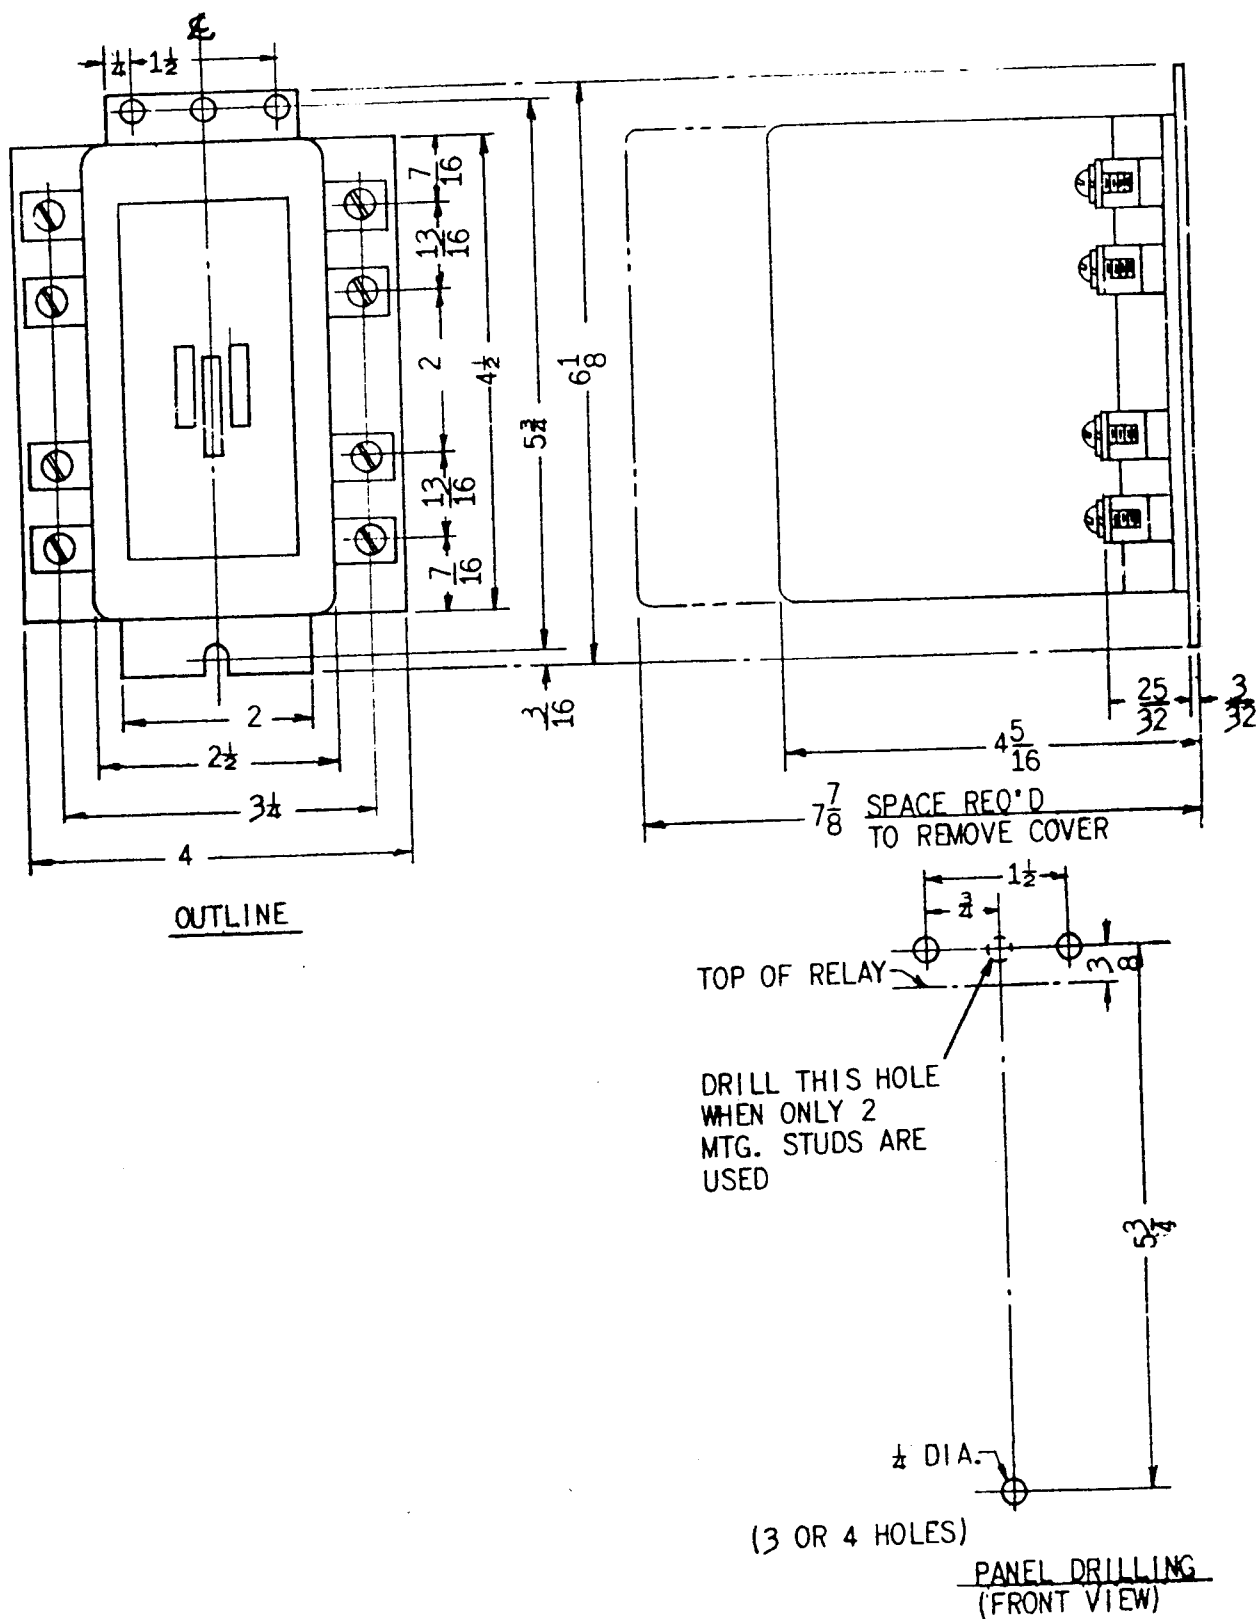


Figure 3 (0208A3642-1) Outline and Panel Drilling Dimensions for the Surface-Mounted NGV15B Relay

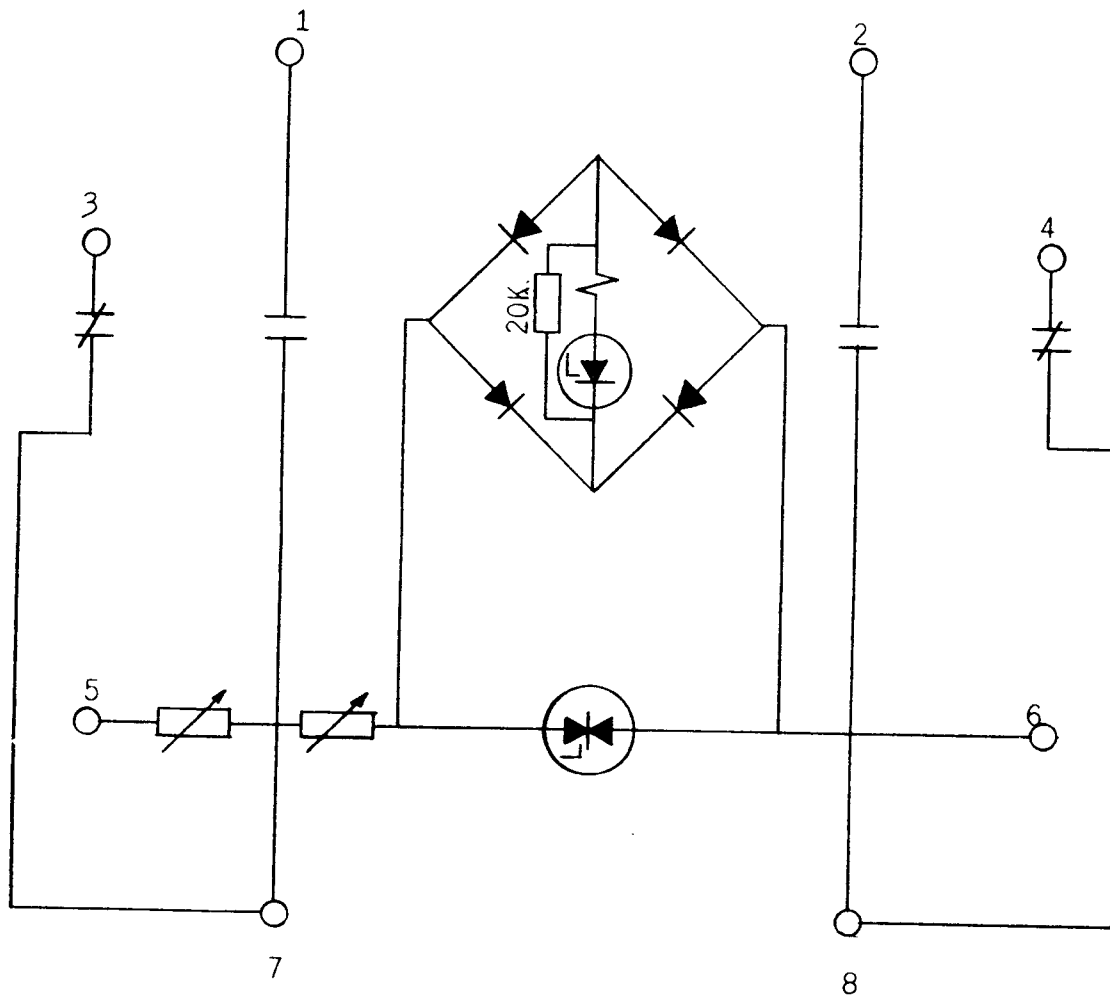

BACK VIEW

Figure 4 (0178A9050-0) Internal Connections Diagram for the NGV15A10A Relay

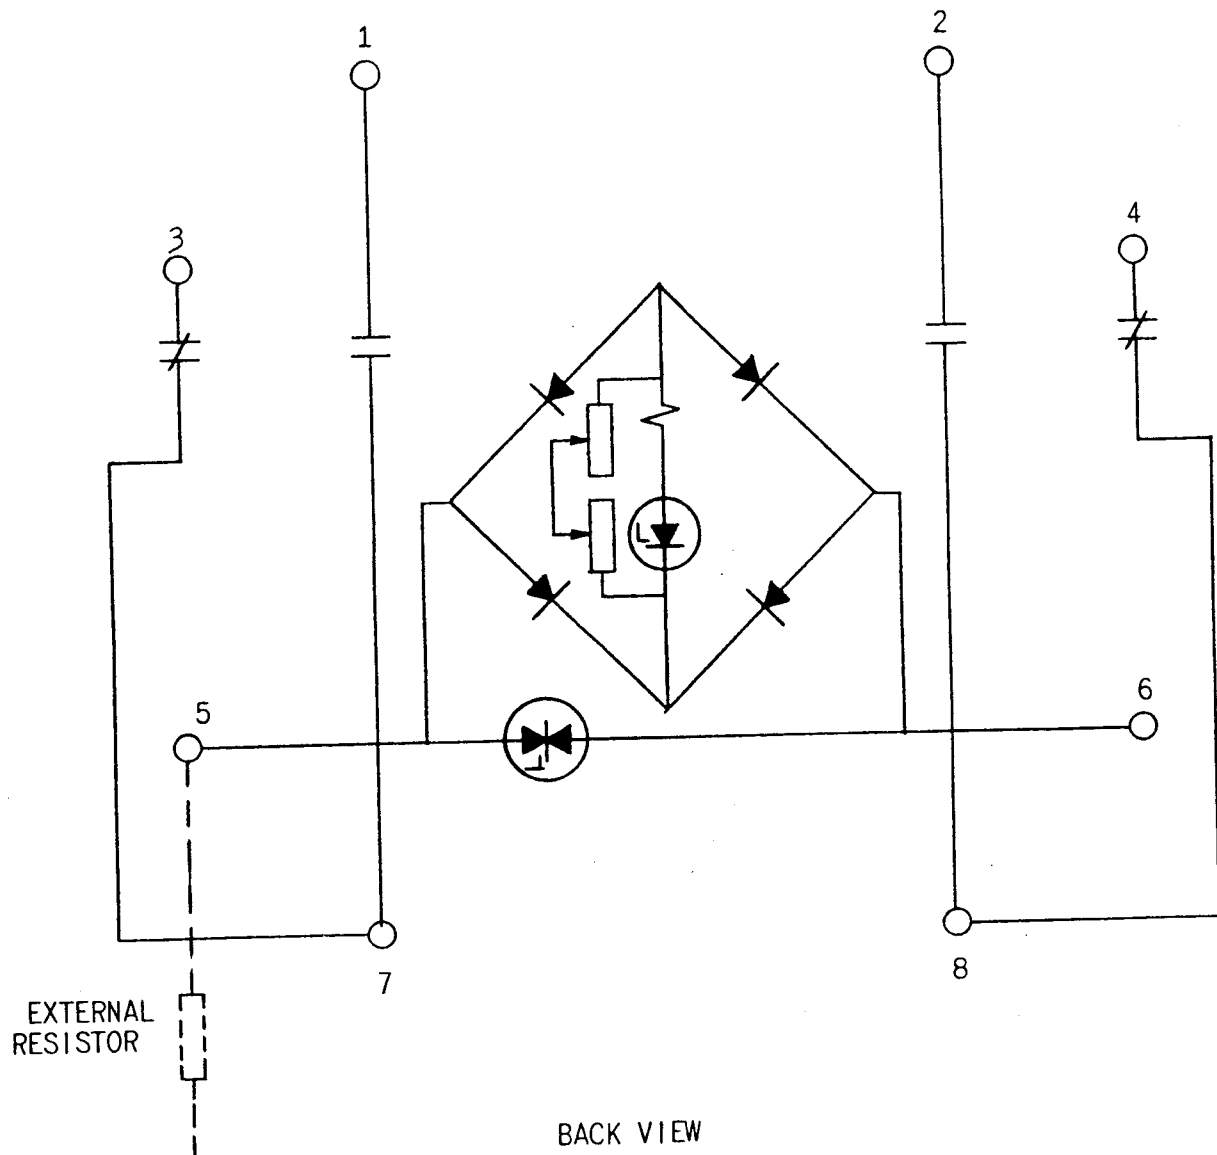


Figure 5 (0178A9051-0) Internal Connections Diagram for the NGV15A(-)A Relay, Forms 11 & 12, and NGV15B6A


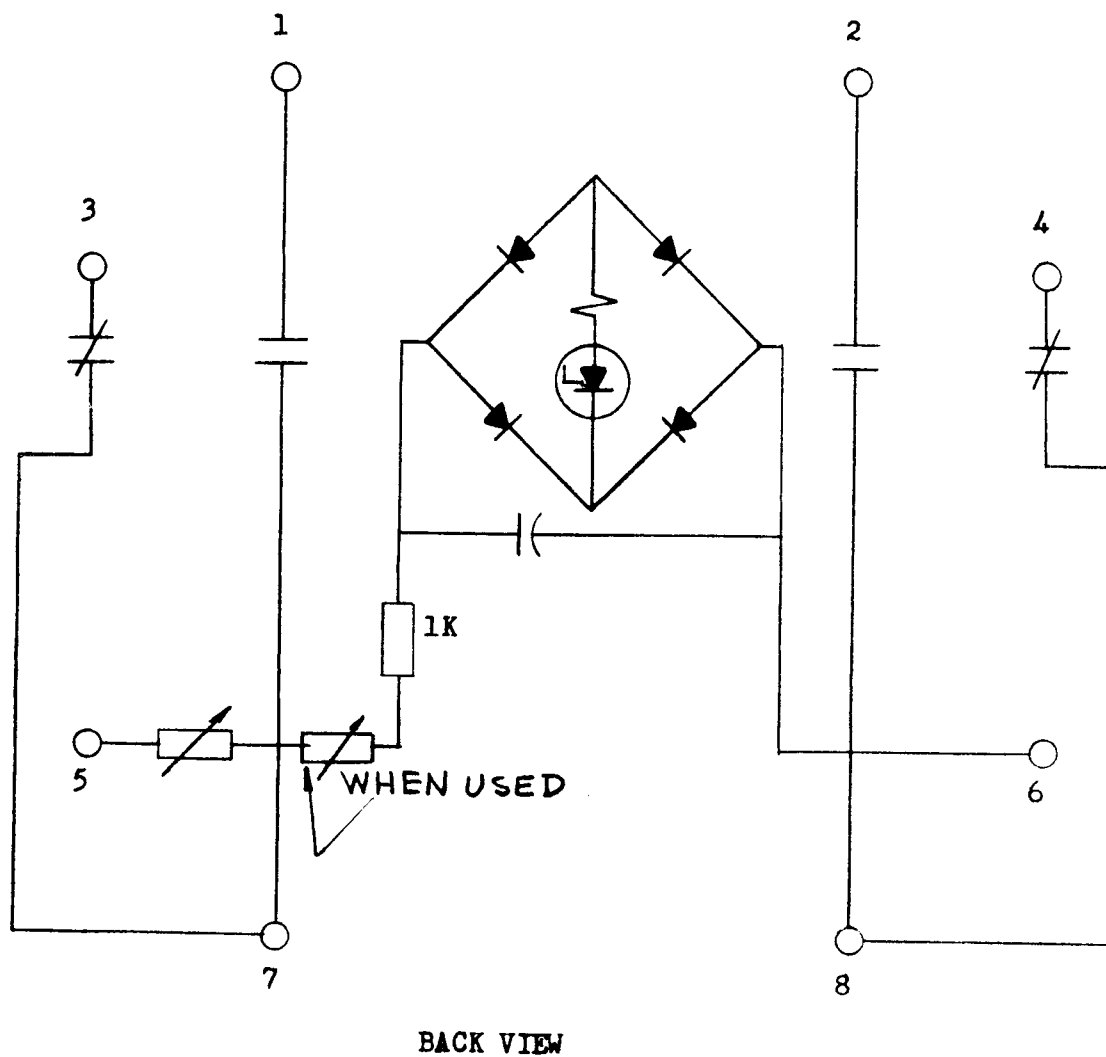


Figure 6 (0195A4944-0) Internal Connections Diagram
for the NGV15A(-)A , Forms 21 through 29, NGV1535A, and NGB15B(-)A Relays

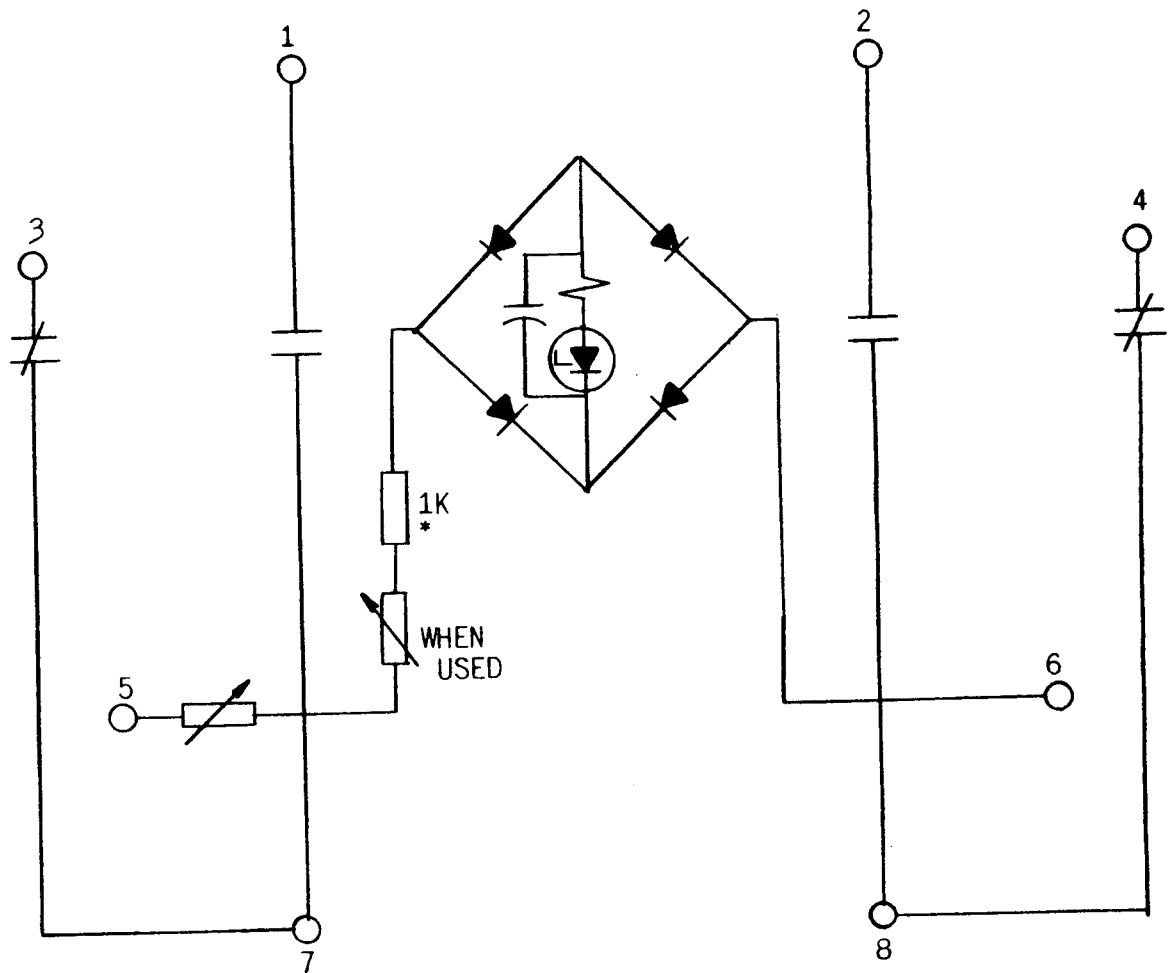

*500 OHMS ON 69 VOLT MODELS

Figure 7 (0203A8599-0) Internal Connections Diagram
for the NGV15A(-)A Relay, Forms 30 & 31

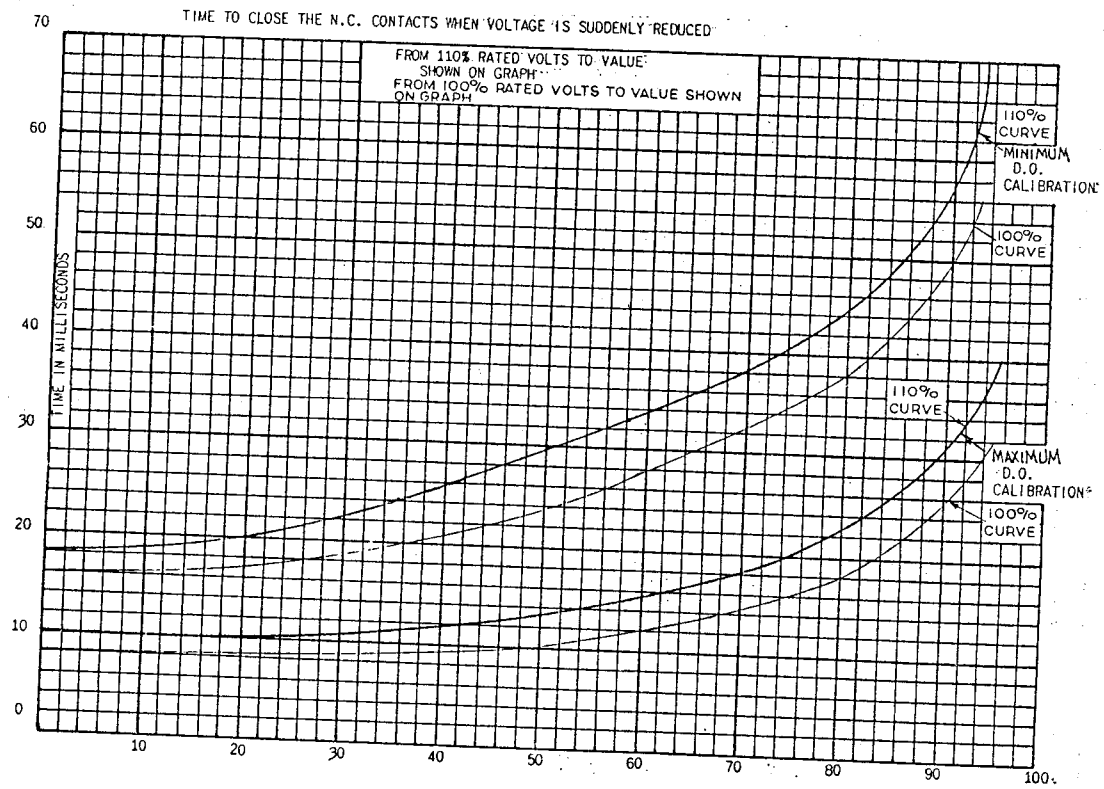


Figure 8 (0165A7560-2) Operating Time Curves for the NGV Relays

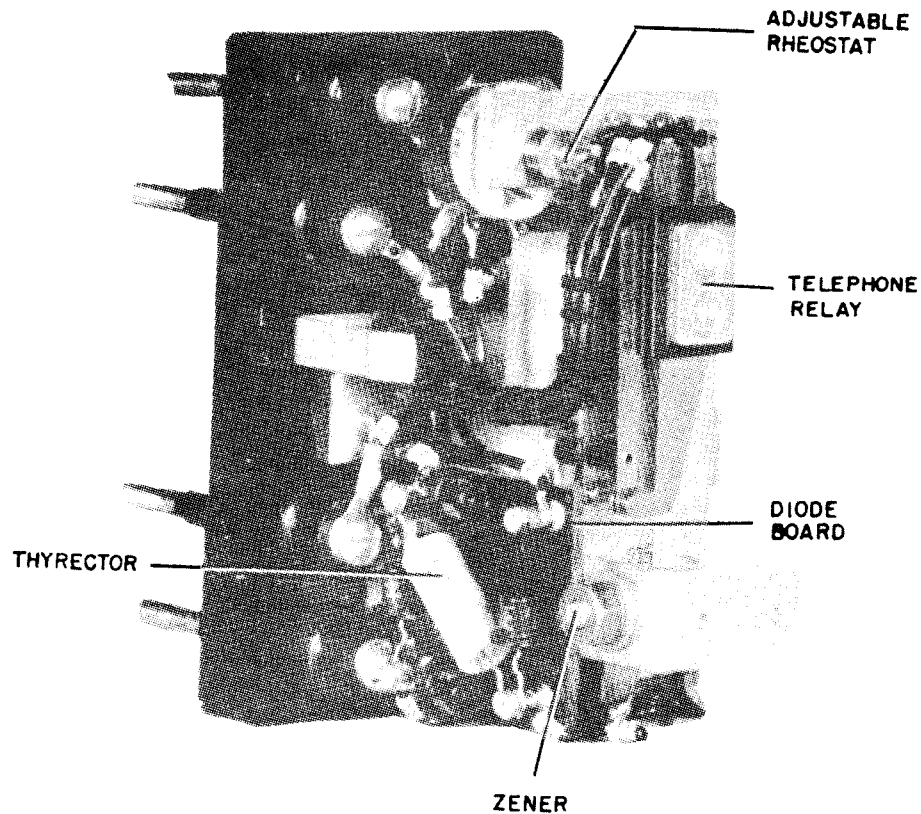


Figure 9 (8031439) NGV15A Relay with Case Cover Removed

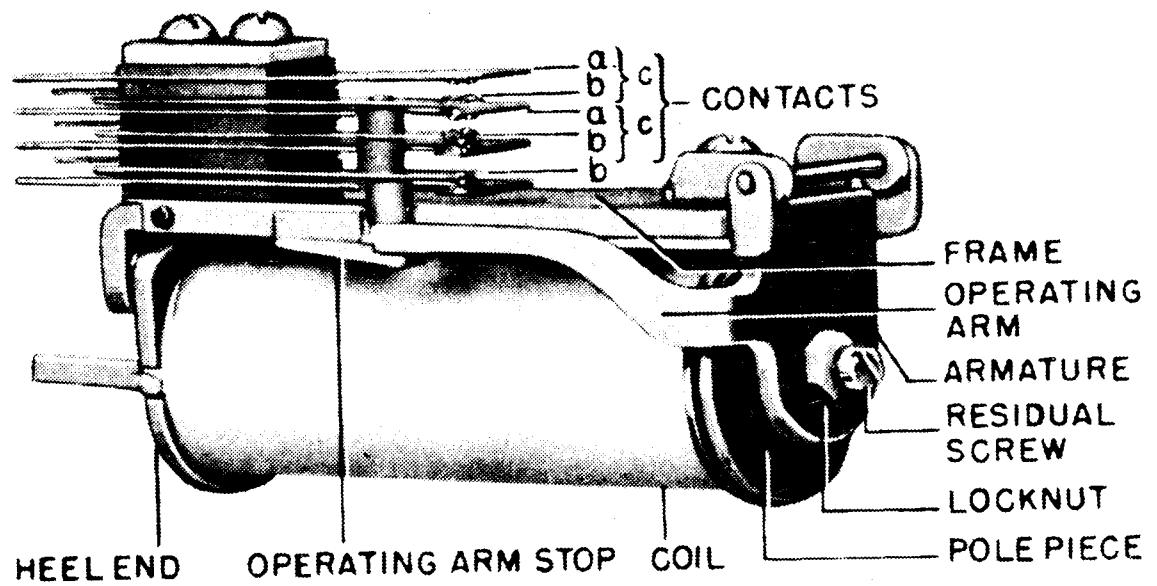


Figure 10 (8012106) Typical Telephone-Relay Unit Used in the NGV15A and 15B Relay

***Meter and Control
Business Department***

ST-12/94 (1200)

General Electric Company
Protection and Control
205 Great Valley Parkway
Malvern, Pennsylvania 19355-0715