

Installation Instructions
for AKR Substructure
Kits 343L690 G1 and G2

Low-Voltage Power Circuit Breakers

Position Switch Accessory

General

These instructions detail the installation of the position switch accessory to the Type AKR drawout substructures.

Position Switch Kit Cat. No.	Substructure Typical Cat. No.
343L690G1	TAK___SS___
343L690G2	TAK___SR___


Description

The position switch mechanism is activated by the AKR


breaker when the breaker is in its CONNECTED position. The switch is a GE Type SBM control switch #10AR414. It is furnished by the customer.

Installation


1. Mounting location depends on substructure type. Mount the 343L690G1 Position Switch in the lower right rear of the substructure or 343L690G2 in the lower left rear of the substructure.
2. Mounting holes exist so no drilling is required. All necessary hardware is provided.

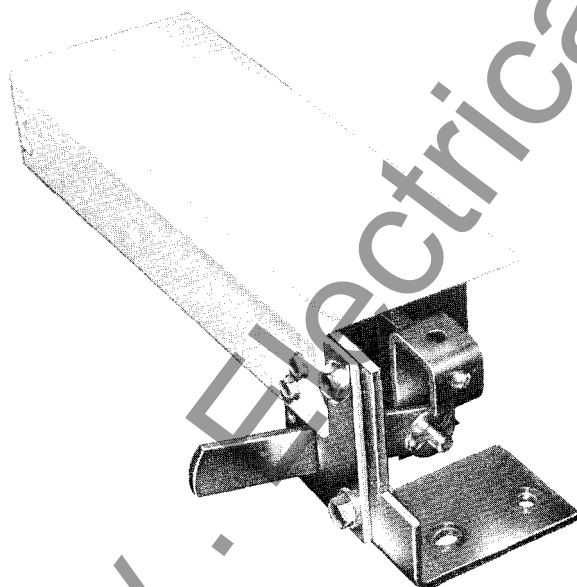

343L690G1

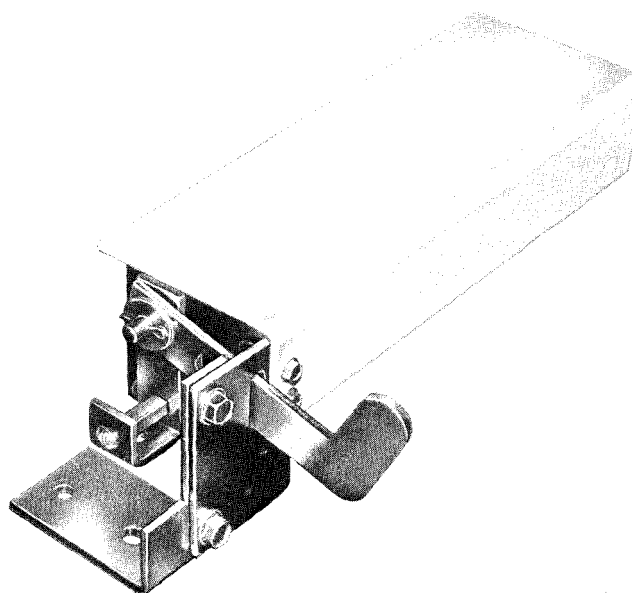

343L690G2

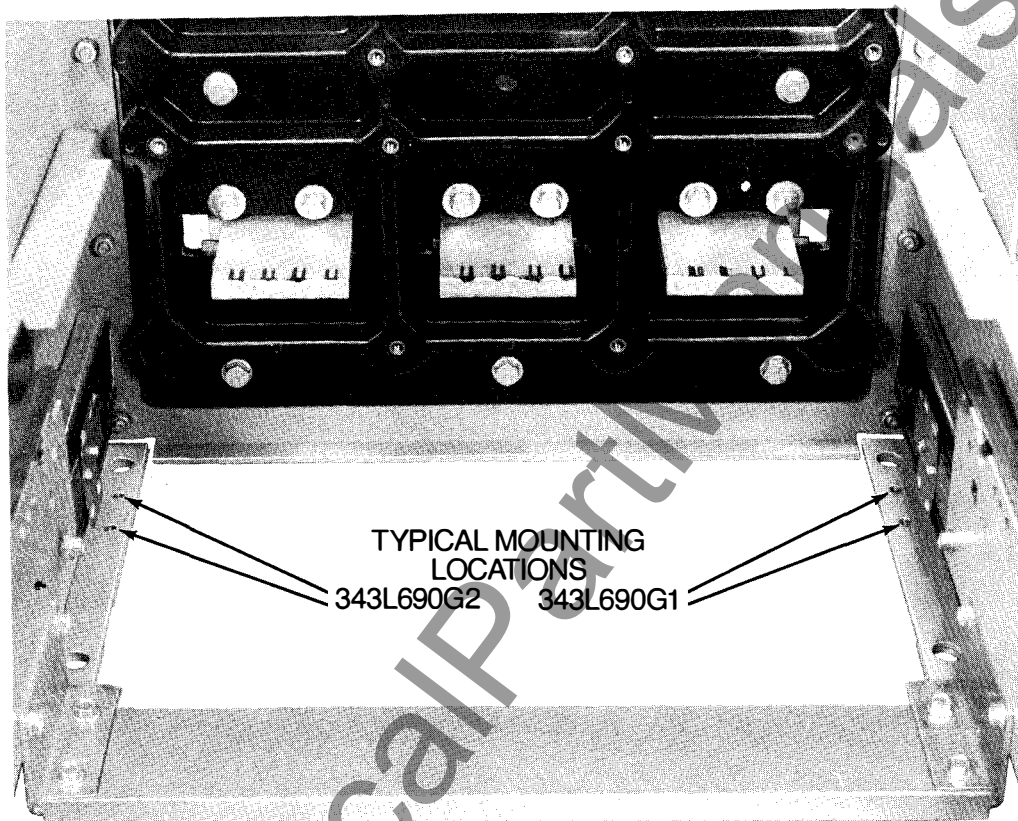

TYPICAL MOUNTING
LOCATIONS

343L690G2

343L690G1

© 1984 GENERAL ELECTRIC COMPANY

These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company.

For further information
call or write your local
General Electric
Sales Office or . . .

Construction Equipment
Business Operations
41 Woodford Avenue
Plainville, CT 06062 U.S.A.

Outside the U.S. and Canada write International Trading Operations.
570 Lexington Avenue, New York, NY 10022 U.S.A.

GEH-4388C 584PSB

GENERAL  **ELECTRIC**