





Switchgear Circuit Breaker Parts Catalog

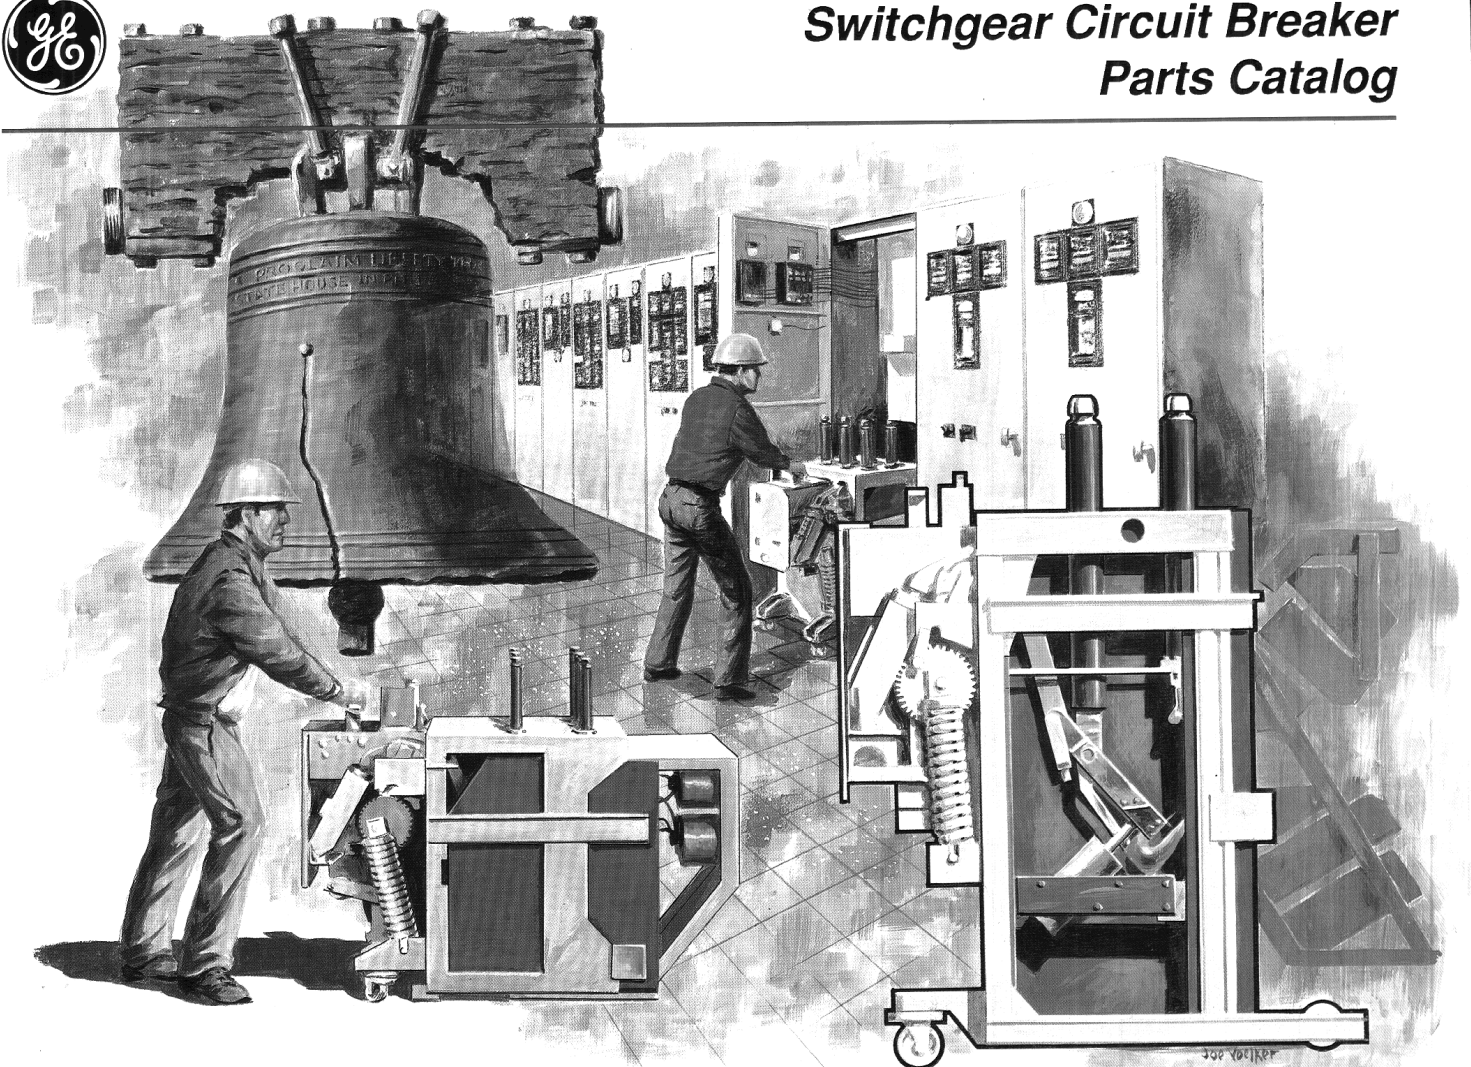

Power Delivery & Control/Breaker Plant Operation/Phila., Pa. 19142

***Metal Clad Switchgear, Air Magnetic & GE/Vac Breakers
Rated 4.16 kV Through 13.8 kV***

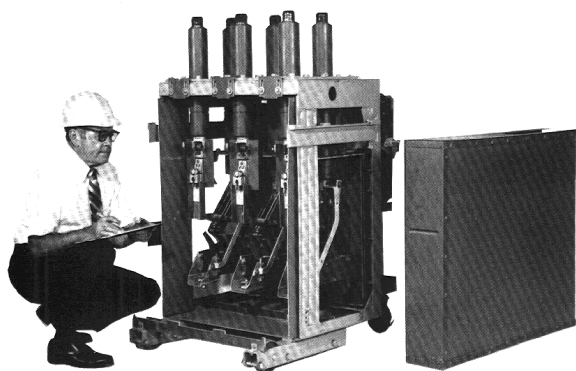

By selecting and installing genuine GE switchgear circuit breaker parts, you will have taken an important step toward extending the service life of your GE metalclad switchgear lineup.

Manufactured to original equipment specifications, parts for either GE air magnetic Magne Blast breakers or the GE/Vac type VVC Vacuum breakers will readily fit and affix to the breaker structures, saving time for your maintenance personnel. When properly installed and maintained, GE parts will help assure the breaker meets its original nameplate ratings for many years to come.

To aid selection, parts listings in this catalog have been arranged and categorized by type of GE breaker. Specific catalog numbers for the various components of the breakers have been segregated within each breaker category. For example, bushings for Magne Blast breakers, are listed separately on page 6.

Listings match the nameplate designations. Check the nameplate and copy the breaker rating and the design "dash" number which appears prior to the ampere rating. See Page 4 for examples of nameplates on both breakers and lineups. Choose the component catalog numbers that correspond to the breaker nameplate listed.

(continued on inside back cover)



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

TABLE OF CONTENTS

SECTION I

PARTS BY DESCRIPTION

	Page	Page
ORDERING INSTRUCTIONS	3	
EQUIPMENT IDENTIFICATION	4	
REPLACEMENT CIRCUIT BREAKERS	5	

CIRCUIT BREAKER & ML-13 MECHANISM PARTS

BUSHINGS	6,7
CHARGING MOTORS	8
CONTACTS	9,10
OPERATION COUNTERS	11
CLOSING COILS	11
TRIP COILS	11
SWITCHES	11
RELAYS	11
SPRINGS	12
BEARING REPLACEMENT KITS	13
ML-13 RENEWAL PARTS	14-17

METAL-CLAD SWITCHGEAR PARTS

ELEVATING MOTORS	18
ELEVATING MECHANISMS	19
FRONT AND REAR PRIMARIES	20
POSITIVE INTERLOCKS	21
HEATERS	22
CHAINS	22
SHUTTER MECHANISMS	22
FUSE BLOCKS	22
MERCURY SWITCHES	22
DOOR HANDLES	22
CAPACITOR TRIP DEVICES	23
SILICON RECTIFIERS	23
BUS INSULATION/SUPPORTS	24
TAPE AND INSULATION	24
GREASE, COMPOUND, & VARNISH	24
MODIFICATIONS AND UPGRADES	25



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

TABLE OF CONTENTS

SECTION II

PARTS BY BREAKER TYPE

EQUIPMENT DESIGNATION

<u>CIRCUIT BREAKER</u>	<u>SWITCHGEAR</u>	<u>Page</u>
AM 4.16-250-6,-7,-8,-9	M26	26
AM 4.16-350-1	M26H	27
AM 4.16-350-2	M26H	28
AM 7.2-500-6	M36	29
AM 13.8-500-5,-6	M36	30
AM 13.8-750-4	M36H	31
AM 13.8-750-5,-6	M36H	32
AM 13.8-1000-3	M36HH	33
AM 13.8-1000-4	M36HH	34
GE/Vac ALL RATINGS		35



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA



ORDERING INSTRUCTIONS

1. ALWAYS specify the complete nameplate data of the equipment.
2. Specify the quantity, part name, and catalog number (if listed).
If you do not know what the catalog number is, or no catalog number is listed:
Describe the part; specify the sub-assembly on which the part is used,
(i.e. ML-13 mechanism) and the type of equipment (i.e. AM 4.16-
250-1200A breaker). Reference any technical publication used,
including the page, figure, and reference number.
3. For pricing and availability, contact your local GE representative. The factory can
refer you to your local office if you call 215-726-2516.




METAL-CLAD SWITCHGEAR EQUIPMENT

Nameplate is located in left most breaker cubicle

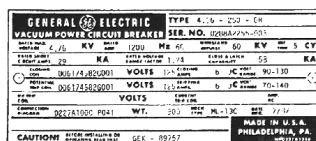

**EQUIPMENT SUMMARY NUMBER
AND/OR CIRCUIT BREAKER
SERIAL NUMBER ARE MOST
IMPORTANT FOR IDENTIFICATION
PURPOSES**

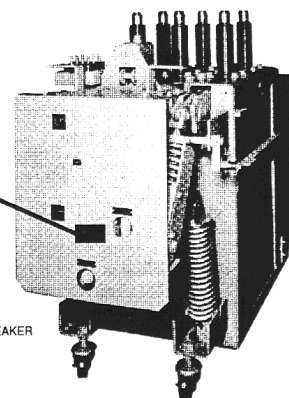

MAGNE-BLAST® BREAKER



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

GE/Vac® CIRCUIT BREAKERS

**NOW YOU CAN REPLACE WORN OUT OR OBSOLETE MAGNE-BLAST®
BREAKERS WITH NEW GE/Vac® UNITS.**

- SWITCHGEAR COMPARTMENTS AND CABLE CONNECTIONS REMAIN UNCHANGED.
- COST MAY BE LESS THAN OVERHAULING YOUR PRESENT BREAKER.

RATINGS AVAILABLE*

<u>TYPE:</u>	<u>MAXIMUM Voltage (kv)</u>	<u>INTERRUPTING CAPACITY (KA)</u>	<u>MOMENTARY RATING (KA)</u>	<u>CONTINUOUS CURRENT (A)</u>
4.16-250 MVA	4.76	29	58	1200
4.16-250 MVA	4.76	29	58	2000
7.2-500 MVA	8.25	33	66	1200
7.2-500 MVA	8.25	33	66	2000
13.8-500 MVA	15.5	18	37 or 58	1200
13.8-500 MVA	15.5	18	37 or 58	2000
13.8-750 MVA	15.5	28	58	1200
13.8-750 MVA	15.5	28	58	2000
13.8-1000 MVA	15.5	37	77	1200
13.8-1000 MVA	15.5	37	77	2000
13.8-1000 MVA	15.5	37	77	3000

* Symmetrical Basis of Rating, Per ANSI 37.06



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA


MAGNE-BLAST® CIRCUIT BREAKER FRONT & REAR BUSHINGS

BREAKER RATING

FRONT BUSHINGS

REAR BUSHINGS

AM 4.16-250-6-1200A	0845D0123G001	0845D0124G001
AM 4.16-250-6-2000A	0688C0515G001	0688C0516G001
AM 4.16-250-7-1200A	0845D0123G001	0845D0124G001
AM 4.16-250-7-2000A	0688C0515G001	0688C0516G006
AM 4.16-250-8-1200A	0845D0123G001 920	0845D0124G001 920
AM 4.16-250-8-2000A	0688C0515G001	0688C0516G006
AM 4.16-250-9-1200A	0845D0123G001	0845D0124G001
AM 4.16-250-9-2000A	0688C0515G001	0688C0516G006
AM 4.16-350-1-1200A	0845D0123G002	0845D0124G002
AM 4.16-350-1-2000A	0688C0515G005	0688C0516G007
AM 4.16-350-1-3000A	0619C0438G002	0619C0438G001
AM 4.16-350-2-1200A	0845D0123G002	0845D0124G006
AM 4.16-350-2-2000A	0688C0515G005	0688C0516G008
AM 4.16-350-2-3000A	0619C0438G002	0619C0438G001
AM 7.2-500-6-1200A	0845D0123G003	0845D0124G003
AM 7.2-500-6-2000A	0958C0683G003	0958C0684G005
AM 13.8- 500-5-1200A	0845D0123G003	0845D0124G003
AM 13.8- 500-5-2000A	0958C0683G003	0958C0684G003
AM 13.8- 500-6-1200A	0845D0123G003	0845D0124G003
AM 13.8- 500-6-2000A	0958C0683G003	0958C0684G005
AM 13.8- 500-7-1200A	0845D0123G003	0845D0124G003
AM 13.8- 500-7-2000A	0958C0683G003	0958C0684G005
AM 13.8- 750-4-1200A	0845D0123G004	0845D0124G007
AM 13.8- 750-4-2000A	0265C0188G007	0132C2725G001
AM 13.8- 750-5-1200A	0845D0123G003	0845D0124G003
AM 13.8- 750-5-2000A	0958C0683G003	0958C0684G005
AM 13.8- 750-6-1200A	0845D0123G003	0845D0124G003
AM 13.8- 750-6-2000A	0958C0683G003	0958C0684G005
AM 13.8-1000-3-1200A	0845D0123G005	0845D0124G005
AM 13.8-1000-3-2000A	0958C0683G003	0958C0684G003
AM 13.8-1000-3-3000A	0688C0514G002	0688C0514G001
AM 13.8-1000-4-1200A	0845D0123G004	0845D0124G007
AM 13.8-1000-4-2000A	0265C0188G007	0132C2725G001
AM 13.8-1000-4-3000A	0688C0514G006	0688C0514G005

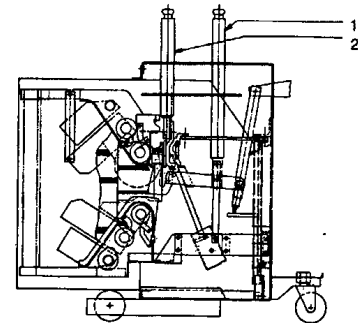


1. Front Bushing
2. Rear Bushing



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

GE/Vac® CIRCUIT BREAKER FRONT & REAR BUSHINGS

BREAKER RATING	FRONT BUSHINGS	REAR BUSHINGS
VVC 4.16-250-0-1200A	0845D0123G001	0845D0124G001
VVC 4.16-250-0-2000A	0688C0515G001	0688C0516G006
VVC 4.16-250-1-1200A	0845D0123G001	0845D0124G001
VVC 4.16-250-1-2000A	0688C0515G001	0688C0516G006
VVC 7.2-500-0-1200A	0845D0123G003	0845D0124G003
VVC 7.2-500-0-2000A	0958C0683G003	0958C0684G005
VVC 7.2-500-1-1200A	0845D0123G003	0845D0124G003
VVC 7.2-500-1-2000A	0958C0683G003	0958C0684G005
VVC 13.8- 500-0-1200A	0845D0123G003	0845D0124G003
VVC 13.8- 500-0-2000A	0958C0683G003	0958C0684G005
VVC 13.8- 500-1-1200A	0845D0123G003	0845D0124G003
VVC 13.8- 500-1-2000A	0958C0683G003	0958C0684G005
VVC 13.8- 750-0-1200A	0845D0123G003	0845D0124G003
VVC 13.8- 750-0-2000A	0958C0683G003	0958C0684G005
VVC 13.8- 750-0L-1200A	0845D0123G004	0845D0124G007
VVC 13.8- 750-0L-2000A	0265C0188G007	0132C2725G001
VVC 13.8- 750-1-1200A	0845D0123G003	0845D0124G003
VVC 13.8- 750-1-2000A	0958C0683G003	0958C0684G005
VVC 13.8- 750-1L-1200A	0845D0123G004	0845D0124G007
VVC 13.8- 750-1L-2000A	0265C0188G007	0132C2725G001
VVC 13.8-1000-0-1200A	0845D0123G004	0845D0124G007
VVC 13.8-1000-0-2000A	0265C0188G007	0132C2725G001
VVC 13.8-1000-0-3000A	0172C7638G002	0172C7638G001
VVC 13.8-1000-1-1200A	0845D0123G004	0845D0124G007
VVC 13.8-1000-1-2000A	0265C0188G007	0132C2725G001
VVC 13.8-1000-1-3000A	0172C7638G002	0172C7638G001

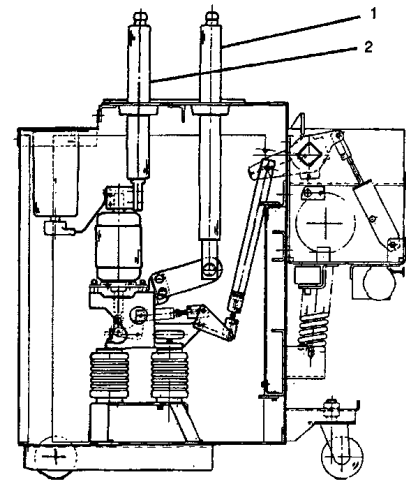


1. Front Bushing
2. Rear Bushing



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

MAGNE-BLAST® & GE/Vac® CIRCUIT BREAKER CHARGING MOTORS

ORIGINAL NUMBER ON MOTOR NAME PLATE OR ENG'R SUMMARY				REPLACEMENT NUMBER
VOLTAGE				
48V DC	0105C9393P001	OR	0275A6815P001	0184B7360G001
115V/ AC/125V AC	0105C9393P002	OR	0275A6815P002	0184B7360G002
230V AC/250V DC	0105C9393P003	OR	0275A6815P003	0184B7360G003
230V AC	0105C9393P004	OR	0275A6815P003	0184B7360G003

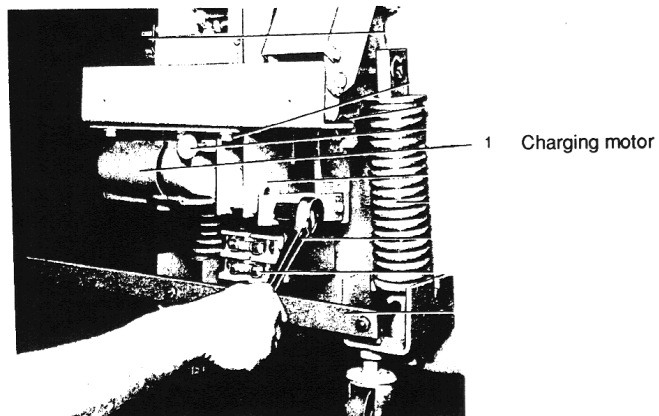

ML-13 OPERATING MECHANISM



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

MAGNE-BLAST® CIRCUIT BREAKER CONTACTS

BREAKER RATING & DASH #	MOVABLE PRIMARY CONTACT	MOVABLE PRIMARY CONTACT	MOVABLE PRIMARY CONTACT	MOVABLE PRIMARY CONTACT	STATIONARY PRIMARY CONTACT	MOVABLE ARCING CONTACT	STATIONARY ARCING CONTACT
AM 4.16-250-6-1200A	0137A9164P003	0137A9164P004			0236C0791P008	0802B0742R003	0236C0790G009
AM 4.16-250-6-2000A	0137A9164P003	0137A9164P004			0236C0791P008	0802B0742R003	0236C0790G009
AM 4.16-250-7-1200A	0114C5382P004				0114C5382P002	0802B0742R003	0236C0790G009
AM 4.16-250-7-2000A	0114C5382P004				0114C5382P002	0802B0742R003	0236C0790G009
AM 4.16-250-8-1200A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 4.16-250-8-2000A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 4.16-250-9-1200A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 4.16-250-9-2000A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 4.16-350-1-1200A	0137A9164P003	0137A9164P004			0236C0791P008	0802B0742R004	0383A0903G001
AM 4.16-350-1-2000A	0137A9164P003	0137A9164P004			0236C0791P008	0802B0742R004	0383A0903G001
AM 4.16-350-1-3000A	0114C5382P011	0114C5382P012			0236C0791P008	0802B0742R004	0383A0903G001
AM 4.16-350-2-1200A	0137A9164P005	0137A9164P006			0114C5382P002	0227A5306G001	0213X0344R032
AM 4.16-350-2-2000A	0137A9164P005	0137A9164P006			0114C5382P002	0227A5306G001	0213X0344R032
AM 4.16-350-2-3000A	0114C5382P011	0114C5382P012			0114C5382P002	0227A5306G002	0213X0344R032
AM 7.2-500-6-1200A	0114C5382P004				0114C5382P002	0227A5306G001	0213X0344R032
AM 7.2-500-6-2000A	0114C5382P004				0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-1000-3-1200A	0688C0595P022	0688C0595P021	0137A9164P003	0137A9164P004	0236C0791P008	0966C0353G001	0966C0354R002
AM 13.8-1000-3-2000A	0688C0595P022	0688C0595P021	0137A9164P003	0137A9164P004	0236C0791P008	0966C0353G001	0966C0354R002
AM 13.8-1000-3-3000A	0688C0595P024	0688C0595P023	0114C5382P012	0114C5382P011	0236C0791P008	0966C0353G002	0966C0354G003
AM 13.8-1000-4-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-1000-4-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-1000-4-3000A	0114C5382P011	0114C5382P012			0114C5382P002	0227A5306G003	0213X0344R032
AM 13.8-500-5-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0802B0742R003	0236C0790G009
AM 13.8-500-5-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0802B0742R003	0236C0790G009
AM 13.8-500-6-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G004	0236C0790G009
AM 13.8-500-6-2000A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 13.8-500-7-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G004	0236C0790G009
AM 13.8-500-7-2000A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 13.8-750-4-1200A	0114C5382P004				0114C5382P002	0227A5306G001	0213X0344G031
AM 13.8-750-4-2000A	0114C5382P004				0114C5382P002	0227A5306G001	0213X0344G031
AM 13.8-750-5-1200A	0114C5382P004				0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-750-5-2000A	0114C5382P004				0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-750-6-1200A	0114C5382P004				0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-750-6-2000A	0114C5382P004				0114C5382P002	0227A5306G001	0213X0344R032

For quantity of contacts
per breaker consult section II



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

MAGNE-BLAST® CIRCUIT BREAKER CONTACTS (con't)

BREAKER RATING & DASH #	MOVABLE PRIMARY CONTACT	MOVABLE PRIMARY CONTACT	MOVABLE PRIMARY CONTACT	MOVABLE PRIMARY CONTACT	STATIONARY PRIMARY CONTACT	MOVABLE ARCING CONTACT	STATIONARY ARCING CONTACT
HIGH MOMENTARY RATINGS:							
AM 4.16-250B-7-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0802B0742R003	0236C0790G009
AM 4.16-250B-7-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0802B0742R003	0236C0790G009
AM 4.16-250B-8-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G004	0236C0790G009
AM 4.16-250B-8-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G004	0236C0790G009
AM 4.16-250B-9-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G004	0236C0790G009
AM 4.16-250B-9-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G004	0236C0790G009
AM 7.2-500B-6-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R032
AM 7.2-500B-6-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-500B-6-1200A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 13.8-500B-6-2000A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 13.8-500B-7-1200A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 13.8-500B-7-2000A	0114C5382P004				0114C5382P002	0227A5306G004	0236C0790G009
AM 13.8-750B-4-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R031
AM 13.8-750B-4-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R031
AM 13.8-750B-5-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-750B-5-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-750B-6-1200A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R032
AM 13.8-750B-6-2000A	0137A9164P003	0137A9164P004			0114C5382P002	0227A5306G001	0213X0344R032


GE/Vac® CIRCUIT BREAKER VACUUM INTERRUPTERS

BREAKER
RATING

INTERRUPTER

VVC 4.16-250-1200/2000A
VVC 7.2-500-1200/2000A
VVC 13.8-500-1200/2000A
VVC 13.8-750-1200/2000A
VVC 13.8-1000-1200A
VVC 13.8-1000-2000A
VVC 13.8-1000-3000A

0186L0739P056
0186L0739P041
0186L0739P055
0186L0739P041
0186L0739P044
0186L0739P044
0186L0739P043



TYPE VVC 13.8-500 MVA CIRCUIT BREAKER



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

MAGNE-BLAST® & GE/Vac® CIRCUIT BREAKER COILS, SWITCHES, COUNTERS, & RELAYS

<u>CLOSING COILS:</u>	
VOLTAGE	
48 DC	006174582G034
110/125 DC	006174582G001
220 DC	006174582G015
250 DC	006174582G002
115 AC	006174582710
230 AC	006174582G014
<u>TRIPPING COILS:</u>	
24 DC	006275070G001
32 DC	006275070G003
48 DC	006174582G034
125 DC	006174582G001
220 DC	006174582G015
250 DC	006174582G002
115 AC	006174582G013
230 AC	006174582732
<u>CURRENT TRIP COIL:</u>	
(3 Amps)	006174599G002
<u>UNDERVOLTAGE COILS:</u>	
115 AC	006275017G016
230 AC	006275017G012
48 DC	006275017G045
125 DC	006275017G015
250 DC	003241202P001


<u>AUXILIARY SWITCH</u>		
ALL RATINGS		0137A9192R011
<u>MICRO SWITCHES</u>		
NORMALLY OPEN		0456A0866P005
NORMALLY CLOSED		0456A0866P006
<u>OPERATION COUNTERS</u>		
SIZE		
STANDARD (ALL)		0161A5802R001
LARGE (ALL)		0114C5316G001
<u>RELAYS</u>		
CLOSING VOLTAGE	HZ	
48 DC	—	0137A7575P004
110 DC	—	0137A7575P001
125 DC	—	0137A7575P001
220 DC	—	0108B5565R004
250 DC	—	0108B5565R004
115 AC	60	0137A7575P005
230 AC	60	0137A7575P002
230 AC	50	0137A7575P009




GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

MAGNE-BLAST® & GE/Vac® CIRCUIT BREAKER ML-13 STORED ENERGY MECHANISM SPRINGS


DESCRIPTION	BREAKER RATINGS	REF. NO.	CATALOG NUMBER
PROP SPRING	ALL	15	0137A9252P001
PROP SPRING #2	ALL VVC & ALL MAGNE-BLAST WITH DUAL SPRINGS	16	006071231P001
TRIP LATCH SPRING	ALL	19	0137A9262P001
RESET SPRING	ALL	20	0137A9261P001
CLOSING LATCH SPRING (TENSION TYPE)	ALL MAGNE-BLAST BEFORE 1980	74	0161A4231P001
CLOSING LATCH SPRING (TORSION TYPE)	ALL VVC & MAGNE-BLAST AFTER 1980	17	0257A6973P001
DRIVING PAWL SPRING	ALL	51	0161A4241P001
PAWL SPRING	ALL	89	0161A5909P001

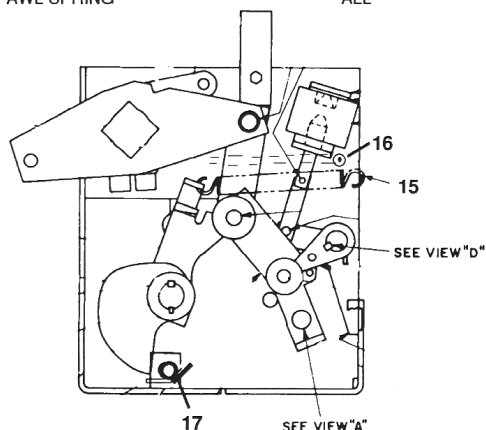


A. Sectional side view




VIEW A



VIEW D

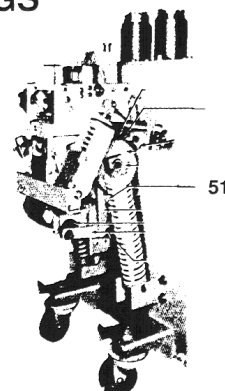

Right side view



Left side view



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA


MECHANISM BEARING REPLACEMENT KITS

MECHANISM BEARING KITS

Type Mechanism	Description	Kit Catalog Number
ML-13	Replaces fibre or aluminum bronze bearings with aluminum bronze.	0156C9403G001
MS-13	Replaces fibre and oil impregnated bearings with aluminum bronze.	0172C7847G001
ML-11	Replaces fibre and oil impregnated bearings with aluminum bronze.	0172C7848G001
ML-12	Replaces fibre and oil impregnated bearings with aluminum bronze.	0172C7849G001

Installation instructions are included
with each kit.

These kits are factory recommended for replacements.

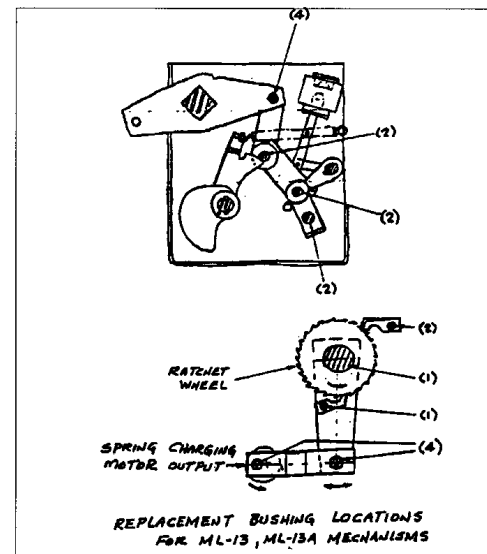



Numbers in above figure represent
quantity of bearings



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

ML-13 MECHANISM RENEWAL PARTS

DESCRIPTION	RATING	QTY	REF NO.	CATALOG NUMBER
LINK	ALL	1	3	0213X0702G012
LINK	A	2	4	0213X0702G020
LINK	B	2	4	0134C3585P003
LINK	ALL	1*	5	0213X0702G021
CAM	ALL	1	7	0105C9311G002
STOP PIN	ALL	1	9	0105C9304P003
BUSHING	ALL	2	10	0456A0885P021
LATCH (TRIP)	ALL	1	11	0105C9302R002
PIN (PROP)	ALL	1	12	0105C9302P004
PROP SPRING	ALL	1	15	0137A9252P001
PROP SPRING #2	SEE PG 12 FIG 16			006071231P001
SHAFT	ALL	1	18	0105C9308P004
COIL SUPPORT	ALL	1	25	0105C9316P002
ARMATURE	ALL	1	26	0114C5347P004
CRANK	ALL	1	28	0105C9316G001
BEARING (O.R.)	ALL	1	35	0414A0112P052
BEARING (I.R.)	ALL	1	36	0414A0112P053
BEARING (O.R.)	ALL	2	39	0414A0112P061
BEARING (O.R & I.R.)	A	1	40	0414A0112P001
BEARING (O.R & I.R.)	B	1	40	0414A0112P054
TRIP COIL	1	46	SEE PAGE 11	

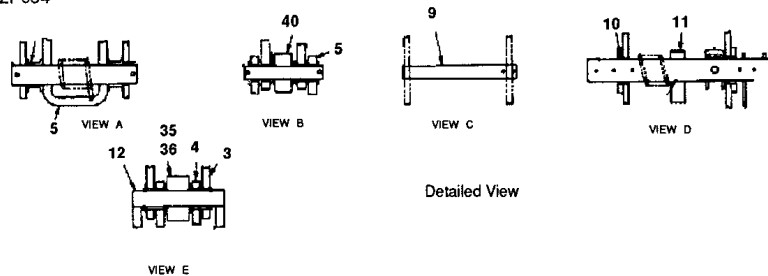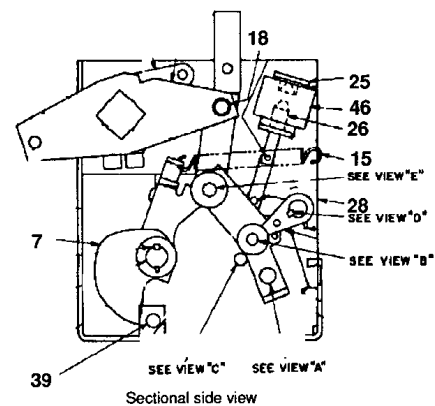

A.) ALL EXCEPT 13.8-1000MVA

B.) 13.8-1000 MVA ONLY





* USE QTY 2 ON 13.8-1000 MVA ONLY



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

ML-13 MECHANISM RENEWAL PARTS

DESCRIPTION	RATING	QTY	REF. NO.	CATALOG NUMBER
INDICATOR (OPEN/CL)	ALL	1	49	0105C9308G002
INDICATOR (CHG/DIS.)	ALL	1	66	0105C9306G002
PAWL (DRIVING)	ALL	1	50	0213X0702R016
PAWL SPRING	ALL	1	51	0161A4241P001
RATCHET WHEEL	ALL	1	52	0105C9310G002
BEARING BLOCK	ALL	2	53	0213X0702G022
CRANK	ALL	1	55	0257A6975G001
PAWL (OUTSIDE)	ALL	1	58	0213X0702R014
PAWL (INSIDE)	ALL	1	59	0213X0702R015
CAM	ALL	1	63	0105C9311G002
SWITCH (N.C.)	ALL	1	88	0456A0866P006
SWITCH (N.O.)	ALL	1	69	0456A0866P005
LATCH (CLOSING)	ALL	1	71	0114C5342G001
CLOS.LATCH SPRING	ALL	1	74	0161A4231P001
RELAY		1	77	SEE PAGE 11
CLOSING COIL		1	78	SEE PAGE 11
MOTOR		1	81	SEE PAGE 8
MOTOR MOUNT	ALL	1	83	0105C9313G001
AUXILIARY SWITCH	ALL	1	85	0137A9192R011
LATCH CK. SWITCH	ALL	1	86	0161A4282R001
PAWL SPRING	ALL	2	89	0161A5909P001
CL. LATCH ROLLER	ALL	1	93	0414A0112P058

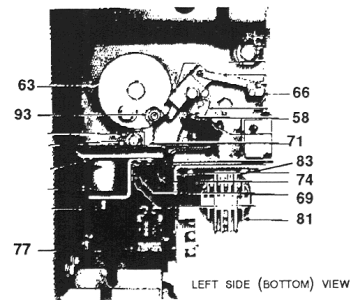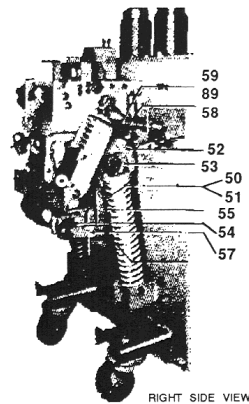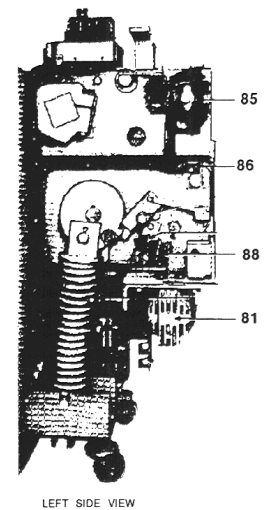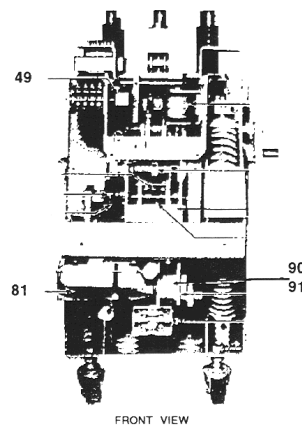



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

ML-13 MECHANISM RENEWAL PARTS

CURRENT TRIP AND UNDERVOLTAGE DEVICE

DESCRIPTION	RAT- ING	QTY	CATALOG NUMBER
UNDERVOLTAGE COIL		1	SEE PG 11
CURRENT TRIP COIL	ALL	3	006174599G002
CUTOFF SWITCH, AC	ALL	1	006275259R001
CUTOFF SWITCH, DC	ALL	1	006275259R002

SPRING RELEASE

			Ref. No.	
CRANK	C	1	153	0114C5343G002
CRANK	D	1	153	0114C5343G003

C.) 4.16-250 & 350 MVA ONLY
D.) ALL 7.2 & 13.8 RATINGS



PLUNGER INTERLOCK

COMPLETE ASSEMBLY	ALL	1	5	0105C9305R001
-------------------	-----	---	---	---------------


SECONDARY DISCONNECT DEVICE(MALE)

COMPLETE ASSEMBLY	ALL	1	180	0108B1931R005
CONTACT PIN	ALL	16	181	006319964P002
CONTACT BASE	ALL	1	183	006505244P001

NON-CHAIN DRIVE

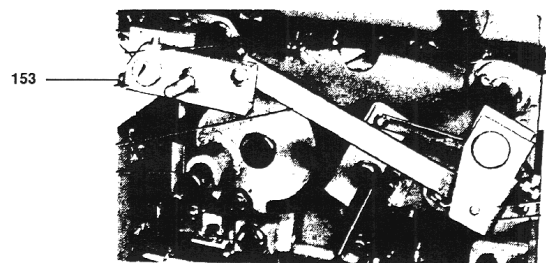

Spring release

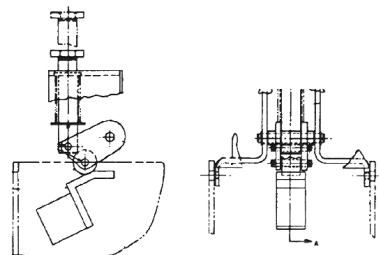

Side view

Plunger interlock (Ref. 5)

SECONDARY DISCONNECT DEVICE(FEMALE)

SOLENOID MECHANISM	0237C0473G010
ML-13 MECHANISM	0237C0473G011





GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

ML-13 MECHANISM RENEWAL PARTS

DESCRIPTION:

			NON -CHAIN DRIVE	CHAIN DRIVE
	QTY	REF. NO.		
ECCENTRIC	1	01	0165B7926P001	0153B5208P001
LINK (INCL. BUSHING)	1	02	0213X0702G018	0934D0136G003
BEARING	2	03	0414A0112P059	0414A0112P097
BEARING INNER RACE	2	04	0414A0112P060	0414A0112P100

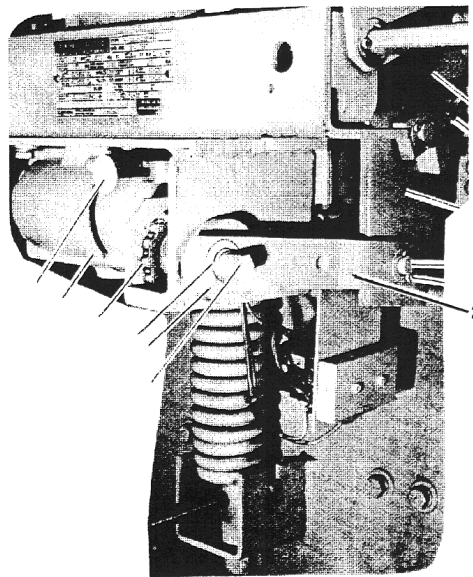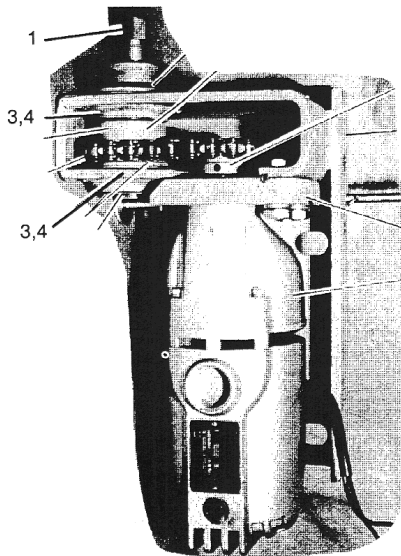




GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

METAL-CLAD SWITCHGEAR BREAKER ELEVATING MOTORS

		ORIGINAL NUMBER ON MOTOR NAME PLATE OR ENG'R SUMMARY		REPLACEMENT NUMBER
<u>VOLTAGE</u>				
115V AC/125V DC	0149C9619G002	OR	0243C0492G001	0685C0810G004
115V AC/125V DC	0149C9619G006	OR	0243C0492G001	0685C0810G004
115V AC/125V DC	0149C9619G007	OR	0243C0492G001	0685C0810G004
115V AC/125V DC	0149C9620P002	OR	0243C0492G001	0685C0810G004
230V AC/250V DC	0149C9619G004	OR	0243C0492G003	0685C0810G005
230V AC/250V DC	0149C9619G008	OR	0243C0492G003	0685C0810G005
230V AC/250V DC	0149C9619G009	OR	0243C0492G003	0685C0810G005
230V AC/250V DC	0149C9620P004	OR	0243C0492G003	0685C0810G005
REMOTE ELEVATING MOTORS:				
115V AC/125V DC	0687C0879G008	OR	0243C0492G001	0687C0879G001
230V AC/250V DC	0687C0879G009	OR	0243C0492G003	0687C0879G003

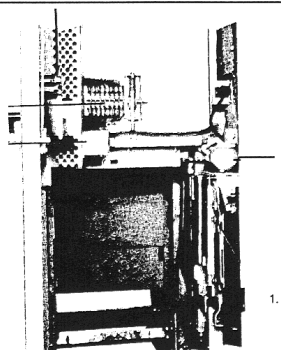

1. Elevating Motor






GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

METAL-CLAD SWITCHGEAR ELEVATING MECHANISMS

EQUIP DESIG.	BREAKER RATING	FIG. NO.	LEFT HAND	RIGHT HAND
M26	4.16-250-1200	1	0834C0194G009	0834C0194G008
M26	4.16-250-2000	1	0834C0194G009	0834C0194G008
M26H	4.16-350-1200	1	0832C0481G002	0832C0481G001
M26H	4.16-350-2000	1	0832C0481G002	0832C0481G001
M26H	4.16-350-3000	2	0685C0957G005	0685C0957G004
M36	7.2-500-1200	1	0834C0194G010	0834C0194G007
M36	7.2-500-2000	2	0829C0485G009	0829C0485G008
M36	13.8-500-1200	1	0834C0194G010	0834C0194G007
M36	13.8-500-2000	2	0829C0485G009	0829C0485G008
M36HN	13.8-750-1200	1	0834C0194G010	0834C0194G007
M36HN	13.8-750-2000	2	0829C0485G009	0829C0485G008
M36H	13.8-750-1200	2	0265C0267G004	0265C0267G005
M36H	13.8-750-2000	2	0265C0267G004	0265C0267G005
M36HH	13.8-1000-1200	3	0828C0486G004	0828C0486G003
M36HH	13.8-1000-2000	3	0828C0486G004	0828C0486G003
M36HH	13.8-1000-3000	3	0828C0486G002	0828C0486G001

Component parts for elevating mechanisms are also available. Please supply equipment summary number with request.

Elevating mechanisms are also available for pre-1968 switchgear. Please supply summary number from equipment nameplate for identification purposes.

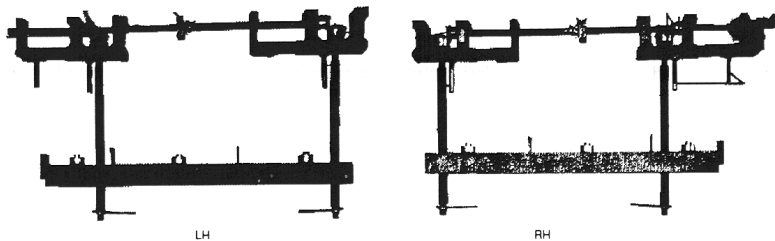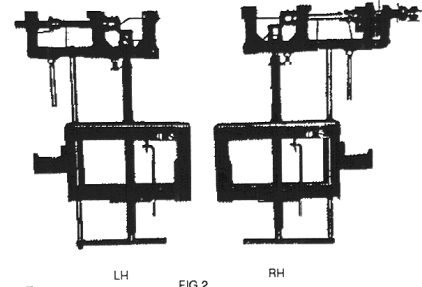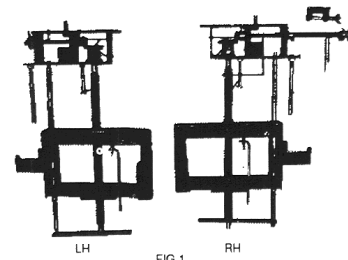






GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

METAL-CLAD SWITCHGEAR FRONT & REAR PRIMARY DISCONNECTS

Primary disconnects are available for:

M26
M26H
M36
M36H
M36HN
M36HH

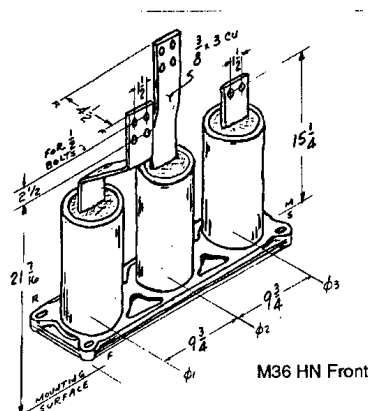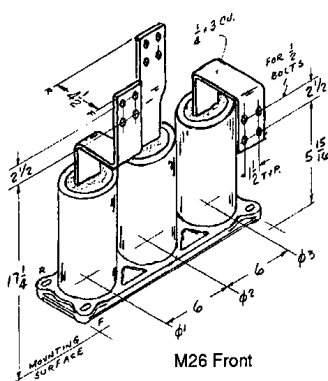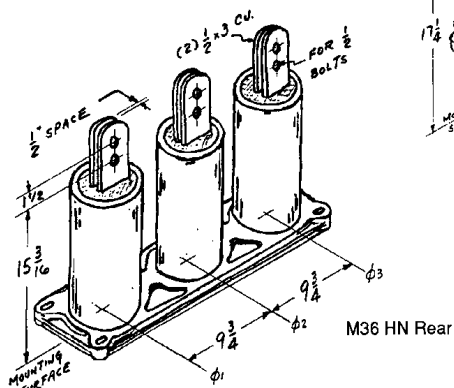


FRONT AND REAR PRIMARY DISCONNECTS ARE MANUFACTURED BY GE.
DUE TO THE UNIQUENESS OF SWITCHGEAR CUBICLES, IT IS NOT POSSIBLE TO PUBLISH A STANDARD
LIST. PLEASE FURNISH NAMEPLATE SUMMARY NUMBER AND UNIT NUMBER WITH YOUR REQUEST.



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

METAL-CLAD SWITCHGEAR POSITIVE INTERLOCKS

BREAKER RATING	EQUIP. DESIGN	CATALOG NUMBER
4.16-250-1200	M26	006519802G002
4.16-250-2000	M26	006519802G002
4.16-350-1200	M26H	006517965G004
4.16-350-2000	M26H	006517965G004
4.16-350-3000	M26H	006517965G006
7.2-500-1200	M36	006517965G005
7.2-500-2000	M36	006517965G004
13.8-750-1200	M36H	0265C0235G002
13.8-750-2000	M36H	0265C0235G002
13.8-500-1200	M36	006517965G005
13.8-500-2000	M36	006517965G004
13.8-750-1200	M36HN	006517965G005
13.8-750-2000	M36HN	006517965G004
13.8-1000-1200	M36HH	0829C0463G001
13.8-1000-2000	M36HH	0829C0463G001
13.8-1000-3000	M36HH	0829C0463G001

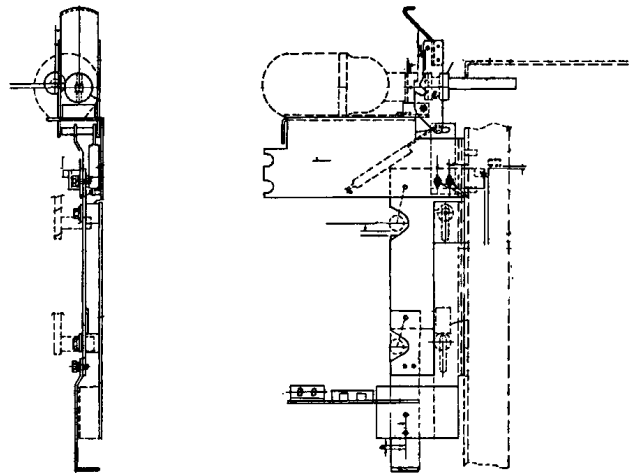


Positive Interlock Assembly for M36




METAL-CLAD SWITCHGEAR RENEWAL PARTS

GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA


CHAINS:



Rating:	
4.16-250-1200/2000A	0226A8265P003
7.2-500-1200A	0226A8265P004
13.8-500-1200A	0226A8265P004
13.8-750-1200A	0226A8265P004
7.2-500-2000A	0226A8265P025
13.8-500-2000A	0226A8265P025
13.8-750-2000A	0226A8265P025

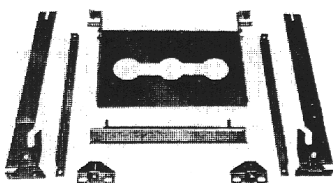


Shutter mechanism M-26

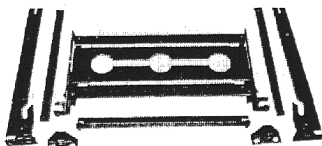

Shutter mechanism M-36

Shutter assemblies are available
for most switchgear.
Submit your nameplate data with
request

DOOR HANDLES:




REF.
NO.

1	DOOR HANDLE	006533892P001
2	DOOR HANDLE	006533892P002
3	DOOR HANDLE	006533892P003
4	DOOR HANDLE	006533892P004
5	DOOR HANDLE	006533892P005



METAL-CLAD SWITCHGEAR RENEWAL PARTS

GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA




Auto-charged capacitor trip device

0177C3941701



Capacitor trip device

0105C9380G003




Silicon rectifiers for circuit breaker
closing service

0962C0670G001 for up to 65 Amps
0105C3009G001 for 65 Amps and above

HEATERS:

115V, 250W	0269A3691AAP042
230V, 250W	0269A3690612



FUSE BLOCKS:

30 AMP, 250V	0132A1578001	297
60 AMP, 250V	0132A1578002	254



MERCURY SWITCHES:

CUBICLE POSITION:

UPPER	0172C7622G001
LOWER	0172C7622G002
FRONT ENCLOSURE	0172C7622G003
ALL THREE	0172C7622G004





134.00
134.00
134.00(R)
369.00
399.00



METAL-CLAD SWITCHGEAR BUS INSULATION, TAPE, GREASE, & VARNISH

GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

BUS SIZE	BUS INSULATION MATERIALS	
1/4 X 4 X 92 5/8 IN.	0161A5075P001	
3/8 X 4 X 92 5/8 IN.	0161A5076P001	
3/8 X 6 X 92 5/8 IN.	0161A5077P001	
5/8 X 6 X 92 5/8 IN.	0161A5078P001	
1/2 X 6 X 92 5/8 IN.	0161A5080P001	




TAPING KITS:

0172A8835G003 (15KV)
0172A8835G012 (5 KV)


Note: Above represents material for three bus connections.

DESCRIPTION	SIZE	REF. NO.	CATALOG NUMBER
IRRATHENE TAPE	1 1/2" WIDE ROLLS	131	0226A8265P042
GLASS TAPE	1 1/2" WIDE ROLLS	132	0226A8265P046
JOINT COMPOUND	5 LB. BAGS	134	0226A8265P048
RED VARNISH (U-310) 15 KV	QUART CANS	133	0226A8265P050
BLACK VARNISH (U-311) 5 KV	QUART CANS	133	0226A8265P051

Parts shown below must be identified based on the equipment summary and unit number.



Bus support, molded



Bus connection boot (4.16 KV and 13.8 KV)
Specify unit No. and phase on which boot is to be used

GREASE

Catalog Number	GE SPEC.	COLOR	SIZE	Usage
0269A3691AAP108	D50H109	YELLOW	4 oz.	For bus joints when red sleeving is used to insulate the bus.
0269A3691AAP109	D50H15	WHITE	4 oz.	For Magne-Blast breaker mechanism and switchgear lifting mechanism.
0183L0907P037	D6A15A1	RED	4 oz.	Replacement for black D50H47 grease. For sliding contacts and bus joints when insulated with gray sleeving or tape. Also used on GE/Vac breaker mechanisms.

NOTE: All grease is sold in individual tubes of 4 oz. each



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

SWITCHGEAR MODIFICATIONS AVAILABLE

MODIFICATIONS AND UPGRADES

- CURRENT TRANSFORMER RATIO CHANGES
- INSTRUMENT PANEL ADDITIONS
- MATCH AND LINE UP BREAKER COMPARTMENTS
- POTENTIAL OR CONTROL POWER TRANSFORMER ADDITIONS
- SWITCHGEAR MODERNIZATION TO ACCEPT GE/Vac® BREAKERS
- BUS INSULATION REPLACEMENT OR UPGRADE TO PORCELAIN
- BUS DUCT REPLACEMENTS
- UPRATING OF EQUIPMENT TO HIGHER MOMENTARY/INTERRUPTING CAPACITY
- BIFURCATION OF FEEDERS
- FORCED COOLED CURRENT UPGRADES OF BREAKERS

ORIGINAL ENGINEERING DOCUMENTATION AVAILABLE AT GE
PERMANENT RECORDS OF EQUIPMENT MODIFICATIONS ARE RETAINED AT THE FACTORY
EQUIPMENT ENGINEERED AND BUILT TO GE QUALITY STANDARDS



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 4.16-250-6,-7,-8,-9

DESCRIPTION AMPS	NO. REQ.	BREAKER TYPE	CATALOG NO.
---------------------	-------------	-----------------	-------------

FRONT BUSHINGS

1200A	3	250-6,-7,-8,-9	0845D0123G001
2000A	3	250-6,-7,-8,-9	0688C0515G001

REAR BUSHINGS

1200A	3	250-6,-7,-8,-9	0845D0124G001
2000A	3	250-6	0688C0516G001
2000A	3	250-7,-8,-9	0688C0516G006

MOVABLE PRIMARY CONTACTS

1200A	3	250-6	0137A9164P003
1200A	3	250-6	0137A9164P004
2000A	6	250-6	0137A9164P003
2000A	6	250-6	0137A9164P004
ALL	6	250-7,-8,-9	0114C5382P004**
ALL	6	250-7,-8,-9	0137A9164P003*
ALL	6	250-7,-8,-9	0137A9164P004*

STATIONARY PRIMARY CONTACTS

1200A	12	250-6	0236C0791P008
2000A	24	250-6	0236C0791P008
ALL	18	250-7,-8,-9	0114C5382P002
ALL	24	250-7,-8,-9	0114C5382P002

PRIMARY CONTACT SPRINGS

1200A	12	250-6	0121A5964P001
1200A	18	250-9	0414A0180P001**
1200A	24	250-9	0121A5964P001*
2000A	24	250-6	006509787P001
2000A	18	250-9	0121A5964P001**
2000A	24	250-9	0121A5964P001*
ALL	18	250-7,-8	0121A5964P001

DESCRIPTION AMPS	NO. REQ.	BREAKER TYPE	CATALOG NO.
---------------------	-------------	-----------------	-------------

MOVABLE ARCING CONTACTS

ALL	3	250-6,-7	0802B0742R003
ALL	3	250-8,-9	0227A5306G004

STATIONARY ARCING CONTACTS

ALL	3	250-6,-7,-8,-9	0236C0790G009
-----	---	----------------	---------------

FLEXIBLE CONNECTORS (RIGHT)

ALL	3	250-6,-7,-8,-9	0236C0791G001
-----	---	----------------	---------------

FLEXIBLE CONNECTORS (LEFT)

ALL	3	250-6,-7,-8,-9	0236C0791G004
-----	---	----------------	---------------

TUBE & PISTON ASSEMBLY

1200A	3	250-6,-7	0213X0343G043
2000A	3	250-6,-7	0213X0343G044
2000A	3	250-8,-9	0213X0343R091
1200A	3	250-8,-9	0213X0343R090

OPERATING ROD ASSEMBLY

ALL	3	250-6,-7,-8,-9	0281B0708R002
ALL	3	250-9	0281B0708R008*

BOX BARRIERS

ALL	1	250-9	0152C5962R001
ALL	1	250-6,-7,-8	0114C5388R001

BOOSTER CYLINDER

ALL	3	250-6,-7,-8,-9	0619C0444G005
-----	---	----------------	---------------

* ALL BREAKERS WITH "B" DESIGNATION
** ALL BREAKERS EXCEPT "B" DESIGNATION



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 4.16-350-1

DESCRIPTION AMPS	NO. REQ.	CATALOG NO.	DESCRIPTION AMPS	NO. REQ.	CATALOG NO.
FRONT BUSHINGS			MOVABLE ARCING CONTACTS		
1200A	3	0845D0123G002	ALL	3	0802B0742R004
2000A	3	0688C0515G005	STATIONARY ARCING CONTACTS		
3000A	3	0619C0438G002	ALL	3	0383A0903G001
REAR BUSHINGS			FLEXIBLE CONNECTORS		
1200A	3	0845D0124G002	ALL	3	0366A0413G001
2000A	3	0688C0516G007	TUBE & PISTON ASSEMBLY		
3000A	3	0619C0438G001	1200/2000A	3	0213X0343G046
MOVABLE PRIMARY CONTACTS			3000A	3	0619C0473G003
1200A	6	0137A9164P003	OPERATING ROD ASSEMBLY		
1200A	6	0137A9164P004	1200A/2000A	3	0281B0708R008
2000A	6	0137A9164P004	3000A	3	0802B0730R001
2000A	6	0137A9164P003	BOX BARRIERS		
3000A	6	0114C5382P012	1200A/2000A	1	0619C0465G001
3000A	6	0114C5382P011	3000A	3	0619C0467G001
STATIONARY PRIMARY CONTACTS			BOOSTER CYLINDER		
1200A	24	0236C0791P008	ALL	3	0619C0479P017
2000A	24	0236C0791P008			
3000A	36	0236C0791P008			
PRIMARY CONTACT SPRINGS					
1200A	48	0414A0180P001			
2000A	48	0414A0180P001			
3000A	72	0414A0180P001			
MOVABLE TERTIARY CONTACTS					
3000A	6	0619C0469P003			
STATIONARY TERTIARY CONTACTS					
3000A	12	0236C0791P008			



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 4.16-350-2

DESCRIPTION AMPS	NO. REQ.	CATALOG NO.	DESCRIPTION AMPS	NO. REQ.	CATALOG NO.
FRONT BUSHINGS			MOVABLE ARCING CONTACTS		
1200A	3	0845D0123G002	1200/2000A	3	0227A5306G001
2000A	3	0688C0515G005	3000A	3	0227A5306G002
3000A	3	0619C0438G002	STATIONARY ARCING CONTACTS		
REAR BUSHINGS			ALL	3	0213X0344R032
1200A	3	0845D0124G006	FLEXIBLE CONNECTORS		
2000A	3	0688C0516G008	LEFT, LONG	3	0208A8017G001
3000A	3	0619C0438G001	RIGHT, LONG	3	0208A8017G002
MOVABLE PRIMARY CONTACTS			LEFT, SHORT	3	0208A8017G003
1200/2000A	6	0137A9164P005	RIGHT, SHORT	3	0208A8017G004
1200/2000A	6	0137A9164P006	TUBE & PISTON ASSEMBLY		
3000A	6	0114C5382P012	1200/2000A	3	0213X0343R094
3000A	6	0114C5382P011	3000A	3	0132C2748R003
STATIONARY PRIMARY CONTACTS			OPERATING ROD ASSEMBLY		
1200/2000A	24	0114C5382P002	1200A/2000A	3	0281B0708R008
3000A	36	0114C5382P002	3000A	3	0802B0730R001
PRIMARY CONTACT SPRINGS			BOX BARRIERS		
1200/2000A	24	0121A5964P001	1200A/2000A	1	0132C2742G001
3000A	36	0414A0180P001	3000A	3	0619C0467G001
			BOOSTER CYLINDER		
			ALL	3	0132C2745G001



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 7.2-500-6

DESCRIPTION AMPS	NO. REQ.	CATALOG NO.	DESCRIPTION AMPS	NO. REQ.	CATALOG NO.
FRONT BUSHINGS			MOVABLE ARCING CONTACTS		
1200A	3	0845D0123G003	ALL	3	0227A5306G001
2000A	3	0958C0683G003	STATIONARY ARCING CONTACTS		
REAR BUSHINGS			ALL	3	0213X0344R032
1200A	3	0845D0124G003	FLEXIBLE CONNECTORS		
2000A	3	0958C0684G005	LEFT, LONG	3	0208A8017G001
MOVABLE PRIMARY CONTACTS			RIGHT, LONG	3	0208A8017G002
1200/2000A	6	0114C5382P004	LEFT, SHORT	3	0208A8017G003
1200/2000A	6	0137A9164P003*	RIGHT, SHORT	3	0208A8017G004
1200/2000A	6	0137A9164P004*	TUBE & PISTON ASSEMBLY		
STATIONARY PRIMARY CONTACTS			ALL	3	0213X0343R094
1200/2000A	18	0114C5382P002**	OPERATING ROD ASSEMBLY		
1200/2000A	24	0114C5382P002*	ALL	3	0281B0708R001
PRIMARY CONTACT SPRINGS			BOX BARRIERS		
1200/2000A	18	0121A5964P001	ALL	3	0265C0176R005
			BOOSTER CYLINDER		
			ALL	3	0263B0292P002

* ALL BREAKERS WITH "B" DESIGNATION
** ALL BREAKERS EXCEPT "B" DESIGNATION



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 13.8-500-5,-6,-7

DESCRIPTION AMPS	NO. REQ.	BREAKER TYPE	CATALOG NO.
---------------------	-------------	-----------------	-------------

FRONT BUSHINGS

1200A	3	500-5,-6,-7	0845D0123G003
2000A	3	500-5,-6,-7	0958C0683G003

REAR BUSHINGS

1200A	3	500-5,-6,-7	0845D0124G003
2000A	3	500-5	0958C0684G003
2000A	3	500-6,-7	0958C0684G005

MOVABLE PRIMARY CONTACTS

1200A	3	500-5	0137A9164P003
1200A	3	500-5	0137A9164P004
1200A	3	500-6,-7	0137A9164P003**
1200A	3	500-6,-7	0137A9164P004**
1200/2000A	6	500-6,-7	0114C5382P004*
2000A	6	500-5	0137A9164P003
2000A	6	500-5	0137A9164P004
2000A	6	500-6,-7	0114C5382P004

STATIONARY PRIMARY CONTACTS

1200A	12	500-5	0114C5382P002
1200A	12	500-6,-7	0114C5382P002**
1200A	18	500-6,-7	0114C5382P002*
2000A	24	500-5	0114C5382P002
2000A	18	500-6,-7	0114C5382P002

PRIMARY CONTACT SPRINGS

1200A	12	500-5,-6,-7	0414A0180P001**
1200A	24	500-5	0121A5964P001*
1200A	18	500-6,-7	0121A5964P001*
2000A	24	500-5	006509787P001
2000A	18	500-6,-7	0121A5964P001

* ALL BREAKERS WITH "B" DESIGNATION
** ALL BREAKERS EXCEPT "B" DESIGNATION

DESCRIPTION AMPS	NO. REQ.	BREAKER TYPE	CATALOG NO.
---------------------	-------------	-----------------	-------------

MOVABLE ARCING CONTACTS

ALL	3	500-5	0802B0742R003
ALL	3	500-6,-7	0227A5306G004

STATIONARY ARCING CONTACTS

ALL	3	500-5,-6,-7	0236C0790G009
-----	---	-------------	---------------

FLEXIBLE CONNECTORS (RIGHT)

ALL	3	500-5,-6,-7	0236C0791G001
-----	---	-------------	---------------

FLEXIBLE CONNECTORS (LEFT)

ALL	3	500-5,-6,-7	0236C0791G004
-----	---	-------------	---------------

TUBE & PISTON ASSEMBLY

1200A	3	500-5	0236C0792R031
2000A	3	500-5	0236C0792G015
1200/2000A	3	500-6	0213X0343R094
1200A	3	500-7	0213X0343R092
2000A	3	500-7	0213X0343R094

OPERATING ROD ASSEMBLY

ALL	3	500-5,-6,-7	0281B0708R001
-----	---	-------------	---------------

BOX BARRIERS

ALL	3	500-5,-6	0265C0176G001
ALL	3	500-7	0152C5910R001

BOOSTER CYLINDER

ALL	3	500-5,-6,-7	0263B0292P002
-----	---	-------------	---------------



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 13.8-750-4

DESCRIPTION AMPS	NO. REQ.	CATALOG NO.	DESCRIPTION AMPS	NO. REQ.	CATALOG NO.
FRONT BUSHINGS			MOVABLE ARCING CONTACTS		
1200A	3	0845D0123G004	ALL	3	0227A5306G001
2000A	3	0265C0188G007	STATIONARY ARCING CONTACTS		
REAR BUSHINGS			ALL	3	0213X0344G031
1200A	3	0845D0124G007	FLEXIBLE CONNECTORS		
2000A	3	0132C2725G001	RIGHT, LONG	3	0208A8017G002
MOVABLE PRIMARY CONTACTS			RIGHT, SHORT	3	0208A8017G004
1200/2000A	6	0114C5382P004**	LEFT, LONG	3	0208A8017G001
1200/2000A	6	0137A9164P003*	LEFT, SHORT	3	0208A8017G003
1200/2000A	6	0137A9164P004*	TUBE & PISTON ASSEMBLY		
STATIONARY PRIMARY CONTACTS			ALL	3	0213X0343R093
1200A	18	0114C5382P002**	OPERATING ROD ASSEMBLY		
1200A	24	0114C5382P002*	ALL	3	0281B0708R001**
PRIMARY CONTACT SPRINGS			ALL	3	0281B0708R007*
ALL	18	0121A5964P001**	BOX BARRIERS		
ALL	24	0121A5964P001*	ALL	3	0619C0419G008
			BOOSTER CYLINDER		
			ALL	3	0263B0292P002

* ALL BREAKERS WITH "B" DESIGNATION
** ALL BREAKERS EXCEPT "B" DESIGNATION



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 13.8-750-5,-6

DESCRIPTION AMPS	NO. REQ.	CATALOG NO.	DESCRIPTION AMPS	NO. REQ.	CATALOG NO.
FRONT BUSHINGS			MOVABLE ARCING CONTACTS		
ALL	3	0845D0123G003	ALL	3	0227A5306G001
ALL	3	0958C0683G003	STATIONARY ARCING CONTACTS		
REAR BUSHINGS			ALL	3	0213X0344R032
ALL	3	0845D0124G003	FLEXIBLE CONNECTORS		
ALL	3	0958C0684G005	RIGHT, LONG	3	0208A8017G002
MOVABLE PRIMARY CONTACTS			RIGHT, SHORT	3	0208A8017G004
ALL	6	0114C5382P004**	LEFT, LONG	3	0208A8017G001
ALL	6	0137A9164P003*	LEFT, SHORT	3	0208A8017G003
ALL	6	0137A9164P004*	TUBE & PISTON ASSEMBLY		
STATIONARY PRIMARY CONTACTS			ALL	3	0213X0343R094
ALL	18	0114C5382P002**	OPERATING ROD ASSEMBLY		
ALL	24	0114C5382P002*	ALL	3	0281B0708R001
PRIMARY CONTACT SPRINGS			ALL	3	0165B7903G007*
ALL	18	0121A5964P001**	BOX BARRIERS		
ALL	24	0121A5964P001*	ALL	3	0265C0176R006
			BOOSTER CYLINDER		
			ALL	3	0263B0292P002

* ALL BREAKERS WITH "B" DESIGNATION
** ALL BREAKERS EXCEPT "B" DESIGNATION



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 13.8-1000-3

DESCRIPTION AMPS	NO. REQ.	CATALOG NO.	DESCRIPTION AMPS	NO. REQ.	CATALOG NO.
FRONT BUSHINGS			MOVABLE ARCING CONTACTS		
1200A	3	0845D0123G005	1200/2000A	3	0966C0353G001
2000A	3	0958C0683G003	3000A	3	0966C0353G002
3000A	3	0688C0514G002	STATIONARY ARCING CONTACTS (INCLUDES FLEX CONN.)		
REAR BUSHINGS			1200/2000A	3	0966C0354R002
1200A	3	0845D0124G005	3000A	3	0966C0354G003
2000A	3	0958C0684G003	FLEXIBLE CONNECTORS		
3000A	3	0688C0514G001	RIGHT	3	0966C0351G004
MOVABLE PRIMARY CONTACTS			FLEXIBLE CONNECTORS		
1200/2000A	3	0688C0595P022	LEFT	3	0966C0351G003
1200/2000A	3	0688C0595P021	TUBE & PISTON ASSEMBLY		
1200/2000A	3	0137A9164P004	1200/2000A	3	0213X0343G048
1200/2000A	3	0137A9164P003	3000A	3	0966C0355G006
3000A	3	0688C0595P023	OPERATING ROD ASSEMBLY		
3000A	3	0688C0595P024	1200/2000A	3	0281B0708R007
3000A	3	0114C5382P011	3000A	3	0688C0520G001
3000A	3	0114C5382P012	BOX BARRIERS		
STATIONARY PRIMARY CONTACTS			1200A	3	0105C9373G001
1200/2000A	24	0236C0791P008	2000A	3	0105C9373G003
3000A	36	0236C0791P008	3000A	3	0105C9373G002
PRIMARY CONTACT SPRINGS			BOOSTER CYLINDER		
1200/2000A	24	0414A0180P001	1200/2000A	3	0114C5308G003
3000A	36	0414A0180P001	3000A	3	0114C5308G004
MOVABLE TERTIARY CONTACTS					
3000A	6	0619C0469P003			
STATIONARY TERTIARY CONTACTS					
3000A	12	0236C0791P008			



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

AM BREAKER 13.8-1000-4


DESCRIPTION AMPS	NO. REQ.	CATALOG NO.	DESCRIPTION AMPS	NO. REQ.	CATALOG NO.
FRONT BUSHINGS			MOVABLE ARCING CONTACTS		
1200A	3	0845D0123G004	1200/2000A	24	0227A5306G001
2000A	3	0265C0188G007	3000A	36	0227A5306G003
3000A	3	0688C0514G006	STATIONARY ARCING CONTACTS		
REAR BUSHINGS			ALL	3	0213X0344R032
1200A	3	0845D0124G007	FLEXIBLE CONNECTORS		
2000A	3	0132C2725G001	RIGHT, LONG	3	0208A8017G002
3000A	3	0688C0514G005	RIGHT, SHORT	3	0208A8017G004
MOVABLE PRIMARY CONTACTS			LEFT, LONG	3	0208A8017G001
1200/2000A	6	0137A9164P003	LEFT, SHORT	3	0208A8017G003
1200/2000A	6	0137A9164P004	TUBE & PISTON ASSEMBLY		
3000A	6	0114C5382P012	1200/2000A	3	0213X0343R094
3000A	6	0114C5382P011	3000A	3	0132C2748R003
STATIONARY PRIMARY CONTACTS			OPERATING ROD ASSEMBLY		
1200/2000A	24	0114C5382P002	1200/2000A	3	0281B0708R001
3000A	36	0114C5382P002	3000A	3	0134C3582R001
PRIMARY CONTACT SPRINGS			BOX BARRIERS		
1200/2000A	24	0121A5964P001	1200A	3	0105C9373G001
3000A	36	0414A0180P001	2000A	3	0105C9373G003
MOVABLE TERTIARY CONTACTS			3000A	3	0105C9373G002
3000A	6	0619C0469P003	BOOSTER CYLINDER		
STATIONARY TERTIARY CONTACTS			ALL	3	0263B0292P002
3000A	12	0114C5382P002			



GE POWER DELIVERY AND CONTROL
PHILADELPHIA, PENNSYLVANIA

GE /Vac® CIRCUIT BREAKERS

BREAKER TYPE	AMPS	FRONT BUSHINGS	REAR BUSHINGS	OPERATING ROD ASSEMBLY	VACUUM INTERRUPTERS
4.16-250-0	1200A	0845D0123G001	0845D0124G001	0172C7625G001	0186L0739P056
	2000A	0688C0515G001	0688C0516G006	0172C7625G001	0186L0739P056
4.16-250-1	1200A	0845D0123G001	0845D0124G001	0172C7624G001	0186L0739P056
	2000A	0688C0515G001	0688C0516G006	0172C7624G001	0186L0739P056
7.2-500-0	1200A	0845D0123G003	0845D0124G003	0172C7624G001	0186L0739P041
	2000A	0958C0683G003	0958C0684G005	0172C7624G001	0186L0739P041
7.2-500-1	1200A	0845D0123G003	0845D0124G003	0172C7624G001	0186L0739P041
	2000A	0958C0683G003	0958C0684G005	0172C7624G001	0186L0739P041
13.8-500-0	1200A	0845D0123G003	0845D0124G003	0172C7624G001	0186L0739P055
	2000A	0958C0683G003	0958C0684G005	0172C7624G001	0186L0739P055
13.8-500-1	1200A	0845D0123G003	0845D0124G003	0172C7624G001	0186L0739P055
	2000A	0958C0683G003	0958C0684G005	0172C7624G001	0186L0739P055
13.8-750-0	1200A	0845D0123G003	0845D0124G003	0172C7624G001	0186L0739P041
	2000A	0958C0683G003	0958C0684G005	0172C7624G001	0186L0739P041
13.8-750-0L	1200A	0845D0123G004	0845D0124G007	0172C7624G001	0186L0739P041
	2000A	0265C0188G007	0132C2725G001	0172C7624G001	0186L0739P041
13.8-750-1	1200A	0845D0123G003	0845D0124G003	0172C7624G001	0186L0739P041
	2000A	0958C0683G003	0958C0684G005	0172C7624G001	0186L0739P041
13.8-750-1L	1200A	0845D0123G004	0845D0124G007	0172C7624G001	0186L0739P041
	2000A	0265C0188G007	0132C2725G001	0172C7624G001	0186L0739P041
13.8-1000-0	1200A	0845D0123G004	0845D0124G007	0172C7624G003	0186L0739P044
	2000A	0265C0188G007	0132C2725G001	0172C7624G003	0186L0739P044
	3000A	0172C7638G002	0172C7638G001	0172C7624G003	0186L0739P043
13.8-1000-1	1200A	0845D0123G004	0845D0124G007	0172C7624G003	0186L0739P044
	2000A	0265C0188G007	0132C2725G001	0172C7624G003	0186L0739P044
	3000A	0172C7638G002	0172C7638G001	0172C7624G003	0186L0739P043

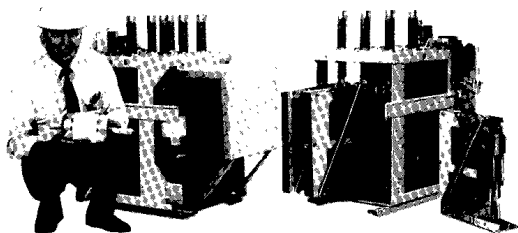

***We Haven't Stopped Thinking About Your
Need to Modernize Either...***

Consideration should be given to replacing the entire assembly or the complete breaker if it has been subjected to abnormal, repetitive switching -- or has been installed in harsh environments.

There is now a GE vacuum breaker that will replace aging Magne-Blast breakers, extending the advantages of vacuum interruption to all GE vertical lift switchgear installations. Designed for direct replacement, GE/Vac breakers of the same rating can be rolled into the switchgear compartment and engaged without modification to the switchgear components. In a short time, GE/Vac breakers and vacuum interruption will reduce maintenance time and expense as there is less deterioration of switch contacts. For certain applications, the GE/Vac advantage will enable you to uprate to a higher interrupting capacity. For example, at 13.8 kV you can uprate from 500 to 750 Mva. Catalog numbers for the complete GE/Vac breakers are listed on Page 5.



Whichever you choose -- individual parts -- major assemblies -- or complete breakers, you will receive components that meet original GE design specifications, a major assist towards extending the service life of your GE metalclad lineup.

We have more than 11,000 Renewal Parts
for current and obsolete breakers and equipment...
manufactured from GE's original design.

Faint, illegible text, possibly a stamp or header.



Breaker Plant Operation

*6901 Elmwood Ave.
Philadelphia, Pa. 19142
215-726-2515*