



INSTRUCTIONS

Kalernicz
412-963
5181

TYPE DB-75 "DE-ION"

AIR CIRCUIT BREAKER

3000 AMPERE FRAME SIZE

600 Volts A-C
250 Volts D-C

INTERRUPTING RATING

75,000 Amperes - 600 Volts A-C
100,000 Amperes - 250 Volts A-C

November, 1956

I.B. 35-240-1

WESTINGHOUSE ELECTRIC CORPORATION


Switchgear Division - East Pittsburgh Plant, East Pittsburgh, Pa.

TABLE OF CONTENTS

| Description | Page |
|---|------|
| PART I - RECEIVING, HANDLING, AND STORING | |
| Inspection | 6 |
| Storing | 7 |
| PART II - INSTALLATION | |
| Connections | 7 |
| PART III - MAINTENANCE | |
| Pole Unit | 11 |
| Contacts | 11 |
| Maintenance of Contacts | 12 |
| Operating Mechanism | 12 |
| Closing Solenoid | 12 |
| Overcurrent Tripping Device | 12 |
| 1. Construction | 15 |
| 2. Installation and Removal | 15 |
| 3. Operation | 15 |
| 4. Time Current Characteristics | 20 |
| 5. Adjustment of Calibration Settings | 20 |
| 6. Maintenance | 20 |
| Control Relay | 22 |
| Shunt Trip Attachment | 22 |
| Undervoltage Trip Attachment | 23 |
| Undervoltage Time Delay Attachment | 24 |
| Auxiliary Switch | 24 |
| Alarm Switch Attachment | 25 |
| Electric Lockout Attachment | 25 |
| Key Lock Attachment | 25 |
| Key Interlock Attachment | 29 |
| Rectifier Unit for A-C Undervoltage and A-C Electric Lockout Attachments | 29 |

LIST OF ILLUSTRATIONS

| Figure | | Page |
|--------|--|------|
| 1 | DB-75 Outline and Mounting Dimensions | 8 |
| 2 | Typical Wiring Diagrams | 9 |
| 3 | Cross-Sectional View of Type DB-75 Circuit Breaker | 10 |
| 4 | Adjusting Limits of Main and Arcing Contacts for DB-75 Circuit Breakers | 11 |
| 5 | Closing Solenoid - Construction Details | 13 |
| 6 | Cross-sectional View of Overcurrent Tripping Device with Long Delay and Instantaneous elements | 14 |
| 7 | Schematic and Typical Time-Current Characteristics of Overcurrent Tripping Device with Long Delay and Instantaneous Elements | 16 |
| 8 | Cross-Sectional View of Overcurrent Tripping Device With Long Delay and Short Delay Elements | 17 |
| 9 | Schematic and Typical Time-Current Characteristics of Overcurrent Tripping Device with Long Delay and Short Delay Elements | 18 |
| 10A | Schematic Diagram of Overcurrent Tripping Device with Instantaneous Element Only | 19 |
| 10B | Typical Time-Current Characteristics of Overcurrent Tripping Device with Instantaneous Element Only | 20 |
| 11 | Control Relay - Construction Details | 21 |
| 12 | Shunt Trip Attachment - Construction Details | 22 |
| 13 | Undervoltage Trip Attachment - Construction Details | 23 |
| 14 | Undervoltage Time-Attachment - Construction Details | 24 |
| 15 | Auxiliary Switch - Construction Details | 25 |
| 16 | Alarm Switch Attachment - Construction Details | 26 |
| 17 | Electrical Lock-Out Attachment - Construction Details | 27 |
| 18 | Key Lock or Key Interlock Attachment - Construction Details | 28 |
| 19 | Rectifier Unit for A-C Undervoltage and A-C Electrical Lockout Attachments | 30 |

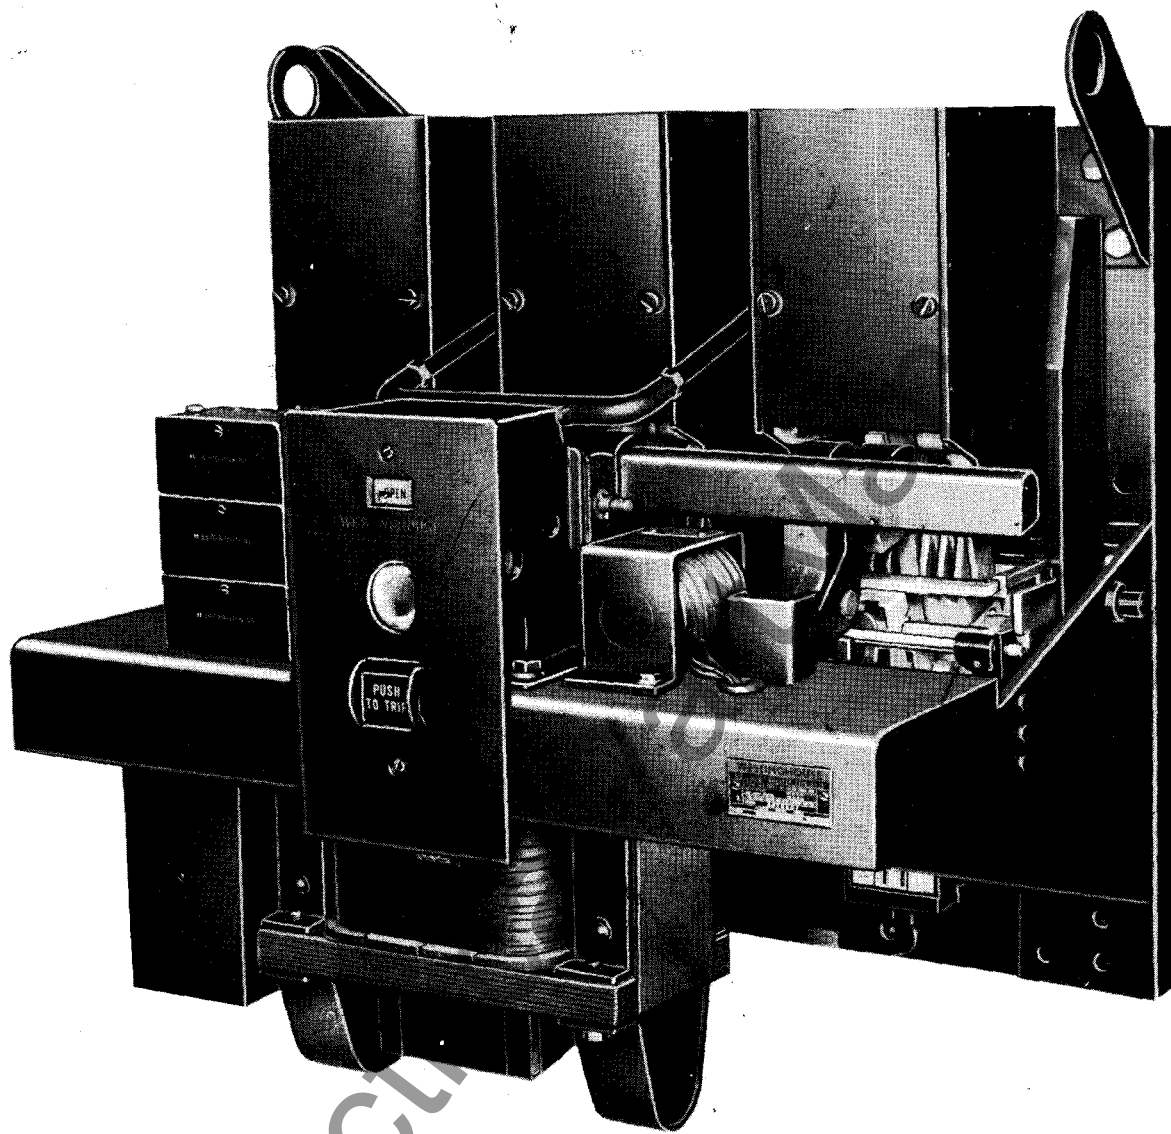

Westinghouse
TYPE "DB" AIR CIRCUIT BREAKER

Type "DB" air circuit breaker is designed to give continuous and reliable service as the protective link between the power source and associated productive equipment. This breaker is built to operate with a minimum of maintenance, while at the same time its simplified construction permits maximum accessibility for inspection and adjustment when required. The ease with which attachments may be added or removed is an outstanding feature of the "DB" design.

For the greatest measure of safety to operating personnel and also to minimize maintenance requirements, the breaker should be mounted in an enclosure suitable to local operating conditions. A selection of standard enclosures is available for various applications.

IMPORTANT: To assure proper functioning, inspect each breaker at regular intervals in accordance with a systematic maintenance schedule. The frequency and character of the inspections will for the most part be determined by the severity of the duty performed. The minimum requirements, however, should consist of a light monthly inspection, with a thorough inspection semi-annually. Occasional checks on calibration as well as on coordination and freedom of all moving parts, must be included in the maintenance schedule. Consult Westinghouse Engineering and Service Personnel for recommendations pertaining to special operating or maintenance conditions.

PART I

RECEIVING, HANDLING AND STORING

Type DB-75 air circuit breakers, are shipped in wooden crates with all attachments mounted in place.

IMPORTANT: To avoid damage to the breakers, DO NOT USE HOOKS in handling.

Net weights of Type DB-75 are given in Table No. 1.

TABLE NO. 1 - NET WEIGHTS

| 2 POLE | 3 POLE |
|----------|----------|
| 400 lbs. | 500 lbs. |

Immediately upon receipt, examine shipment for any loss or damage incurred during shipment. If injury or rough handling is evident, file a damage claim at once with the transportation company and notify the nearest Westinghouse Sales Office.

When unpacking, be sure that no loose parts are missing or left in the packing material. Report all shortages at once. Blow out any dust or particles of packing material that may have accumulated on the circuit breaker parts. Do not remove the cardboard "dust guards" from top of the arc chutes until the breaker is to be placed in service.

INSPECTION

The "DB" breaker assembly consists of a coordinated group of sub-assemblies mounted on an aluminum supporting panel. The complete breaker assembly is to be mounted with the aluminum panel in a vertical position. All inspections for proper operation should, therefore, be made with the breaker in this position. Final inspection should preferably be made with the breaker in its permanent mounting.

Inspect the breaker as follows:

1. Lift trip finger by hand to make sure that it does not bind.

2. Remove any foreign particles from the hinge end of the moving contacts.

3. Insert the maintenance operating handle and slowly close the breaker.

a. Observe whether all parts are in proper alignment and move freely.

b. Be sure that the contacts are clean and properly aligned.

c. The hinge end of the moving contact is lubricated with graphite grease and is therefore black. For a description of contact alignment refer to "CONTACTS", Page (11).

4. If the contacts are in alignment and all parts move freely, continue the closing until the breaker is latched.

5. Hold the maintenance operating handle down. Push the "Push to Trip" button to trip breaker.

a. The toggle linkage should collapse and the moving contact assembly move freely to the full open position. This should be followed by complete resetting of the links in the toggle mechanism as the handle is raised.

b. The links must always be free to move without friction or binding.

6. Check the attachments for operation in accordance with the appropriate instructions as given under "Maintenance". Part III of this book.

NOTE: It is not advisable to lubricate any parts of the breaker. The lubrication supplied during factory assembly is sufficient for

years of service. The lubricant is of a special form which is used sparingly. The addition of oil will only promote the accumulation of dust and dirt.

STORING

If circuit breakers are not to be installed in their permanent locations at once, they

should be carefully inspected for loose or damaged parts and then stored in a clean, dry place in an upright position to avoid damage to the circuit breaker parts. A covering of paper will prevent dust from settling on the circuit breaker parts and is preferred to packing or other materials which are apt to absorb moisture. **FOR SAFETY REASONS, STORE THE BREAKER IN THE OPEN POSITION.**

PART II

INSTALLATION

Type "DB-75" circuit breakers are furnished as complete unit assemblies and the installation consists of: (1) bolting them to the supporting frame work or structure; (2) connecting the current carrying cables or bus bars; and (3) completing any secondary control wiring that may be necessary.

CAUTION: DURING INSTALLATION, THE CIRCUIT BREAKER SHOULD BE IN THE OPEN POSITION. Be sure to de-energize the load and control leads to be connected, and also the section of the switchboard where installation is being made.


Mounting dimensions and details of the front enclosure cutouts are shown in Figure 1.

To prevent distortion of the breaker panel, the supporting structure should be checked for alignment.

CONNECTIONS

Typical circuit breaker wiring diagrams are shown in Figure 2. The connecting cables or bus bars should have adequate current carrying capacity, or heat will be conducted to the circuit breaker resulting in possible excessive temperature rise. Connecting cables or bus bars must be supported so that the circuit breaker studs will not be subjected to unnecessary stresses.

The circuit breaker studs and all connections should be clean, smooth and free from burrs to assume full contact area. They should be firmly clamped or bolted in place to prevent excessive heating.

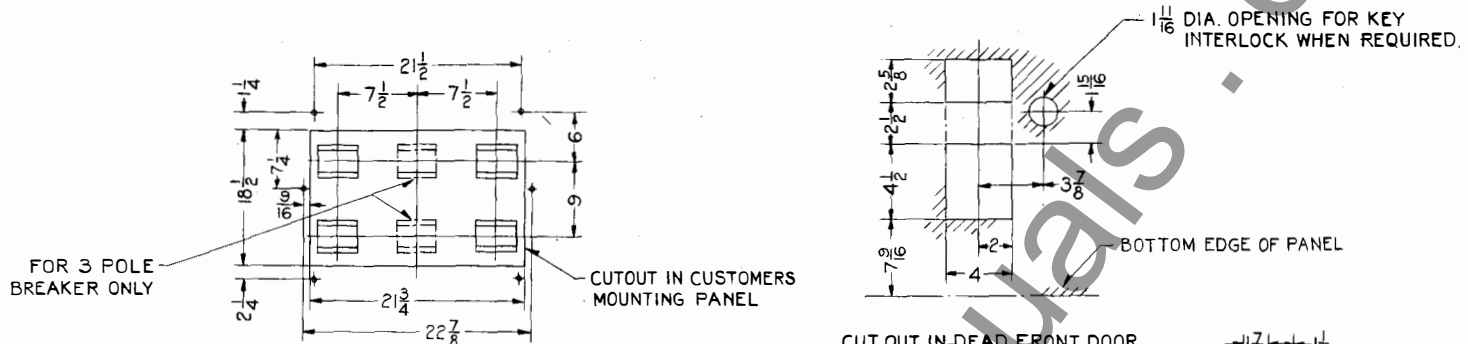

FRONT VIEW OF STUD LOCATIONS FOR MOUNTING 2 OR 3 POLE BREAKER WITH OR WITHOUT OVERCURRENT TRIPS

CUT OUT IN DEAD FRONT DOOR OR COVER

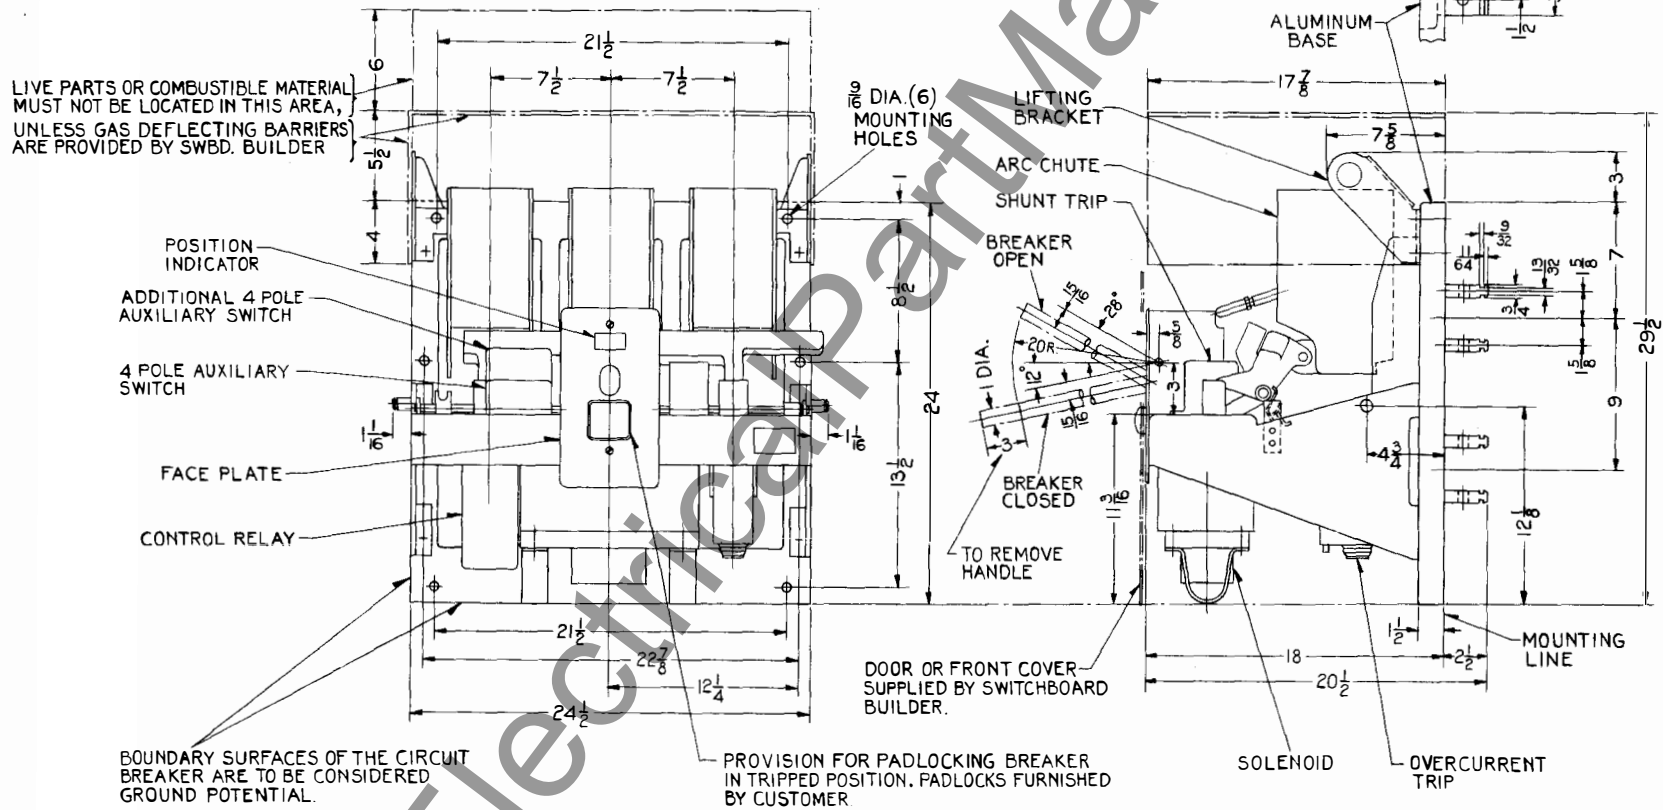


FIG. 1 - DB-75 OUTLINE AND MOUNTING DIMENSIONS

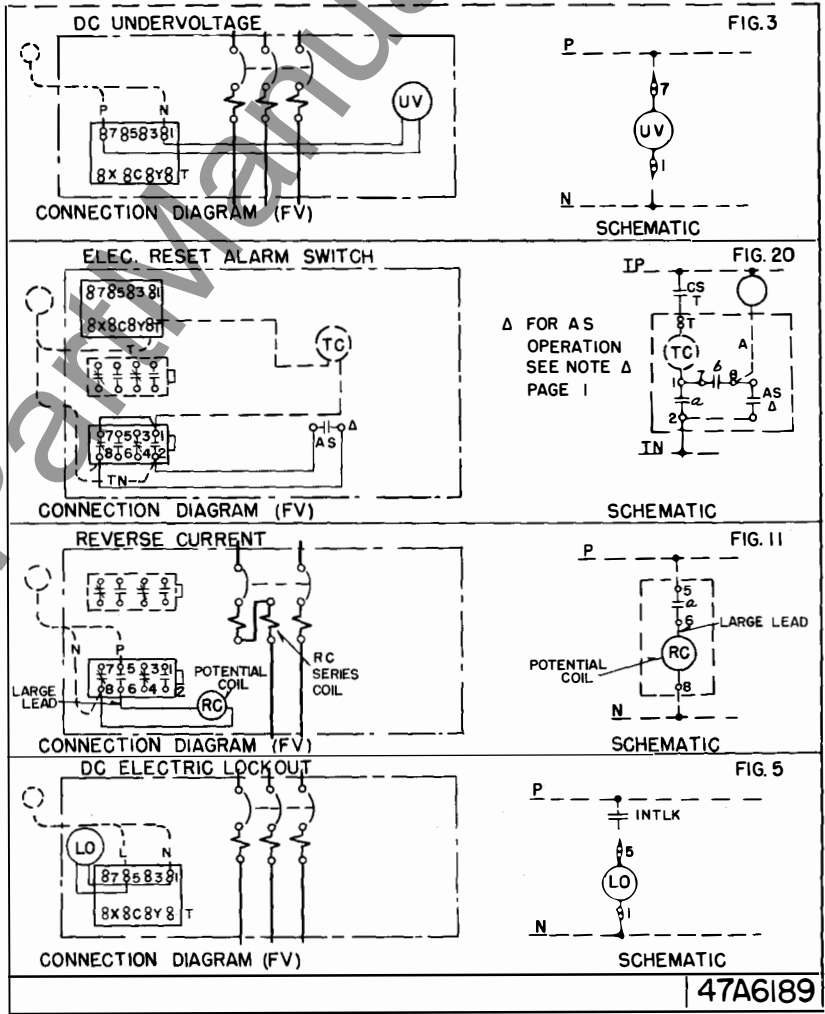
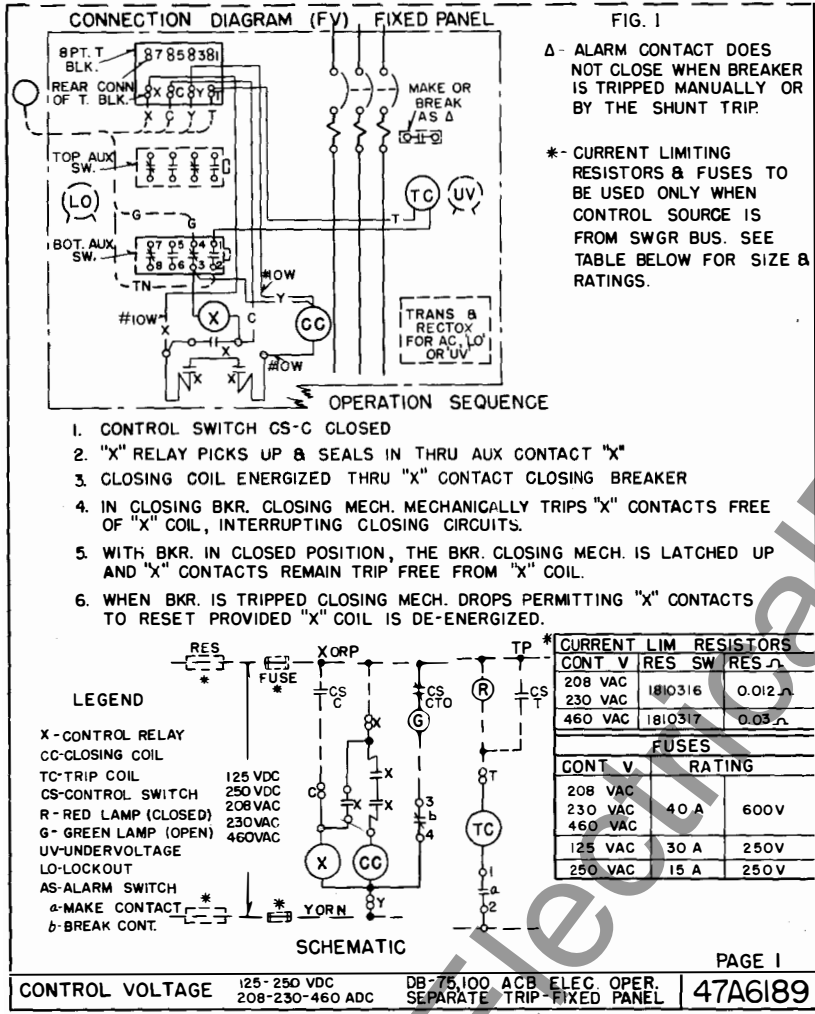


FIG. 2 - TYPICAL WIRING DIAGRAMS

TYPE DB-75 DE-ION AIR CIRCUIT BREAKER

DB-75 CIRCUIT BREAKER
3000 AMPERES 600 VOLTS A-C

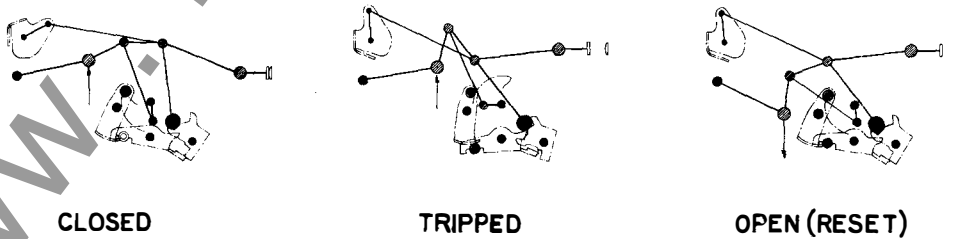
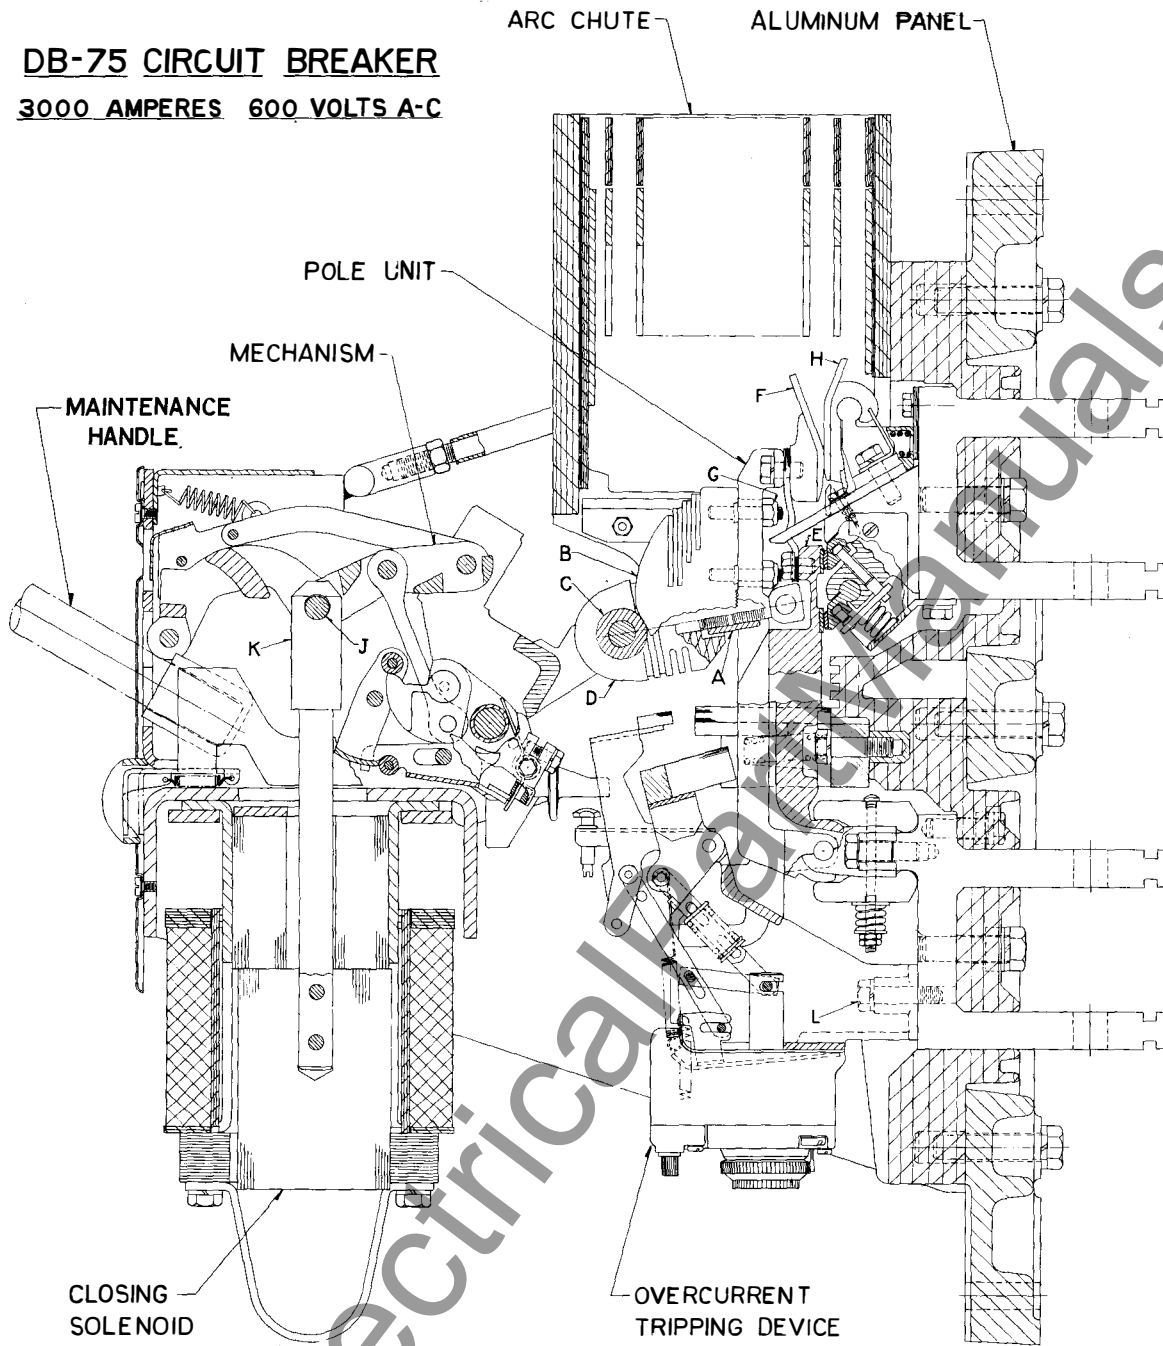


FIG. 3 - CROSS-SECTIONAL VIEW OF DB-75 CIRCUIT BREAKER

PART III

MAINTENANCE

POLE UNIT

Each pole unit (Fig. 3) is mounted on a separate molded base. The molded bases are attached to the aluminum mounting panel and provide insulation for the breaker studs.

The upper stud and contact are attached to the molded base by two bolts. The moving contact arm is pivoted on the lower stud and is attached to the cross bar through insulating links. The lower stud is fastened to the molded base by four bolts.

CONTACTS: (See Figure 3) The DB-75 arcing contact must touch first on closing and open last on opening.

Do not adjust one set of contacts without checking the complete sequence of all poles. With the breaker open proceed in the following order:

1. Turn adjusting nuts (A) on insulating links to vary main contact pressure. Use .005 feeler gauge, 1/4 inch wide by 6 inches long, inserted as shown in Figure 4A to check clearance.

Feeler (X) above contact fingers insures that they have all been deflected. Feeler (Y) inserted below fingers insures that they have not gone solid.

2. Check clearance between cam (B) and roller (C) located between insulating links (D) by pulling main moving contact arm (E) toward cross bar with one hand while using a "push-pull" motion on the moving arc tip (F) with the other hand. If cam is tight against roller, loosen the elastic nuts (G), lower cam and tighten. If cam has more than 1/8 inch clearance to roller, raise cam.

3. Move stationary arc tips (H) to obtain deflection as shown in Figure 4B.

4. Check the above adjustments on all three poles. After all poles have been adjusted

and with one set of arcing tips just touching, the clearance between the other two sets of arcing contacts should not exceed 1/8 inch.

FEELER GAGE "X"

FEELER GAGE "Y"

FIG. 4A

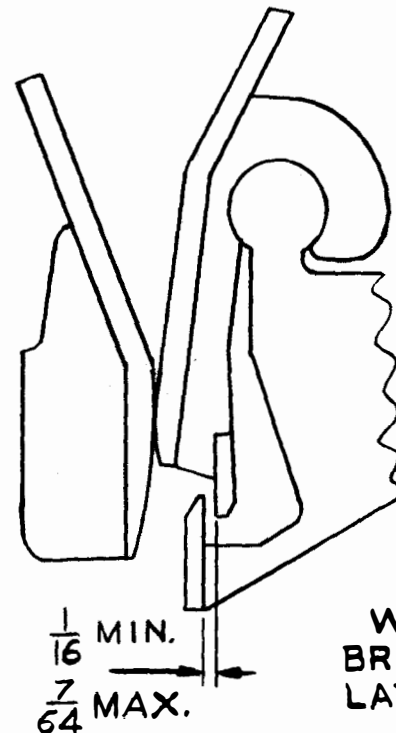


FIG. 4B

ADJUSTING LIMITS OF MAIN AND ARCING CONTACTS FOR DB-75 CIRCUIT BREAKERS

MAINTENANCE OF CONTACTS

Rough or high spots should be removed with a file or emery-cloth. When dressing contacts be sure to protect the hinged contact of all poles with a cloth to prevent foreign matter from lodging in the hinged contact.

CAUTION: ALL POWER MUST BE REMOVED WHEN REPLACING, MAINTAINING OR ADJUSTING CONTACTS.

OPERATING MECHANISM

The operating mechanism (Fig. 3) is non-adjustable and consists of a series of non-ferrous links designed to secure low closing and tripping forces. To check for friction, with the breaker open, raise trip finger and slowly lower the closing handle. Release trip finger and slowly raise handle. The linkage should follow the handle without sticking and a "click" will be heard just before the handle reaches the full up position.

To remove the mechanism proceed as follows:

- (1) Remove the breaker cross bar.
- (2) Loosen the outboard bearings at the ends of the trip bar.
- (3) Remove the tension rods between the mechanism and aluminum panel.
- (4) Free the pin (J-3)* from the moving core. To free the pin, first remove the cotter pin from the spacer on the right side of the pin. Partially close the breaker until the pin lines up with two holes in the sides of the mechanism frame. Hold the moving core up, and then drive the pin to the right just far enough to clear the moving core rod. Lower the moving core until it hits its stop. Drive the pin to the left into its original position.
- (5) Remove the four mounting bolts.

a. **CAUTION: THESE BOLTS ARE ALSO THE MOUNTING BOLTS FOR THE CLOSING SOLENOID; THEREFORE, SUPPORT THE SOLENOID WHILE REMOVING THE BOLTS.**

- (6) Remove the Mechanism.

The mechanism is factory lubricated for life.

CLOSING SOLENOID

The closing solenoid (Fig. 5) is not adjustable. To remove the close coil, proceed as follows:

- (1) **CAUTION: REMOVE THE CLOSE COIL CIRCUIT VOLTAGE.**
- (2) Disconnect the wires from the close coil terminals.
- (3) Loosen the locking clip (4-5) on the bottom of the moving core.
- (4) Remove bolts (5), locking clip (4-5), and the relay trip bracket (6-5).
- (5) Remove bolts (3-5), and using a rawhide or plastic mallet remove the bottom stationary core (7-5).
- (6) Remove the coil.

OVERCURRENT TRIPPING DEVICE

Description

The overcurrent tripping unit for the DB-75 circuit breaker is an air delayed magnetic type of device. The time-current characteristics of the trip units are as follows:

- (1) Long delay and short delay.
- (2) Long delay and instantaneous.
- (3) Instantaneous.

The various ratings of each general type are of similar construction and differ only in springs and calibration.

*The first letter or number refers to the item and the second to the figure number. (Item J - Fig. No. 3).

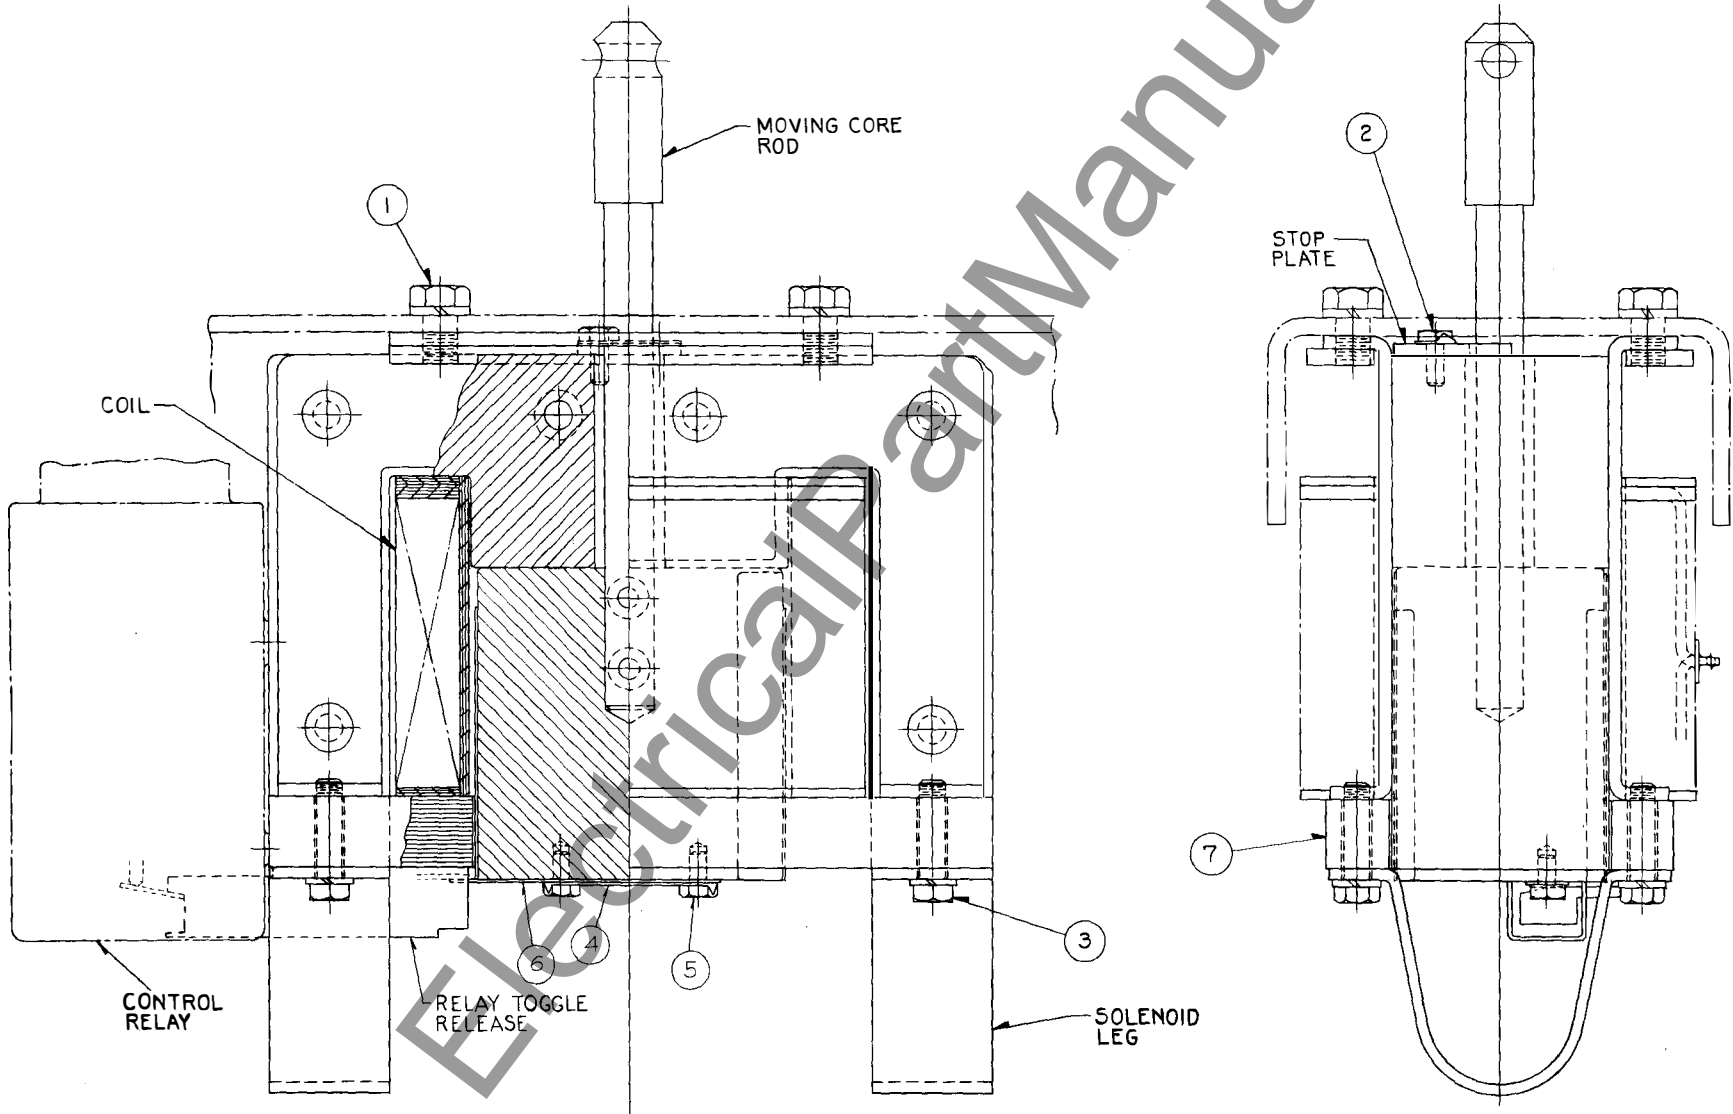


FIG. 5 - CLOSING SOLENOID - CONSTRUCTION DETAILS

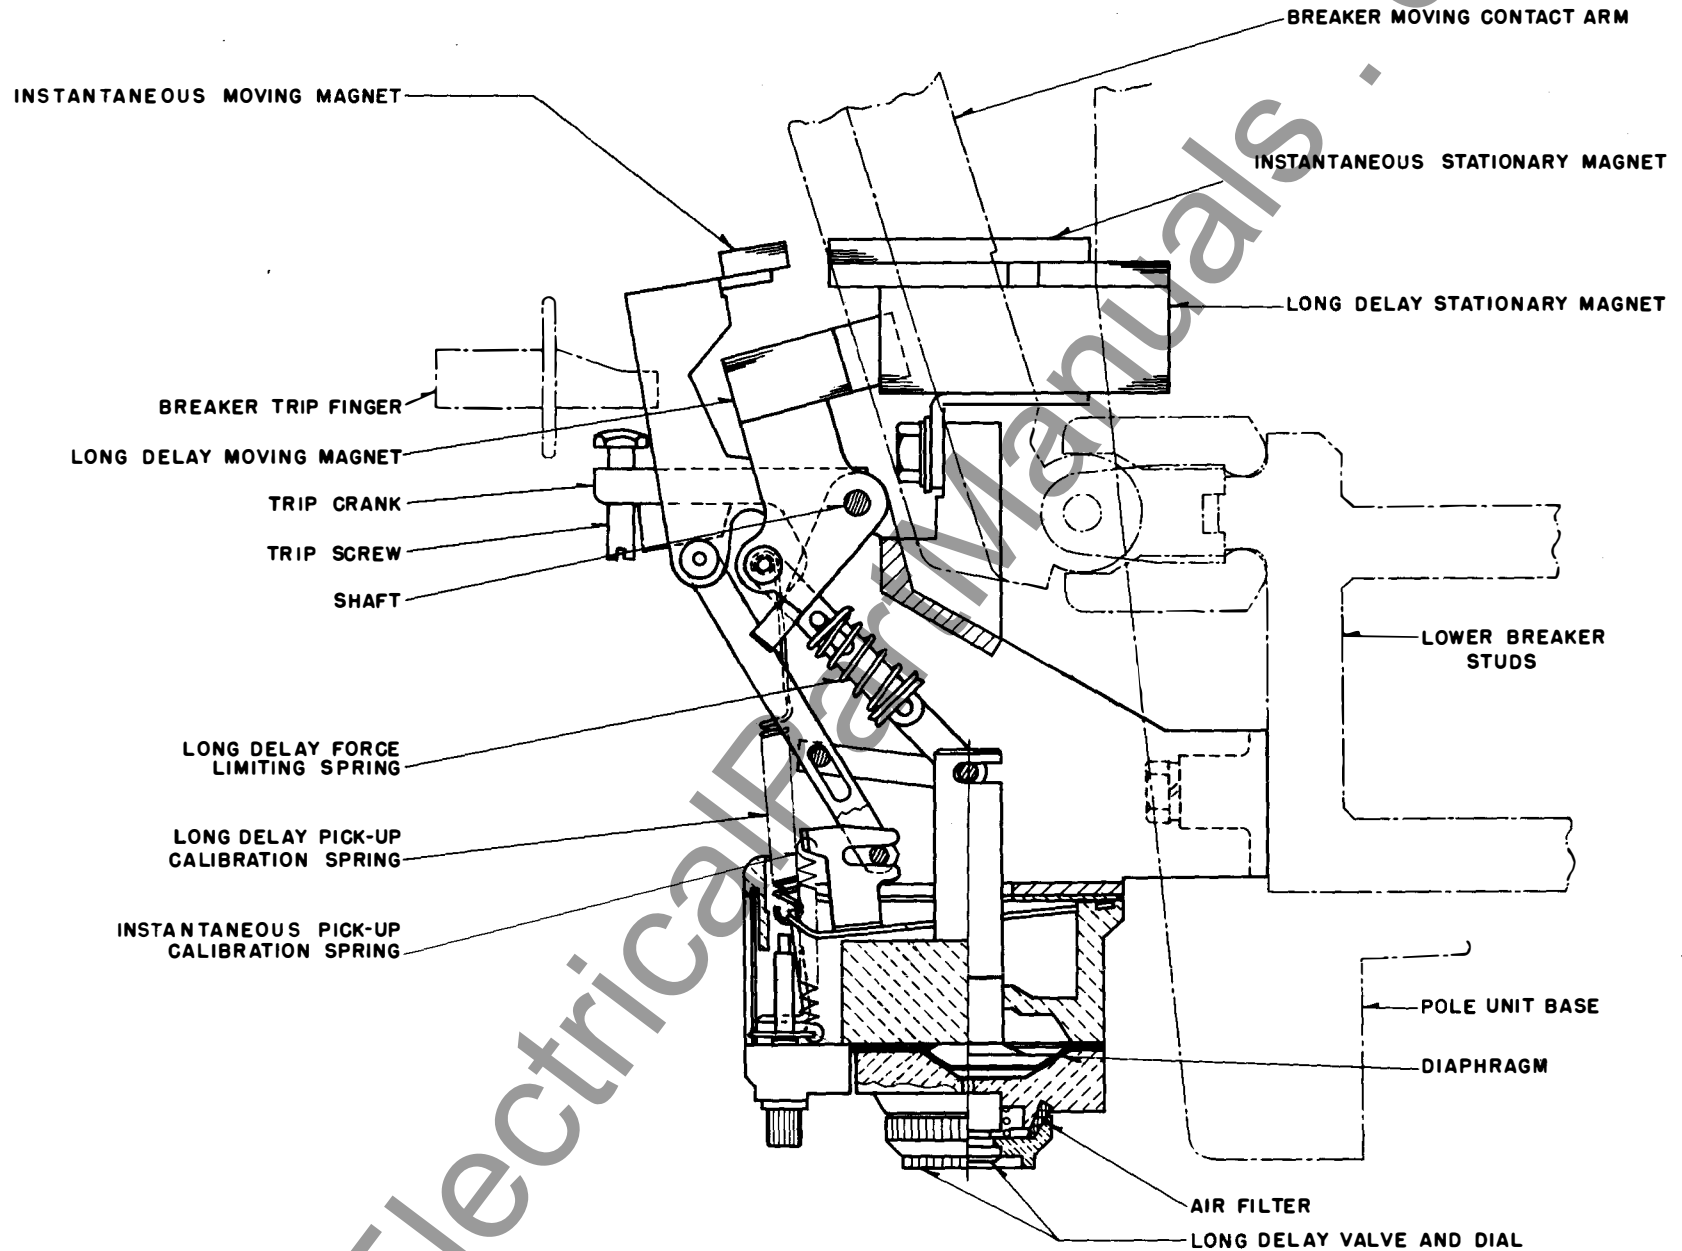


FIG. 6 - CROSS-SECTIONAL VIEW OF OVERCURRENT TRIPPING DEVICE WITH LONG DELAY AND INSTANTANEOUS ELEMENTS

The overcurrent tripping device can be removed from the breaker easily and replaced with another unit of the same or different rating without affecting the calibration of the units involved.

Construction

The mounting frame casting supports the two sub-assemblies of the trip unit. On the upper part of the frame are the two magnetic armatures and their associated links and brackets. Fastened to the lower part of the mounting frame is the moldarta box which contains the calibration springs, time delay elements and calibration knobs. This box is held to the mounting frame by two long screws at the bottom of the calibration box.

Installation and Removal

CAUTION: BEFORE REMOVING OR INSTALLING A TRIPPING DEVICE, BE SURE THAT THE BREAKER IS IN THE OPEN POSITION AND DE-ENERGIZED

To remove an overcurrent tripping device from the breaker, loosen the two captive bolts at the bottom of the mounting frame (L-3) until they turn freely. Then loosen the two bolts at the top of the mounting frame while supporting the trip unit so that it does not fall. These two bolts clamp a slotted angle mounting bracket and merely have to be loosened; they do not have to be removed from the mounting frame. The trip unit is then free to be removed from the breaker by lowering it down behind the breaker platform.

To install a tripping device on a breaker, first make certain that the breaker is open and is not connected to live circuits. Then loosen the upper mounting bolts on the trip unit so that the bolts can slide into the slotted mounting brackets on the stationary yoke. Then install the trip unit from the bottom of the breaker, sliding it up behind the mechanism platform. Start the bottom two captive mounting bolts, but do not tighten completely. Next, align the trip unit so that the gaps between the tapered portions of the main armature are approximately equal when the main armature is closed. Then tighten all four mounting bolts securely.

Adjustment of Trip Screw

The trip screw mounted on the trip finger must be adjusted properly to obtain proper tripping.

CAUTION: SINCE THIS ADJUSTMENT INVOLVES TRIPPING THE BREAKER, CARE MUST BE TAKEN TO KEEP FINGERS AND FACE AWAY FROM ALL CONTACT ARMS AND OPERATING LINKAGE. To proceed with the adjustment, turn the long time dial at the bottom of the calibration box counter-clockwise to the stop so that the trip unit is set for minimum time delay. Then close the breaker and carefully reach under the mechanism with both hands and push the lower armature fully closed with the thumbs. Hold it closed for at least the minimum long delay time (20 to 40 seconds). If the breaker trips, reset the screw at the end of the tripping finger until the breaker just barely trips. Before re-adjusting the trip screw, make sure that the breaker is in the open position. After finding the position of the trip screw at which the breaker just trips, turn the screw exactly one full turn in the direction to trip the breaker sooner. Check to make sure that the breaker will trip when either armature is closed if long and instantaneous type trip units are used, or when both armatures are closed if long and short delay type trip units are used. The short delay armature is for timing only. Closing it alone will not trip the breaker.

Operation

STANDARD OVERCURRENT TRIPPING DEVICE
(Refer to Figure 7A)


When a small overload current flows through the breaker pole unit conductor (R), it causes the moving armature (B) to be attracted toward the stationary core (A). The motion of the armature is retarded by the diaphragm (D) whose motion is in turn controlled by the amount of air admitted by the long time delay valve (F). After a time delay, determined by the setting of valve (F), the armature will have rotated the trip crank (J) far enough to trip the breaker by moving the trip lever (K). During this type of tripping, the compression spring (C) is not compressed beyond its normal length.

LEGEND:


A-LONG DELAY STATIONARY MAGNET
 B-LONG DELAY MOVING MAGNET
 C-LONG DELAY FORCE LIMITING SPRING
 D-DIAPHRAGM
 E-AIR CHAMBER
 F-LONG DELAY VALVE AND DIAL
 G-LONG DELAY PICK-UP CALIBRATION SPRING
 H-RESET VALVE

J-TRIP CRANK
 K-BREAKER TRIP FINGER
 L-INSTANTANEOUS STATIONARY MAGNET
 M-INSTANTANEOUS MOVING MAGNET
 Q-INSTANTANEOUS PICK-UP CALIBRATION SPRING
 R-BREAKER MOVING CONTACT ARM
 W-SHAFT

GUIDE BEARING
 SOLID JOINT
 PINNED JOINT
 NO JOINT
 STOP SURFACE

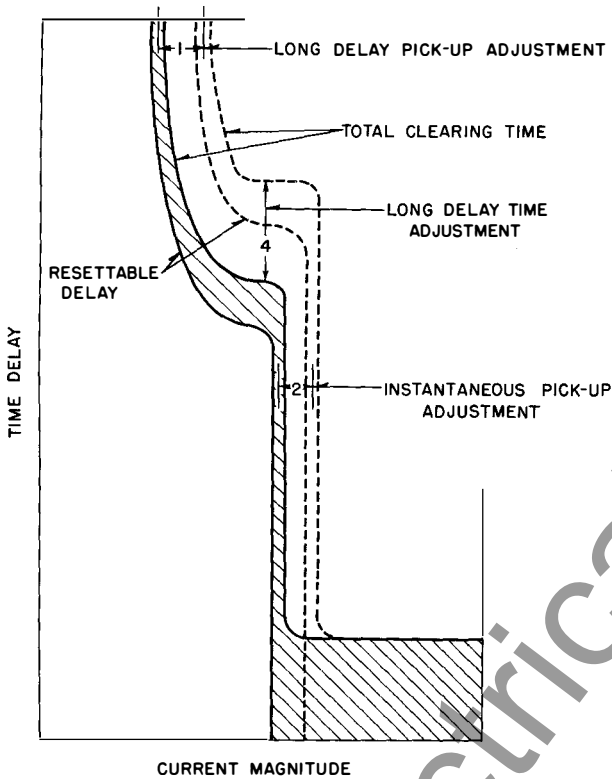


TYPICAL TRIPPING CHARACTERISTICS
 FIGURE 7B

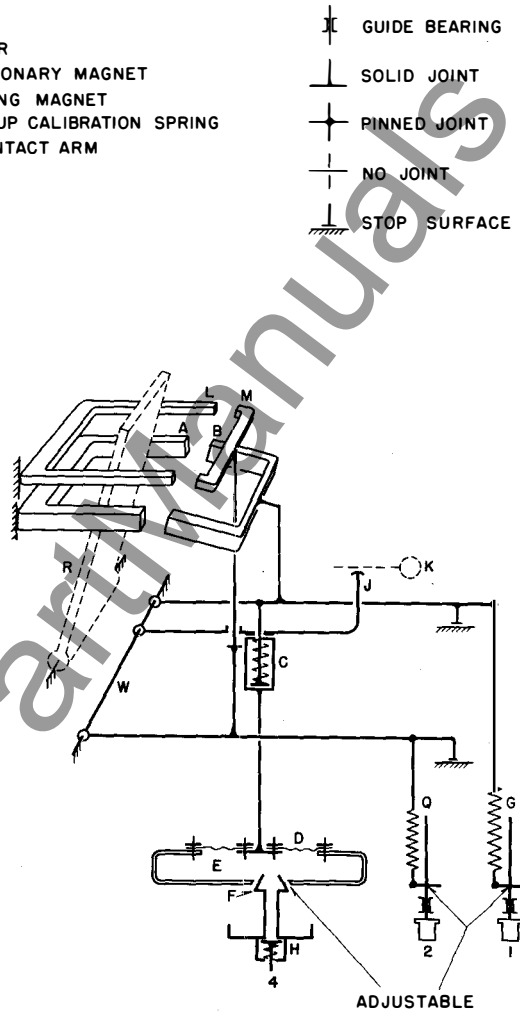

SCHEMATIC DIAGRAM

FIGURE 7A

FIG. 7 - SCHEMATIC AND TYPICAL TIME-CURRENT CHARACTERISTICS OF
 OVERCURRENT TRIPPING DEVICE WITH LONG DELAY AND
 INSTANTANEOUS ELEMENTS

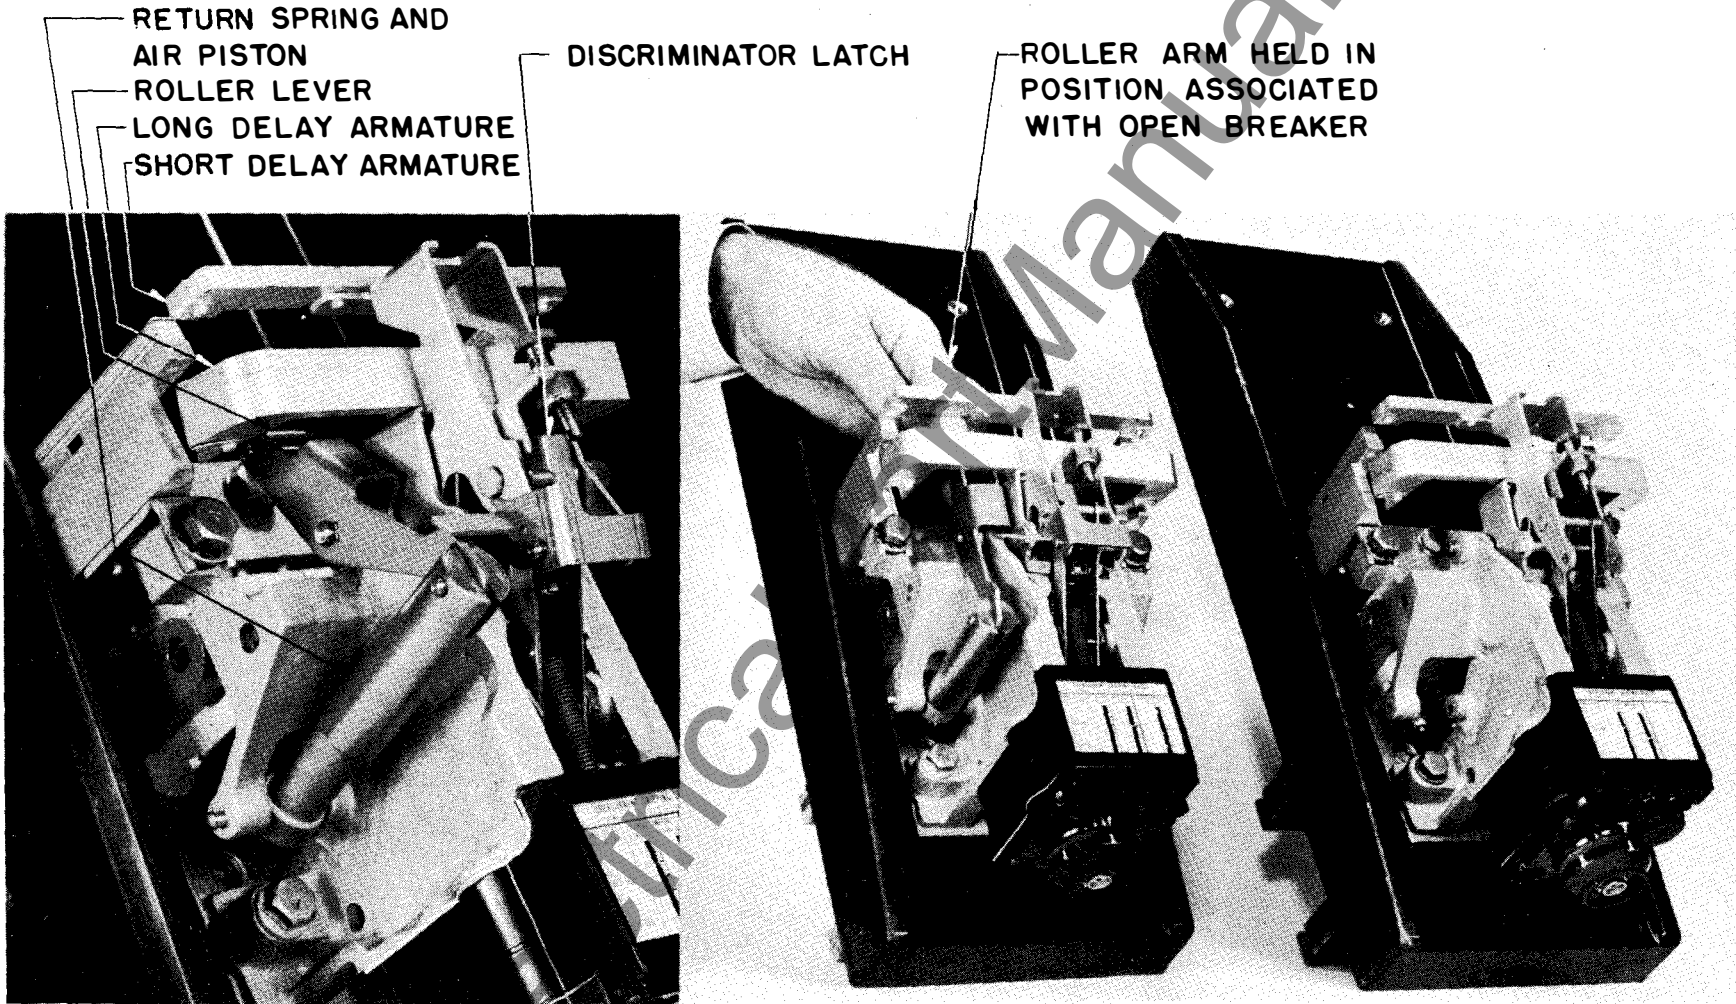

PARTS WHICH DISCRIMINATE BETWEEN:

- A. BREAKER IN CLOSED POSITION.
- B. BREAKER DURING PERIOD OF CLOSING.

ARRANGED FOR LONG DELAY AND SHORT DELAY TRIPPING.

ARRANGED FOR LONG DELAY AND INSTANTANEOUS TRIPPING.

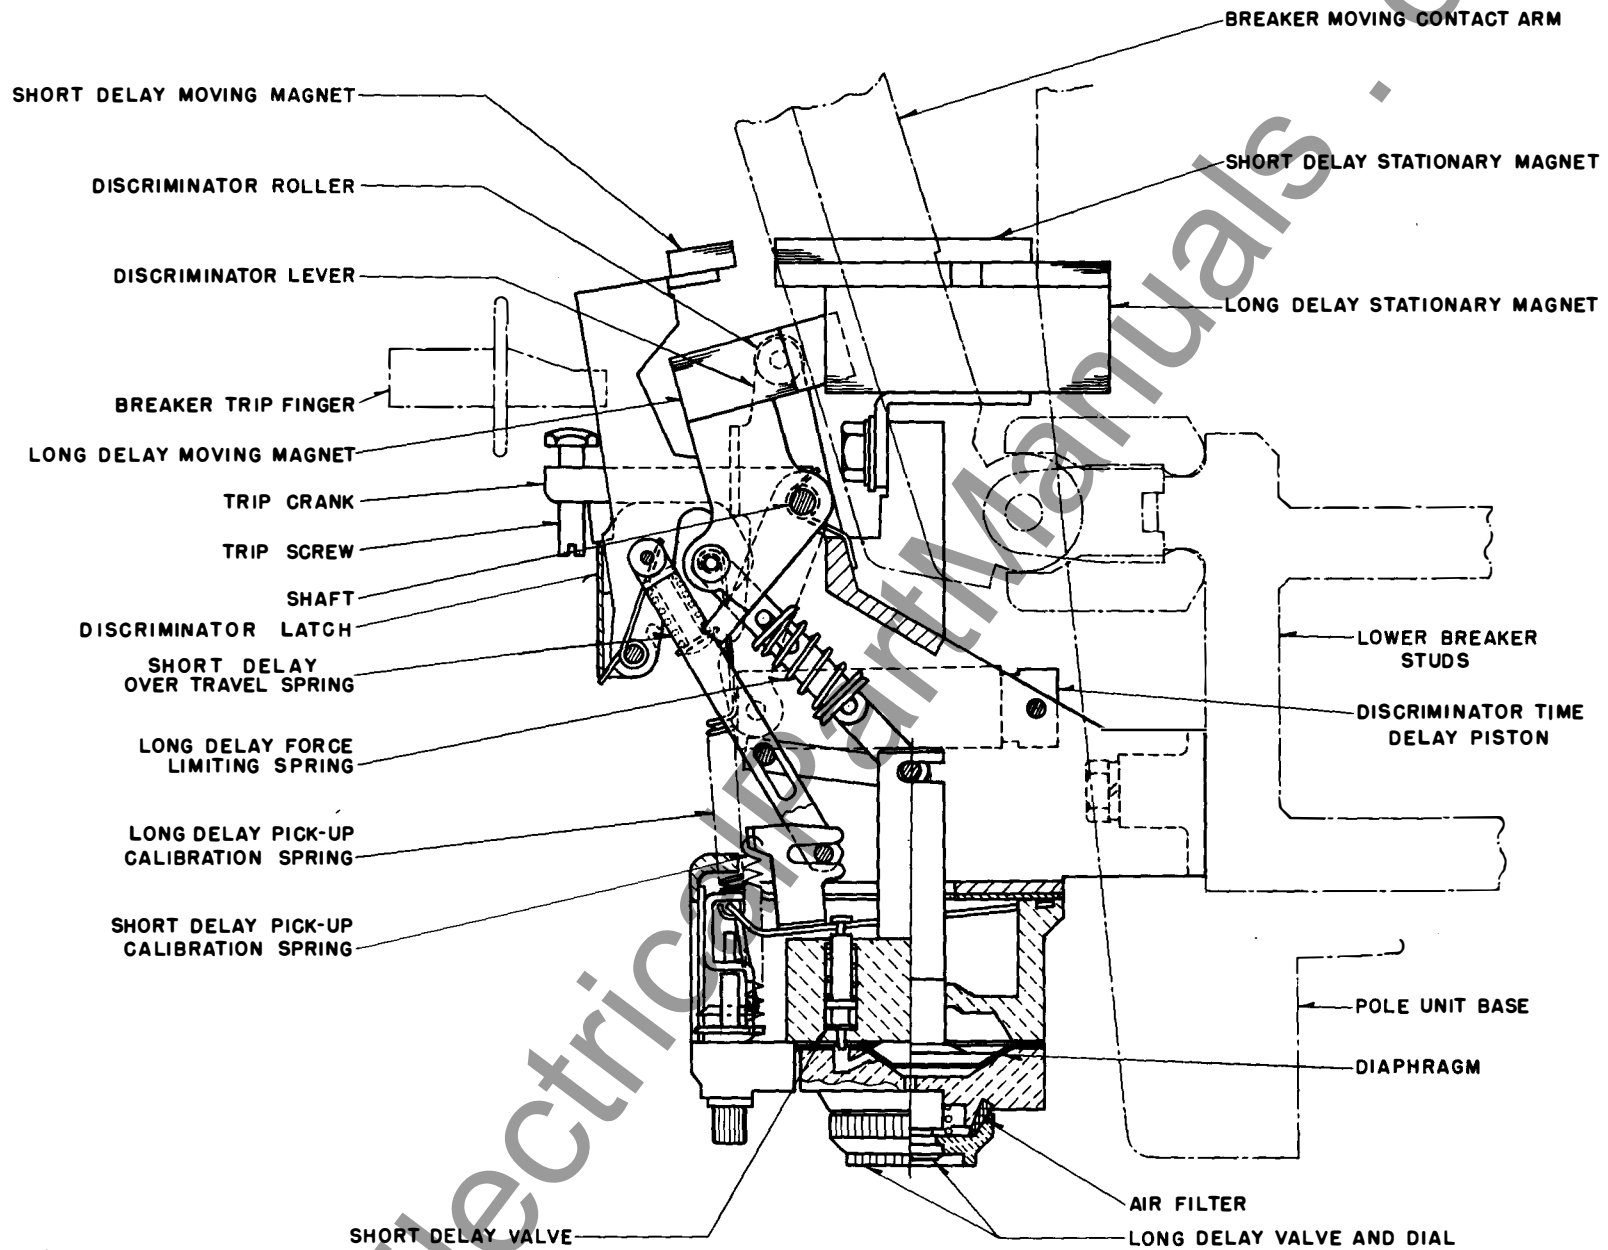



FIG. 8 - CROSS-SECTIONAL VIEW OF OVERCURRENT TRIPPING DEVICE WITH
LONG DELAY AND SHORT DELAY ELEMENTS

LEGEND:

- A-LONG DELAY STATIONARY MAGNET
- B-LONG DELAY MOVING MAGNET
- C-LONG DELAY FORCE LIMITING SPRING
- D-DIAPHRAGM
- E-AIR CHAMBER
- F-LONG DELAY VALVE AND DIAL
- G-LONG DELAY PICK-UP CALIBRATION SPRING
- H-RESET VALVE
- J-TRIP CRANK
- K-BREAKER TRIP FINGER
- L-SHORT DELAY STATIONARY MAGNET


- M-SHORT DELAY MOVING MAGNET
- N-SHORT DELAY OVER TRAVEL SPRING
- P-SHORT DELAY VALVE
- Q-SHORT DELAY PICK-UP CALIBRATION SPRING
- R-BREAKER MOVING CONTACT ARM
- S-DISCRIMINATOR ROLLER
- T-DISCRIMINATOR TIME DELAY PISTON
- U-DISCRIMINATOR LEVER
- V-DISCRIMINATOR LATCH
- W-SHAFT

- GUIDE BEARING
- SOLID JOINT
- PINNED JOINT
- NO JOINT
- STOP SURFACE

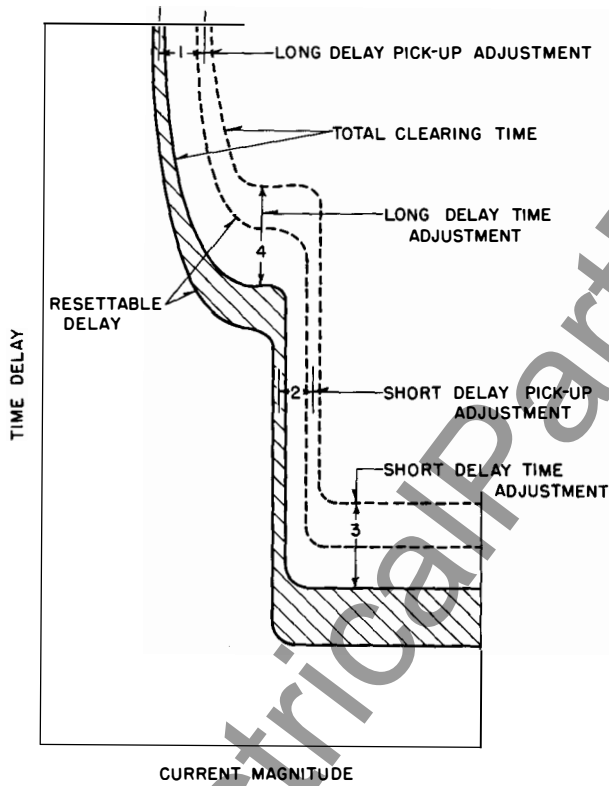

TYPICAL TRIPPING CHARACTERISTICS

FIGURE 9B

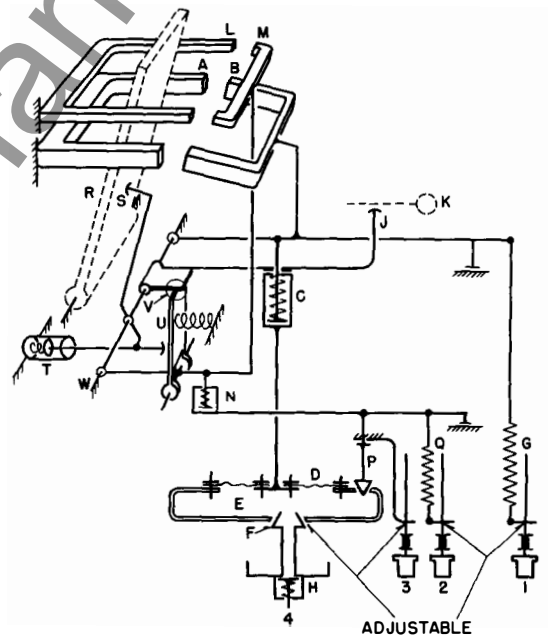

SCHEMATIC DIAGRAM

FIGURE 9A

FIG. 9 - SCHEMATIC AND TYPICAL TIME-CURRENT CHARACTERISTICS OF OVERCURRENT TRIPPING DEVICE WITH LONG DELAY AND SHORT DELAY ELEMENTS

On larger overload currents, the action is essentially the same as above except that the moving armature (B) will close completely as soon as the overload is applied. When the armature closes, it compresses spring (C) which applies a force to diaphragm (D). After a time delay determined by valve (F), the diaphragm movement permits the spring to rotate the trip crank (J) far enough to trip the breaker by moving the trip lever (K).

Large fault currents cause the instantaneous armature (M) to close immediately. This armature lifts the trip crank (J) without any delaying action and trips the breaker.

Selective Overcurrent Tripping Device

(Refer to Figure 9A)

For small and intermediate overloads, the operation of this device is the same as for the standard overcurrent tripping device. However, the selective overcurrent tripping device operates differently when large fault currents occur.

When the fault current is large enough to close the short delay armature (M), the linkage attached to the armature opens valve (P) which permits air to enter the diaphragm chamber at a much faster rate than through the long delay valve (F). Tripping is then accomplished by the same means as though a small overload had occurred. That is; the main armature (B) has closed, pulling on the compression spring (C) which is restrained by diaphragm (D) until sufficient air has entered valve (P) to permit the spring assembly (C) to lift crank (J) and trip the breaker by rotating the trip finger (K).

A discriminator arm is used on the selective overcurrent trip units to make the unit behave as an instantaneous type trip unit while the breaker is being closed and for a short interval of time after closing. This is achieved by having a discriminator latch connection between the short delay armature bracket and the trip crank. When this latch is engaged, the short delay armature will lift the trip crank directly if the current is greater than

the short delay pick-up setting. If the current does not rise above this value, then the breaker remains closed and the discriminator arm disengages the discriminator latch so that the trip unit will then revert to its normal function as one having long and short time delay characteristics.

Instantaneous Overcurrent Tripping Device (Single Element)

This device operates in an instantaneous manner to trip the breaker at any time when the current rises above the calibrated setting. The main armature (B), of Figure 7A, is modified so that it lifts the trip crank (J) and trips the breaker directly. The operation is similar to the instantaneous trip of the standard overcurrent tripping device.

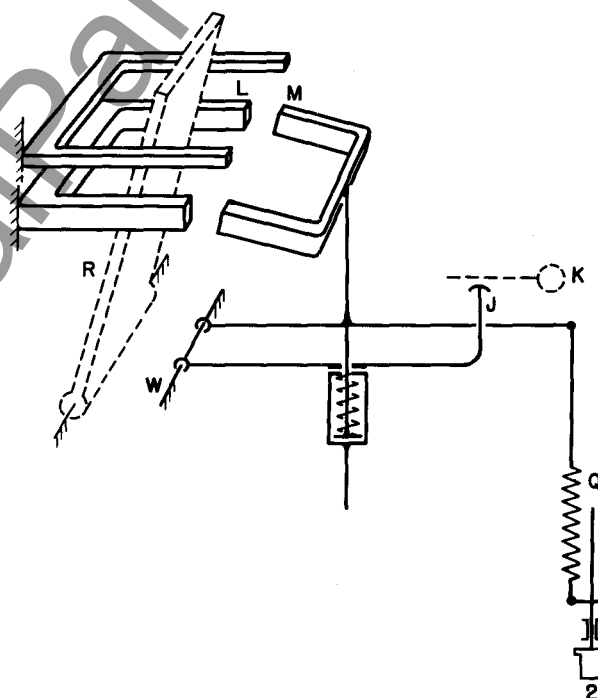


FIG. 10A - SCHEMATIC DIAGRAM OF OVERCURRENT TRIPPING DEVICE WITH INSTANTANEOUS ELEMENT ONLY

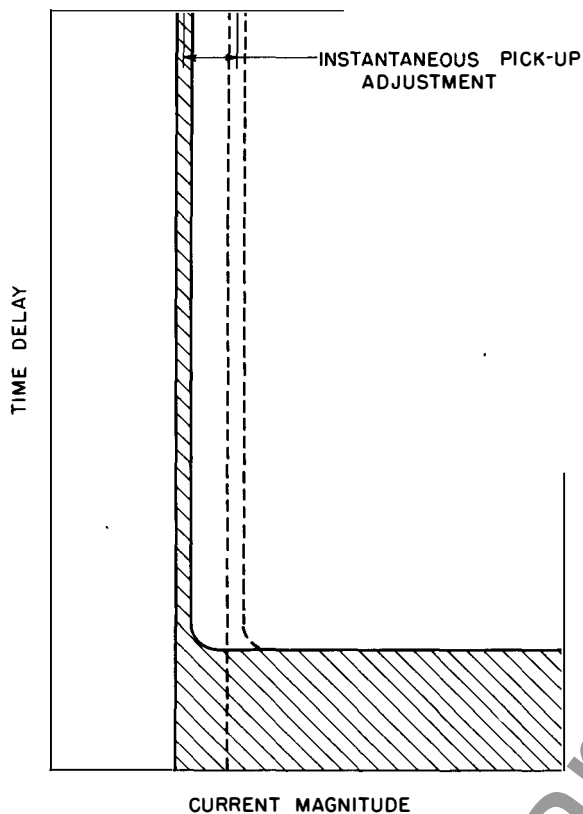


FIG. 10B - TYPICAL TIME-CURRENT CHARACTERISTICS OF OVERCURRENT TRIPPING DEVICE WITH INSTANTANEOUS ELEMENT ONLY

Time-Current Characteristics

STANDARD OVERCURRENT TRIPPING DEVICE

(Refer to Fig. 7B)

The long delay pick-up adjustment can change the position of the upper part of the curve through the range indicated by the number (1). This adjustment is accomplished by changing the tension on the spring which controls the force the long delay armature must overcome in order to close.

The long delay time adjustment can be used to shift the knee of the curve over the range indicated by the Number (4). This adjustment is changed by turning the knob, located at the bottom of the molded calibration box, which opens or closed the valve to control the amount of air entering the diaphragm chamber.

The instantaneous pick-up adjustment can shift the vertical part of the curve to the left or right as indicated by number (2). This is achieved by changing the spring force applied to the smaller instantaneous armature.

The flat portion of the curve at the bottom represents the minimum time for the breaker to clear when fault currents exceed ten times the trip unit rating.

SELECTIVE OVERCURRENT TRIPPING DEVICE

(Refer to Figure 9B)

The time-current characteristic of this trip unit is the same as the standard device except that the position of the flat portion of the curve can be shifted as indicated by the number (3). This adjustment can be made by changing the setting of the short delay time on the calibration box. The adjustment controls the maximum opening of the short delay valve and thereby controls the tripping time when currents are high enough to operate the short delay armature.

Calibration

Overcurrent tripping devices of this general type must be calibrated by using a definite procedure and technique, as well as specialized equipment. Because few customers have access to such equipment, it is highly recommended that trip units be returned to the factory if it appears that they need to be calibrated.

Maintenance

In ordinary use, this trip unit needs very little maintenance. Any accumulation of dust should be blown off occasionally. No oil or lubricant should be applied to any of the pins or links. Do not disassemble the unit for cleaning purposes. In the event that major repair work is needed, it is advisable to return the unit to the factory.

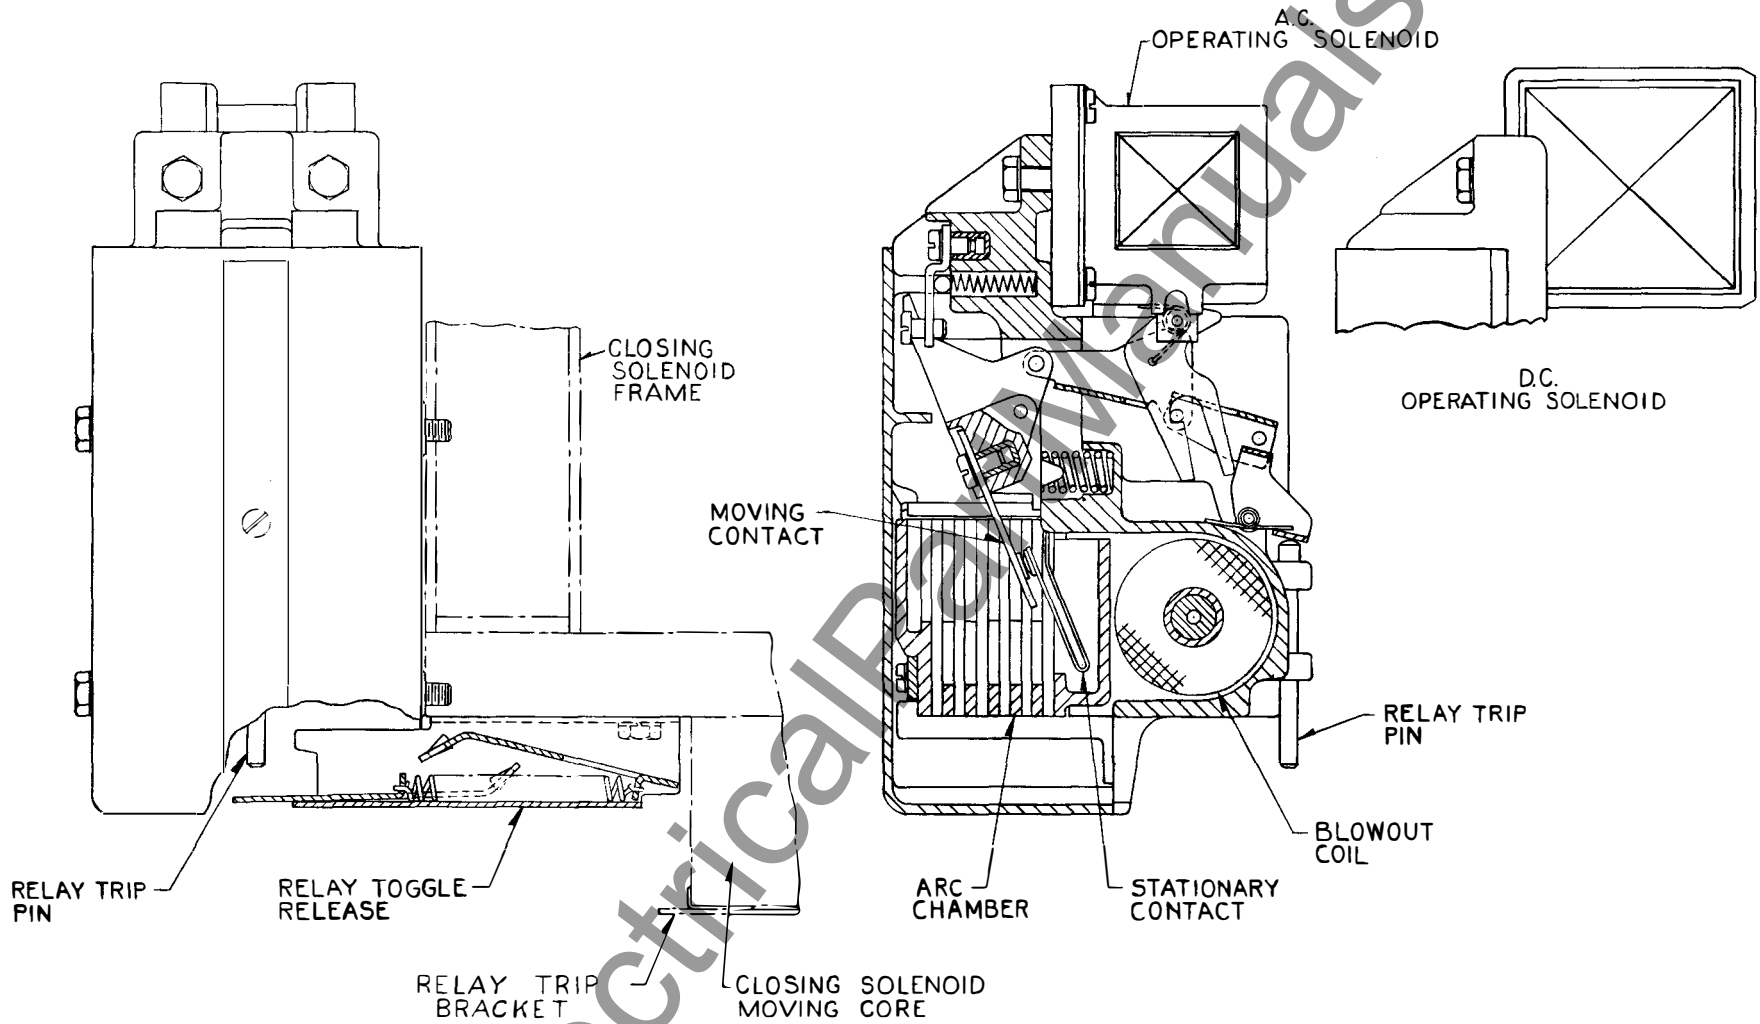


FIG. 11 - CONTROL RELAY - CONSTRUCTION DETAILS

CONTROL RELAY

The control relay (Figure 11) mounts directly under the auxiliary switch. It is a single-coil, mechanical tripping device with the coil suitable for continuous duty. The operation sequence is outlined in Figure 2, Page 9. The contacts should normally last the life of the breaker, but are replaceable if necessary.

The relay trip pin and relay toggle release are designed so that the relay trips at approximately the same time as the breaker latches. The relay is not adjustable.

SHUNT TRIP ATTACHMENT

The shunt trip (Figure 12) mounts on top of the platform immediately to the right of

the operating mechanism. It is non-adjustable and is intended for intermittent duty only. The shunt trip circuit must always be open by an auxiliary switch contact.

Inspection

With the breaker in the open position, manually pull the shunt trip moving core against the stationary core and manually attempt to close the breaker. The breaker should be trip free.

The trip rod of the shunt trip should have approximately 7/32 inch clearance to the trip rod clip.

Maintenance

Check for loose bolts and faulty coil.

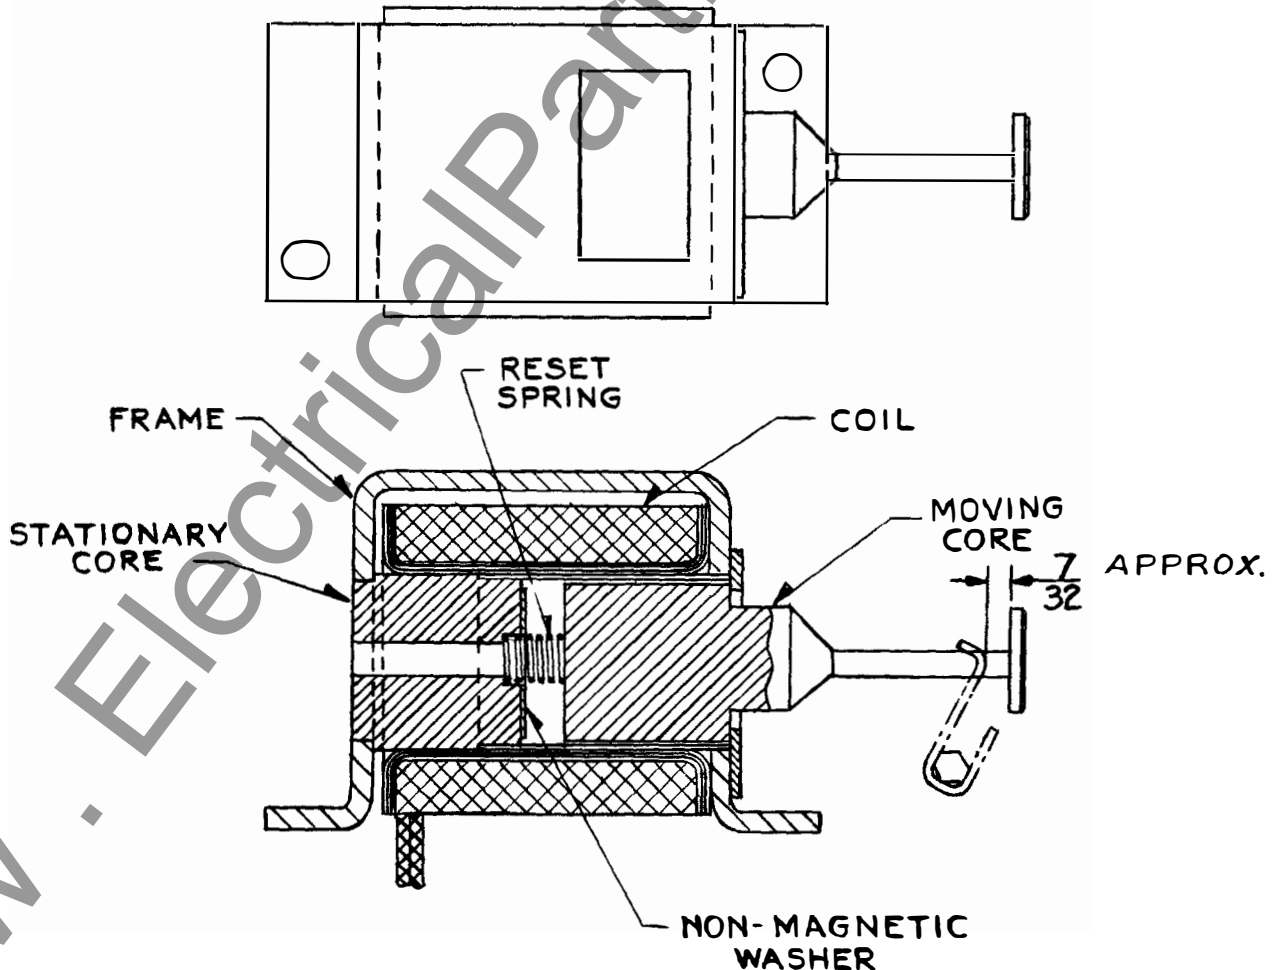


FIG. 12 - SHUNT TRIP ATTACHMENT - CONSTRUCTION DETAILS

UNDERVOLTAGE TRIP ATTACHMENT

The undervoltage trip (Figure 13) mounts on top of the platform, to the right of the shunt trip. Its function is to trip the breaker when the voltage falls to between 30 and 60 percent of normal.

The moving coil is normally held magnetically against the stationary core to hold the rod and consequently the reset lever in the reset position. When the coil voltage is reduced sufficiently, the reset lever spring overcomes the magnetic attraction of the cores and rotates the reset lever clockwise. As

the reset lever rotates, the pin pushes against the latch to release it from its latch plate. When the latch releases, the trip spring rotates the trip lever to trip the breaker. The linkage is reset by the cross bar as the breaker opens.

Always connect the coil to the line side of the breaker unless the attachment is equipped with time delay device. In this case, the time delay will delay the tripping of the breaker long enough to permit energization of the undervoltage coil from the load side. Do not use an auxiliary switch contact in the undervoltage circuit.

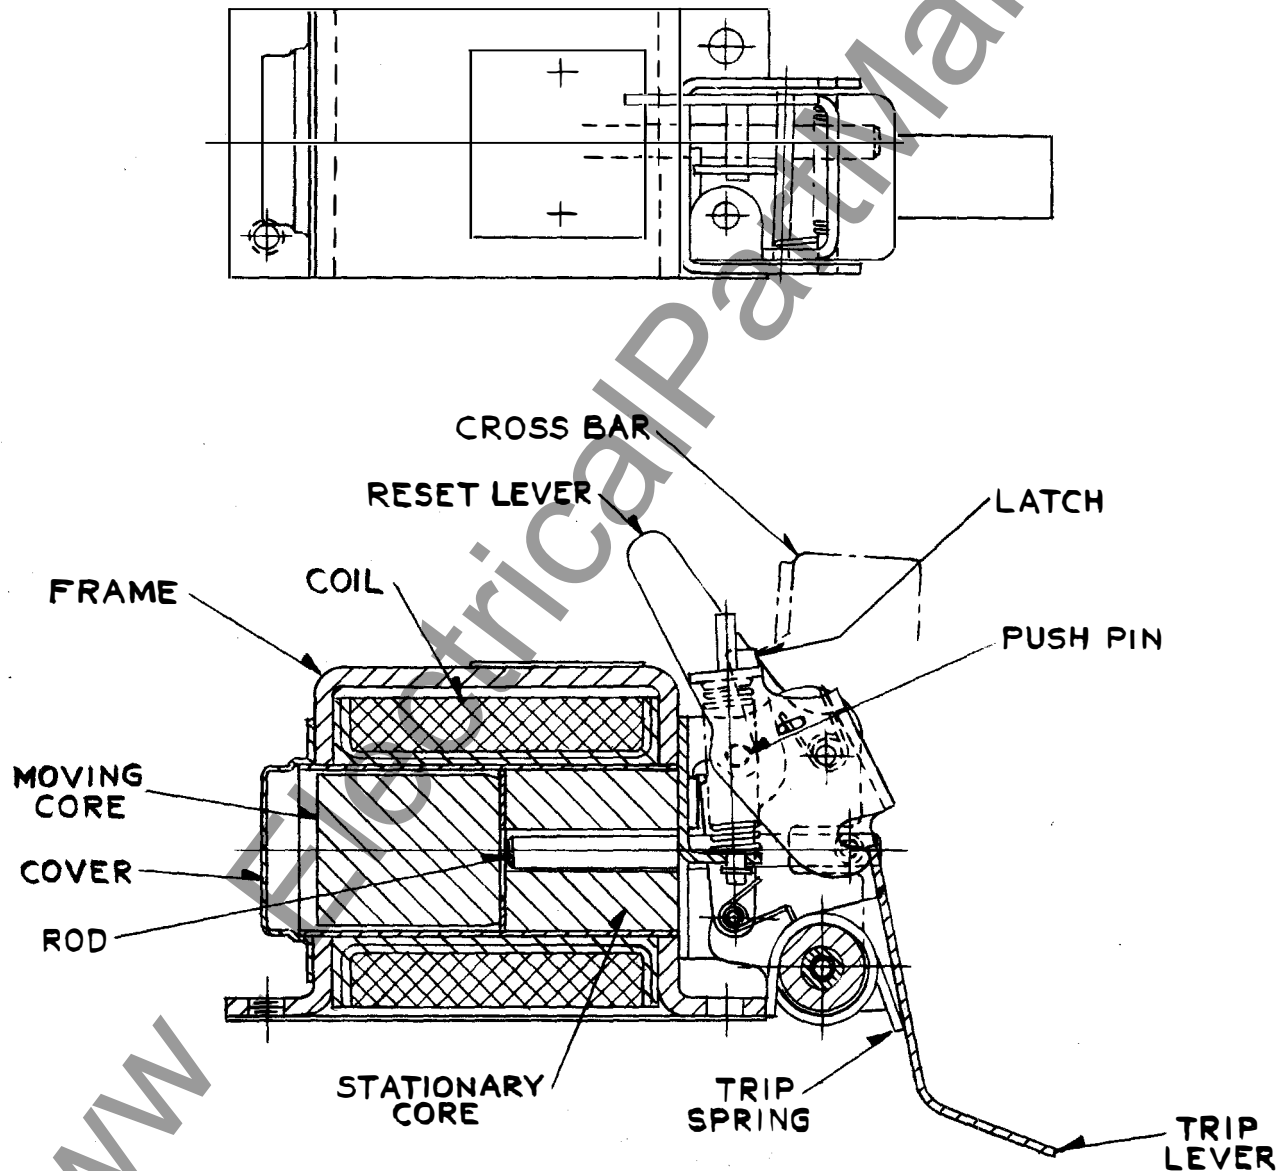


FIG. 13 - UNDERVOLTAGE TRIP ATTACHMENT - CONSTRUCTION DETAILS

UNDERVOLTAGE TIME DELAY ATTACHMENT

The undervoltage air dashpot time delay attachment (Figure 14) mounts on the front of the undervoltage trip, replacing the moving core cover. The needle valve screw in the top regulates the opening through which the air is forced and hence the time delay. The attachment does not have a quick reset feature and therefore approximately one minute should be allowed between operations to permit complete resetting.

Inspection

Hold the U.V. trip lever down and close the breaker manually. Release the trip lever slowly, allowing the undervoltage trip spring to rotate the trip rod and trip the breaker after a time delay.

CAUTION: DO NOT USE YOUR FINGERS TO HOLD AND RELEASE THE U.V. RESET LEVER.

Maintenance

Check for loose bolts and faulty coils.

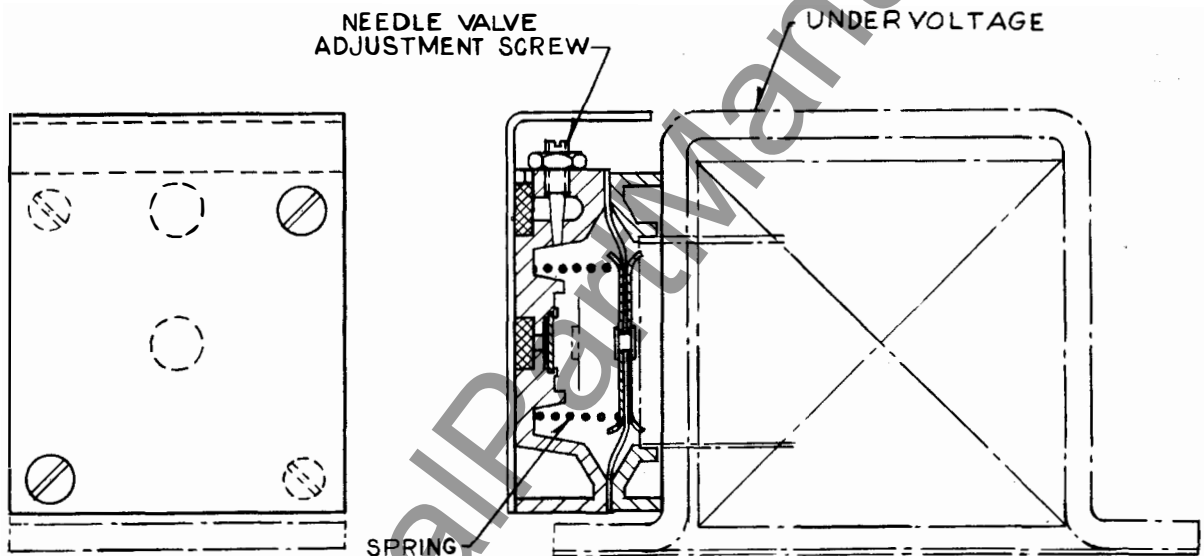


FIG. 14 - UNDERVOLTAGE TIME ATTACHMENT - CONSTRUCTION DETAILS

AUXILIARY SWITCH

The auxiliary switch (Figure 15) mounts on top of the platform to the left of the operating mechanism. The contacts will carry 15 amperes continuously or 250 amperes for 3 seconds.

The switch is a shaft-operated, 4-pole, rotary type normally having two "a" contacts (closed when the breaker is closed) and two "b" contacts (closed when the breaker is open). The rotor operates through a 90 degree angle and is non-adjustable. However, the contacts may be changed from "a" to "b" or vice versa. To change, remove the switch from the platform, remove the back cover, shaft and end bushing. Remove the rotor and change the contacts as desired. Be sure to replace the shaft in the original position relative to one of the unchanged contacts.

TABLE NO. 3 INTERRUPTING CAPACITY

INTERRUPTING CAPACITY IN AMP.

| VOLTS | NON-INDUCTIVE CIRCUIT | INDUCTIVE CIRCUIT |
|------------|-----------------------|-------------------|
| 125 V. D-C | 11 | 6.25 |
| 250 V. D-C | 2 | 1.75 |
| 115 V. A-C | 75 | 15 |
| 450 V. A-C | 25 | 5 |

Inspection

Remove the front cover and make sure contacts are touching well before the end of travel.

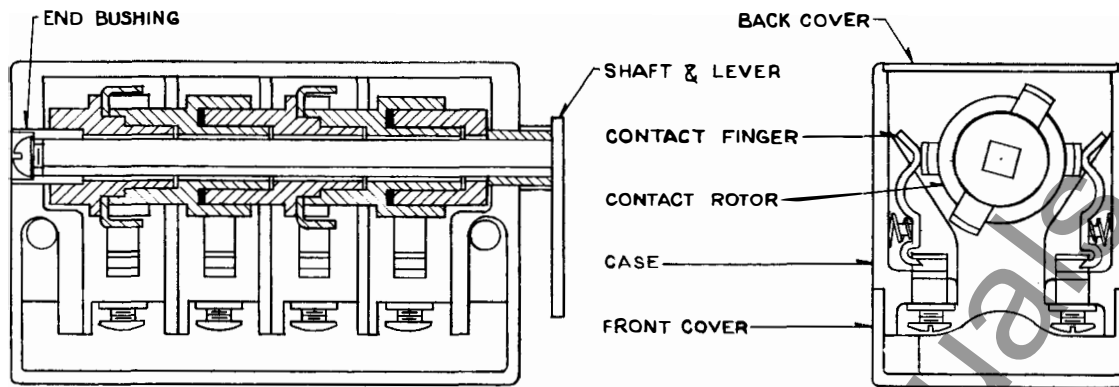


FIG. 15 - AUXILIARY SWITCH - CONSTRUCTION DETAILS

Maintenance

Check for loose bolts. Replace contacts if necessary.

ALARM SWITCH ATTACHMENT

The alarm switch (Fig. 16) is integrated with the shunt trip attachment and will energize the alarm circuit on all opening operations except those initiated through the push to trip button and shunt trip. The alarm switch may be reset manually by trip button or electrically by energizing the shunt trip coil (when electrical resetting has been provided). Closing the breaker also resets alarm switch.

Inspection

Close the breaker manually and then trip by trip button to be sure the alarm contact do not "make". Repeat the above procedure except trip by raising the O.C.T. trip finger. Note that the alarm contacts do make contact.

Maintenance

Clean the alarm contacts when necessary. Check for loose bolts.

ELECTRIC LOCKOUT ATTACHMENT

The electric lockout (Figure 17) mounts on the top of the platform, on the extreme left side and behind the auxiliary switches. Its function is to hold the breaker open (trip free) until the lockout coil is energized. The lockout coil can be de-energized after closure of the breaker, if desired, without tripping the breaker.

Inspection

Attempt to close the breaker. The lockout should prevent closure of the breaker by holding the trip rod in the trip free position. Holding the lockout armature in the closed position should permit closure of the breaker. Releasing the armature after closure should not trip the breaker.

Maintenance

The device is non-adjustable. Check for faulty coil and loose bolts.

KEY LOCK ATTACHMENT

The key lock (Figure 18) mounts on the right side of the operating mechanism frame.

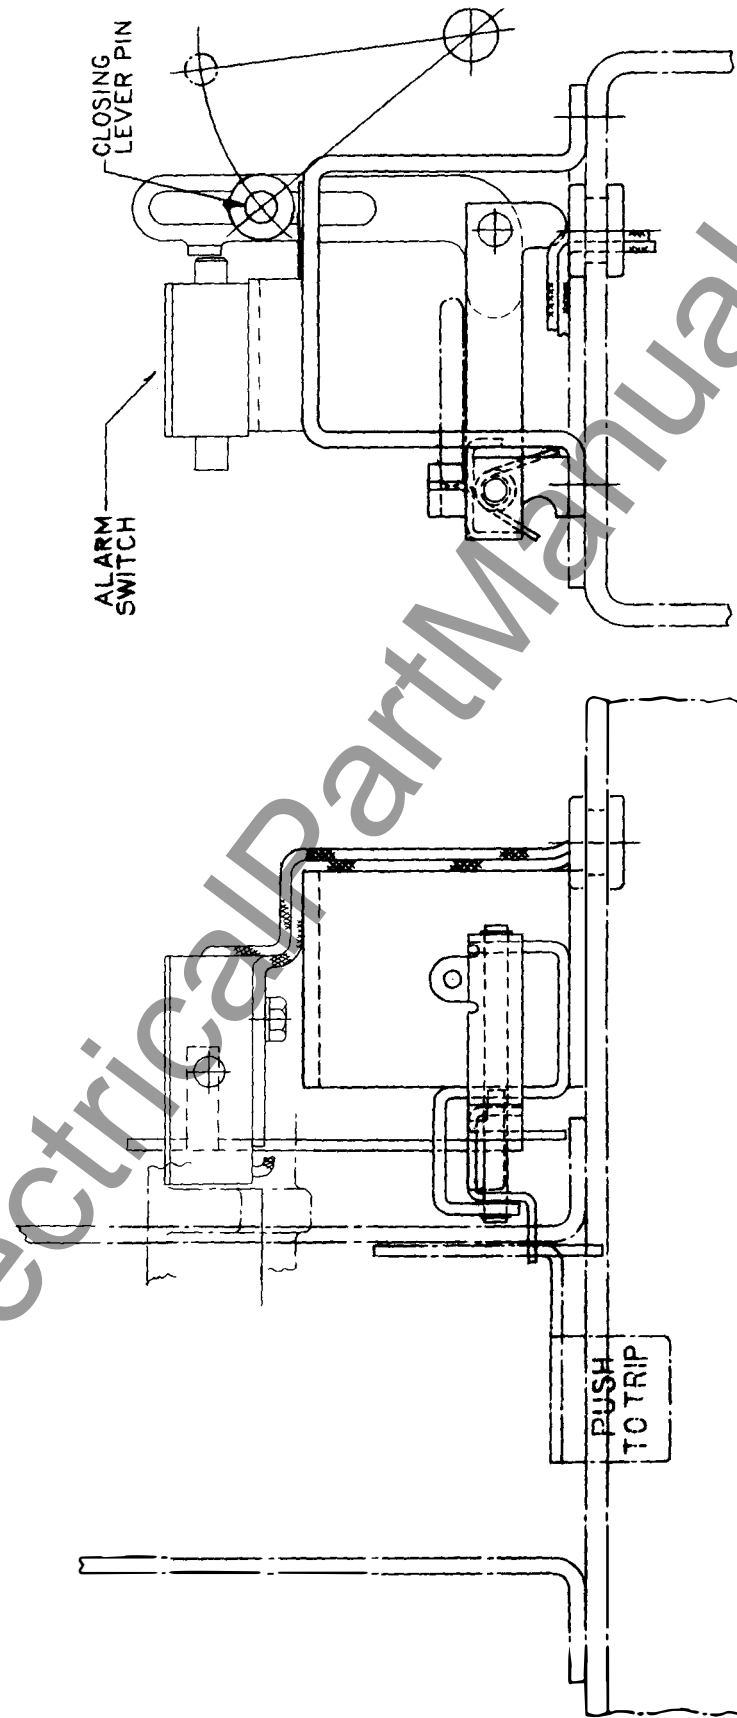


FIG. 16 - ALARM SWITCH ATTACHMENT - CONSTRUCTION DETAILS

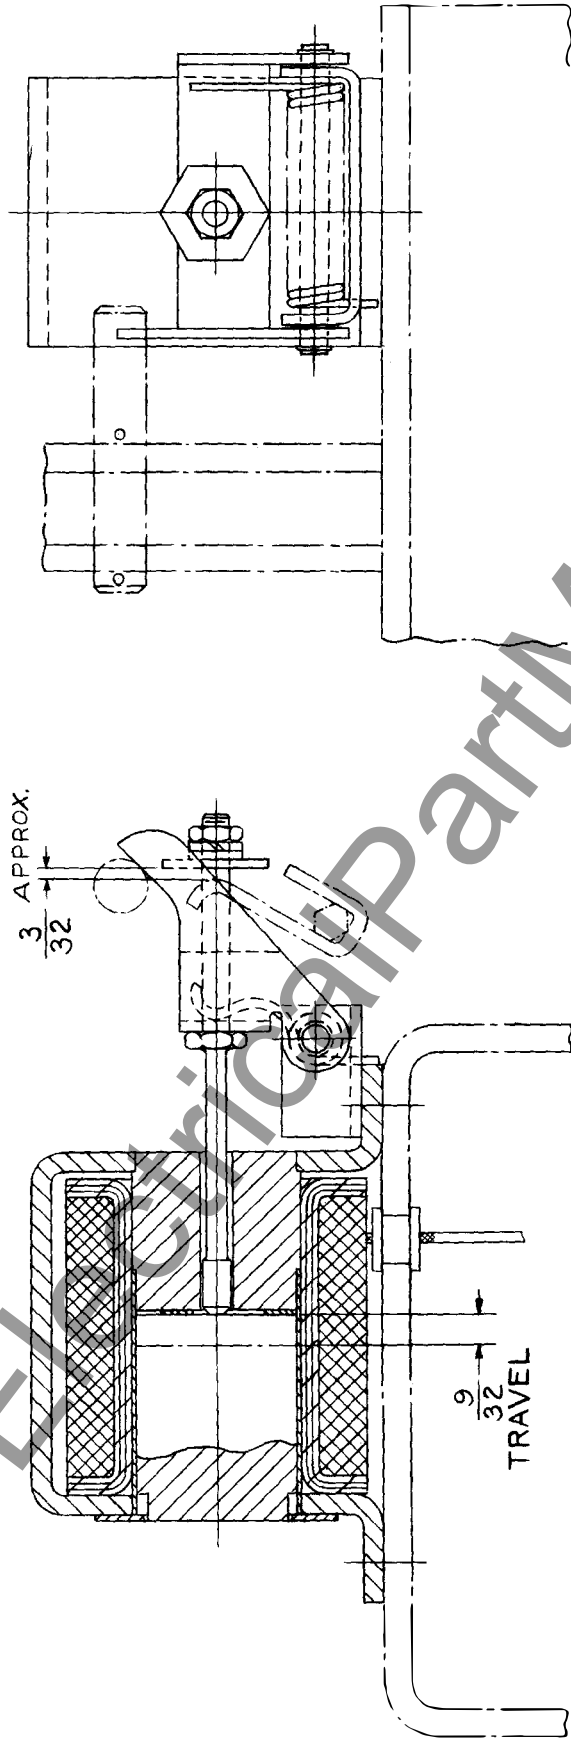


FIG. 17 - ELECTRICAL LOCK-OUT ATTACHMENT - CONSTRUCTION DETAILS

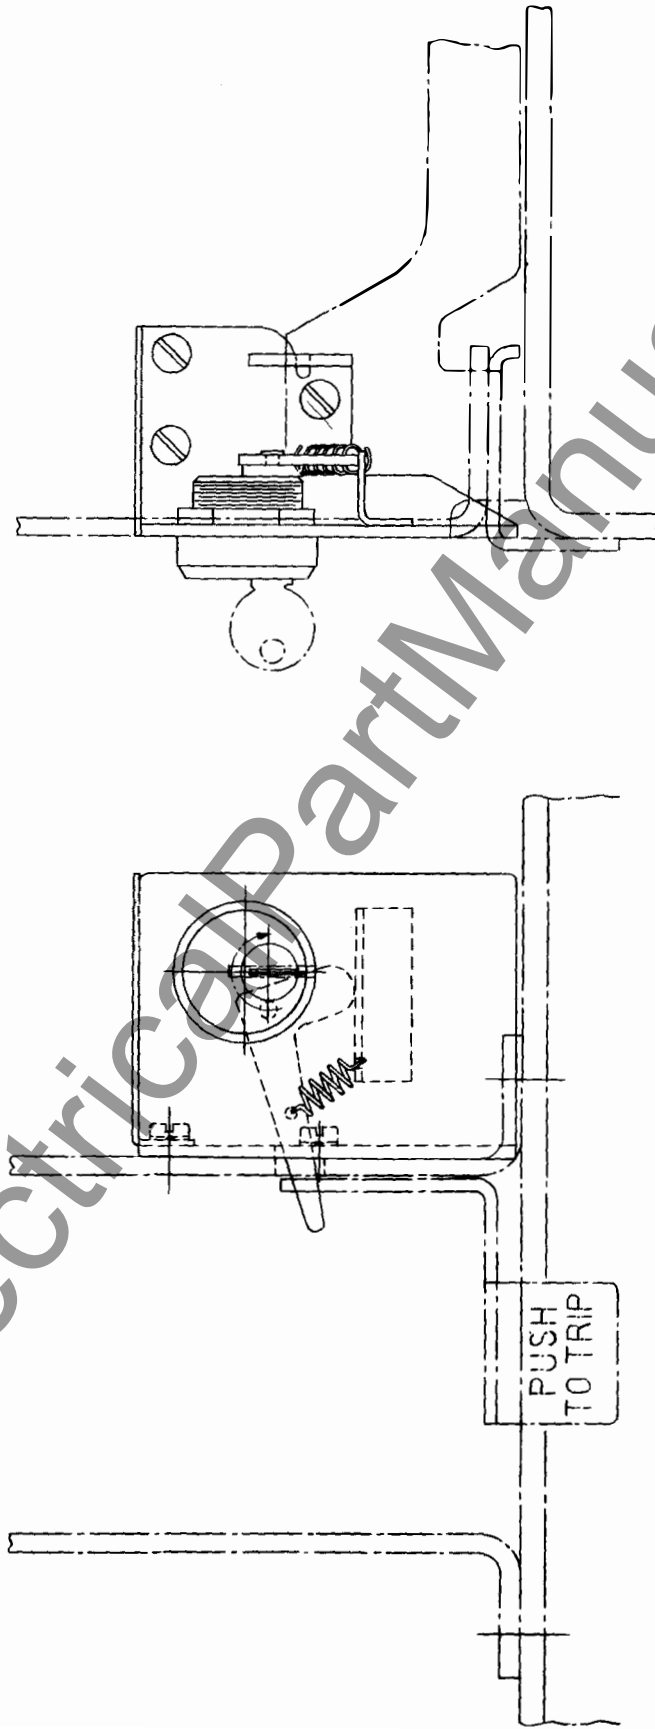


FIG. 18 - KEY LOCK OR KEY INTERLOCK ATTACHMENT - CONSTRUCTION DETAILS

The key can be removed in the open or closed position of the breaker.

Inspection

Push the trip button and turn key to the locked position. The key is then removable and the breaker is locked in the trip-free position. Replace key and rotate to the unlocked position to free breaker trip button. The key is also removed in this position.

Maintenance

The device is non-adjustable. Check for loose bolts only.

KEY INTERLOCK ATTACHMENT

The key interlock (Figure 18) closed mounts on the right side of the operating mechanism frame. When the key interlock attachment is furnished, the key lock attachment cannot be supplied. With the key interlock attachment the key cannot be removed unless the breaker is locked in the open position.

Inspection

Push the trip button and turn key to the locked position. The key is then removable and the breaker is locked in the trip-free position. Replace the key and rotate to the

unlocked position to free the breaker trip button. The key is not removable in this position.

Maintenance

The device is non-adjustable. Check for loose bolts and nuts only.

RECTIFIER UNIT FOR A-C UNDERVOLTAGE AND A-C ELECTRIC LOCKOUT ATTACHMENTS

When an a-c undervoltage attachment or an a-c electric lockout attachment or both are required, a RECTOX unit is mounted underneath the breaker platform under the undervoltage device as shown in Figure 19. An auto-transformer is provided in the unit so that the common voltages for 60 cycles and 25 cycles can be connected to the appropriate terminal on the unit. A terminal block is mounted on the rectifier unit to facilitate all wiring.

Inspection

There are no moving parts. Make certain a-c incoming leads are connected to proper terminals.

Maintenance

Check for loose connections.

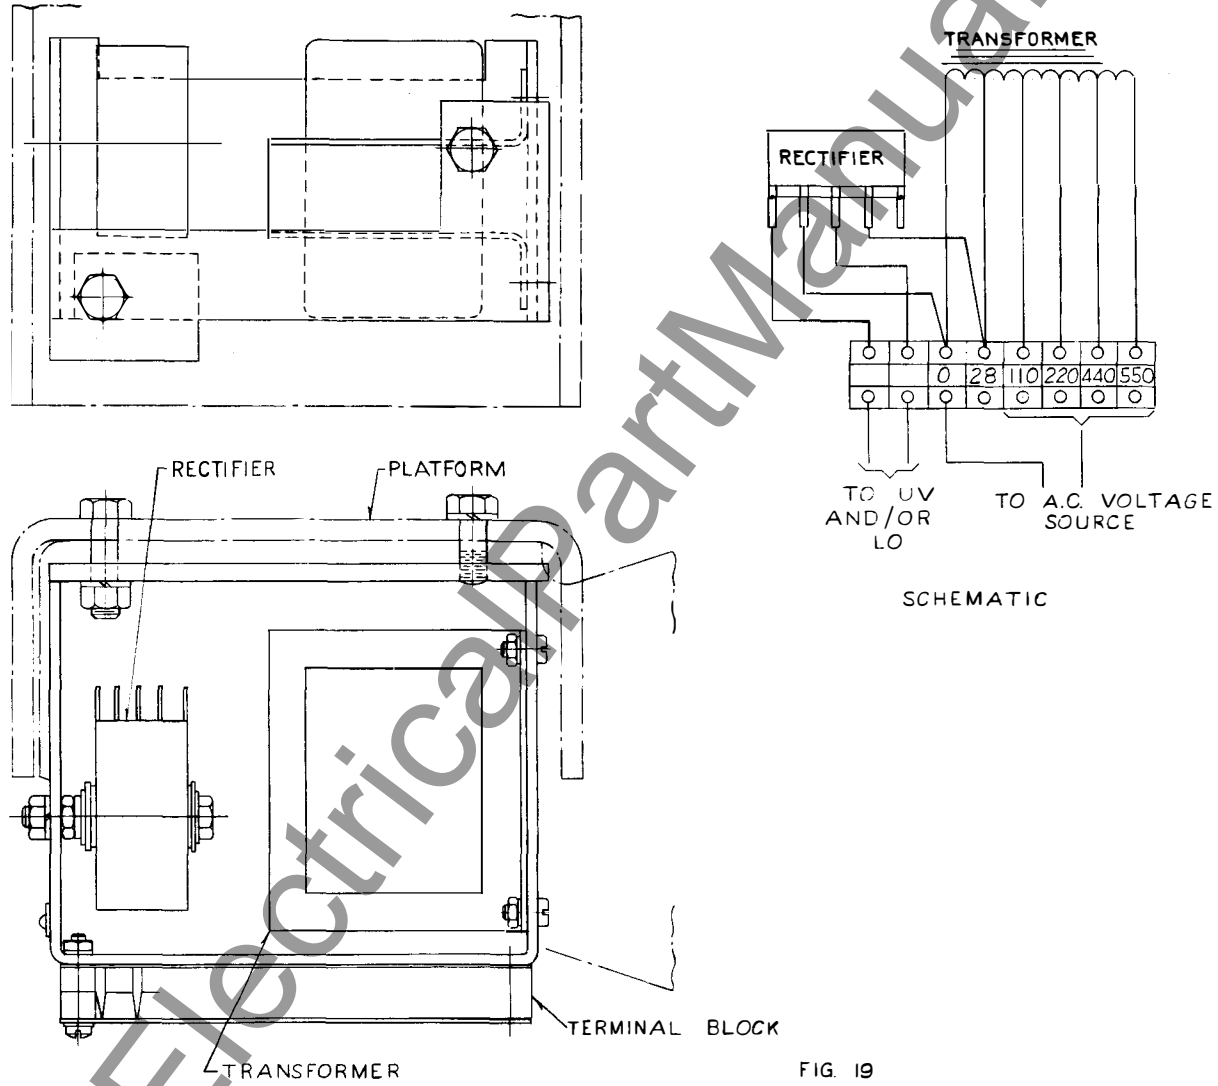


FIG. 19

FIG. 19 - RECTIFIER UNIT FOR A-C UNDERVOLTAGE AND ELECTRICAL LOCKOUT ATTACHMENTS

www.ElectricalManuals.com

