


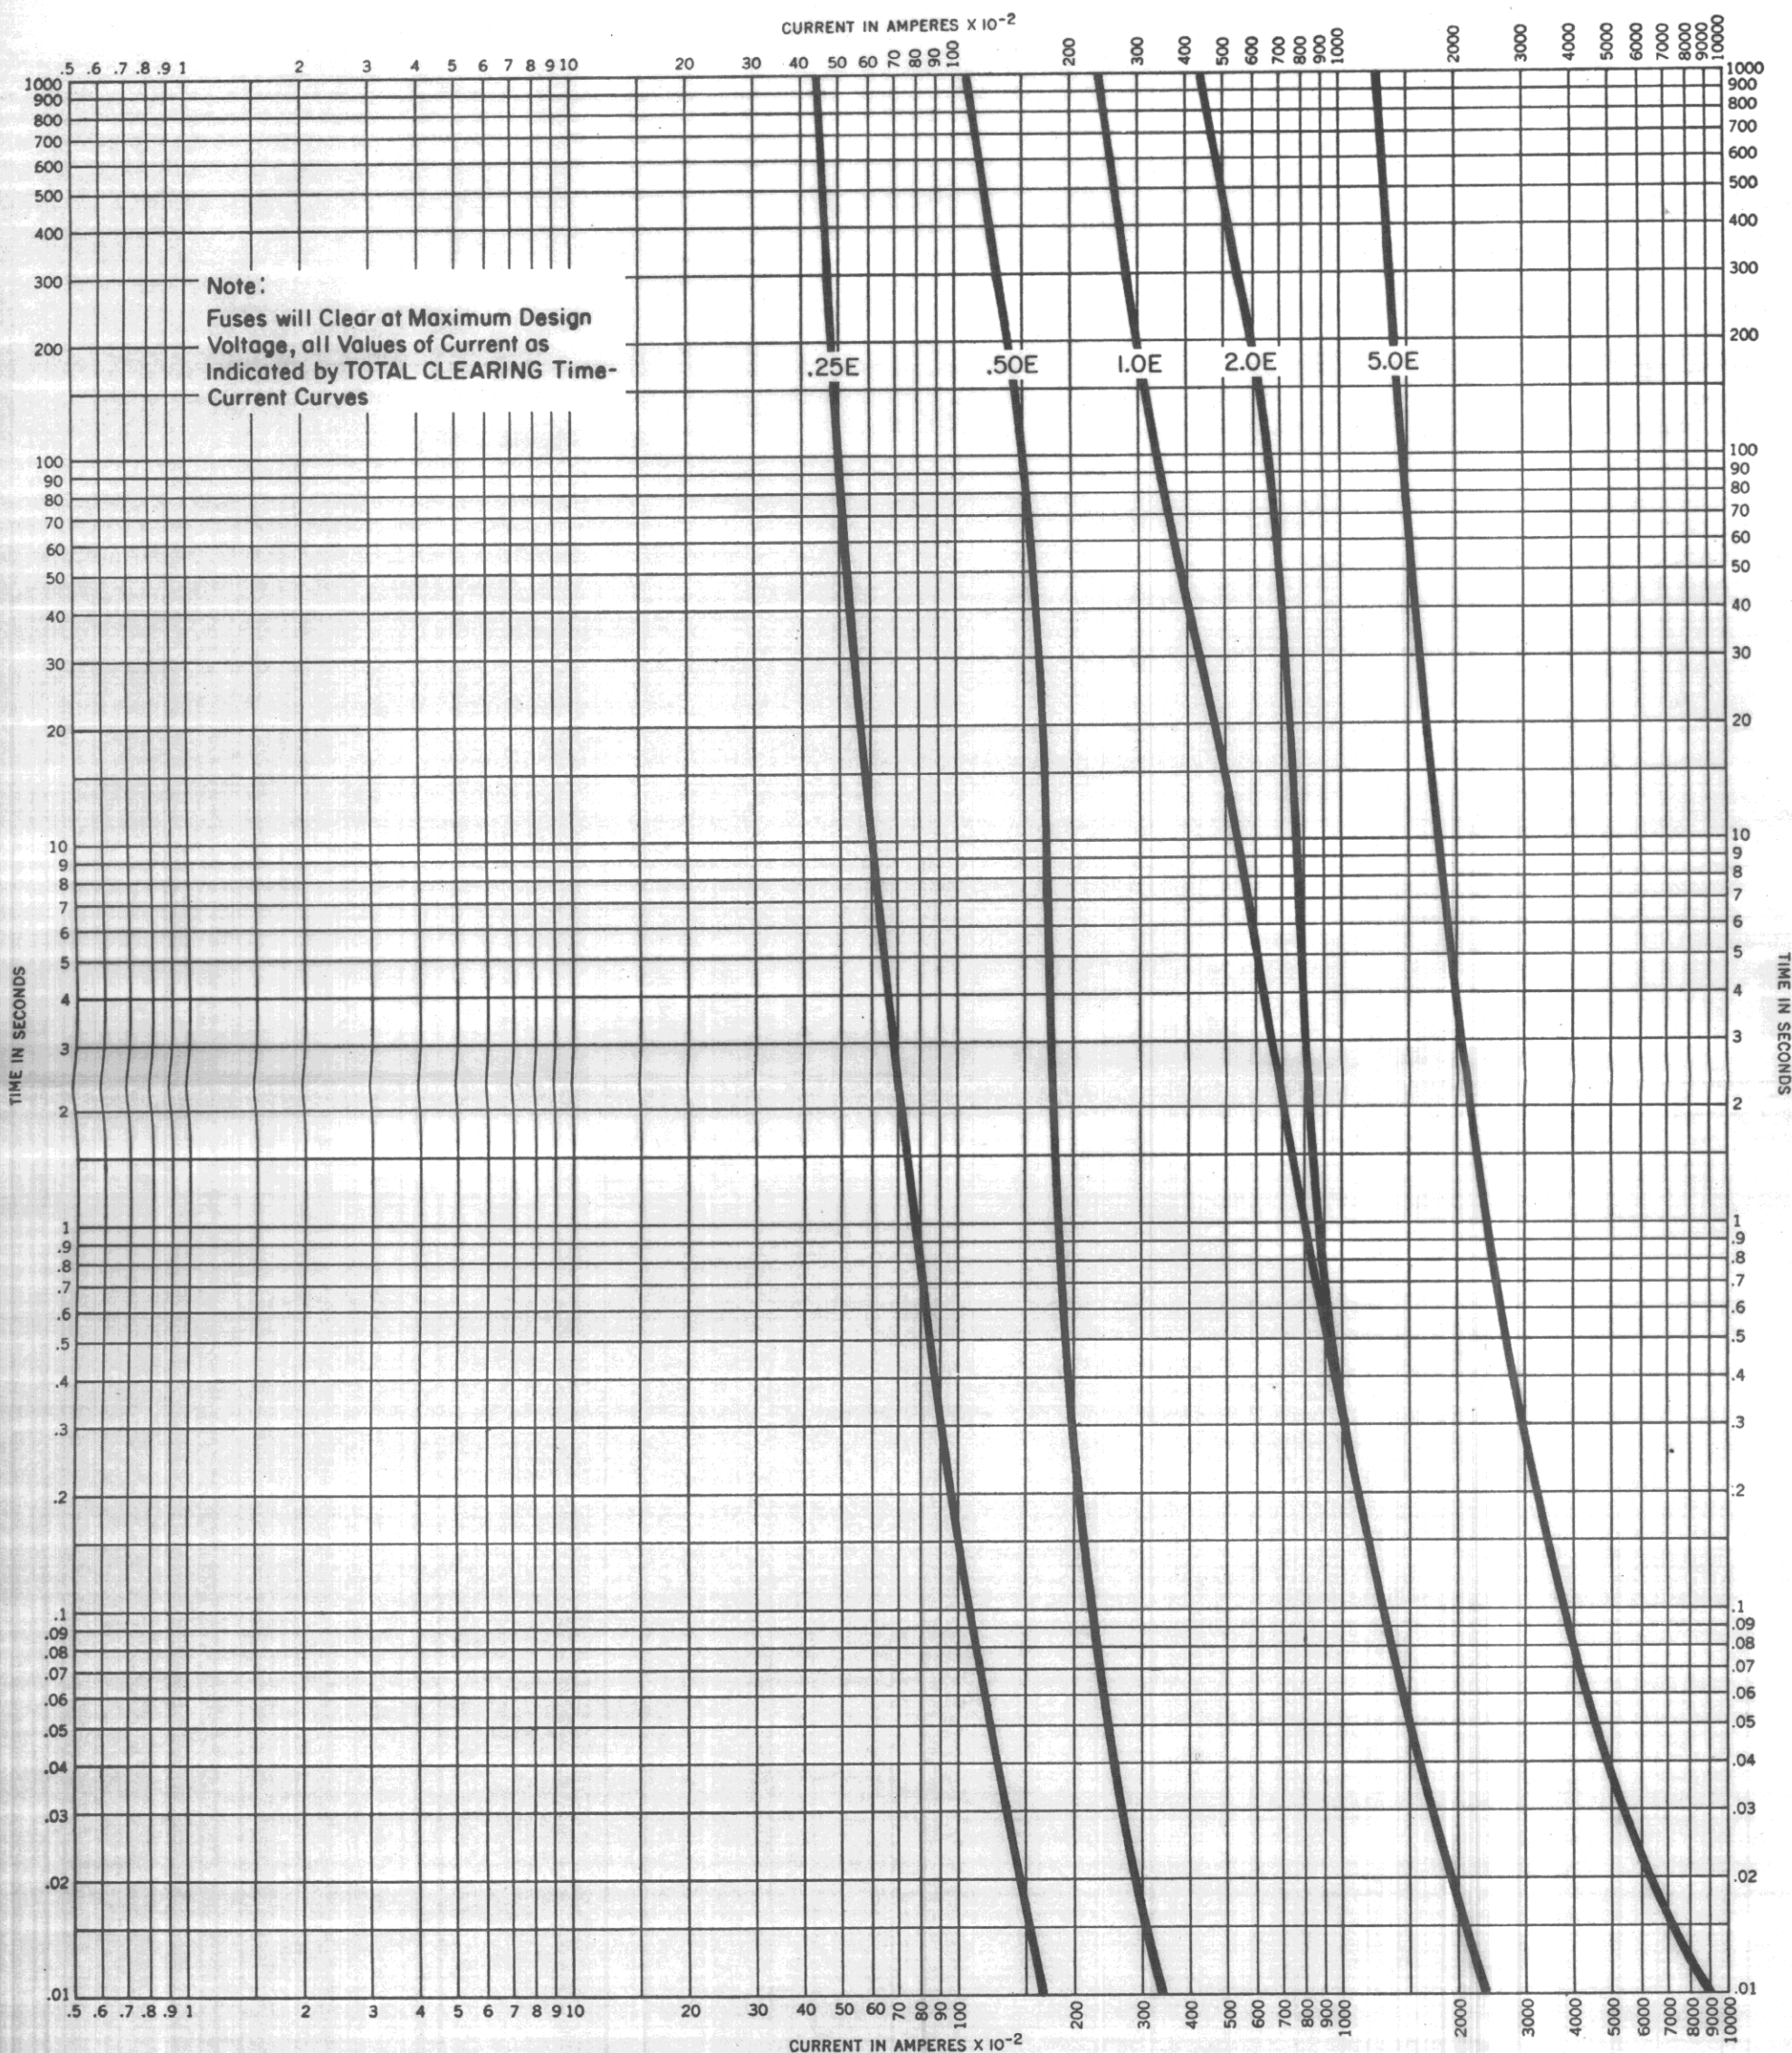

Type CLE-PT (Non-Indicating) Current Limiting Power Fuses

Total clearing time-current characteristics, 2.0 Kv to 5.5 Kv

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so variations should be negative.

Westinghouse Electric Corporation

Switchgear Division, Power Switching Equipment, East Pittsburgh, Pa.
Printed in USA

Curve No.

40

Supersedes Curve No. 40, dated November, 1966

Reference No. 598837

May, 1968