


INSTRUCTION MANUAL

FOR

OVERCURRENT RELAYS

BE1-50/51B-230 and BE1-50/51B-234

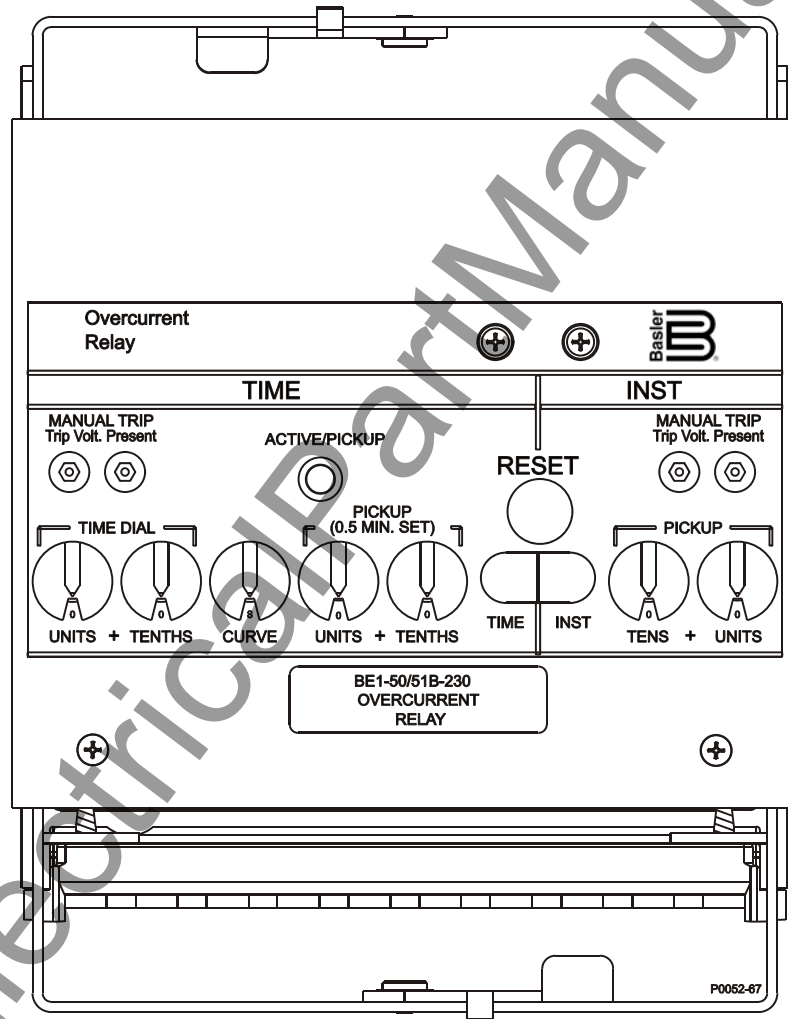

B Basler Electric

Publication: 9252000894
Revision: D 05/08

www.ElectricalPartManuals.com

INTRODUCTION

This instruction manual provides information about the operation and installation of the BE1-50/51B-230 and BE1-50/51B-234 Overcurrent Relays. To accomplish this, the following information is provided:

- General Information and Specifications
- Controls and Indicators
- Functional Description
- Installation and Maintenance
- Testing

WARNING!

To avoid personal injury or equipment damage, only qualified personnel should perform the procedures in this manual.

NOTE

Be sure that the relay is hard-wired to earth ground with no smaller than 12 AWG copper wire attached to the ground terminal on the rear of the unit case. When the relay is configured in a system with other devices, it is recommended to use a separate lead to the ground bus from each unit.

First Printing: October 2006

Printed in USA

© 2008 Basler Electric, Highland Illinois 62249 USA

All Rights Reserved

May 2008

CONFIDENTIAL INFORMATION

of Basler Electric, Highland Illinois, USA. It is loaned for confidential use, subject to return on request, and with the mutual understanding that it will not be used in any manner detrimental to the interest of Basler Electric.

It is not the intention of this manual to cover all details and variations in equipment, nor does this manual provide data for every possible contingency regarding installation or operation. The availability and design of all features and options are subject to modification without notice. Should further information be required, contact Basler Electric.

**BASLER ELECTRIC
ROUTE 143, BOX 269
HIGHLAND IL 62249 USA**

<http://www.basler.com>, info@basler.com

PHONE +1 618.654.2341

FAX +1 618.654.2351

REVISION HISTORY

The following information provides a historical summary of the changes made to this instruction manual (9252000894). Revisions are listed in reverse chronological order.

Manual Revision and Date	Change
D, 05/08	<ul style="list-style-type: none">• Updated Figures 2-2, 2-3, and 2-4 to show new layout of SW3.• Minor corrections in Section 5, <i>Testing</i>.
C, 03/08	<ul style="list-style-type: none">• Updated front panel drawings.
B, 11/07	<ul style="list-style-type: none">• Added 9252000234 (1 amp relay).
A, 12/06	<ul style="list-style-type: none">• Revised target current ranges stated throughout the manual.• Clarified continuous rating for the current sensing input. Added derating graph.• Added IEEE C37.90.2 compliance for radiated interference.• Added cURus recognition.• Modified target testing procedure to provide individual testing of the 51 and 50-A targets.• Added publication number and revision level to the footer of each page.
—, 10/06	<ul style="list-style-type: none">• Initial release

www.ElectricalPartManuals.com

This page intentionally left blank.

CONTENTS

SECTION 1 • GENERAL INFORMATION	1-1
SECTION 2 • CONTROLS AND INDICATORS	2-1
SECTION 3 • FUNCTIONAL DESCRIPTION	3-1
SECTION 4 • INSTALLATION	4-1
SECTION 5 • TESTING	5-1
APPENDIX A • CHARACTERISTIC CURVES.....	A-1

www.ElectricalPartManuals.com

www.ElectricalPartManuals.com

This page intentionally left blank.

SECTION 1 • GENERAL INFORMATION

TABLE OF CONTENTS

SECTION 1 • GENERAL INFORMATION	1-1
INTRODUCTION.....	1-1
FEATURES.....	1-1
Advantages.....	1-1
SPECIFICATIONS	1-2
Time Overcurrent (51) Element.....	1-2
Instantaneous Overcurrent A (50-A) Element.....	1-2
Instantaneous Overcurrent B (50-B) Element.....	1-3
Current Sensing Input	1-3
Frequency Response	1-5
Transient Response	1-5
Harmonic Rejection.....	1-5
Target Indicators	1-6
Output Contacts	1-7
Type Tests.....	1-7
Agency Recognition	1-7
Environment	1-7
Physical	1-7
Figures	
Figure 1-1. Current Sensing Input Derating Curve (BE1-50/51B-230).....	1-3
Figure 1-2. Current Sensing Input Derating Curve (BE1-50/51B-234).....	1-4
Figure 1-3. Current Sensing Input Burden (BE1-50/51B-230)	1-4
Figure 1-4. Current Sensing Input Burden (BE1-50/51B-234)	1-5
Figure 1-5. Harmonic Rejection.....	1-6

www . ElectricalPartManuals . com

This page intentionally left blank.

SECTION 1 • GENERAL INFORMATION

INTRODUCTION

BE1-50/51B-230 and BE1-50/51B-234 relays provide non-directional, single-phase or ground overcurrent protection and are direct replacements for General Electric IAC66K relays. The BE1-50/51B-230 has a 5 ampere current sensing input. The BE1-50/51B-234 has a 1 ampere current sensing input. The BE1-50/51B-230 and BE1-50/51B-234 relays are supplied as draw-out assemblies that plug directly into existing cases for IAC66K relays. The draw-out assemblies are supplied with connection plugs, relay covers, and adaptor plates for mounting the covers onto existing IAC66K cases.

BE1-50/51B-230 and BE1-50/51B-234 relays are self-powered, compatible with 50 or 60 Hz power systems, and have three protection elements: one time overcurrent (51) element and two instantaneous overcurrent (50) elements. The 51 element offers timing characteristic curves similar to those used by GE IAC and ABB relays.

FEATURES

A wide range of pickup settings and front panel selectable time characteristics permit applications involving coordination with fuses, reclosers, cold load pickup, motor starting, and fixed time requirements. In addition, an integrating reset function is available to simulate the disk reset of electromechanical relays.

BE1-50/51B-230 and BE1-50/51B-234 overcurrent relays have the following standard features.

- Independent time and instantaneous elements
- A secure method to manually trip the breaker at the relay front panel
- Direct reading front panel controls
- Minimum pickup setting for safety during installation
- Time characteristics extend to a pickup multiple of 40
- Rugged draw-out construction with steel case
- Gravity latching targets retain indication without power
- Built-in accuracy eliminates internal adjustments
- Minimum transient overreach
- Field selectable characteristic curve selection similar to either GE IAC or ABB type curves
- Field selectable instantaneous or integrating reset
- Field selectable 50 or 60 Hz operation
- Field selectable 0.0 or 0.1 second, fixed, instantaneous delay

Internal switches provide for selecting system-operating frequencies of 50 or 60 Hz, instantaneous element delays of 0.0 or 0.1 second, characteristic curve group selection for either GE IAC or ABB type curves, and instantaneous or integrating reset characteristics. Switch location and description is provided in Section 2.

Advantages

BE1-50/51B-230 and BE1-50/51B-234 overcurrent relays have many advantages over other overcurrent relays. The primary advantages are:

- Time characteristics are defined by equations and graphs
- Field selectable time characteristics
- Very low burden extends the linear range of the CTs
- Self powered from the sensed current
- Continuous automatic calibration

BE1-50/51B-230 and BE1-50/51B-234 overcurrent relays may be tested without removing the relay from the case. Shorting contacts are provided for all current inputs when the connection plugs or relay chassis is removed from the relay case.

SPECIFICATIONS

BE1-50/51B-230 and BE1-50/51B-234 electrical and physical specifications are listed in the following paragraphs.

Time Overcurrent (51) Element

BE1-50/51B-230 Pickup

Setting Range: 0.5 to 15.9 Aac
Setting Increment: 0.1 Aac
Accuracy: Sum of $\pm 2\%$ and ± 25 mAac

BE1-50/51B-234 Pickup

Setting Range: 0.1 to 3.18 Aac
Setting Increment: 0.02 Aac
Accuracy: Sum of $\pm 2\%$ and ± 5 mAac

Dropout

Dropout occurs at 95% of pickup value.

Characteristic Curves

Available curve types follow IEEE Standard C37.112 (1996) and emulate standard GE IAC, ABB CO, and BS142 curves. Appendix A, *Characteristic Curves* illustrates the available curves and lists the applicable constants.

Curve Types: Short Inverse, Long Inverse, Definite Time, Moderately Inverse, Inverse, Very Inverse, Extremely Inverse, BS142 Very Inverse, BS142 Extremely Inverse, Fixed Time
Time Multiplier: 11 curves for each characteristic
Timing Accuracy: ± 1 cycle, $\pm 2\%$. This accuracy applies to the range of 1.3 to 40 times tap and is for a given measured multiple of tap.

Fixed Timing

Setting Range: 0.1 to 9.9 s
Setting Increment: 0.1 s
Timing Accuracy: ± 1 cycle, $\pm 2\%$ of the time to trip for time dial settings ≥ 0.1 .

Reset

Integrating: Simulates the disk reset of electromechanical relays and begins when the current decreases below 95% of pickup. Appendix A, *Characteristic Curves* illustrates the integrating reset characteristic curve and equation.
Instantaneous: Reset occurs within 16 ms of when the current decreases below 95% of the pickup level.

Instantaneous Overcurrent A (50-A) Element

BE1-50/51B-230 Pickup

Setting Range: 2 to 99 Aac
Setting increment: 1 Aac
Accuracy: Sum of $\pm 2\%$ and ± 25 mAac

BE1-50/51B-234 Pickup

Setting Range: 0.4 to 19.8 Aac
Setting increment: 0.2 Aac
Accuracy: Sum of $\pm 2\%$ and ± 5 mAac

Dropout

Dropout occurs at 95% of pickup value.

Time Delay

Switch selectable—no intentional delay (SW3-2 open/off) or a fixed delay of 100 ms (SW3-2 closed/on). Appendix A, *Characteristic Curves* illustrates the characteristic curve for the 50-A and 50-B elements.

Instantaneous Overcurrent B (50-B) Element

BE1-50/51B-230 Pickup

Setting Range: 1 to 15.9 Aac
Setting increment: 0.1 Aac
Accuracy: Sum of $\pm 2\%$ and ± 25 mAac

BE1-50/51B-234 Pickup

Setting Range: 0.2 to 3.18 Aac
Setting increment: 0.02 Aac
Accuracy: Sum of $\pm 2\%$ and ± 5 mAac

Dropout

Dropout occurs at 95% of pickup value.

Time Delay

Fixed at no intentional delay. Appendix A, *Characteristic Curves* illustrates the characteristic curve for the 50-A and 50-B elements.

Reset Characteristic

Resets within 16 ms of when sensed current decreases below the pickup level.

Current Sensing Input

BE1-50/51B-230

Continuous Rating: 14 Aac*
1 Second Rating: 400 Aac

* Continuous rating is 14 Aac for temperatures up to 45°C. See Figure 1-1 for derating curve.

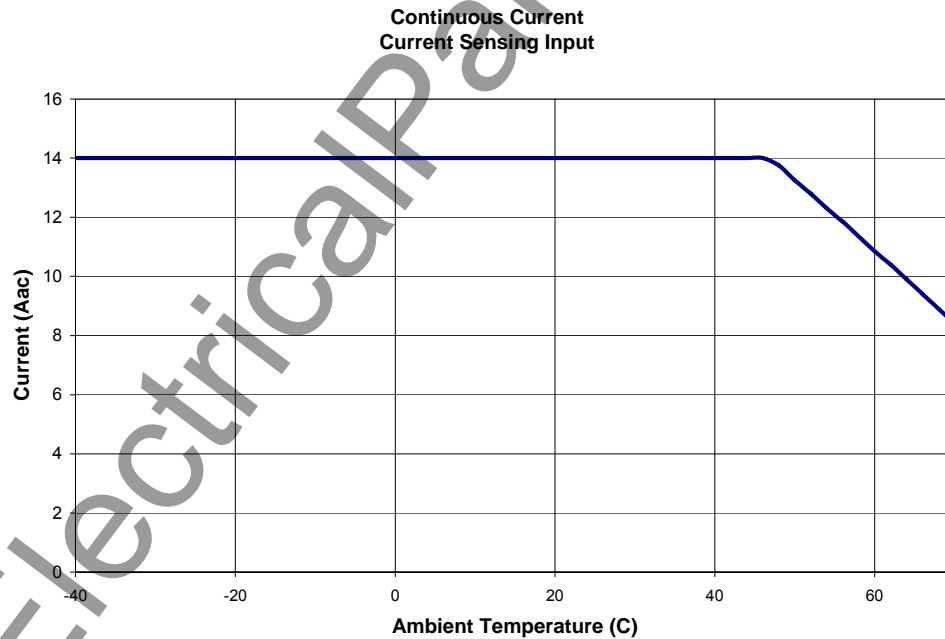


Figure 1-1. Current Sensing Input Derating Curve (BE1-50/51B-230)

BE1-50/51B-234

Continuous Rating: 2.8 Aac*

1 Second Rating: 80 Aac

* Continuous rating is 2.8 Aac for temperatures up to 45°C. See Figure 1-2 for derating curve.

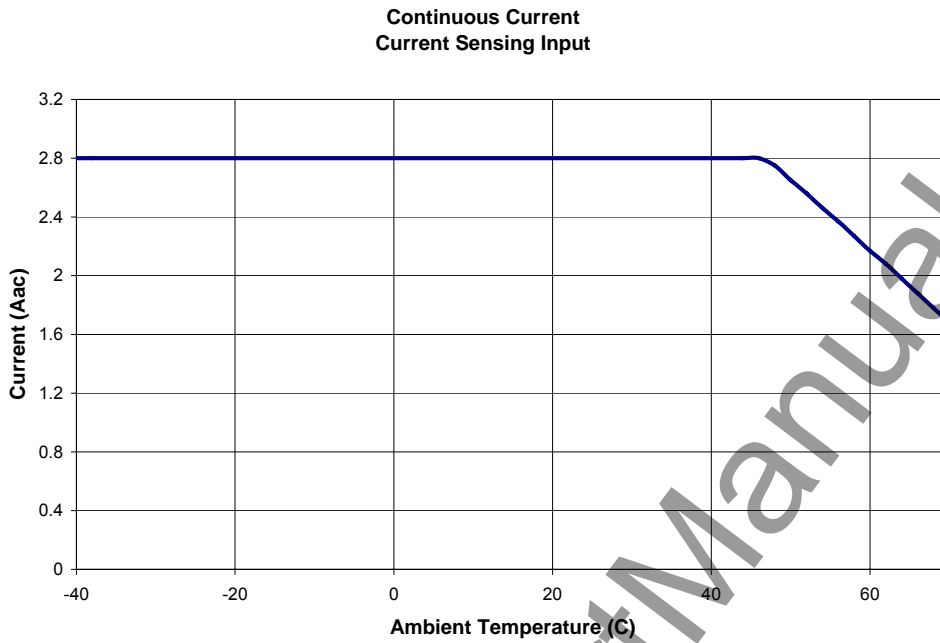


Figure 1-2. Current Sensing Input Derating Curve (BE1-50/51B-234)

BE1-50/51B-230 Burden

Figure 1-3 illustrates the current sensing input burden characteristic.

At 0.5 Aac: 2.8 Ω

At 5.0 Aac: 0.3 Ω

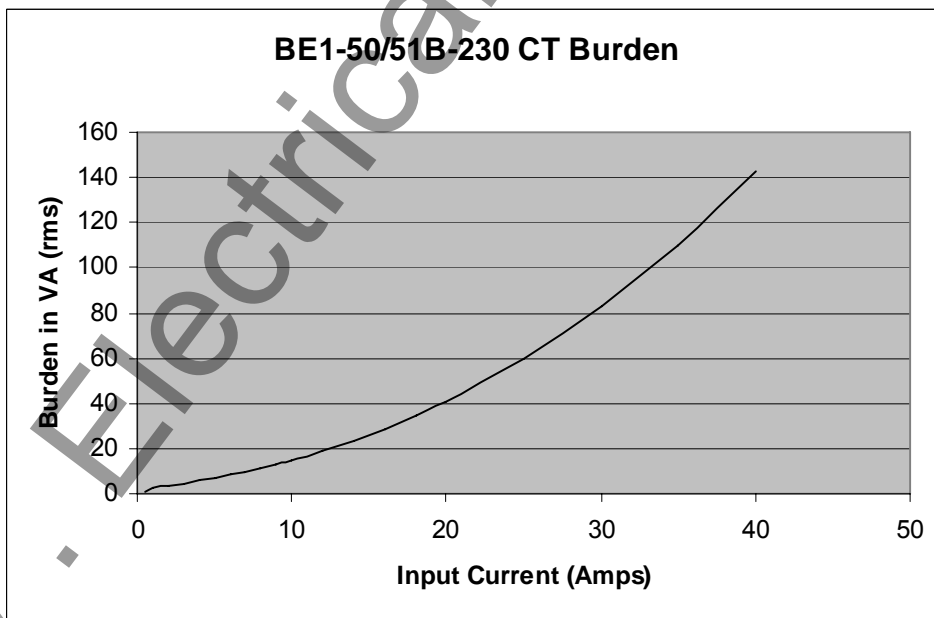


Figure 1-3. Current Sensing Input Burden (BE1-50/51B-230)

BE1-50/51B-234 Burden

Figure 1-4 illustrates the current sensing input burden characteristic.

At 0.1 Aac: 57.0 Ω
At 1.0 Aac: 6.9 Ω

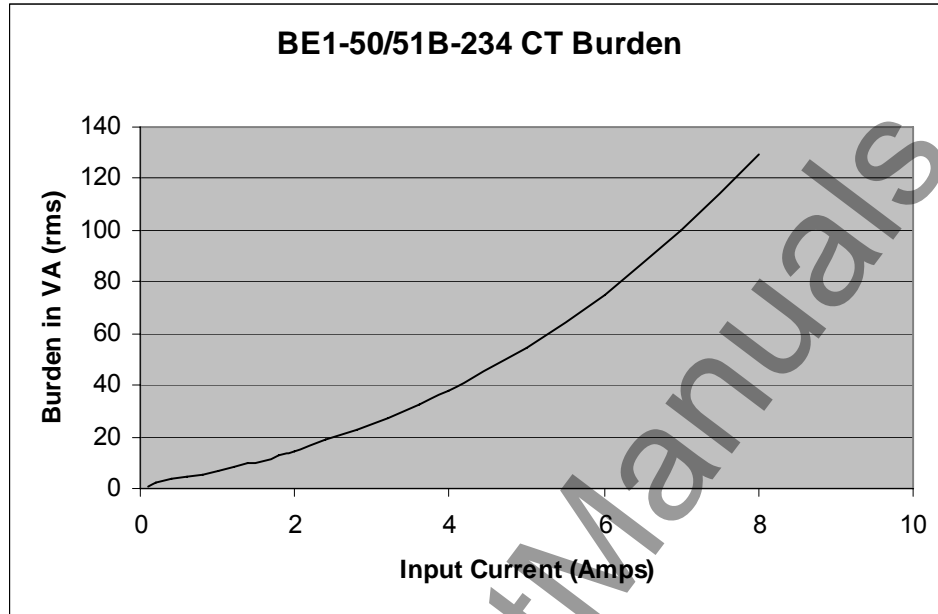


Figure 1-4. Current Sensing Input Burden (BE1-50/51B-234)

Frequency Response

A change of ± 5 Hz from the nominal 50/60 Hz current causes $<0.5\%$ change in the current required for pickup.

Transient Response

$<10\%$ overreach with system time constants up to 40 ms.

Harmonic Rejection

Rejection of odd and even harmonics is illustrated in Figure 1-5.

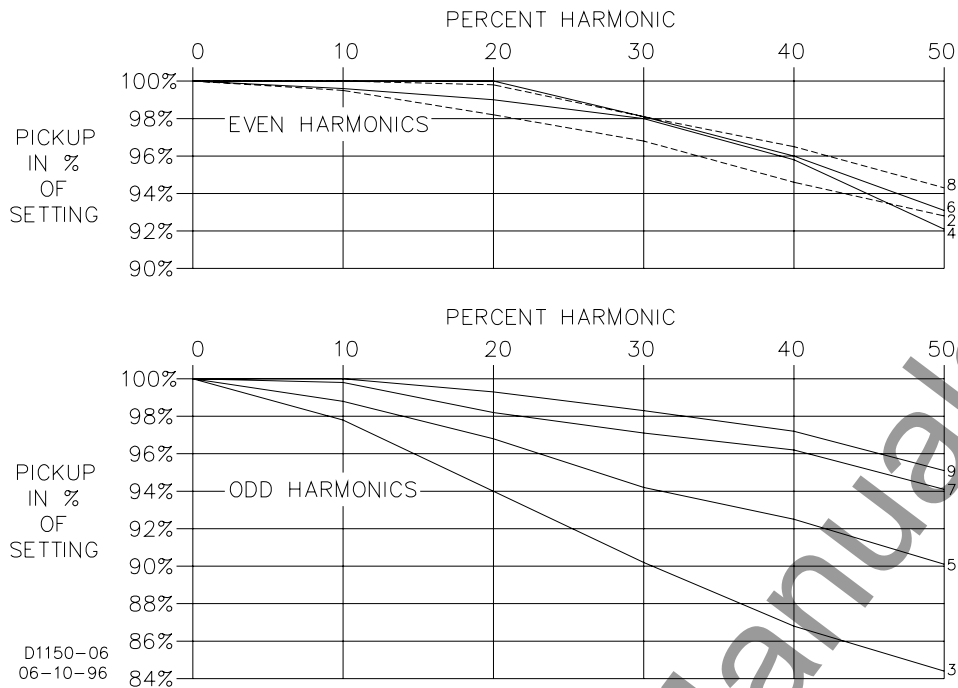


Figure 1-5. Harmonic Rejection

Target Indicators

A gravity-latched, manually-reset, current-operated target indicator is provided for the time-overcurrent (51) trip output and the instantaneous overcurrent A (50-A) trip output. A target indicator is not provided for the 50-B trip output. The level of trip circuit current required to operate each target is individually controlled by a circuit board jumper. See Section 2, *Controls and Indicators* for jumper locations and function assignments

Minimum Operating Current

Jumper Position—Pins 1 and 2: 0.9 to 2.25 A *

Jumper Position—Pins 2 and 3: 80 mA to 200 mA *

* Minimum operating current values. See *Output Contacts* for the maximum acceptable levels of trip circuit currents.

Output Contacts

Each protective element (51, 50-A, and 50-B) is equipped with a set of Form A contacts rated for tripping duty.

Resistive Ratings

120/240 Vac: Make 30 amperes for 0.2 seconds, carry 7 amperes for 2 minutes, 3 amperes continuously, and break 5 amperes.

125/250 Vdc: Make 30 amperes for 0.2 seconds, carry 7 amperes for 2 minutes, 3 amperes continuously, and break 0.3 ampere.

Inductive Ratings

120/240 Vac, 125/250 Vdc: Make and carry 30 amperes for 0.2 seconds, carry 7 amperes for 2 minutes, 3 amperes continuously, and break 0.3 ampere. (L/R = 0.04).

Terminal Assignments

51 Element:	1, 2
50-A Element:	1, 3
50-B Element:	9, 10

Type Tests

Isolation:	IEEE C37.90
Transient Surge:	IEEE C37.90.1
Radiated Interference:	IEEE C37.90.2
Electrostatic Discharge:	IEEE C37.90.3
Vibration:	IEC 255021-1
Shock and Bump:	IEC 255-21-2

Agency Recognition

cURus

cURus recognition per UL Standard 508, File E97035 and CSA Standard C22.2 No. 14

Environment

Operating Temperature:	-40 to 70°C (-40 to 158°F)
Storage Temperature:	-50 to 70°C (-58 to 158°F)

Physical

Weight:	6.1 lb (2.77 kg)
---------	------------------

www . ElectricalPartManuals . com

This page intentionally left blank.

SECTION 2 • CONTROLS AND INDICATORS

TABLE OF CONTENTS

SECTION 2 • CONTROLS AND INDICATORS	2-1
INTRODUCTION.....	2-1
FRONT PANEL CONTROLS AND INDICATORS.....	2-1
CIRCUIT BOARD CONTROLS.....	2-3

Figures

Figure 2-1. Front Panel Controls and Indicators	2-1
Figure 2-2. Circuit Board Controls.....	2-3
Figure 2-3. View of 50-B Pickup Selector Switches (BE1-50/51B-230).....	2-5
Figure 2-4. View of 50-B Pickup Selector Switches (BE1-50/51B-234).....	2-5

Tables

Table 3-1. Front Panel Controls and Indicators.....	2-2
Table 3-2. Circuit Board Controls	2-4

www.ElectricalPartManuals.com

This page intentionally left blank.

SECTION 2 • CONTROLS AND INDICATORS

INTRODUCTION

BE1-50/51B-230 and BE1-50/51B-234 relay controls and indicators are located on the front panel and circuit board.

FRONT PANEL CONTROLS AND INDICATORS

Front panel controls and indicators are illustrated in Figure 2-1 and described in Table 2-1. The locators and descriptions of Table 2-1 correspond to the locators shown in Figure 2-1.

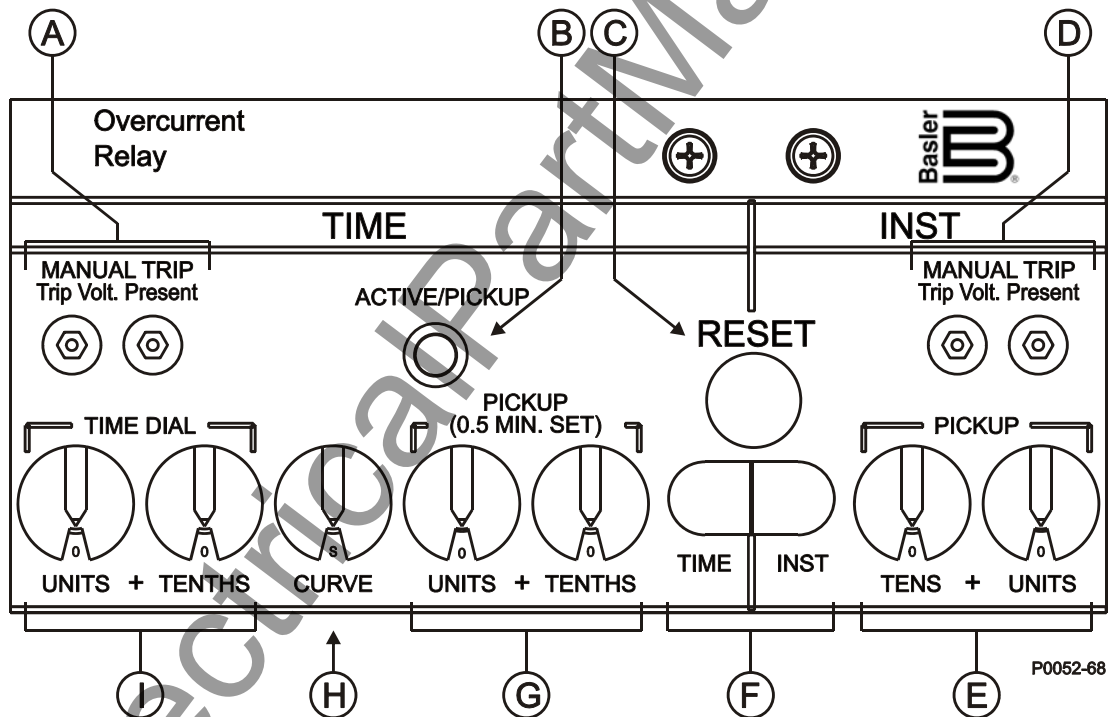


Figure 2-1. Front Panel Controls and Indicators

Table 2-1. Front Panel Controls and Indicators

Locator	Description
A	<i>Time Overcurrent Manual Trip Jacks.</i> These jacks are used to manually trip a breaker controlled by the 51 trip output contacts. This is achieved by plugging a jumper wire, terminated with two standard 0.08 inch diameter phone-tip plugs, into the two jacks.
B	<i>Active/Pickup Indicator.</i> This bicolor LED indicates the level of current sensed by the relay. The LED is red when the sensed current exceeds the time overcurrent pickup setting. The LED color changes from red to green when the sensed current decreases below 95% of the time overcurrent pickup setting. A green LED indicates that the relay is active but not picked up.
C	<i>Target Reset Button.</i> This button is pressed to reset the two, gravity-latched target indicators (locator F).
D	<i>Instantaneous Overcurrent Manual Trip Jacks.</i> These jacks are used to manually trip a breaker controlled by the 50-A trip output contacts. This is achieved by plugging a jumper wire, terminated with two standard 0.08 inch diameter phone-tip plugs, into the two jacks. These jacks do not activate the 50-B trip output contacts.
E	<p><i>Instantaneous Overcurrent A Pickup Selector Switches.</i> These two rotary switches select the instantaneous overcurrent A (50-A) pickup current setting in amperes (UNITS and TENTHS on the BE1-50/51B-230, COARSE and FINE on the BE1-50/51B-234). Adjusting these selector switches while the relay is in service may cause the relay to trip.</p> <div data-bbox="354 926 1289 1089" style="border: 1px solid black; padding: 5px; margin: 10px auto; width: fit-content;"> <p style="text-align: center;">NOTE</p> <p>When testing time overcurrent functions, instantaneous pickup settings of 00 will affect the calibration of the time functions. Time pickup settings of 00 also affect instantaneous functions.</p> </div>
F	<i>Target Indicators.</i> Red target indicators latch when the corresponding set of trip contacts closes and sufficient trip circuit current is detected. (The level of current that will trip each target indicator is jumper-selectable. See <i>Circuit Board Controls</i> for more information.) The Time target indicates the flow of current in the time overcurrent (51) trip circuit. The Inst target indicates the flow of current in the instantaneous overcurrent A (50-A) trip circuit. No target is provided for the instantaneous overcurrent B (50-B) trip circuit. Both target indicators are reset by pressing the target reset button (locator C).
G	<i>Time Overcurrent Pickup Selector Switches.</i> These two rotary switches select the time overcurrent pickup current setting in amperes (UNITS and TENTHS on the BE1-50/51B-230, COARSE and FINE on the BE1-50/51B-234). Adjusting these selector switches while the relay is in service may cause the relay to trip.
H	<i>Curve Selector Switch.</i> This ten position rotary switch selects one of nine inverse timing characteristics or one fixed time function. Refer to Appendix A, <i>Characteristic Curves</i> for details about the timing characteristics of the BE1-50/51B-230 and BE1-50/51B-234.
I	<i>Time Overcurrent Time Dial Selector Switches.</i> These two rotary switches select the desired curve of the timing characteristic selected by the Curve Selector Switch (locator H). When a fixed time characteristic is used (Curve Selector Switch setting of F), the setting of these switches corresponds to a time delay of 0.0 to 9.9 seconds.

CIRCUIT BOARD CONTROLS

Circuit board controls consist of two rotary selector switches, a four-position slide switch, and two jumpers. Circuit board controls are illustrated in Figure 2-2 and described in Table 2-2. The locators and descriptions of Table 2-2 correspond to the locators shown in Figure 2-2.

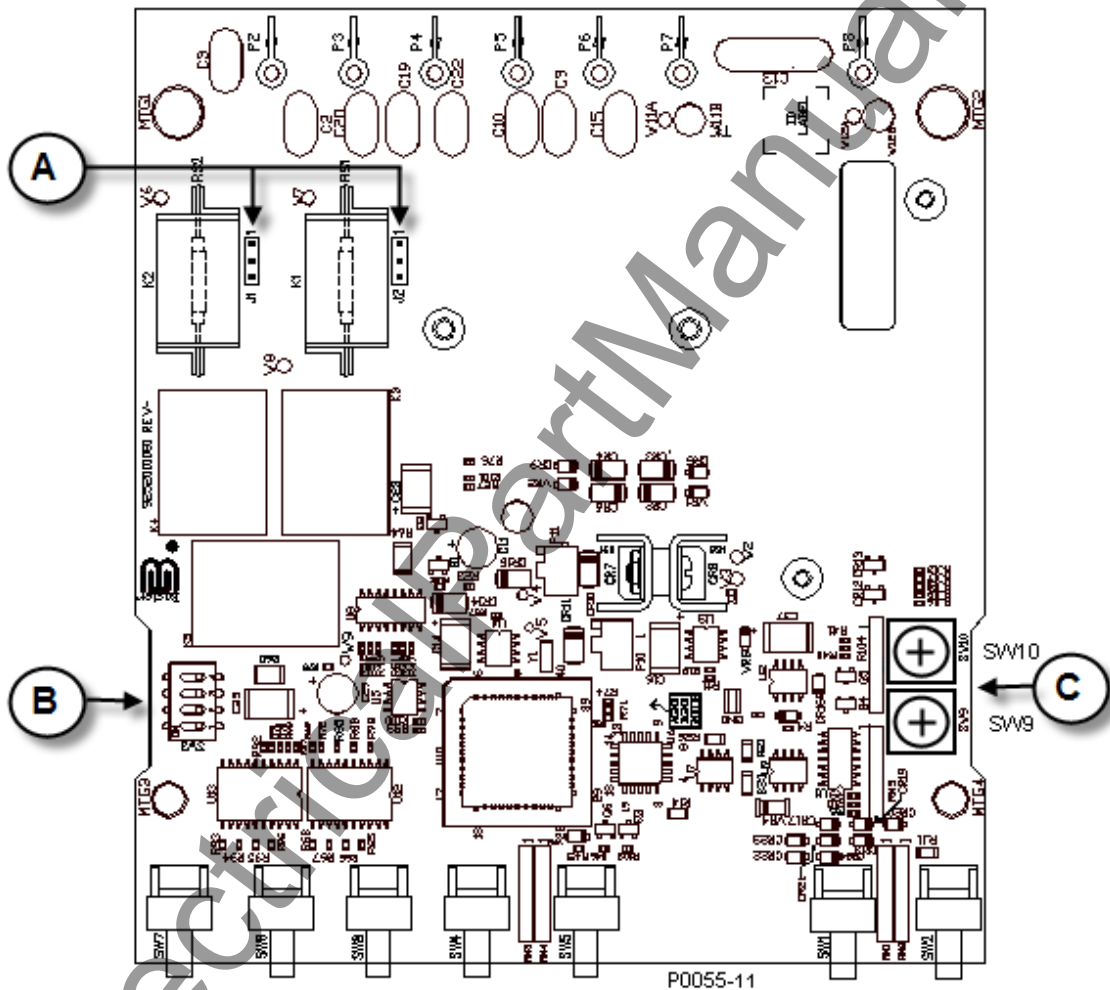


Figure 2-2. Circuit Board Controls

Table 2-2. Circuit Board Controls

Locator	Description
A	<p><i>Target Operating Current Jumpers.</i> Two user-adjustable jumpers control the range of trip circuit current required to operate the time overcurrent (51) and instantaneous overcurrent A (50-A) target indicators. Jumper J1 sets the minimum current range for the 50-A target indicator and J2 sets the minimum current range for the 51 target indicator. Two jumper positions are possible: across pins 1 and 2 or across pins 2 and 3. Installing a jumper across pins 1 and 2 gives a minimum operating current of 0.9 to 2.25 A. Installing a jumper across pins 2 and 3 gives a minimum operating current of 80 to 200 mA.</p>
B	<p><i>Four Position Slide Switch.</i> This switch assembly, designated SW3, has four independent slide switches designated SW3-1, SW3-2, SW3-3, and SW3-4. Each switch functions as follows:</p> <p>SW3-1 selects the nominal system frequency. The OFF position selects 60 Hz operation and the ON position selects 50 Hz operation.</p> <p>SW3-2 provides an additional time delay for the instantaneous overcurrent A (50-A) element. The ON position provides an additional delay of 100 milliseconds.</p> <p>SW3-3 selects either GE IAC or ABB type characteristic curves. The ON position selects the GE IAC type curves (listed in Table A-1) and the OFF position selects the ABB type curves (listed in Table A-2).</p> <p>SW3-4 selects either an instantaneous or integrating time reset characteristic. The ON position selects an integrating reset characteristic and the OFF position selects an instantaneous reset characteristic.</p>
C	<p><i>Instantaneous Overcurrent B Pickup Selector Switches.</i> These two screwdriver-adjusted, rotary switches select the instantaneous overcurrent B (50-B) pickup current setting in amperes.</p> <p>The 50-B pickup switches are accessed on the top side of the draw-out assembly by removing the draw-out assembly from the case. Figure 2-3 shows the 50-B pickup switches as viewed at the right side of the draw-out assembly of the BE1-50/51B-230. The BE1-50/51B-234 is shown in Figure 2-4.</p> <p><u>BE1-50/51B-230</u></p> <p>The left-hand switch (SW9) is a 16-position switch that sets the units portion (#.#) of the 50-B pickup setting in amperes. SW9 setting positions consist of 0 through 9 which correspond to values of 0 to 9 amperes and A through F which correspond to values of 10 to 15 amperes. The right-hand switch (SW10) is a 10-position switch that sets the tenths portion (#.#) of the 50-B pickup setting in amperes. SW10 setting positions consist of 0 through 9 which correspond to values of 0.0 to 0.9 amperes.</p> <p>The minimum allowable 50-B pickup setting is 1.0 Aac and the maximum allowable 50-B pickup setting is 15.9 Aac. Adjusting the 50-B pickup selector switches while the relay is in service may cause the relay to trip.</p> <p>Example: SW9 position 2 and SW10 position 5 is a setting of 2.5 Aac.</p> <p><u>BE1-50/51B-234</u></p> <p>The total pickup setting is the sum of two settings. The first setting, SW9 has a range of 0.2 to 3.0 corresponding to switch position 1 through F. The second setting, SW10 has a range of 0.02 to 0.18 corresponding to switch position 1 through 9.</p> <p>The minimum allowable 50-B pickup setting is 0.2 Aac and the maximum allowable 50-B pickup setting is 3.18 Aac. Adjusting the 50-B pickup selector switches while the relay is in service may cause the relay to trip.</p> <p>Example: SW9 position 2 and SW10 position 5 is a setting of 0.5 Aac.</p>

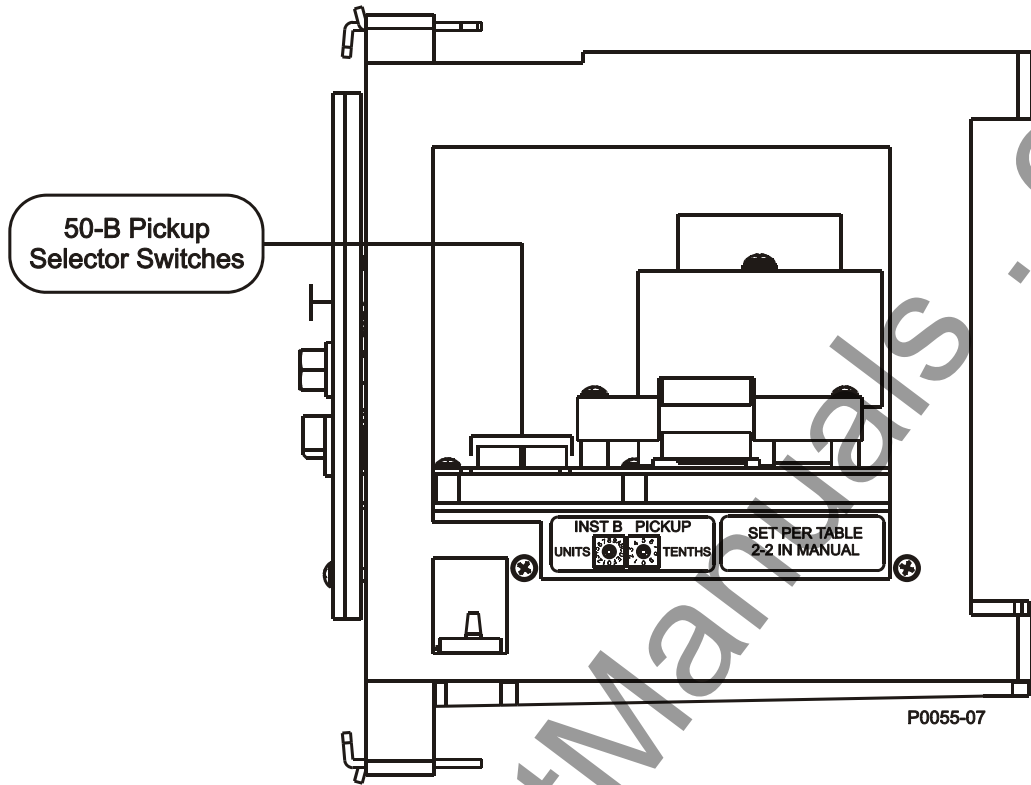


Figure 2-3. View of 50-B Pickup Selector Switches (BE1-50/51B-230)

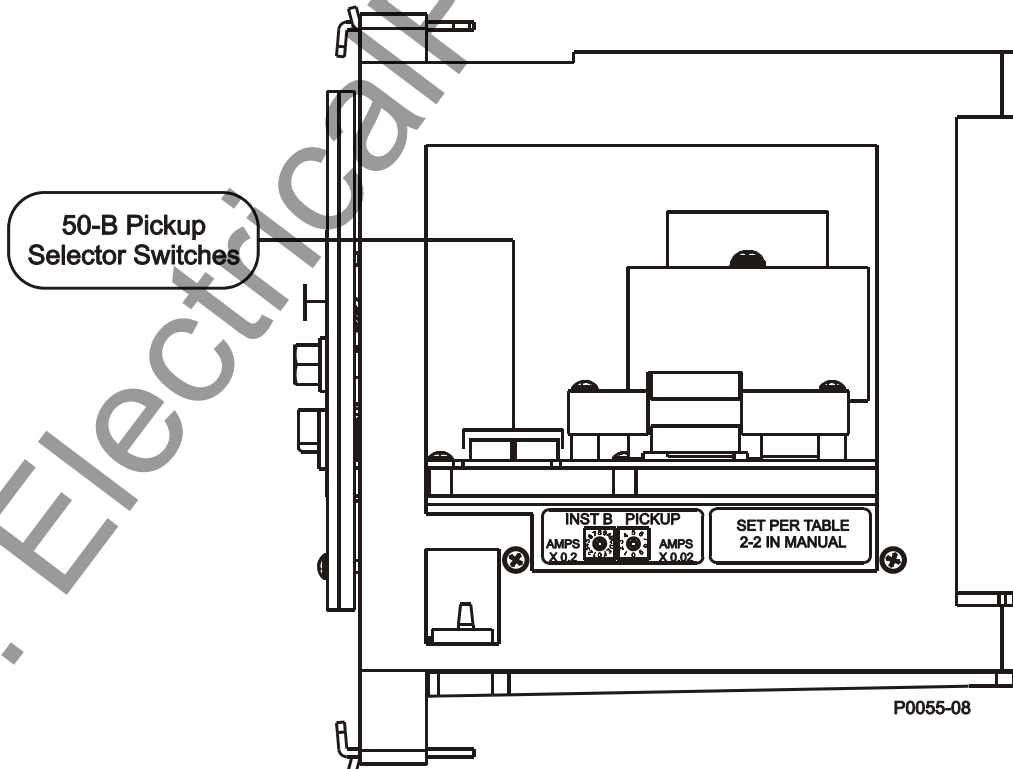


Figure 2-4. View of 50-B Pickup Selector Switches (BE1-50/51B-234)

www.ElectricalPartManuals.com

This page intentionally left blank.

SECTION 3 • FUNCTIONAL DESCRIPTION

TABLE OF CONTENTS

SECTION 3 • FUNCTIONAL DESCRIPTION	3-1
INTRODUCTION.....	3-1
FUNCTION BLOCK DESCRIPTIONS	3-1
Current Sensing Input	3-1
Power CT and Power Supply	3-1
Signal Conditioning	3-1
Microprocessor	3-1
Outputs	3-2
Target Indicators	3-2
Figures	
Figure 3-1. Function Block Diagram.....	3-1

www . ElectricalPartManuals . com

This page intentionally left blank.

SECTION 3 • FUNCTIONAL DESCRIPTION

INTRODUCTION

This section illustrates and describes the functional capabilities of the BE1-50/51B-230 and BE1-50/51B-234 relays.

FUNCTION BLOCK DESCRIPTIONS

The function blocks of the BE1-50/51B-230 and BE1-50/51B-234 relays are illustrated in Figure 3-1 and described in the following paragraphs.

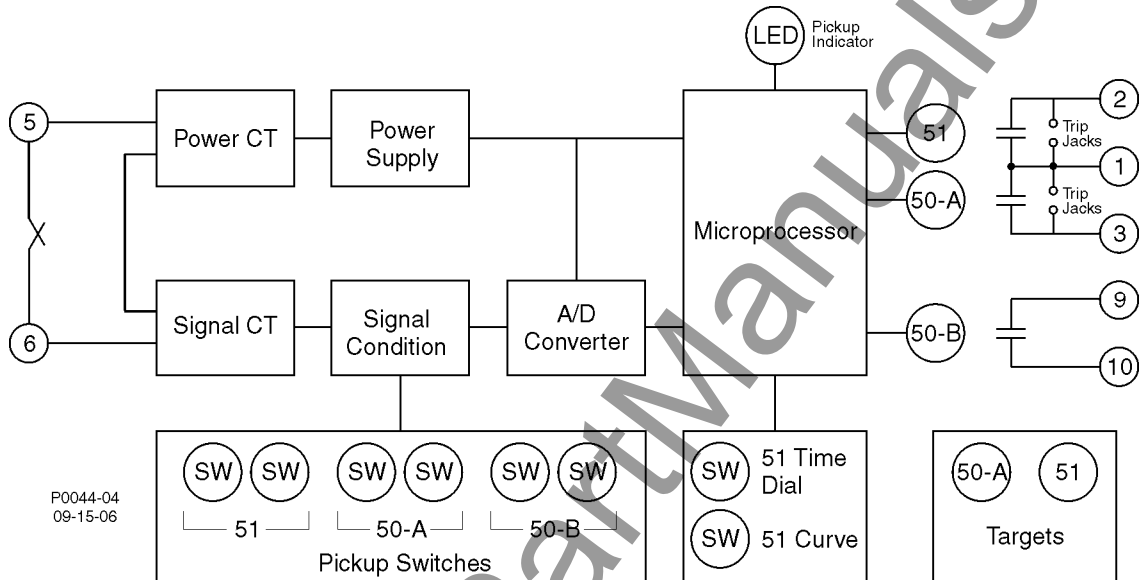


Figure 3-1. Function Block Diagram

Current Sensing Input

Single-phase ac current supplied by a system current transformer (CT) is applied to the BE1-50/51B-230 and BE1-50/51B-234 through terminals 5 and 6. Sensing current is applied to internal power and signal CTs.

Power CT and Power Supply

The output of the power CT is supplied to the power supply which provides rectified and filtered operating power for all relay circuitry. A precision 5 Vdc output of the power supply serves as a reference for automatic calibration.

Signal Conditioning

Current from the signal CT is rectified and applied to three independent sets of scaling resistors controlled by the Time Overcurrent (51), Instantaneous Overcurrent A (50-A), and Instantaneous Overcurrent B (50-B) pickup switches. The analog-to-digital converter receives the analog voltage developed across the scaling resistors and converts it into a digital signal that is supplied to the microprocessor.

Microprocessor

The microprocessor performs program operations based on the sensed current, switch settings, and the internal software program.

When sufficient current is sensed by the relay, the microprocessor is active and executing code, and the Active/Pickup LED is green. When the sensed current decreases below the operating threshold, microprocessor operation is interrupted and the Active/Pickup LED turns off. A watchdog circuit resets the microprocessor program when code execution is interrupted.

Power-off sensing circuits measure the voltage across a capacitor at power-down and power-up. These circuits determine how long power has been removed based on the difference voltage and the circuit's

RC time constant. This provides information from the integrating reset function even when power has been entirely removed.

The microprocessor defines the relay operating parameters based on inputs received from the Time Overcurrent Time Dial Selector, Curve Selector, and four-position slide switch. The microprocessor determines the level of sensed current by a digital signal supplied by the analog-to-digital converter. Sensed current that exceeds the setting of the Time Overcurrent Pickup Selector switches causes the Active/Pickup LED color to change from green to red and the 51 Trip output contacts to close in accordance with the time characteristic equation. Sensed current exceeding the Instantaneous Overcurrent A Pickup selector switch setting causes the 50-A Trip output contacts to close. Likewise, sensed current exceeding the Instantaneous Overcurrent B Pickup selector switch setting causes the 50-B Trip output contacts to close.

Outputs

Each protective element (time overcurrent (51), instantaneous overcurrent A (50-A), and instantaneous overcurrent B (50-B)) is equipped with a set of normally-open contacts rated for tripping duty. A system circuit breaker controlled by the 51 or 50-A output contacts can be manually tripped by connecting a jumper across the Time Overcurrent Manual Trip jacks or the Instantaneous Overcurrent Manual Trip jacks. (Manual trip jacks are not provided for the system circuit breaker controlled by the 50-B output contacts.) Current flow in a trip circuit is indicated by operation of the corresponding target. The targets will not operate without adequate relay operating power.

CAUTION

Trip circuit voltage is present at the front panel trip jacks. When shorting the trip jacks, use insulated jumpers to avoid contact with these voltages.

Target Indicators

Gravity-latched, manually-reset, current-operated target indicators are provided for the time overcurrent (51) trip output and the instantaneous overcurrent A (50-A) trip output. A target indicator is not provided for the 50-B trip output. The level of trip circuit current required to operate each target is individually controlled by a circuit board jumper. The minimum operating current range can be set for 80 to 200 milliamperes or 0.9 to 2.25 amperes. See Section 2, *Controls and Indicators* for jumper locations and function assignments.

SECTION 4 • INSTALLATION

TABLE OF CONTENTS

SECTION 4 • INSTALLATION	4-1
INTRODUCTION.....	4-1
FACTORY SETTINGS.....	4-1
INSTALLATION.....	4-1
CONNECTIONS	4-2
APPLICATION COORDINATION	4-3
MAINTENANCE.....	4-4
STORAGE.....	4-4

Figures

Figure 4-1. Typical AC Connections.....	4-2
Figure 4-2. Typical DC Connections.....	4-3
Figure 4-3. Coordination Timing Diagram	4-4

www.ElectricalPartManuals.com

This page intentionally left blank.

SECTION 4 • INSTALLATION

INTRODUCTION

BE1-50/51B-230 relays are direct replacements for General Electric IAC66K relays with 5 Aac nominal current sensing. BE1-50/51B-234 relays are direct replacements for General Electric IAC66K relays with 1 Aac nominal current sensing. The BE1-50/51B-230 and BE1-50/51B-234 relays are supplied as draw-out assemblies that plug directly into existing cases for IAC66K relays. The draw-out assembly is supplied with a connection plug, relay cover, and adapter plate for mounting the cover onto an existing IAC66K case.

If desired, proper relay operation may be confirmed by performing the test procedures listed in Section 5. If the relay will not be installed immediately, store the relay in its original shipping carton in a moisture- and dust-free environment.

FACTORY SETTINGS

Factory settings for the internal switches of SW3 and jumper settings are as follows:

- SW3-1 — OFF (60 hertz operation).
- SW3-2 — OFF (0.0 additional fixed delay for the instantaneous element).
- SW3-3 — ON (GE IAC type characteristic curves).
- SW3-4 — ON (Integrating reset characteristics).
- J1 pins 2-3 — 50-A minimum target operating current of 80 to 200 mA
- J2 pins 1-2 — 51 minimum target operating current of 0.9 to 2.25 A

INSTALLATION

The relay must be configured with the appropriate settings before commissioning the relay in a specific application. Changing the pickup settings while the relay is in service may cause tripping. Perform the following steps to install the BE1-50/51B-230 or BE1-50/51B-234 relay in an existing GE IAC66K relay case:

1. Remove the existing GE IAC66K relay from its case.
2. Using the four screws provided, attach the cover adapter to the existing case.
3. Insert the BE1-50/51B-230 or BE1-50/51B-234 into the case. Lock the draw-out assembly in place with the cradle latches.
4. Install the connection plug supplied with the relay.
5. Install the cover supplied with the relay.
 - a. Align the interlocking bracket at the top of the cover with the mating receptacle at the top of the cover adapter plate.
 - b. Secure the cover by tightening the captive knob at the bottom of the cover.

NOTE

Be sure that the relay is hard-wired to earth ground with no smaller than 12 AWG copper wire attached to the ground terminal on the rear of the unit case. When the relay is configured in a system with other devices, it is recommended to use a separate lead to the ground bus from each unit.

CONNECTIONS

Typical ac and dc connections are shown in Figures 4-1 and 4-2.

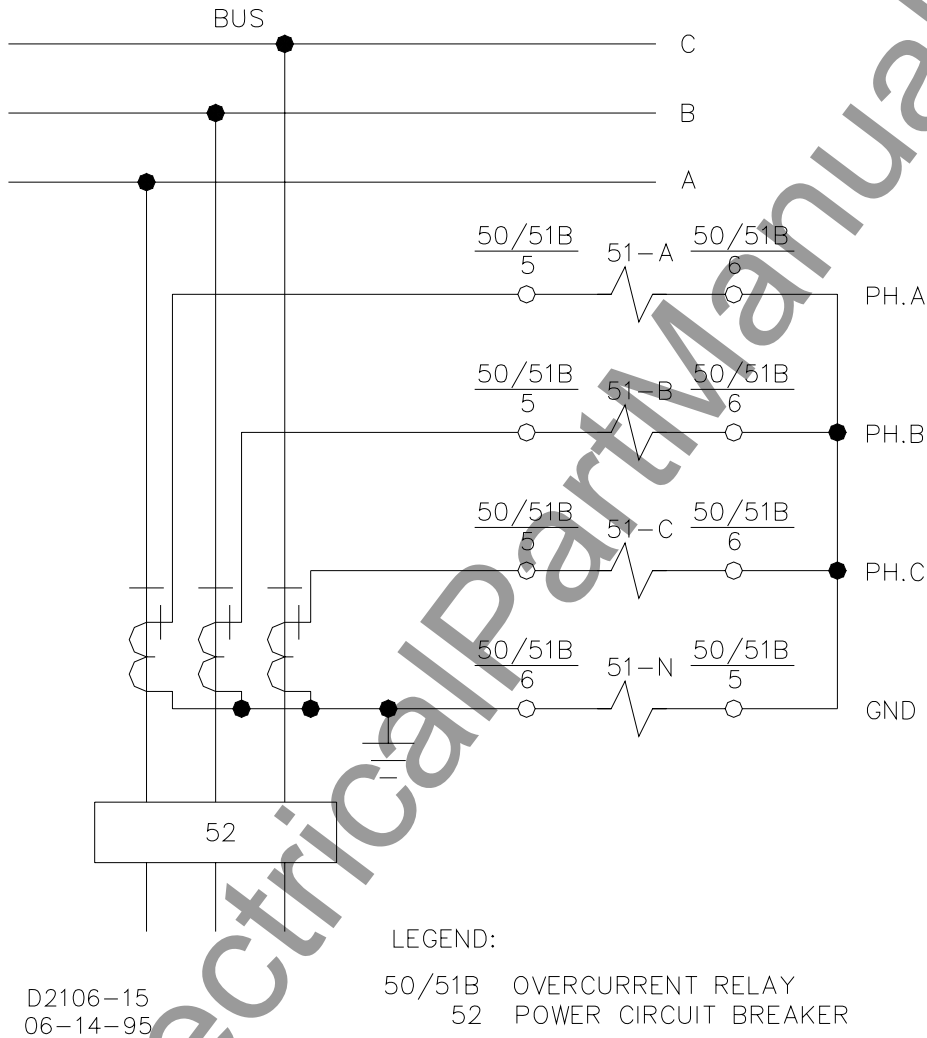


Figure 4-1. Typical AC Connections

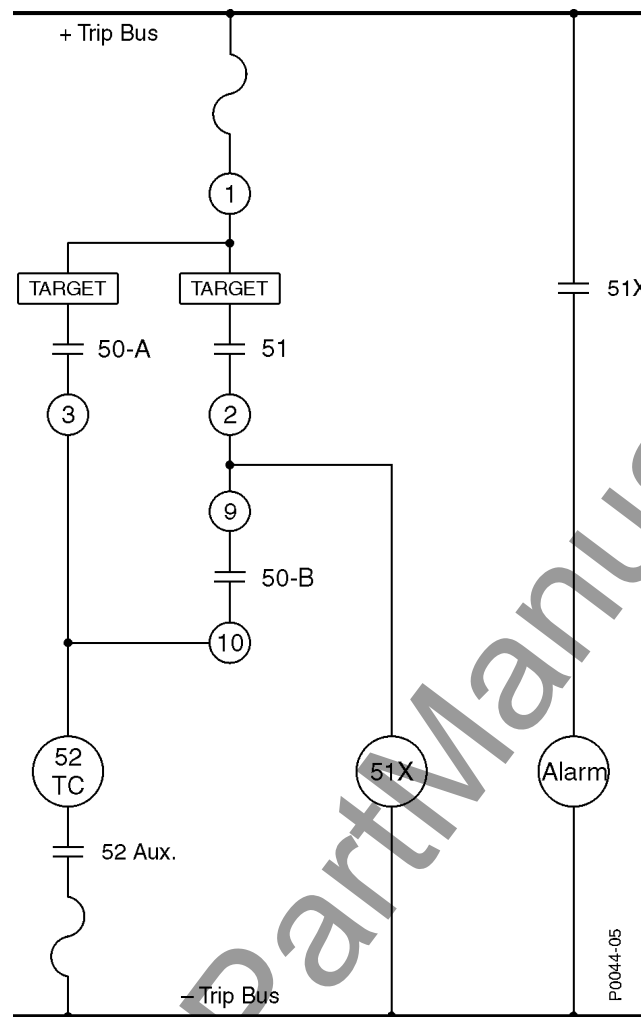


Figure 4-2. Typical DC Connections

APPLICATION COORDINATION

In a typical application coordination scheme, a BE1-50/51B-230 or BE1-50/51B-234 is used to provide primary protection for a radial distribution feeder. An electromechanical overcurrent relay with extremely inverse timing provides protection for the transformer and bus. To improve coordination with the electromechanical relay, the BE1-50/51B-230 or BE1-50/51B-234 is configured with the following settings:

- Integrating reset enabled (SW3-4 ON)
- Time characteristic curve E (extremely inverse) selected
- ABB type curves selected (SW3-3 OFF)
- Time dial set at 2.0

The feeder reclosing relay is set for two reclose attempts at 3 and 15 seconds after the initial trip. If a permanent fault occurs (magnitude 10 times pickup), calculate the feeder breaker trip time for each of the three operations. Refer to Appendix A for the characteristic curve constants and definition of the terms used in the following time characteristic curve equations.

From the time characteristic curve equation:

$$\begin{aligned}
 T_T &= \frac{AD}{M^N - C} + BD + K \\
 &= \frac{7.7624 \times 2}{10^{2.0938} - 1} + (0.02758 \times 2) + 0.028 \\
 &= 0.209 \text{ seconds}
 \end{aligned}$$

From the reset characteristic curve equation:

$$T_R = \frac{RD}{M^2 - 1}$$

M equals 0 if current goes to zero. A negative result indicates reset time.

$$= \frac{7.75 \times 2}{0^2 - 1} = -15.5 \text{ seconds}$$

Result: Full trip = 0.209 seconds and full reset = 15.5 seconds if current goes to zero.

In Figure 4-3:

T_A = 0.209 seconds (relay was at reset)

T_B = value < T_A because rewind has not gone to zero

T_C = value < T_A because rewind has not gone to zero

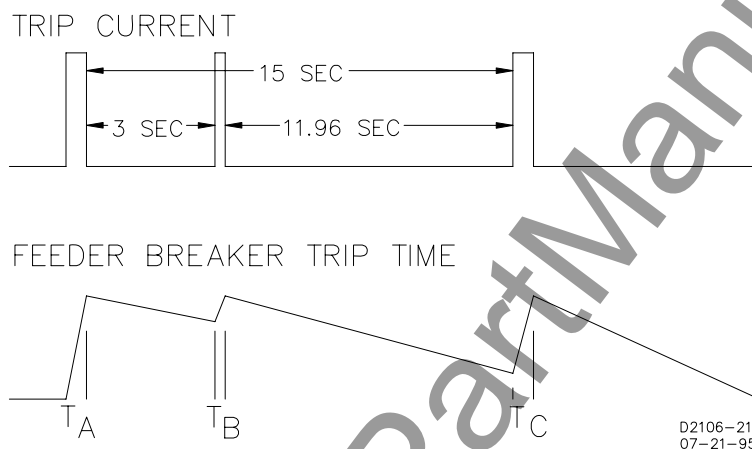


Figure 4-3. Coordination Timing Diagram

MAINTENANCE

BE1-50/51B-230 and BE1-50/51B-234 relays require no preventative maintenance other than periodic checking of relay connections to make sure that they are clean and tight. If the relay fails to function properly, contact the Technical Sales Support department of Basler Electric.

STORAGE

This device contains long-life aluminum electrolytic capacitors. Life in excess of 20 years may be expected if the storage temperature does not exceed 40°C (104°F).

SECTION 5 • TESTING

TABLE OF CONTENTS

SECTION 5 • TESTING	5-1
INTRODUCTION.....	5-1
DIELECTRIC TEST	5-1
TEST PROCEDURES	5-1
Model BE1-50/51B-230 (Five Ampere Sensing Input).....	5-1
Time Overcurrent (51) Pickup.....	5-1
Time Dial.....	5-2
Integrating Reset	5-2
Instantaneous Overcurrent A (50-A) Pickup.....	5-3
Instantaneous Overcurrent B (50-B) Pickup.....	5-4
Target Indicators.....	5-5
Manual Trip.....	5-6
Model BE1-50/51B-234 (One Ampere Sensing Input).....	5-7
Time Overcurrent (51) Pickup.....	5-7
Time Dial.....	5-7
Integrating Reset	5-7
Instantaneous Overcurrent A (50-A) Pickup.....	5-8
Instantaneous Overcurrent B (50-B) Pickup.....	5-9
Target Indicators.....	5-10
Manual Trip.....	5-11

Figures

Figure 5-1. 51 Pickup, Time Dial, and Integrating Reset Test Setup.....	5-3
Figure 5-2. 50-A Pickup Test Setup	5-4
Figure 5-3. 50-B Pickup Test Setup	5-5
Figure 5-4. Target Indicator Test Setup	5-6
Figure 5-5. 51 Pickup, Time Dial, and Integrating Reset Test Setup.....	5-8
Figure 5-6. 50-A Pickup Test Setup	5-9
Figure 5-7. 50-B Pickup Test Setup	5-10
Figure 5-8. Target Indicator Test Setup.....	5-11

www.ElectricalPartManuals.com

This page intentionally left blank.

SECTION 5 • TESTING

INTRODUCTION

Proper relay operation may be confirmed by performing the test procedures in this section.

DIELECTRIC TEST

In accordance with IEC 255-5 and IEEE C37.90-1989, one-minute dielectric (high potential) tests may be performed as follows:

All circuits to ground:	2,828 Vdc or 2,000 Vac
Input to output circuits:	2,828 Vdc or 2,000 Vac

Output contacts are surge protected.

TEST PROCEDURES

The following test procedures verify operation of the BE1-50/51B-230 and BE1-50/51B-234 relays. The test setups illustrated in Figures 5-1 through 5-8 are intended primarily as an illustration of the principles involved. Other test equipment known to be capable of testing with the stated and implied tolerances (including equipment designed specifically for testing protective relays) may be used.

The minimum test equipment requirements are:

- Current source with a range of 0 to 20 Aac (sensing input current)
- Current source with a range of 0 to 3.0 Aac (target operation)
- Timer or counter

NOTES

To ensure proper timing during testing, remove the current from the relay for R times D seconds. (Refer to Appendix A, *Characteristic Curves* for definitions of R and D.)

When testing time overcurrent functions, instantaneous pickup settings of 00 will affect the calibration of the time functions. Time pickup settings of 00 also affect instantaneous functions.

When testing TIME overcurrent functions, INST PICKUP settings of 00 will affect the calibration of the TIME functions. TIME PICKUP settings of 00 also affect INST functions.

Observe all applicable electrostatic discharge (ESD) precautions when handling the relay assembly.

Model BE1-50/51B-230 (Five Ampere Sensing Input)

Time Overcurrent (51) Pickup

1. Connect and configure the relay for 51 pickup testing:
 - a. Connect the test setup shown in Figure 5-1.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set the TIME DIAL to 0.0.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 0.5.

- f. Set INST PICKUP (50-A) to 90.
- g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (15.0 Aac).
2. Apply and increase current to terminals 5 and 6 until the Active/Pickup LED turns red. The applied current should be no greater than 0.55 Aac.
3. Decrease the applied current until the Active/Pickup LED changes from red to green and then off.
4. Set TIME PICKUP to 2.2.
5. Slowly increase current to terminals 5 and 6 until the Active/Pickup LED turns red. The applied current should be between 2.131 and 2.269 Aac.
6. Reduce the applied current to zero.

Time Dial

1. Connect and configure the relay for time dial testing:
 - a. Connect the test setup shown in Figure 5-1.
 - b. Set circuit board switch SW3 as follows:
SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
SW3-2 = OFF (no additional time delay for the 50-A element)
SW3-3 = ON (GE IAC type characteristic curves)
SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 4.5.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 1.0.
 - f. Set INST PICKUP (50-A) to 90.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (15.0 Aac).
2. Prepare to apply 1.5 Aac to terminals 5 and 6 and record the elapsed time from when current is applied until the 51 output contacts close.
3. Apply the current (step from 0 to 1.5 Aac) and record the elapsed time. The elapsed time should be between 0.345 and 0.424 seconds. (This tolerance is greater than $\pm 2\%$ because it is the accumulation of both pickup and timing tolerances.)
4. Remove the input current.

Integrating Reset

1. Connect and configure the relay for integrating reset testing.
 - a. Connect the test setup shown in Figure 5-1.
 - b. Set circuit board switch SW3 as follows:
SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
SW3-2 = OFF (no additional time delay for the 50-A element)
SW3-3 = ON (GE IAC type characteristic curves)
SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 9.9
 - d. Set CURVE to V.
 - e. Set TIME PICKUP to 1.0.
 - f. Set INST PICKUP (50-A) to 90.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (15.0 Aac).
2. Apply 4.0 Aac to terminals 5 and 6. After the unit trips, remove the applied current for 29 ± 0.25 seconds, then reapply the current (4.0 Aac). Note the elapsed time from the reapplication of current to the second trip. The elapsed time should be 2.08 ± 0.4 seconds.

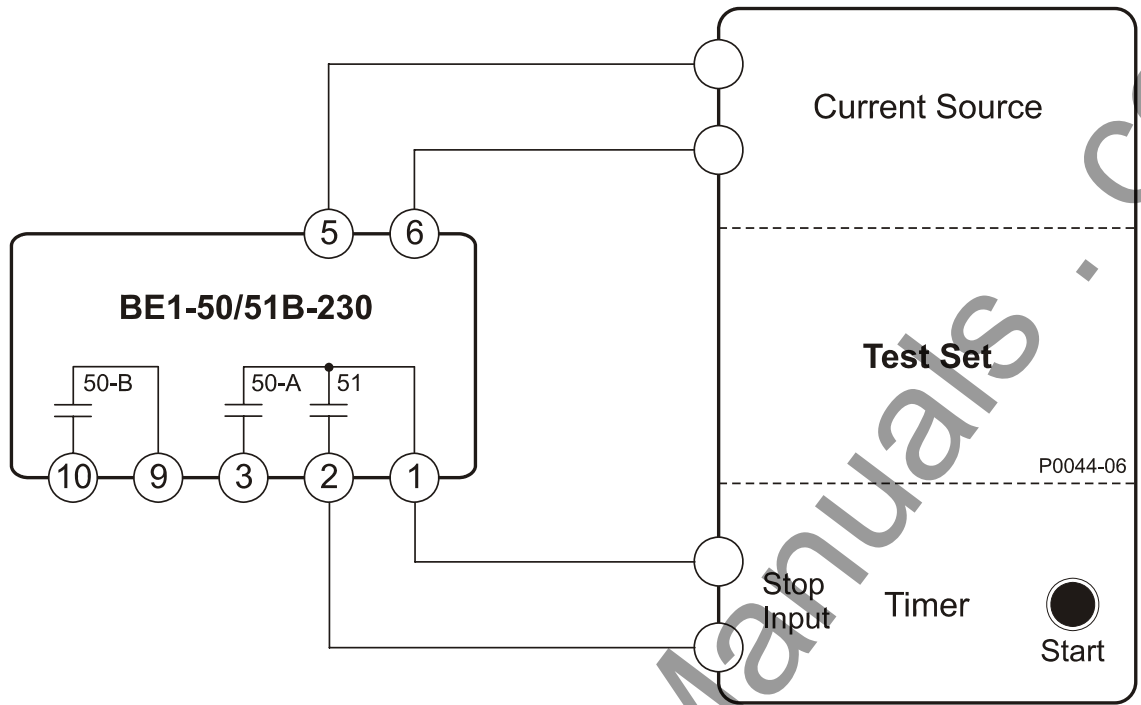


Figure 5-1. 51 Pickup, Time Dial, and Integrating Reset Test Setup

Instantaneous Overcurrent A (50-A) Pickup

1. Connect and configure the relay for 50-A pickup testing:
 - a. Connect the test setup shown in Figure 5-2.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 0.0.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 15.0.
 - f. Set INST PICKUP (50-A) to 02.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (15.0 Aac).
2. Apply and slowly increase current to terminals 5 and 6 until the 50-A output contacts close. The applied current should be between 1.935 and 2.065 Aac.
3. Decrease the applied current until the 50-A output contacts open.
4. Set INST PICKUP (50-A) to 08.
5. Slowly increase the current applied to terminals 5 and 6 until the 50-A output contacts close. The applied current should be between 7.815 and 8.185 Aac.
6. Reduce the applied current to zero.

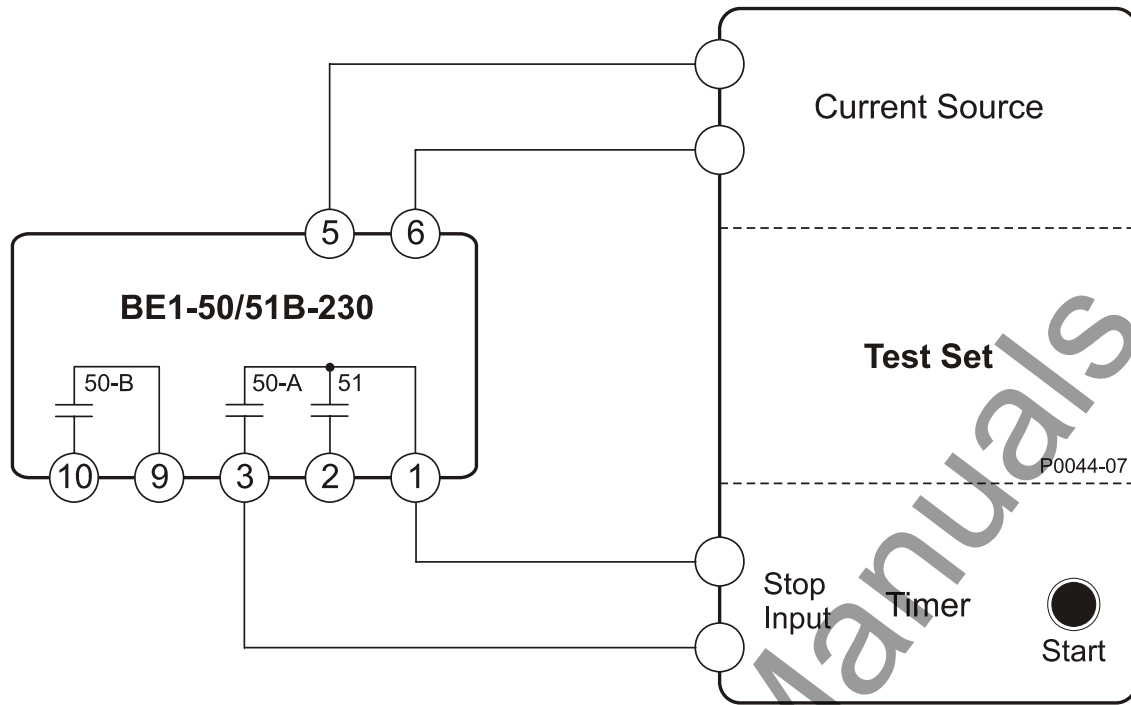


Figure 5-2. 50-A Pickup Test Setup

Instantaneous Overcurrent B (50-B) Pickup

1. Connect and configure the relay for 50-B pickup testing:
 - a. Connect the test setup shown in Figure 5-3.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 0.0.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 15.0.
 - f. Set INST PICKUP (50-A) to 90.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to 20 (2.0 Aac).
2. Apply and slowly increase current to terminals 5 and 6 until the 50-B output contacts close. The applied current should be between 1.935 and 2.065 Aac.
3. Decrease the applied current until the 50-B output contacts open.
4. Set INST PICKUP (50-B) to 80 (8.0 Aac).
5. Slowly increase the current applied to terminals 5 and 6 until the 50-B output contacts close. The applied current should be between 7.815 and 8.185 Aac.
6. Reduce the applied current to zero.

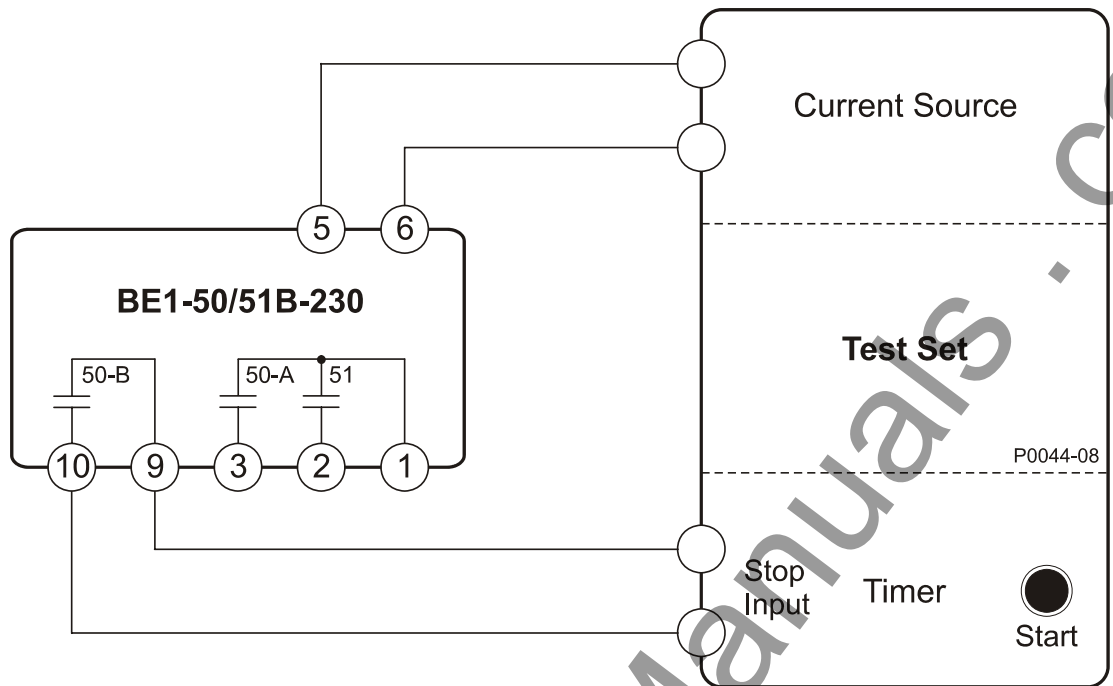


Figure 5-3. 50-B Pickup Test Setup

Target Indicators

1. Connect and configure the relay for target indicator testing:
 - a. Connect the test setup shown in Figure 5-4.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 0.0.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 1.0.
 - f. Set INST PICKUP (50-A) to 90.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (15.0 Aac).
2. Apply 2 Aac to terminals 5 and 6 to trip the 51 relay output.
3. Slowly increase the target current source and verify that the Time target operates at the level of current determined by the Target Operating Current Jumpers.

The Target Operating Current Jumpers are located on the circuit board and identified as J1 and J2. J1 sets the minimum current range for the 50-A target and J2 sets the minimum current range for the 51 target. A jumper installed across pins 1 and 2 gives a minimum operating current of 0.9 to 2.25 A. A jumper installed across pins 2 and 3 gives a minimum operating current of 80 to 200 mA.
4. Remove the target and sensing current and reset the target.
5. Set TIME PICKUP to 9.0.
6. Set INST PICKUP (50-A) to 01.
7. Apply 2 Aac to terminals 5 and 6 to trip the 50-A relay output.
8. Slowly increase the target current source and verify that the Instantaneous target operates at the level of current determined by the Target Operating Current Jumpers.
9. Remove the target and sensing current and reset the targets.

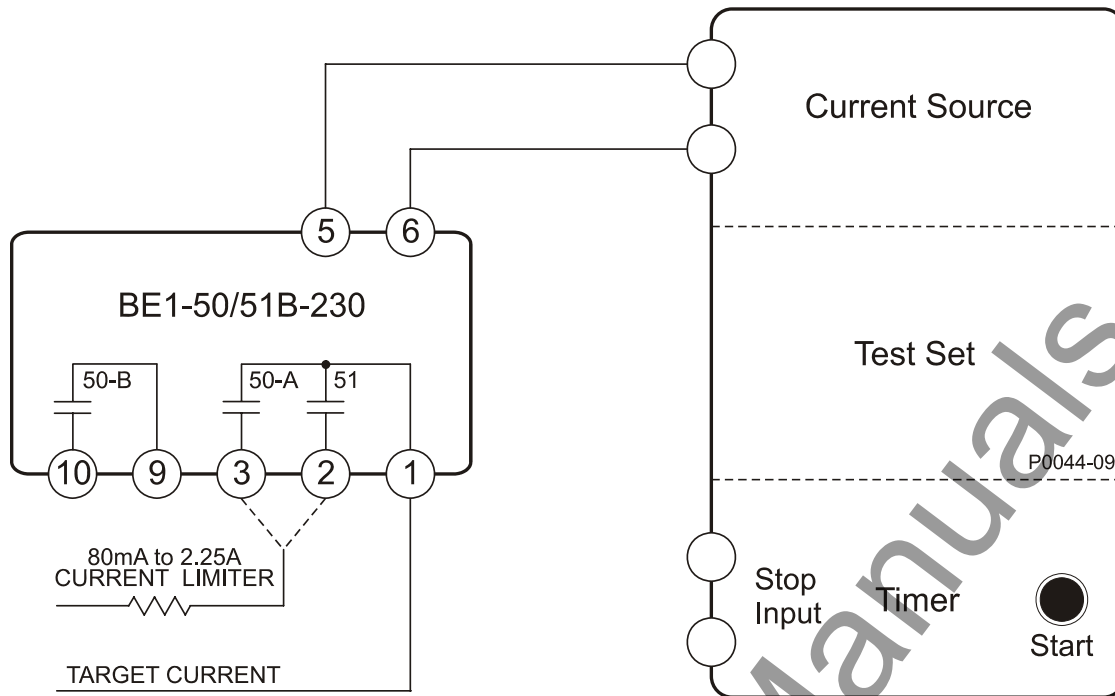


Figure 5-4. Target Indicator Test Setup

Manual Trip

1. Configure the relay for manual trip testing:
 - a. Connect the test setup as shown in Figure 5-1.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 0.0
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 1.0.
 - f. Set INST PICKUP (50-A) to 90.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to 20 (2.0 Aac).
2. Apply 0.9 Aac to terminals 5 and 6 (0.9 Aac provides relay operating power but is below the pickup threshold.)
3. Connect a jumper to the Time Overcurrent Manual Trip jacks. Verify that the stop input of the test set timer recognizes a 51 contact closure.
4. Remove the jumper and the current applied at relay terminals 5 and 6.
5. Apply 0.9 Aac to terminals 5 and 6.
6. Connect a jumper to the Instantaneous Overcurrent Manual Trip jacks. Verify that the stop input of the test set timer recognizes a 50-A contact closure
7. Remove the jumper and the current applied to relay terminals 5 and 6.
8. Reset targets.

Model BE1-50/51B-234 (One Ampere Sensing Input)

Time Overcurrent (51) Pickup

1. Connect and configure the relay for 51 pickup testing:
 - a. Connect the test setup shown in Figure 5-5.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set the TIME DIAL to 0.0.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 0.1.
 - f. Set INST PICKUP (50-A) to 18.0.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (3.0 Aac).
2. Apply and increase current to terminals 5 and 6 until the Active/Pickup LED turns red. The applied current should be no greater than 0.11 Aac.
3. Decrease the applied current until the Active/Pickup LED changes from red to green and then off.
4. Set TIME PICKUP to 0.44.
5. Slowly increase current to terminals 5 and 6 until the Active/Pickup LED turns red. The applied current should be between 0.426 and 0.454 Aac.
6. Reduce the applied current to zero.

Time Dial

1. Connect and configure the relay for time dial testing:
 - a. Connect the test setup shown in Figure 5-5.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 4.5.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 0.2.
 - f. Set INST PICKUP (50-A) to 18.0.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (3.0 Aac).
2. Prepare to apply 0.3 Aac to terminals 5 and 6 and record the elapsed time from when current is applied until the 51 output contacts close.
3. Apply the current (step from 0 to 0.3 Aac) and record the elapsed time. The elapsed time should be between 0.345 and 0.424 seconds. (This tolerance is greater than $\pm 2\%$ because it is the accumulation of both pickup and timing tolerances.)
4. Remove the input current.

Integrating Reset

1. Connect and configure the relay for integrating reset testing.
 - a. Connect the test setup shown in Figure 5-5.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 9.9

- d. Set CURVE to V.
 - e. Set TIME PICKUP to 0.2.
 - f. Set INST PICKUP (50-A) to 18.0.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (3.0 Aac).
2. Apply 0.8 Aac to terminals 5 and 6. After the unit trips, remove the applied current for 29 ± 0.25 seconds, then reapply the current (0.8 Aac). Note the elapsed time from the reapplication of current to the second trip. The elapsed time should be 2.08 ± 0.4 seconds.

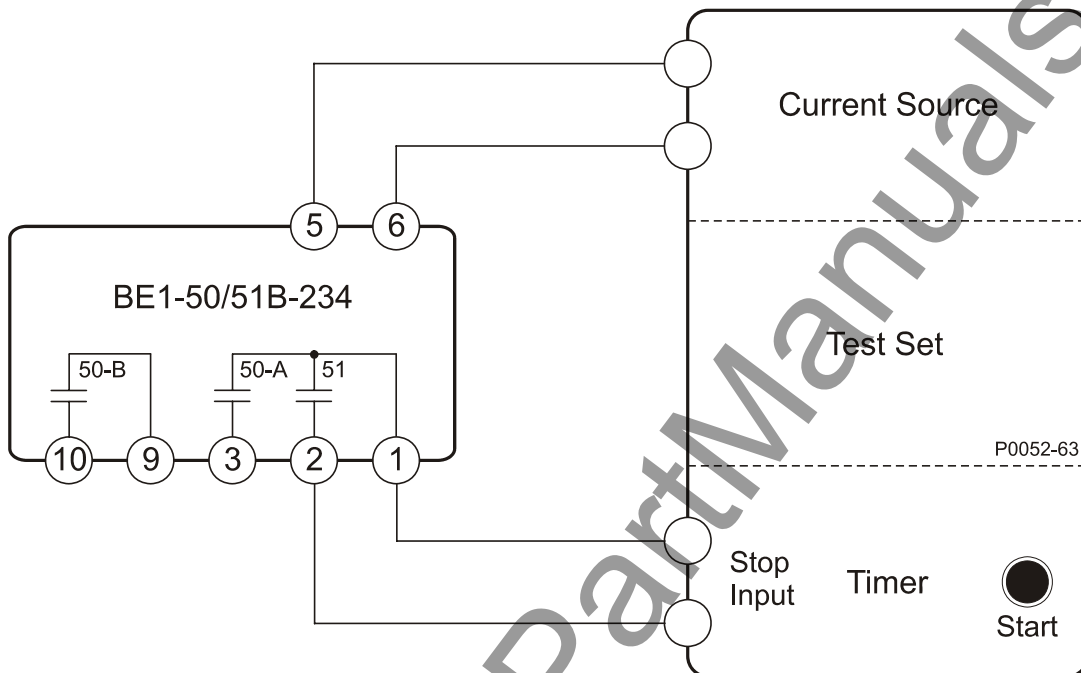


Figure 5-5. 51 Pickup, Time Dial, and Integrating Reset Test Setup

Instantaneous Overcurrent A (50-A) Pickup

1. Connect and configure the relay for 50-A pickup testing:
 - a. Connect the test setup shown in Figure 5-6.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 0.0.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 3.18.
 - f. Set INST PICKUP (50-A) to 0.4.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (3.0 Aac).
2. Apply and slowly increase current to terminals 5 and 6 until the 50-A output contacts close. The applied current should be between 0.387 and 0.413 Aac.
3. Decrease the applied current until the 50-A output contacts open.
4. Set INST PICKUP (50-A) to 1.6.
5. Slowly increase the current applied to terminals 5 and 6 until the 50-A output contacts close. The applied current should be between 1.563 and 1.637 Aac.
6. Reduce the applied current to zero.

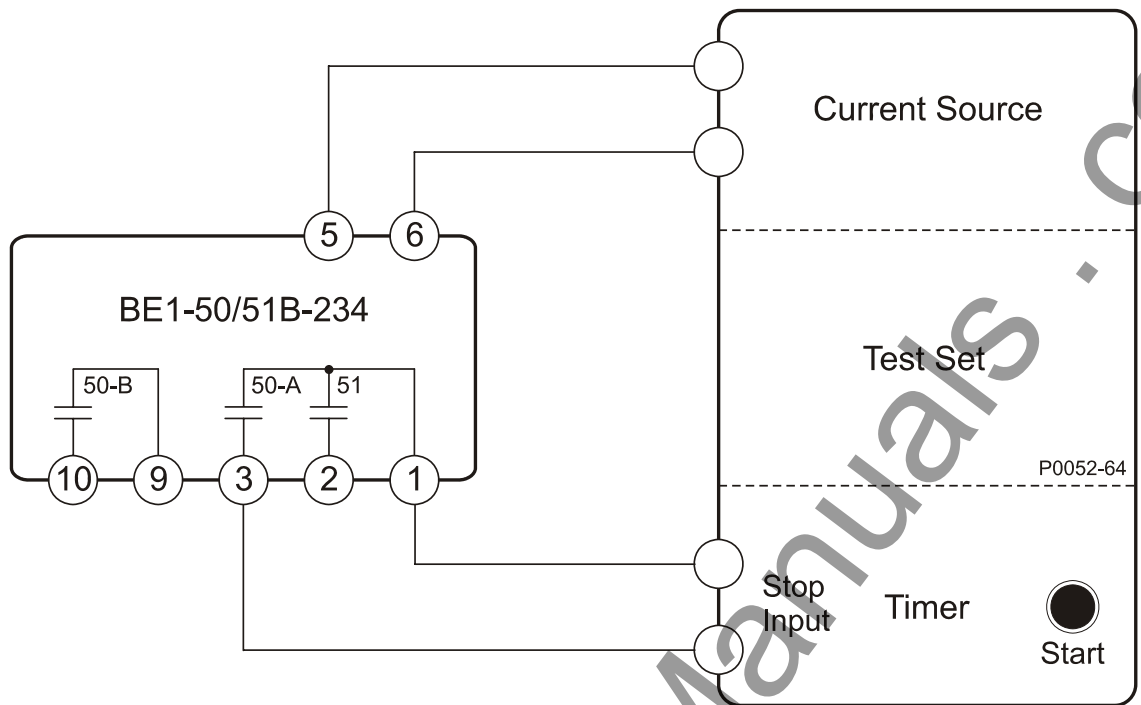


Figure 5-6. 50-A Pickup Test Setup

Instantaneous Overcurrent B (50-B) Pickup

1. Connect and configure the relay for 50-B pickup testing:
 - a. Connect the test setup shown in Figure 5-7.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 0.0.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 3.18.
 - f. Set INST PICKUP (50-A) to 18.0.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to 20 (0.4 Aac).
2. Apply and slowly increase current to terminals 5 and 6 until the 50-B output contacts close. The applied current should be between 0.387 and 0.413 Aac.
3. Decrease the applied current until the 50-B output contacts open.
4. Set INST PICKUP (50-B) to 80 (1.6 Aac).
5. Slowly increase the current applied to terminals 5 and 6 until the 50-B output contacts close. The applied current should be between 1.563 and 1.637 Aac.
6. Reduce the applied current to zero.

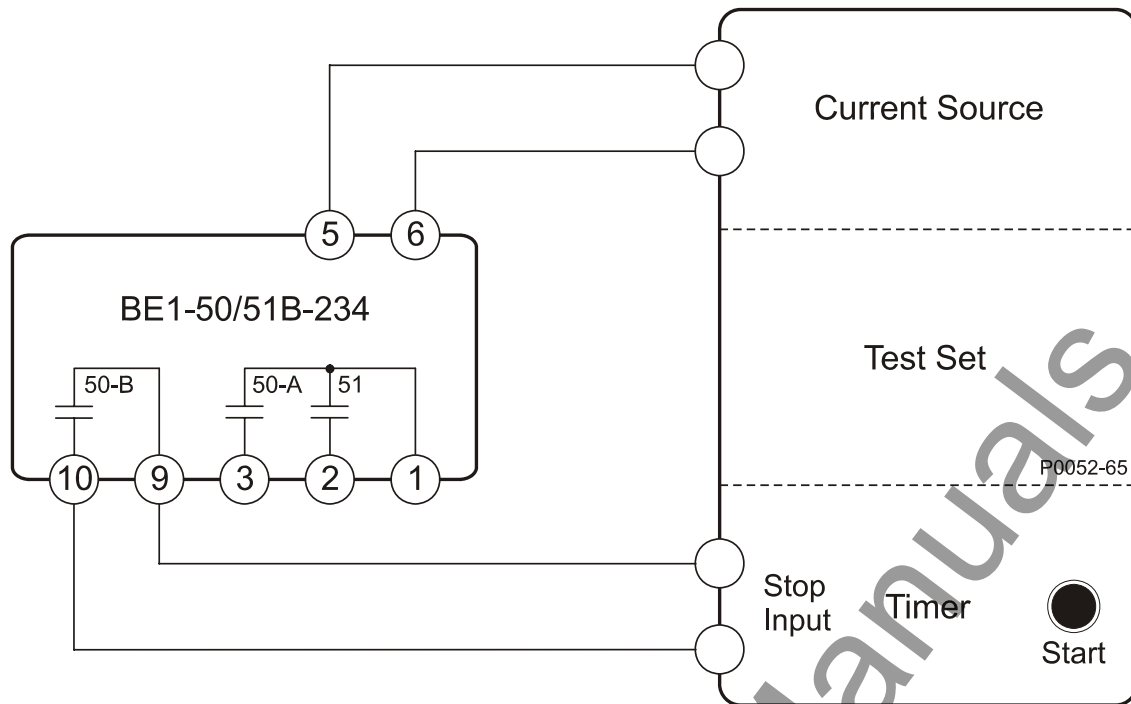


Figure 5-7. 50-B Pickup Test Setup

Target Indicators

1. Connect and configure the relay for target indicator testing:
 - a. Connect the test setup shown in Figure 5-8.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 0.0.
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 0.2.
 - f. Set INST PICKUP (50-A) to 18.0.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) to F0 (3.0 Aac).
2. Apply 0.4 Aac to terminals 5 and 6 to trip the 51 relay output.
3. Slowly increase the target current source and verify that the Time target operates at the level of current determined by the Target Operating Current Jumpers.

The Target Operating Current Jumpers are located on the circuit board and identified as J1 and J2. J1 sets the minimum current range for the 50-A target and J2 sets the minimum current range for the 51 target. A jumper installed across pins 1 and 2 gives a minimum operating current of 0.9 to 2.25 A. A jumper installed across pins 2 and 3 gives a minimum operating current of 80 to 200 mA.
4. Remove the target and sensing current and reset the target.
5. Set TIME PICKUP to 1.8.
6. Set INST PICKUP (50-A) to 0.2.
7. Apply 0.4 Aac to terminals 5 and 6 to trip the 50-A relay output.
8. Slowly increase the target current source and verify that the Instantaneous target operates at the level of current determined by the Target Operating Current Jumpers.
9. Remove the target and sensing current and reset the targets.

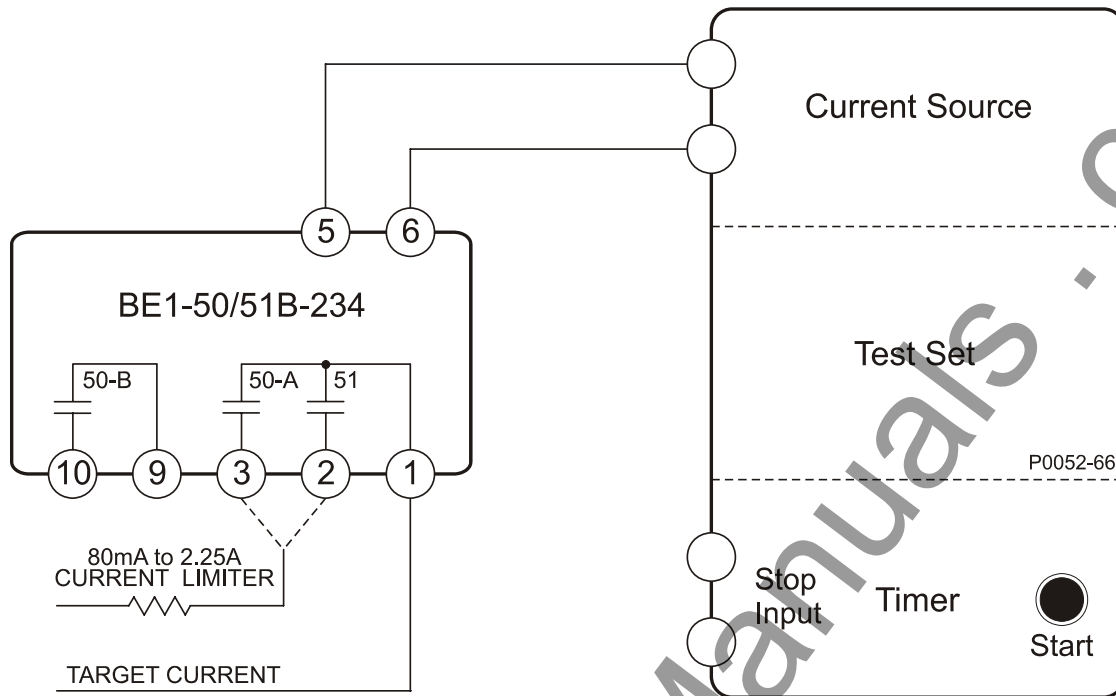


Figure 5-8. Target Indicator Test Setup

Manual Trip

1. Configure the relay for manual trip testing:
 - a. Connect the test setup as shown in Figure 5-5.
 - b. Set circuit board switch SW3 as follows:
 - SW3-1 = ON for 50 Hz operation or OFF for 60 Hz operation
 - SW3-2 = OFF (no additional time delay for the 50-A element)
 - SW3-3 = ON (GE IAC type characteristic curves)
 - SW3-4 = ON (integrating reset characteristic)
 - c. Set TIME DIAL to 0.0
 - d. Set CURVE to S.
 - e. Set TIME PICKUP to 0.2.
 - f. Set INST PICKUP (50-A) to 18.0.
 - g. Set INST PICKUP (50-B) (accessed at the top side of the assembly) at 20 (0.4 Aac).
2. Apply 0.18 Aac to terminals 5 and 6 (0.18 Aac provides relay operating power but is below the pickup threshold.)
3. Connect a jumper to the Time Overcurrent Manual Trip jacks. Verify that the stop input of the test set timer recognizes a 51 contact closure.
4. Remove the jumper and the current applied at relay terminals 5 and 6.
5. Apply 0.18 Aac to terminals 5 and 6.
6. Connect a jumper to the Instantaneous Overcurrent Manual Trip jacks. Verify that the stop input of the test set timer recognizes a 50-A contact closure
7. Remove the jumper and the current applied to relay terminals 5 and 6.
8. Reset targets.

www.ElectricalPartManuals.com

This page intentionally left blank.

APPENDIX A • CHARACTERISTIC CURVES

TABLE OF CONTENTS

APPENDIX A • CHARACTERISTIC CURVES.....	A-1
INTRODUCTION.....	A-1
INSTANTANEOUS OVERCURRENT CHARACTERISTICS	A-1
Timing.....	A-1
Pickup.....	A-1
TIME OVERCURRENT CHARACTERISTICS	A-1
Inverse Time Functions	A-2
Characteristic Curve Groups.....	A-2
Timing Accuracy.....	A-17
Fixed Time Characteristic.....	A-17
INTEGRATING TIME RESET CHARACTERISTIC.....	A-17

Figures

Figure A-1. Instantaneous Characteristic Curves.....	A-1
Figure A-2. Short Inverse (S) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-2)	A-3
Figure A-3. Long Inverse (L) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-5)	A-4
Figure A-4. Definite Time (D) Time Characteristic Curve (Similar to ABB CO-6)	A-5
Figure A-5. Moderately Inverse (M) Time Characteristic Curve (Similar to ABB CO-7)	A-6
Figure A-6. Inverse (I) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-8)	A-7
Figure A-7. Very Inverse (V) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-9).....	A-8
Figure A-8. Extremely Inverse (E) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-11).....	A-9
Figure A-9. BS142 Very Inverse (BS142-B) Time Characteristic Curve.....	A-10
Figure A-10. BS142 Extremely Inverse (BS142-C) Time Characteristic Curve	A-11
Figure A-11. Short Inverse (S2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 55).....	A-12
Figure A-12. Long Inverse (L2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 66)	A-13
Figure A-13. Inverse (I2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 51).....	A-14
Figure A-14. Very Inverse (V2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 53)	A-15
Figure A-15. Extremely Inverse (E2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 77)	A-16
Figure A-16. Integrating Reset Characteristic Curve.....	A-17

Tables

Table A-1. Time Characteristic Curve Constants with Switch SW3-3 Open (Off).....	A-2
Table A-2. Time Characteristic Curve Constants with Switch SW3-3 Closed (On)	A-2

www . ElectricalPartManuals . com

This page intentionally left blank.

APPENDIX A • CHARACTERISTIC CURVES

INTRODUCTION

This appendix describes and defines the instantaneous overcurrent, time overcurrent, and integrating time reset characteristics of the BE1-50/51B-230 and BE1-50/51B-234 relays.

INSTANTANEOUS OVERCURRENT CHARACTERISTICS

Timing

The instantaneous characteristic curves of the BE1-50/51B-230 and BE1-50/51B-234 relays are similar to standard electromechanical instantaneous units. However, the time to trip for applications where the initial sensing current is less than 400 mA may be slightly longer. This may occur on a very lightly loaded circuit or when the relay is providing ground protection and is connected to measure neutral current. Figure A-1 shows the instantaneous characteristic curves for the maximum time to trip.

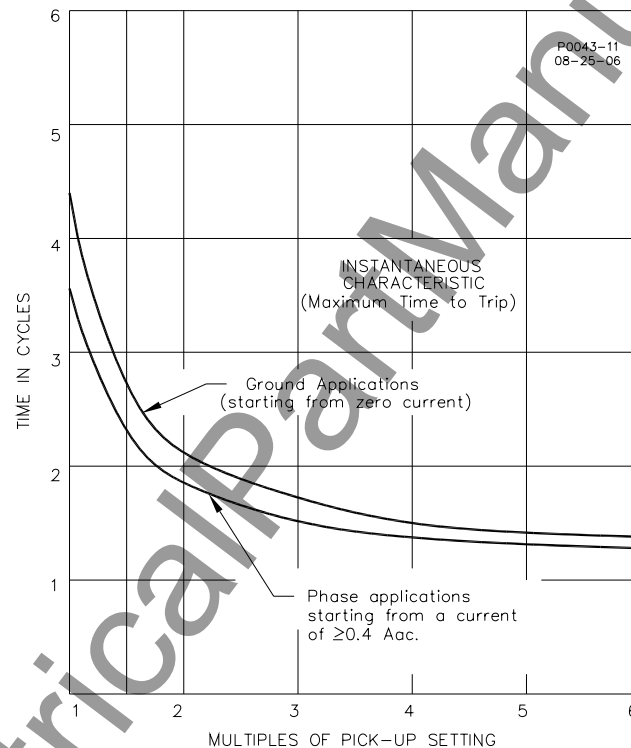


Figure A-1. Instantaneous Characteristic Curves

The delay of the Instantaneous A (50-A) element can be set for no intentional delay (switch SW3-2 open) or a fixed delay of 100 ms (SW3-2 closed). Figure 2-2 illustrates the location of SW3. The time delay of the 50-B element is not switch-selectable and is fixed at no intentional delay.

Pickup

The instantaneous elements of the BE1-50/51B-230 and BE1-50/51B-234 relays may be set lower than the instantaneous element in IAC relays and still have the same reach. This is because the BE1-50/51B-230 and BE1-50/51B-234 instantaneous elements effectively eliminate the fault current transient overreach components. When setting the BE1-50/51B-230 and BE1-50/51B-234 instantaneous elements, calculate the symmetrical value without any adder for transient overreach.

TIME OVERCURRENT CHARACTERISTICS

Nine inverse time functions and one fixed (definite) time function can be selected at the front panel. Curve types are identified by a letter designator. Available curve types are short inverse (S), long inverse (L), definite time (D), moderately inverse (M), inverse (I), very inverse (V), extremely inverse (E), BS142 inverse, (B), and BS142 extremely inverse (C).

Inverse Time Functions

Characteristic curves for the inverse and definite time functions are defined by the following equation:

$$T_T = \frac{AD}{M^N - C} + BD + K$$

Where:

T_T = time to trip in seconds
 D = time dial setting
 M = multiple of pickup setting
 A, B, C, N, K = constants for the particular curve

Characteristic Curve Groups

Either GE IAC or ABB characteristic curve groups are selected through switch SW3-3. (Refer to Figure 2-2 for the location of SW3.)

Characteristic Curve Constants

Tables A-1 and A-2 list the time characteristic curve constants used by the relay. Constants have been selected to conform to the characteristics of electromechanical relays over a range of pickup multiples from 1.3 to 40. Values of the constants are provided for use in PC relay setting applications. Timing accuracy is ± 1 cycle $\pm 2\%$ of time to trip.

Table A-1. Time Characteristic Curve Constants with Switch SW3-3 Open (Off)

Curve Type	Similar To	Figure Number	Constants					
			A	B	C	N	K	R
S	ABB CO-2	A-2	0.2663	0.03393	1.000	1.2969	0.028	0.500
L	ABB CO-5	A-3	5.6143	2.18592	1.000	1.0000	0.028	15.750
D	ABB CO-6	A-4	0.4794	0.21359	1.000	1.5625	0.028	0.875
M	ABB CO-7	A-5	0.3022	0.12840	1.000	0.5000	0.028	1.750
I	ABB CO-8	A-6	8.9341	0.17966	1.000	2.0938	0.028	9.000
V	ABB CO-9	A-7	5.4678	0.10814	1.000	2.0469	0.028	5.500
E	ABB CO-11	A-8	7.7624	0.02758	1.000	2.0938	0.028	7.750
B	BS142-B*	A-9	1.4636	0.00000	1.000	1.0469	0.028	3.250
C	BS142-C*	A-10	8.2506	0.00000	1.000	2.0469	0.028	8.000
F	None†	None	0.0000	1.00000	0.000	0.0000	0.000	1.000

* Curves B and C are defined in British Standard BS142 and IEC 255-4 (International Electrotechnical Commission).

† Fixed time from 0.1 to 9.9 seconds.

Table A-2. Time Characteristic Curve Constants with Switch SW3-3 Closed (On)

Curve Type	Similar To	Figure Number	Constants					
			A	B	C	N	K	R
S	GE IAC 55	A-11	0.0286	0.0208	1.000	0.9844	0.028	0.0940
L	GE IAC 66	A-12	2.3955	0.00002	1.000	0.3125	0.028	7.8001
D	ABB CO-6	A-4	0.4797	0.21359	1.000	1.5625	0.028	0.8750
M	ABB CO-7	A-5	0.3022	0.12840	1.000	0.5000	0.028	1.7500
I	GE IAC 51	A-13	0.2747	0.1042	1.000	0.4375	0.028	0.8868
V	GE IAC 53	A-14	4.4309	0.0991	1.000	1.9531	0.028	5.8231
E	GE IAC 77	A-15	4.9883	0.0129	1.000	2.0469	0.028	4.7742
B	BS142-B*	A-9	1.4636	0.00000	1.000	1.0469	0.028	3.2500
C	BS142-C*	A-10	8.2506	0.00000	1.000	2.0469	0.028	8.0000
F	None†	None	0.0000	1.00000	0.000	0.0000	0.000	1.0000

* Curves B and C are defined in British Standard BS142 and IEC 255-4 (International Electrotechnical Commission).

† Fixed time from 0.1 to 9.9 seconds.

Characteristic Curves

Figures A-2 through A-15 illustrate the BE1-50/51B-230 and BE1-50/51B-234 time overcurrent characteristic curves.

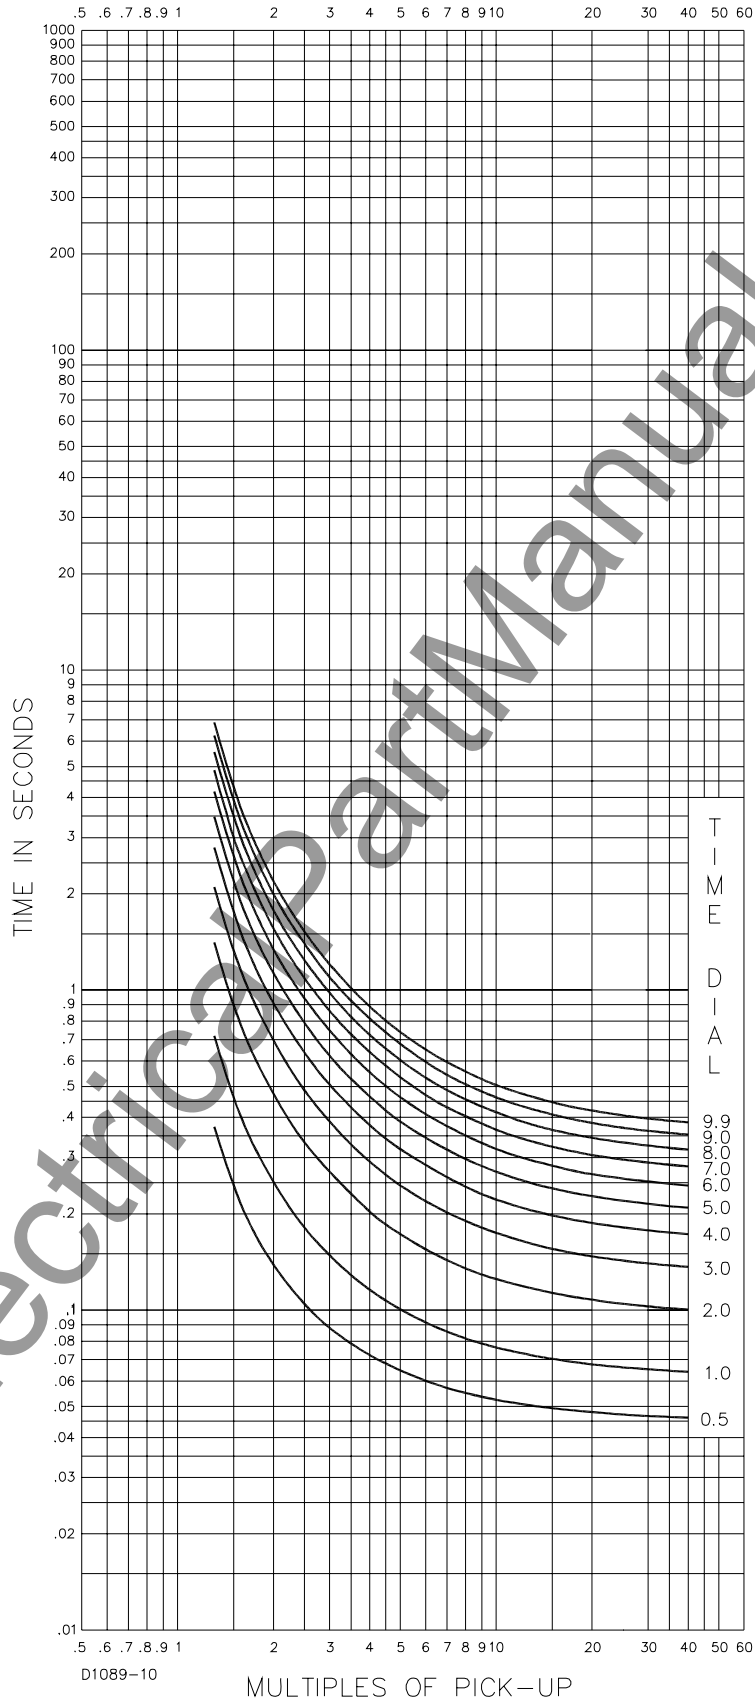


Figure A-2. Short Inverse (S) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-2)

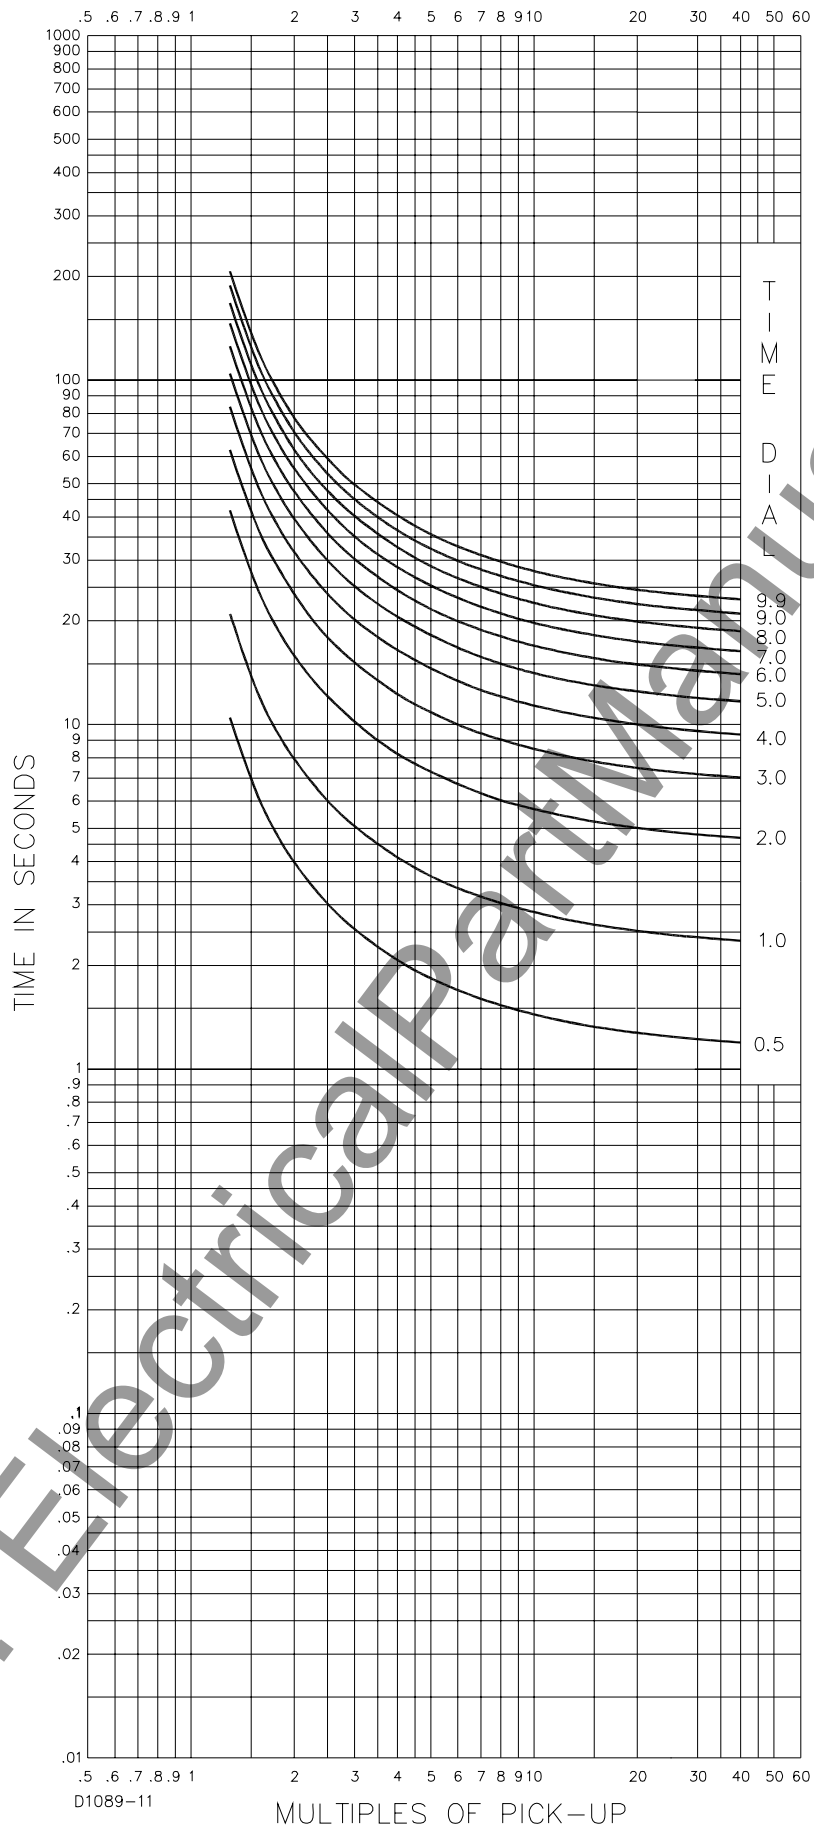


Figure A-3. Long Inverse (L) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-5)

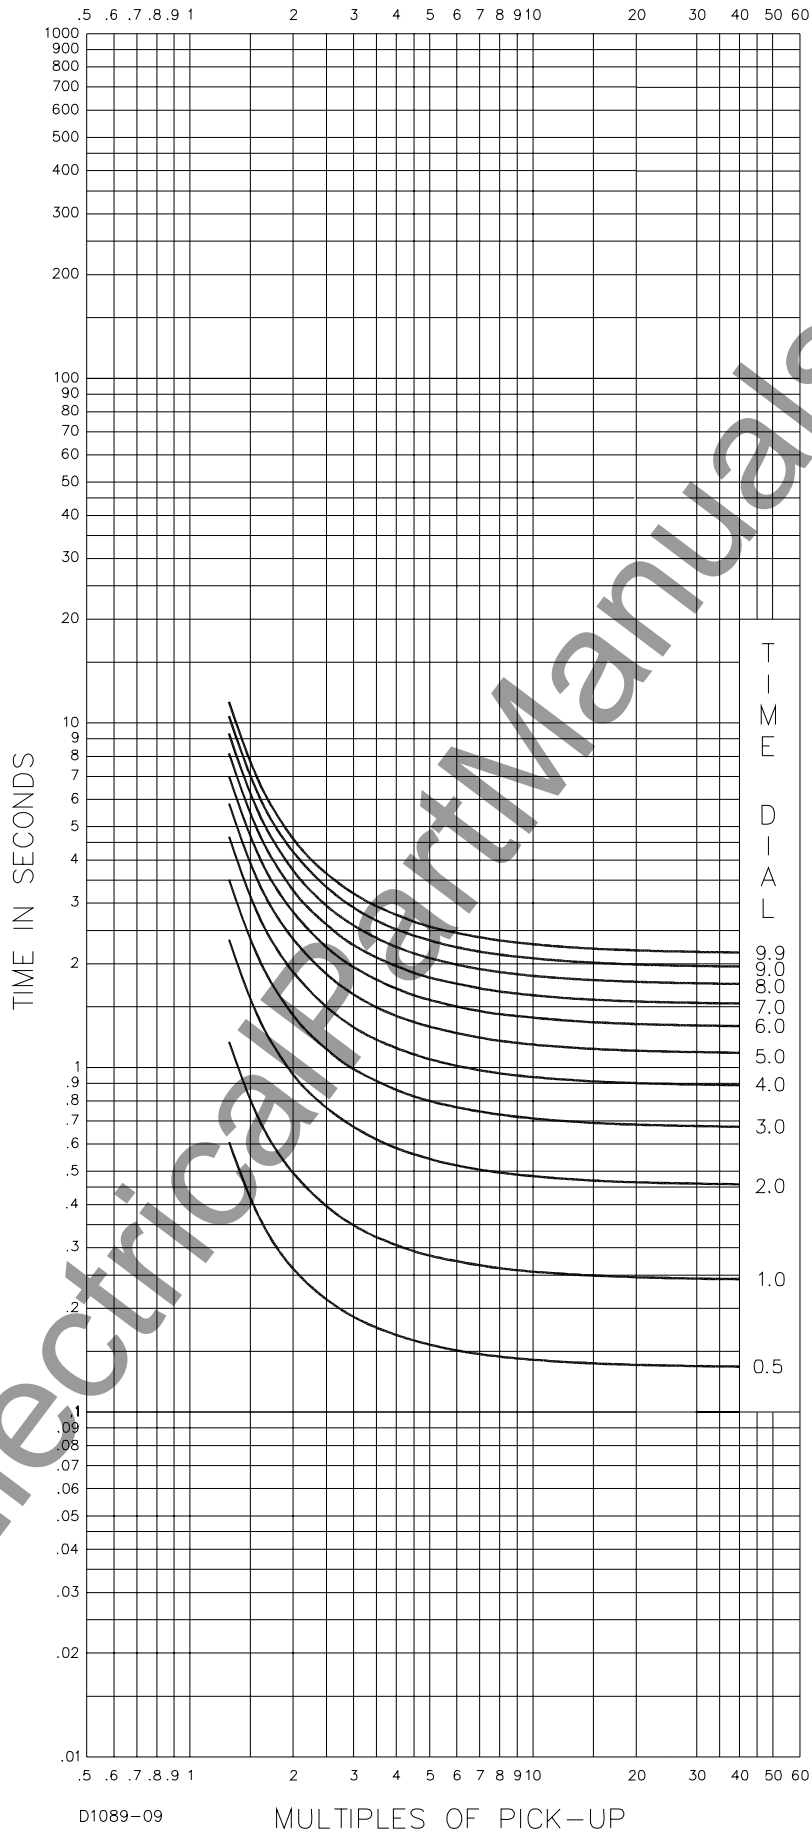


Figure A-4. Definite Time (D) Time Characteristic Curve (Similar to ABB CO-6)

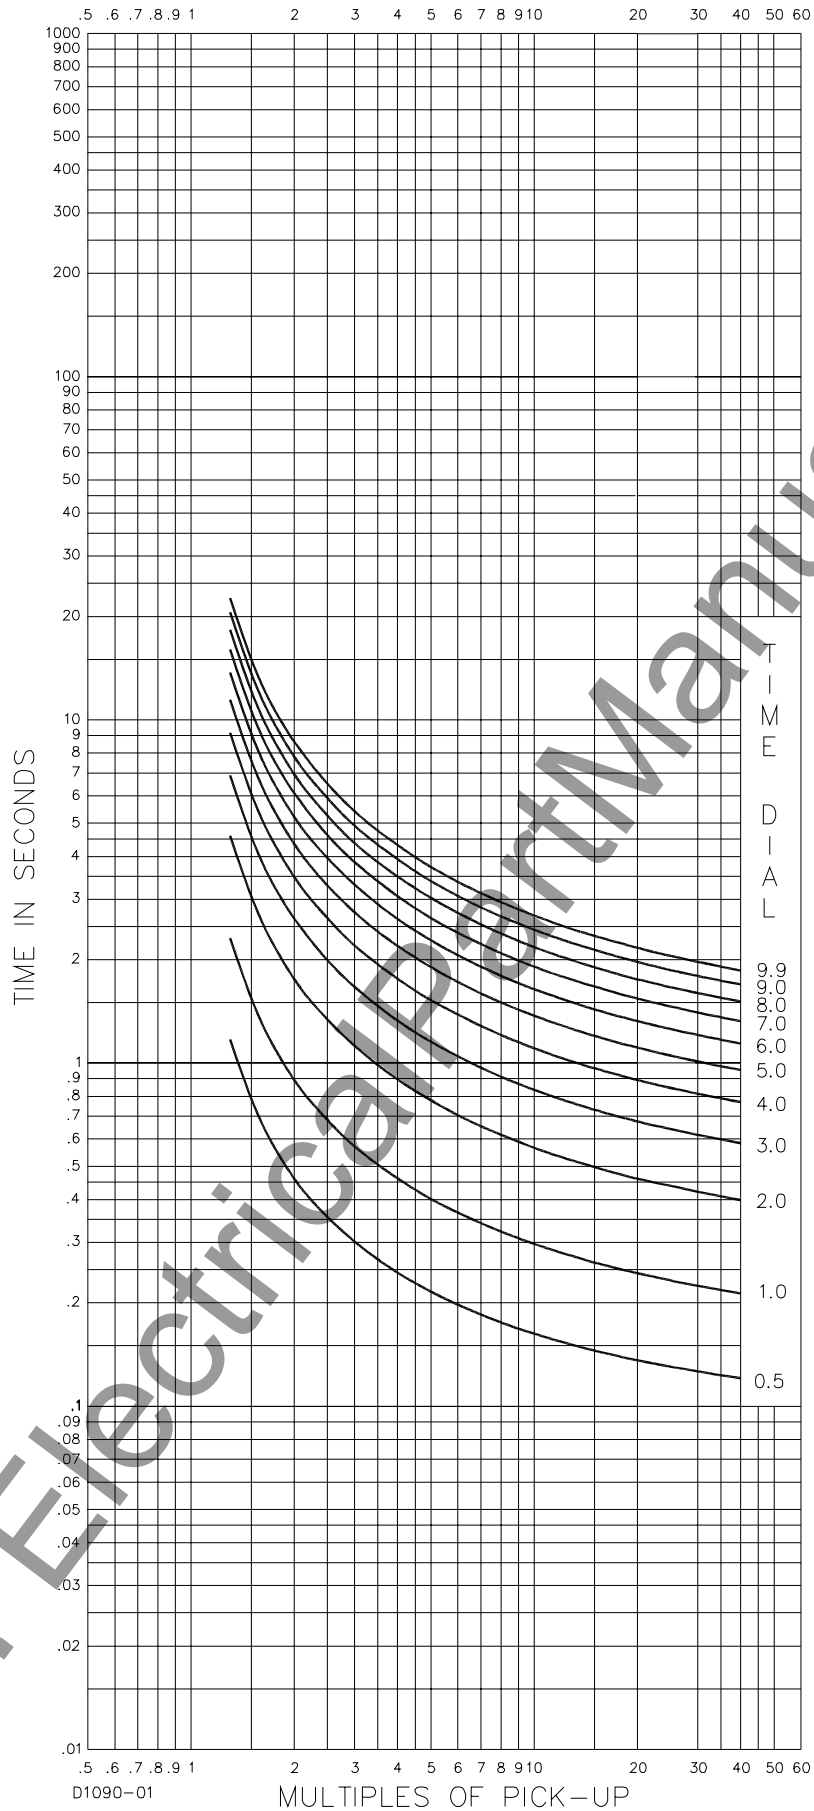


Figure A-5. Moderately Inverse (M) Time Characteristic Curve (Similar to ABB CO-7)

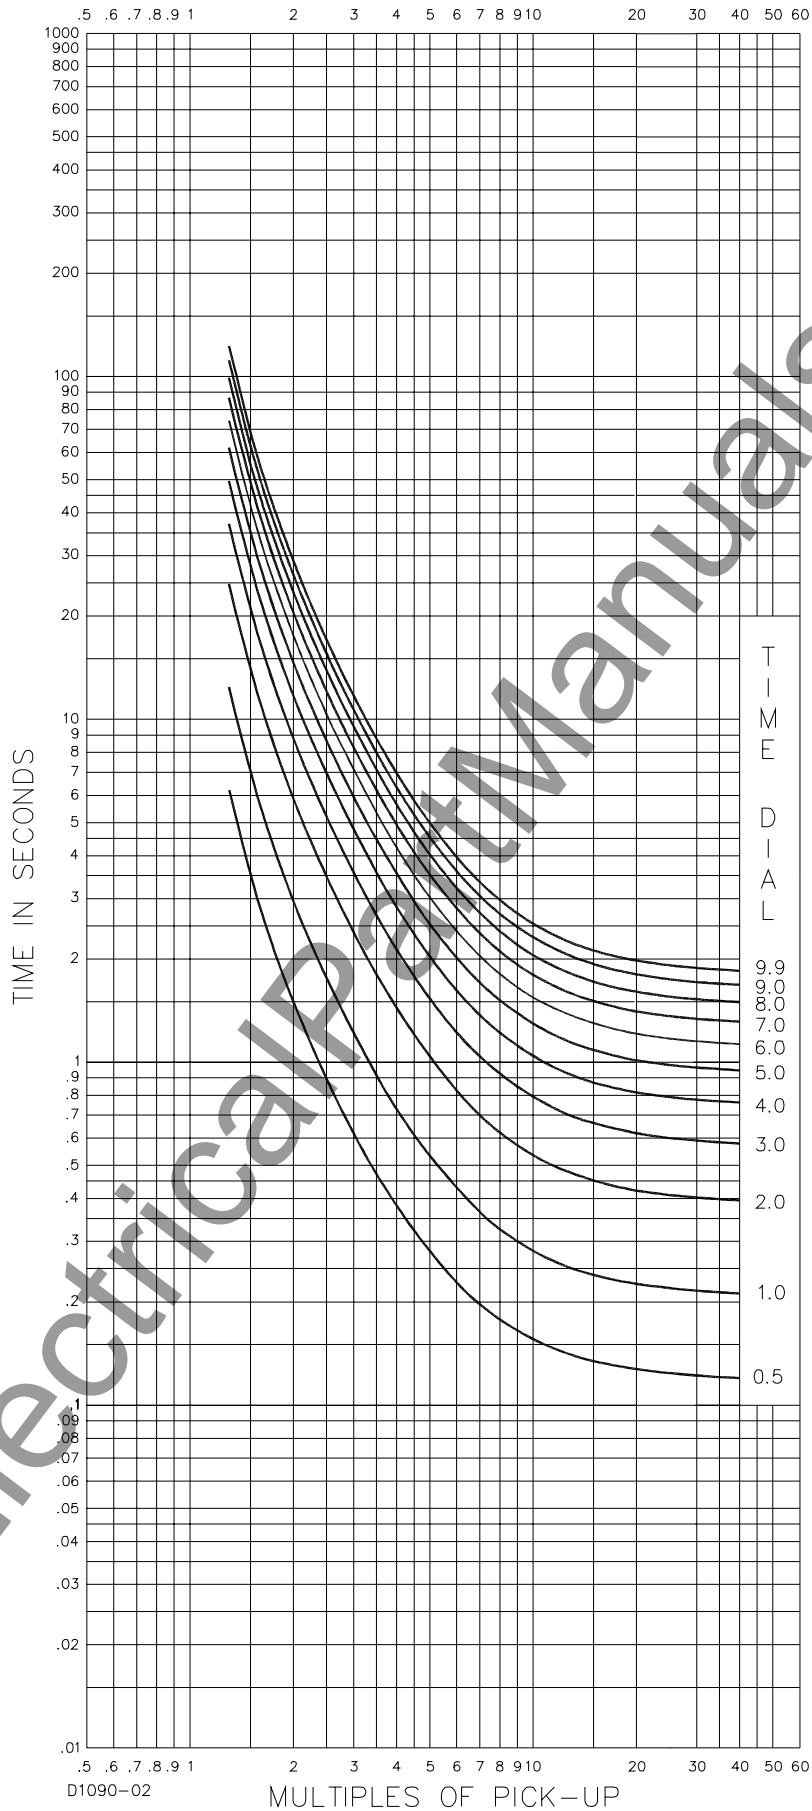


Figure A-6. Inverse (I) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-8)

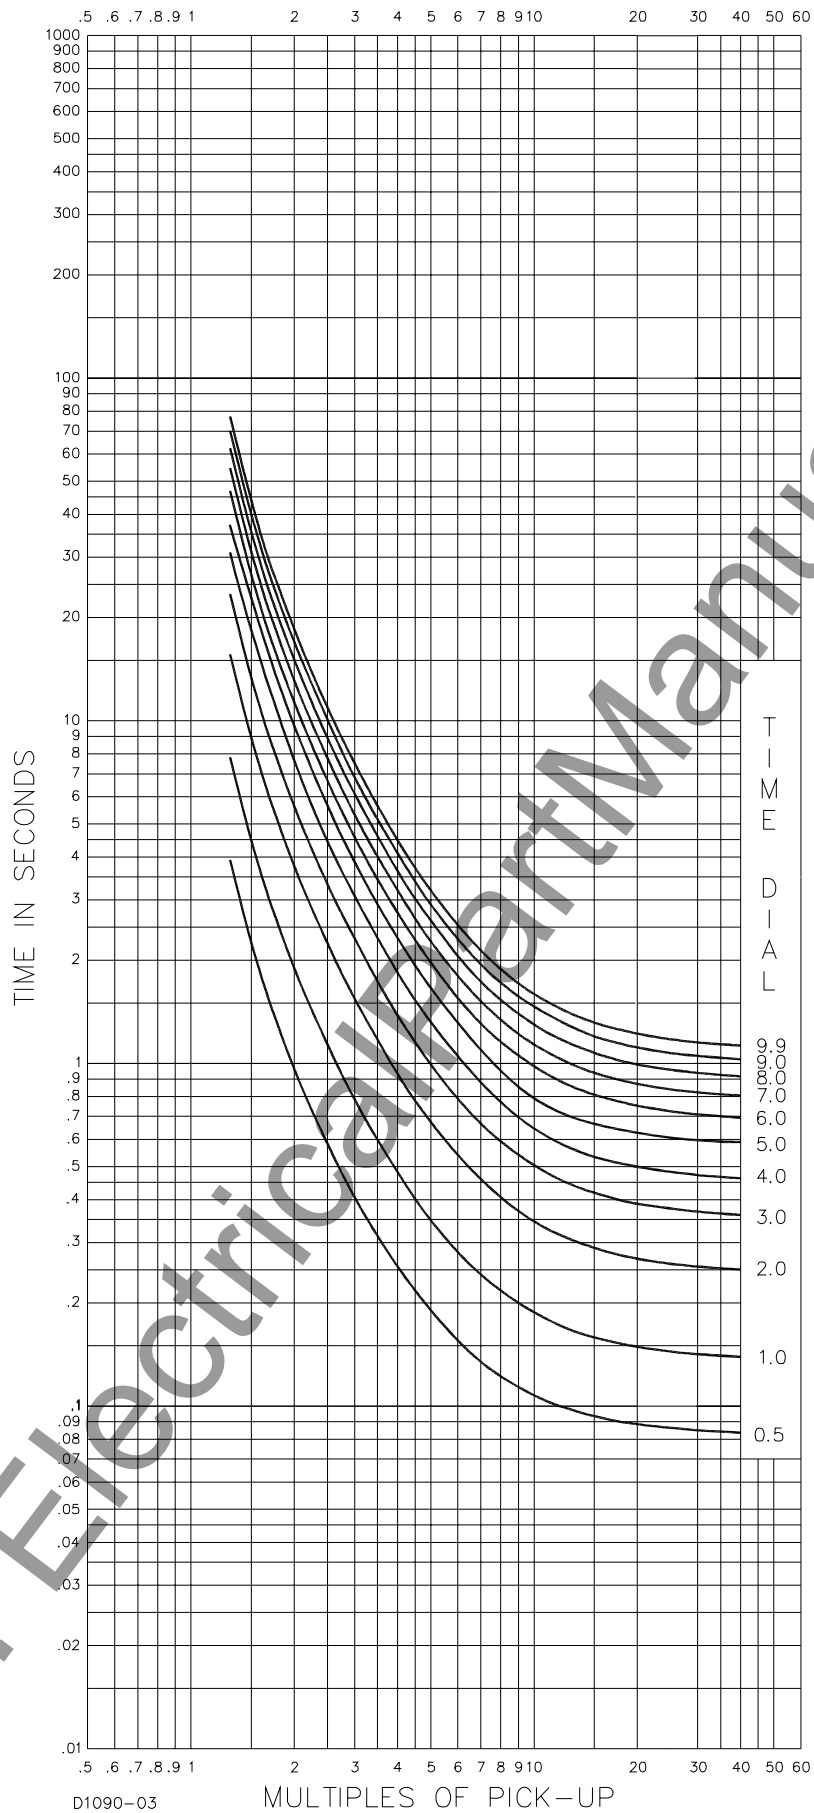


Figure A-7. Very Inverse (V) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-9)

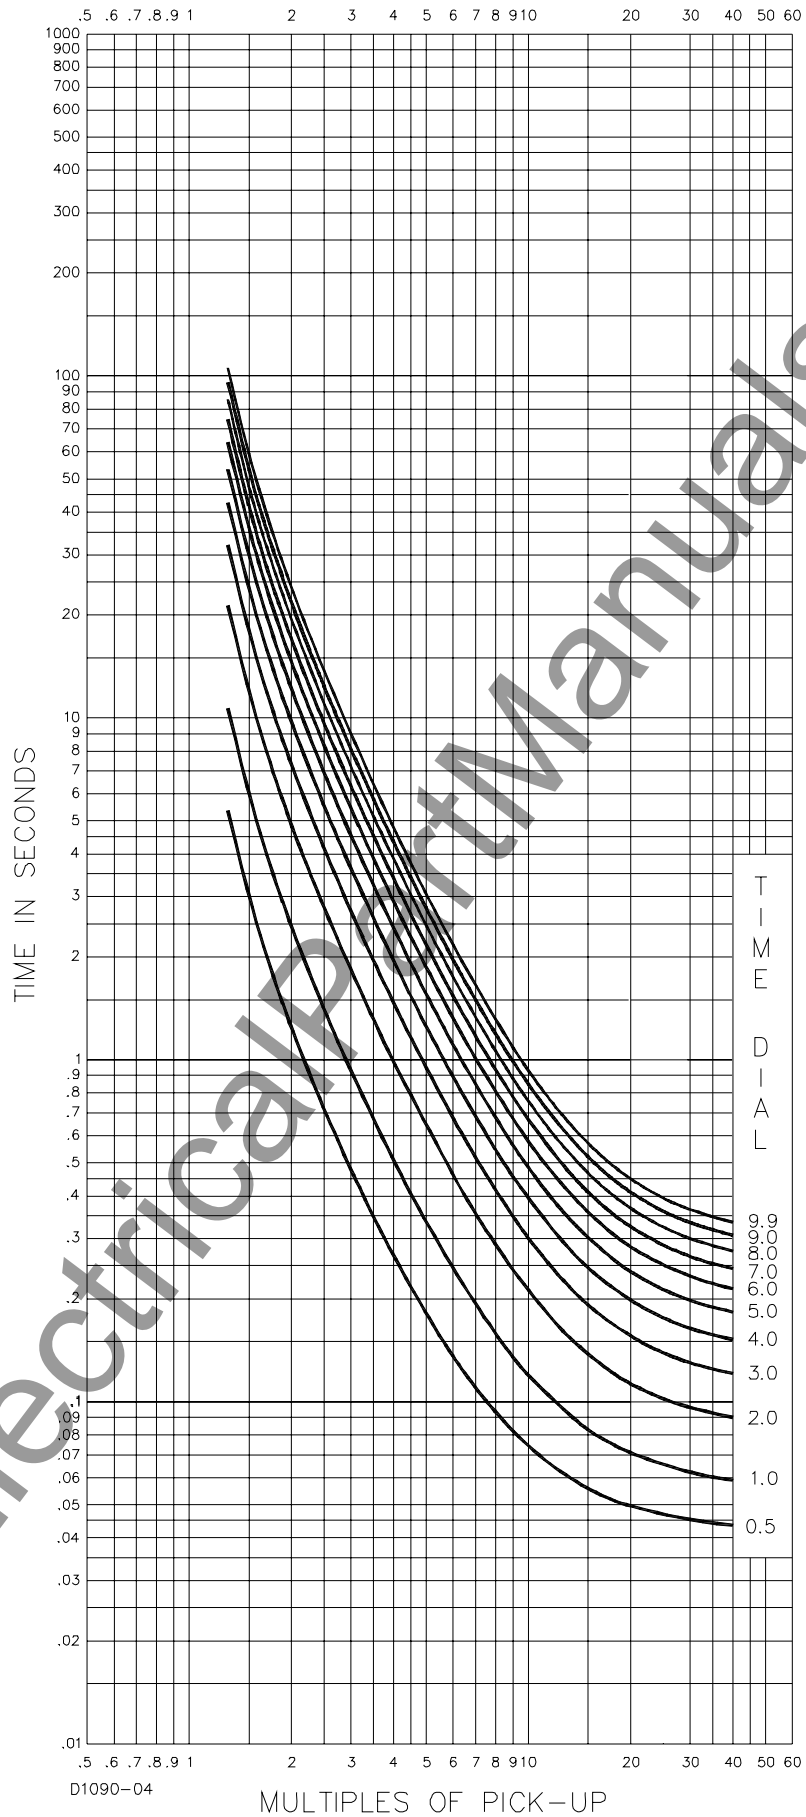


Figure A-8. Extremely Inverse (E) Time Characteristic Curve (SW3-3 Off, Similar to ABB CO-11)

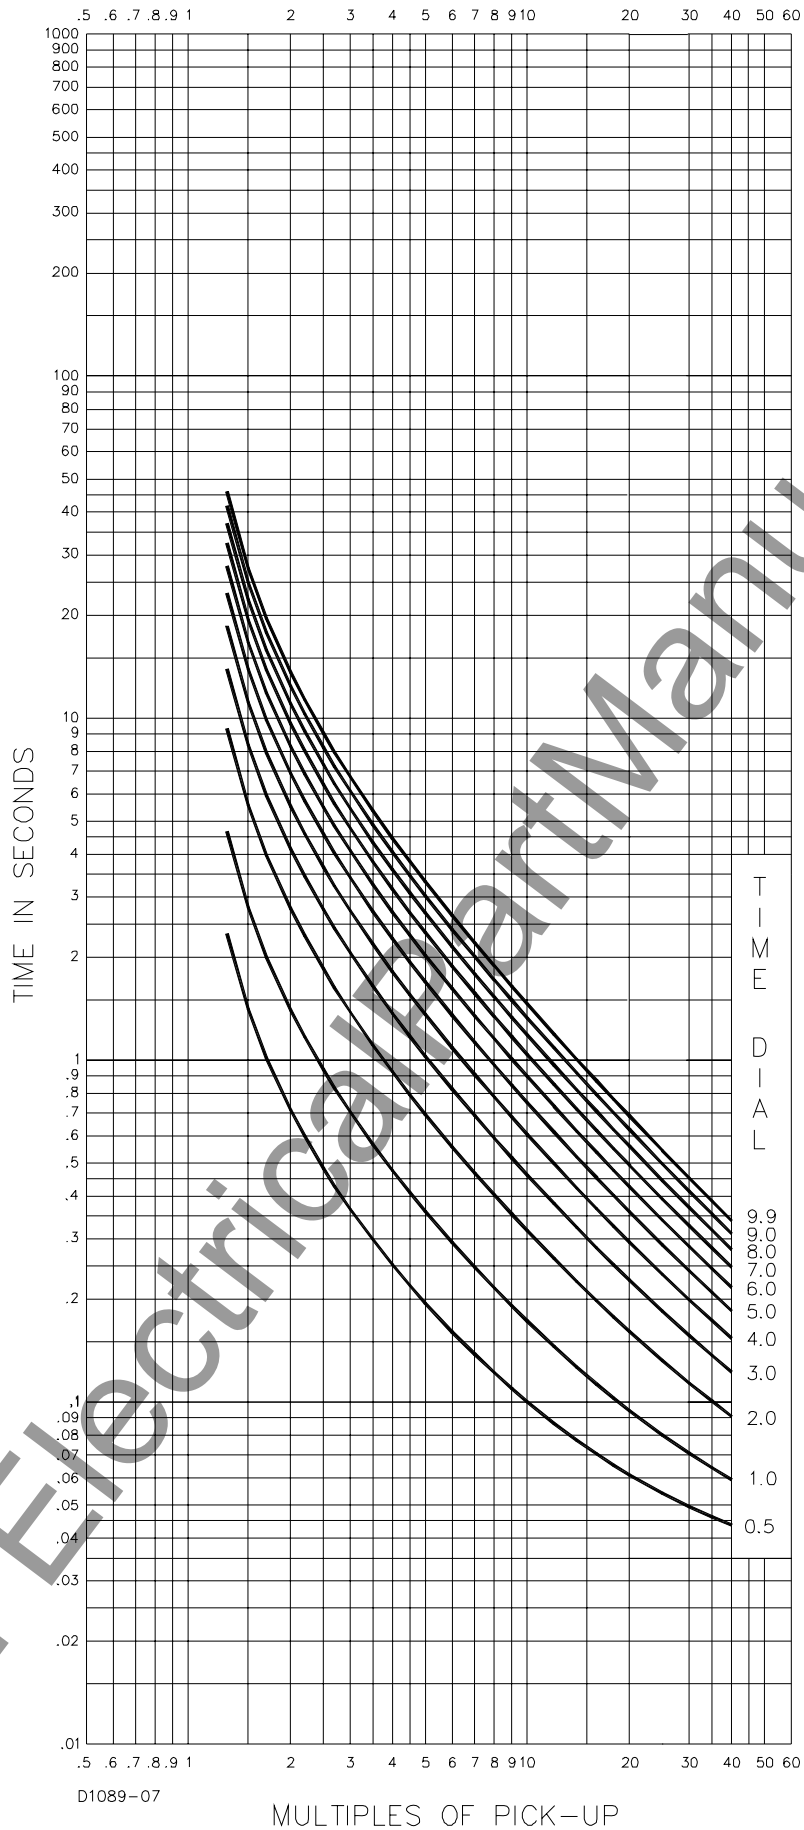


Figure A-9. BS142 Very Inverse (BS142-B) Time Characteristic Curve

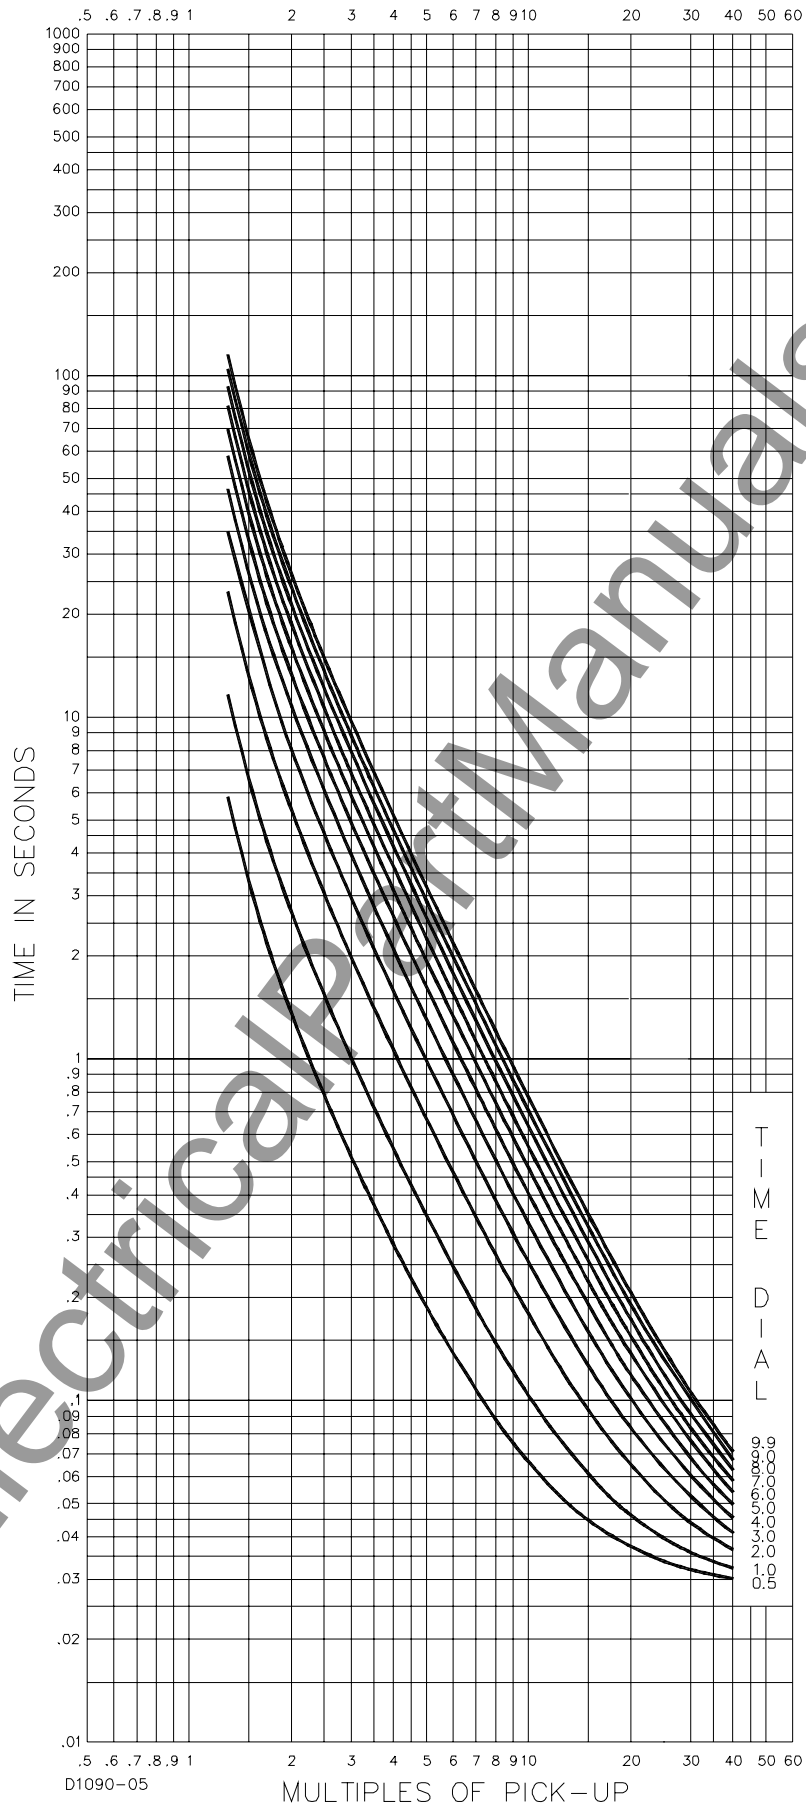


Figure A-10. BS142 Extremely Inverse (BS142-C) Time Characteristic Curve

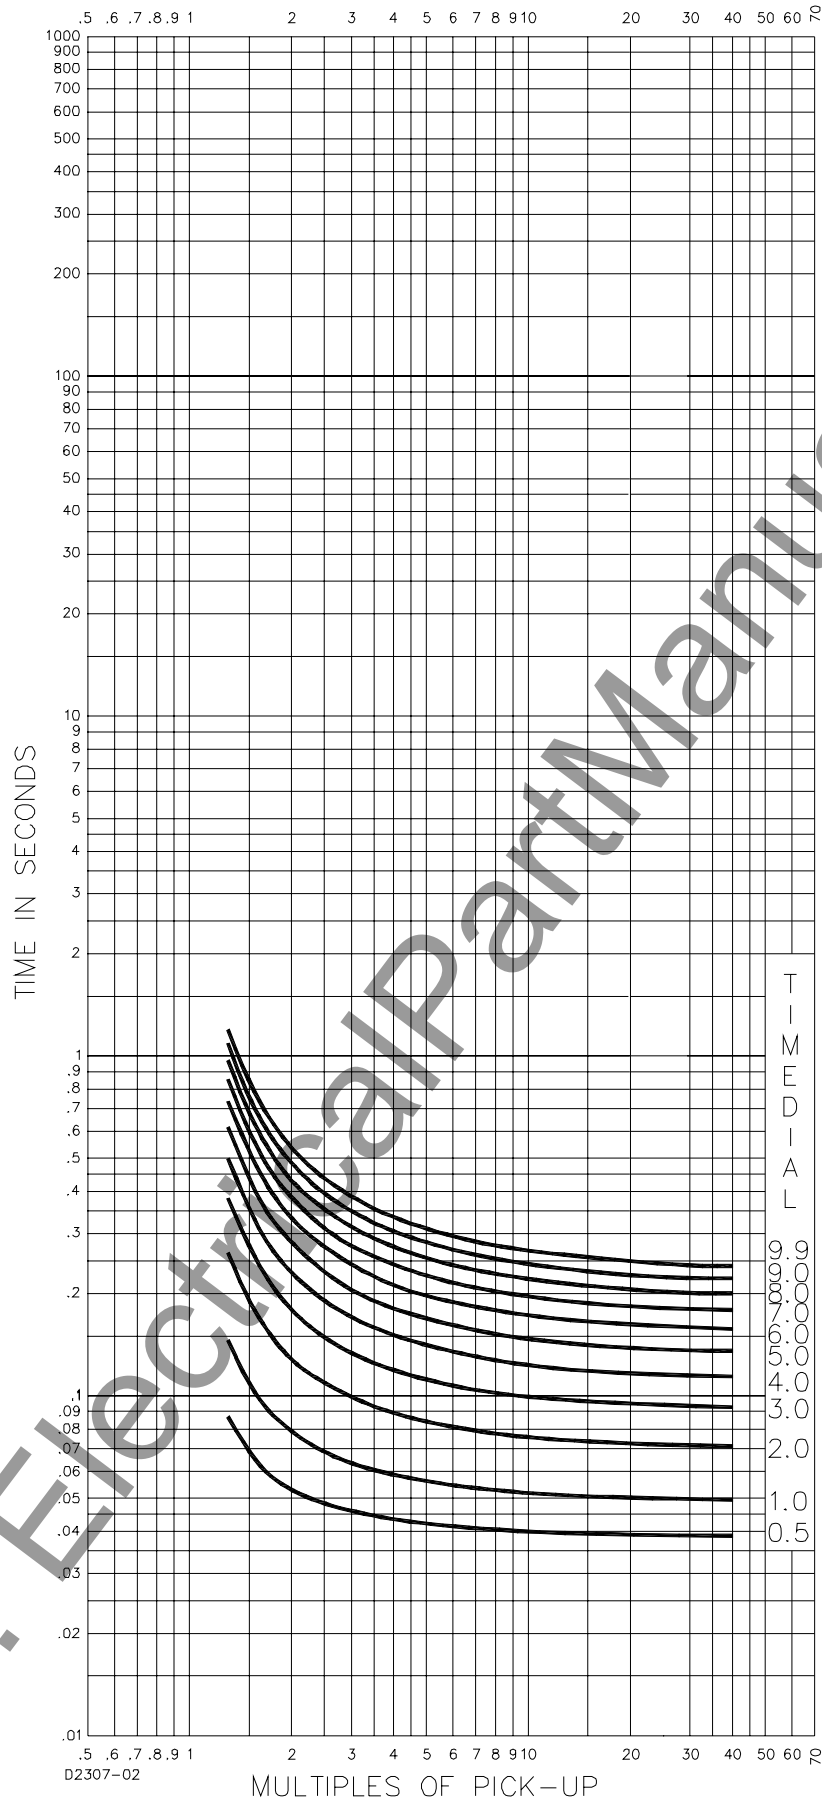


Figure A-11. Short Inverse (S2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 55)

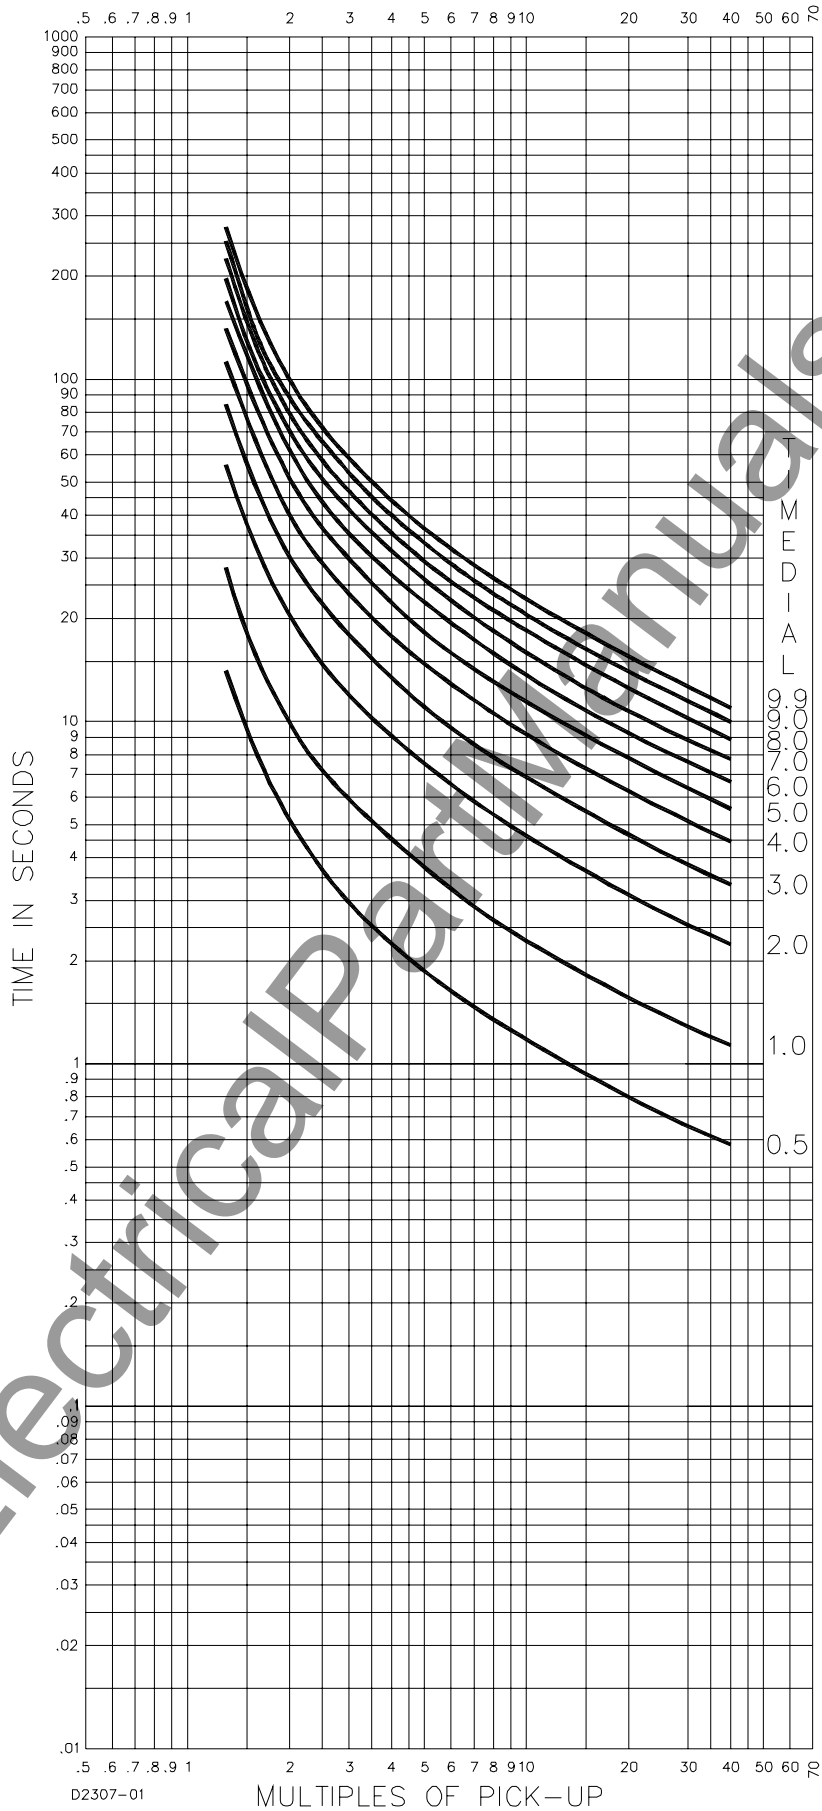


Figure A-12. Long Inverse (L2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 66)

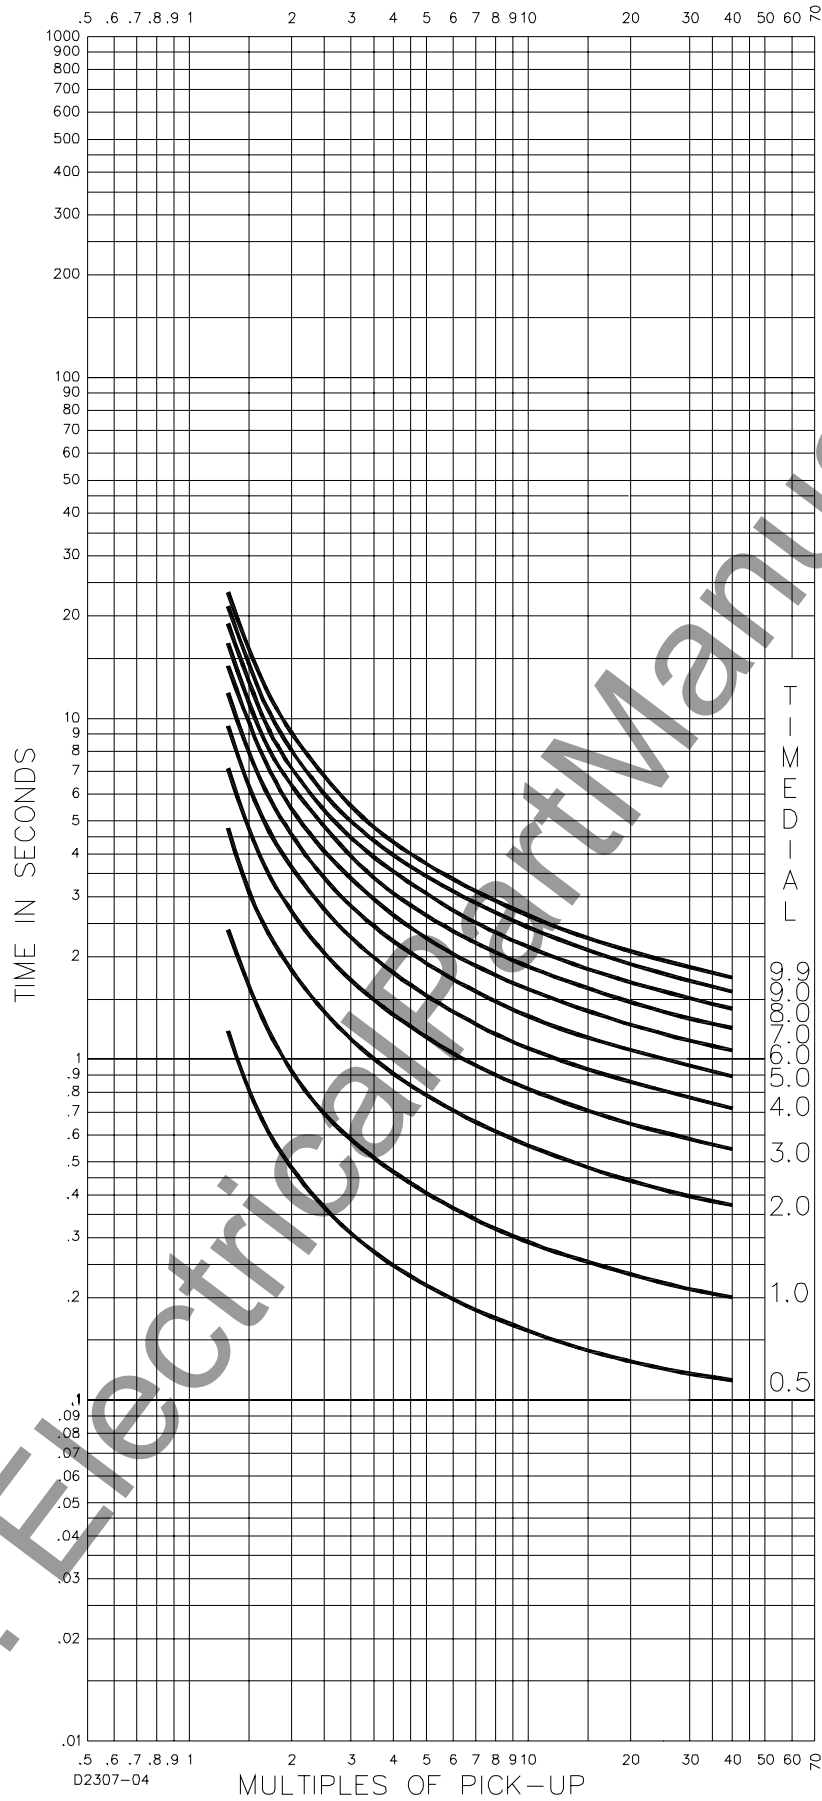


Figure A-13. Inverse (I^2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 51)

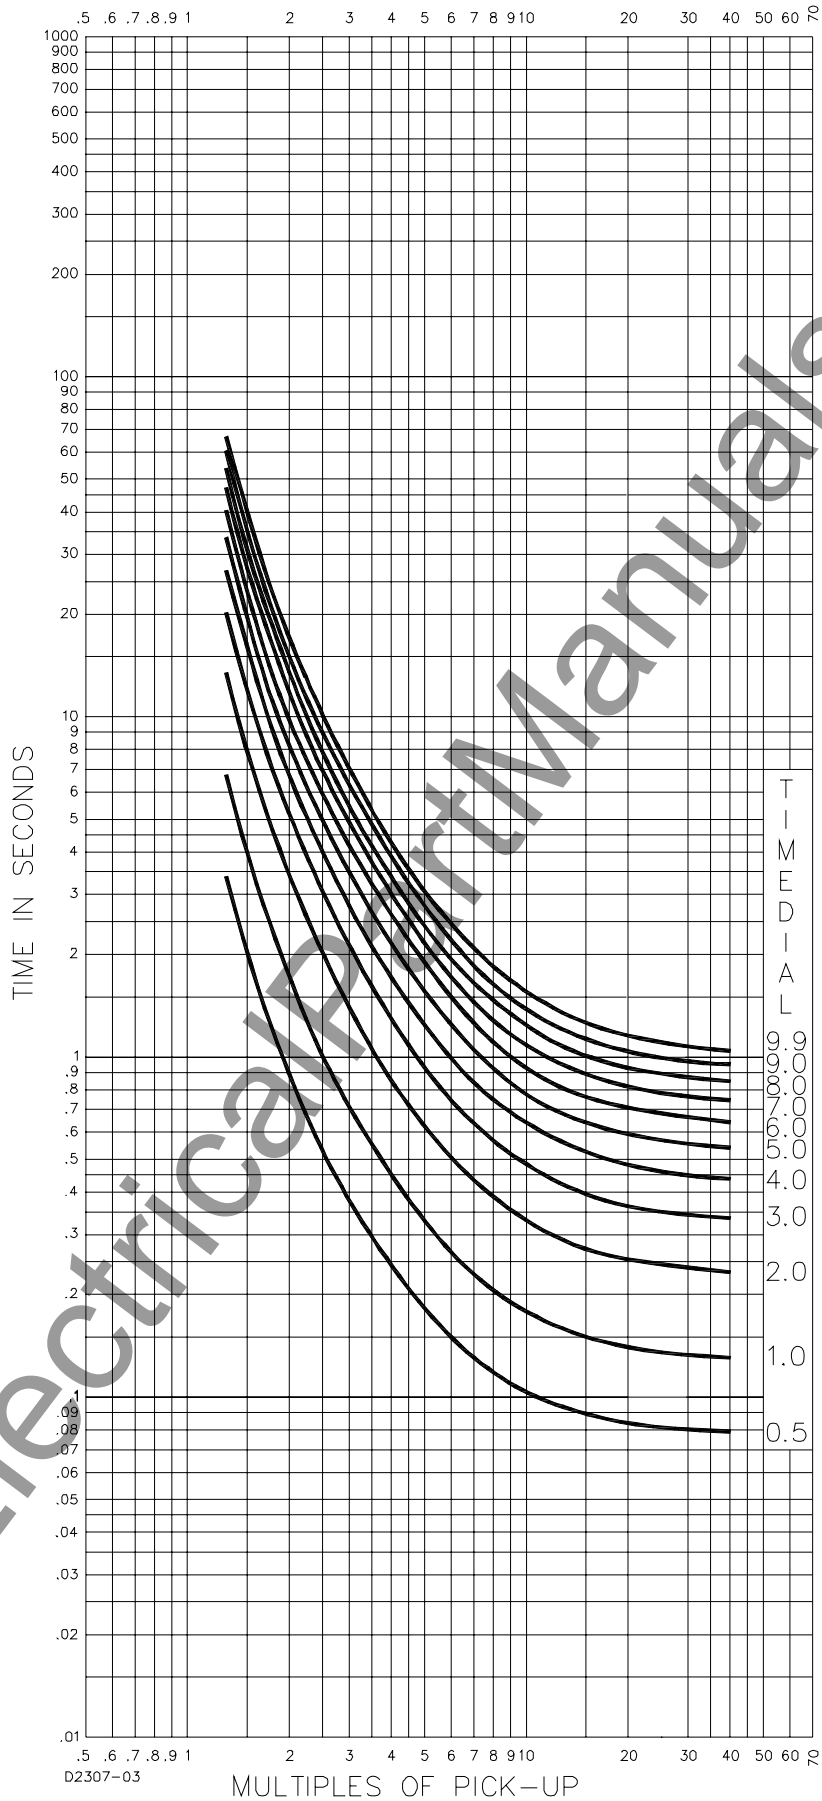


Figure A-14. Very Inverse (V2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 53)

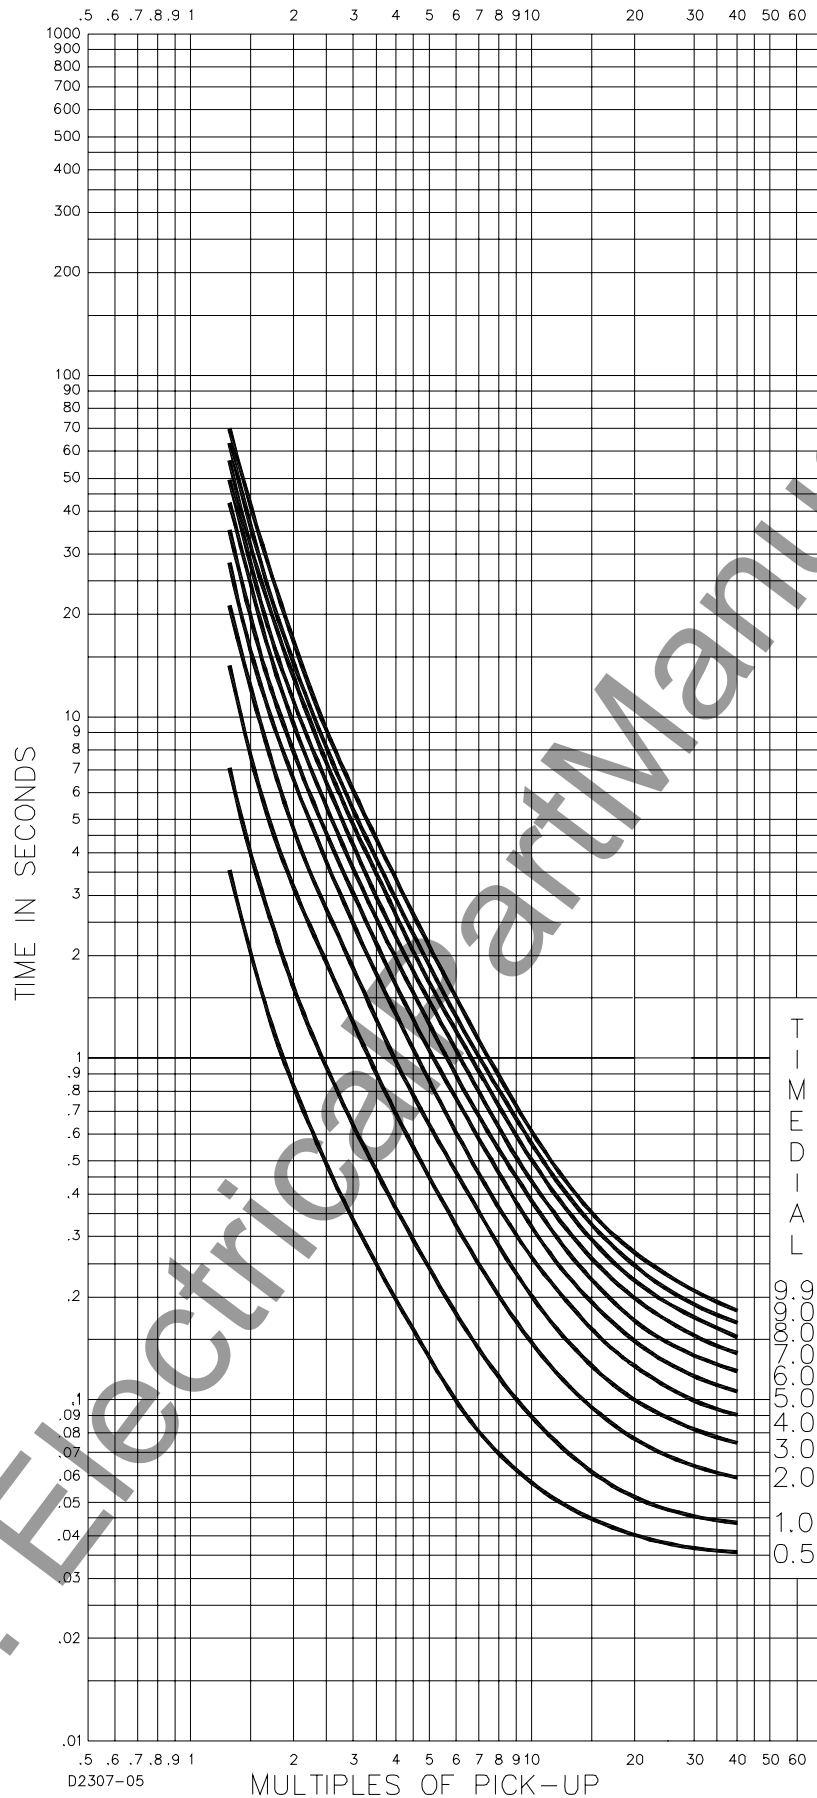


Figure A-15. Extremely Inverse (E2) Time Characteristic Curve (SW3-3 On, Similar to GE IAC 77)

Timing Accuracy

Timing accuracy is the sum of ± 1 cycle, $\pm 2\%$. This accuracy applies to the range of 1.3 to 40 times tap and is for a given measured multiple of tap. Measurement accuracy of the multiple of tap is the sum of $\pm 2\%$, ± 25 mA for the BE1-50/51B-230 and $\pm 2\%$, ± 5 mA for the BE1-50/51B-234.

Fixed Time Characteristic

The fixed time characteristic corresponds to the time dial setting and provides delays of 0.0 to 9.9 seconds. The time setting is constant over a range of pickup multiples from 1.0 to 40. Accuracy is ± 1 cycle, $\pm 2\%$ of the time to trip for time dial settings of 0.1 and greater.

INTEGRATING TIME RESET CHARACTERISTIC

The relay can be user-configured for integrating or instantaneous type reset.

Integrating reset simulates the disk reset of electromechanical relays and begins when the current decreases below 95% of pickup. BE1-50/51B-230 and BE1-50/51B-234 relays provide the integrating reset function even when input current decreases to zero.

Integrating reset characteristics are defined by the following equation and are illustrated in Figure A-16. See Table A-1 and A-2 for the equation constants.

$$T_R = \frac{RD}{M^2 - 1}$$

Where:

T_R	=	time to reset in seconds
R	=	constant for the particular curve
D	=	time dial setting
M	=	current in multiples of pickup setting during reset

Time characteristic curve equation:

$$T_T = \frac{AD}{M^N - C} + BD + K = \text{Time to Trip}$$

Where:

D	=	time dial setting
M	=	multiple of pickup setting

Reset characteristic curve equation:

$$T_R = \frac{RD}{M^2 - 1} = \text{Time to Reset}$$

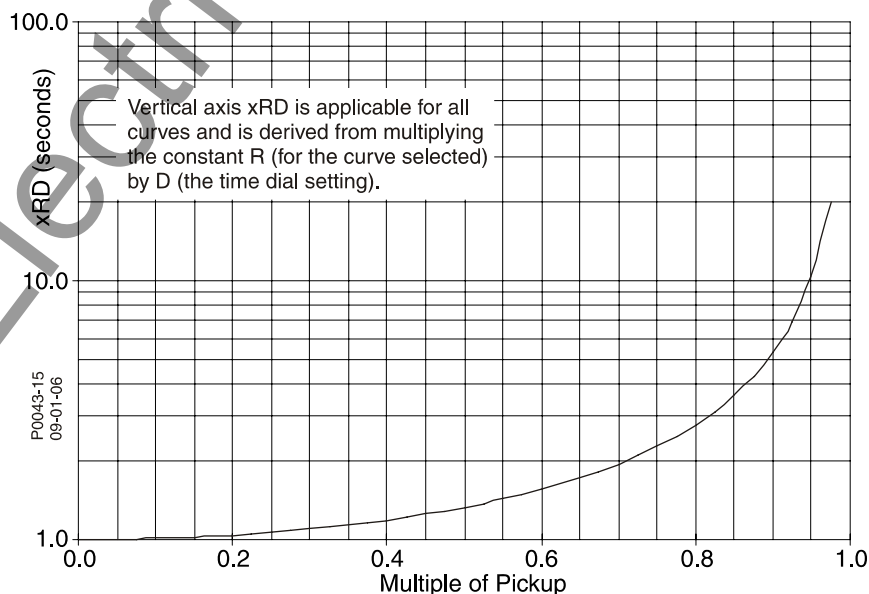


Figure A-16. Integrating Reset Characteristic Curve

Instantaneous Reset

Reset occurs within 16 ms of when the current decreases to 95% of the pickup level.

www.ElectricalPartManuals.com

www.ElectricalPartManuals.com



ROUTE 143, BOX 269

HIGHLAND, IL 62249 USA

<http://www.basler.com>, info@basler.com

PHONE +1 618-654-2341

FAX +1 618-654-2351