




New Information  
Mailed to: E, C/32-000B

# Magnum DS Metal-Enclosed Low-Voltage Switchgear

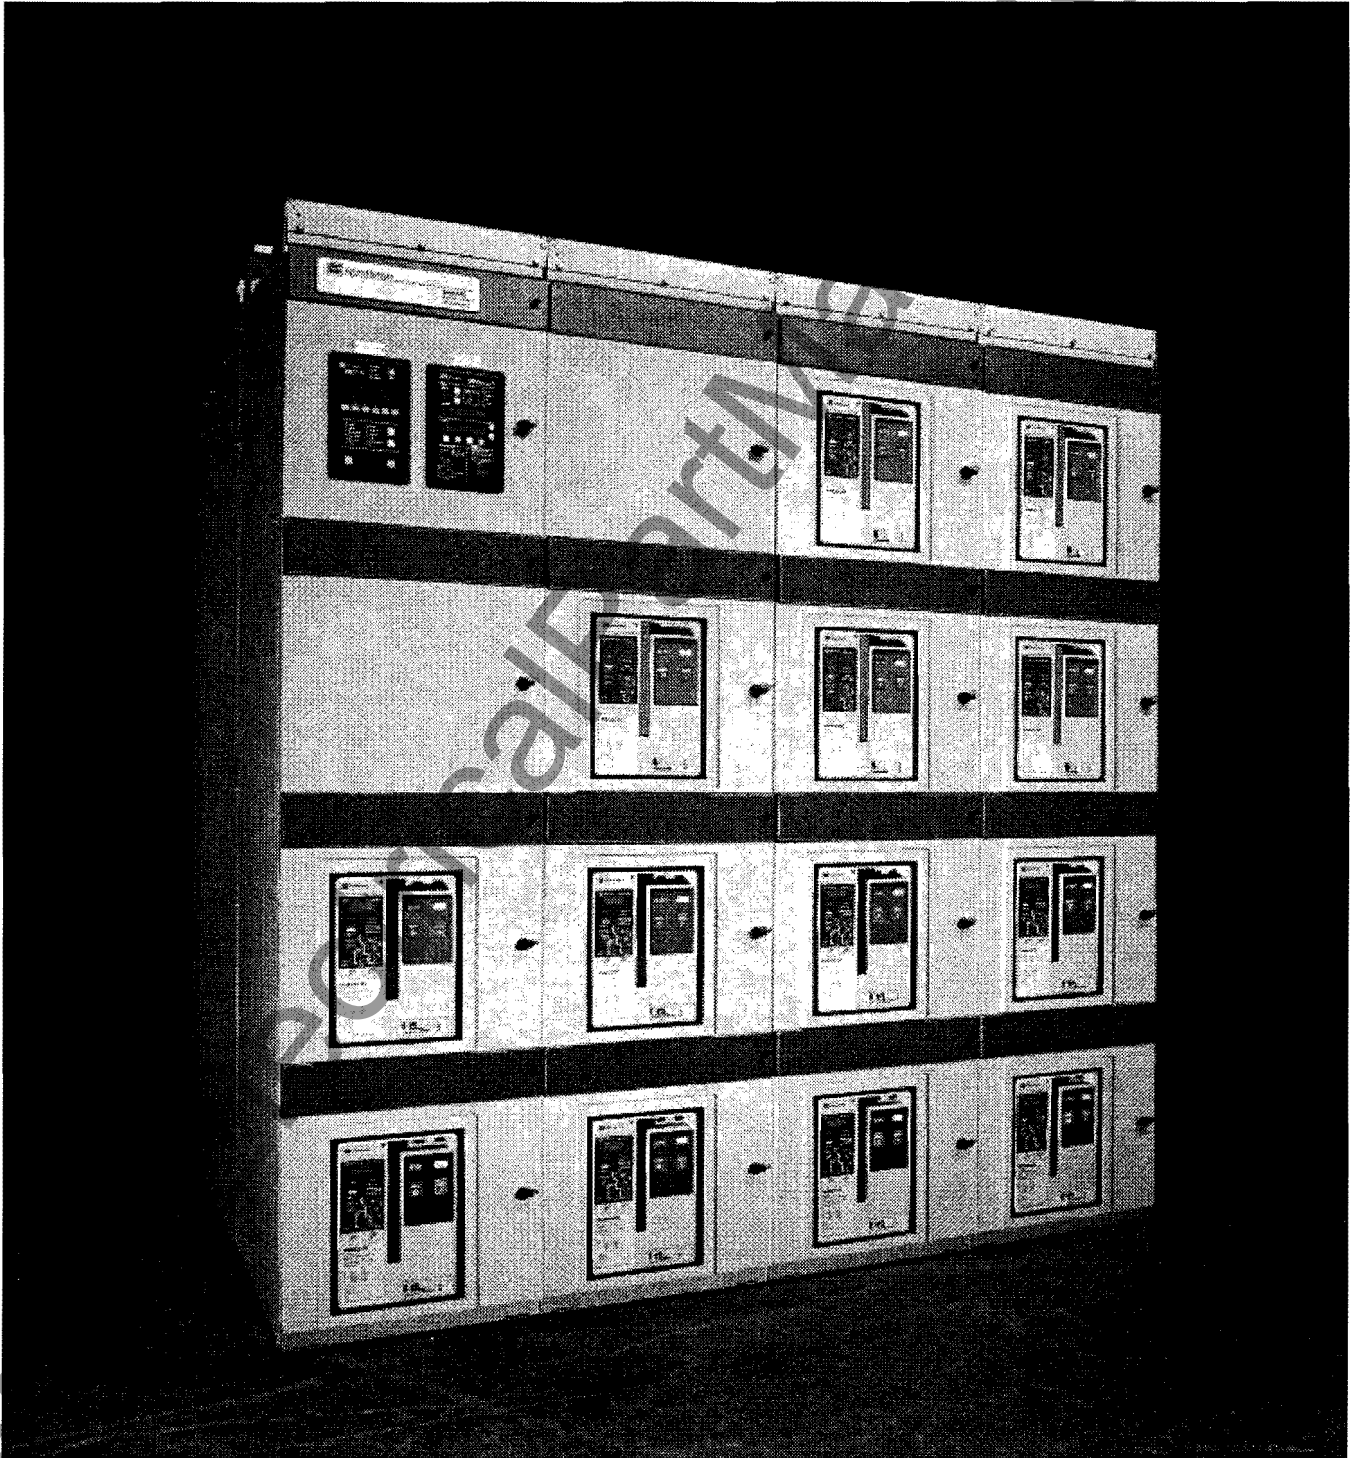

<b>Table of Contents</b>	<b>Page</b>
Why Magnum DS Switchgear . . . . .	2
<b>Ratings</b>	
Voltage Ratings . . . . .	3
Bus Ratings . . . . .	3
Standards . . . . .	3
Magnum DS Breakers . . . . .	3
Breaker Control Voltages . . . . .	3
Sensors and Rating Plugs . . . . .	4
Ground Fault Settings . . . . .	5
Digitrip RMS Trip Curves . . . . .	6-8
CT Metering Accuracies . . . . .	9
Voltage Transformers . . . . .	9
Control Power Transformers . . . . .	9

<b>Application</b>	
Standards . . . . .	10
Voltage/Frequency . . . . .	10
Continuous Current Ratings . . . . .	10
Altitude . . . . .	10
Unusual Environments . . . . .	10
Unit Substations . . . . .	11
Types of Systems . . . . .	12
System Application . . . . .	13
Main Breakers . . . . .	13
Tie Breakers . . . . .	13
Generator Breakers . . . . .	13
Feeder Breakers . . . . .	14
Ground Fault . . . . .	15, 20
High-Resistance Grounding . . . . .	17
Zone Selective Interlocking . . . . .	18
Fault Currents . . . . .	23-25
Breaker Arrangements . . . . .	26-29
Switchgear Section View . . . . .	30
Floor Plan/Conduit Area . . . . .	31
Center of Gravity . . . . .	31
Heat Loss . . . . .	32
Weights . . . . .	32

<b>Features</b>	
Structure . . . . .	33
Bus . . . . .	34
Wiring . . . . .	35
Instrumentation . . . . .	36
Accessories/Options . . . . .	36
Magnum DS Breaker . . . . .	37-38
Typical Specification . . . . .	40

**Why Magnum DS Switchgear**

Cutler-Hammer Magnum DS switchgear is backed by 25 years of power circuit breaker and switchgear development that have set the industry standards for quality, reliability, maintainability and extended operating life. Magnum DS switchgear is designed to meet the changing needs of our customers by providing:

- ⌘ Lower maintenance costs
- ⌘ Higher interrupting ratings
- ⌘ Better coordination capability
- ⌘ Increased tripping sensitivity
- ⌘ Better metering accuracy
- ⌘ Higher quality and reliability
- ⌘ State-of-the-art monitoring and communications

Magnum DS switchgear can meet the needs for general applications, service entrance, harsh environments, multiple source transfer, special grounding systems and many others.

Modern designed Magnum DS Metal-Enclosed Low-Voltage Switchgear and Power Circuit Breakers provide:

- ⌘ 100% rated, fully selective protection
- ⌘ Integral microprocessor-based breaker tripping systems
- ⌘ Two-step stored-energy breaker closing
- ⌘ 100 kA short circuit bus bracing standard
- ⌘ Optional 150 kA and 200 kA short circuit bus bracing, without preceding current limiting fuses
- ⌘ Optional metal barriers isolates the cable compartment from the bus compartment

Many other features for coordinated, safe, convenient, trouble-free and economical control and protection of low-voltage distribution systems are also provided.

Magnum DS Switchgear assemblies have undergone an extensive seismic qualification program. The test program utilized ANSI standard C37.81, the Uniform Building Code (UBC) and the California Building Code (CBC) as a basis for the test program. The assemblies have been tested and qualified to exceed these requirements.

Magnum DS Switchgear conforms to the following standards: NEMA SG3 and SG5, CSA, ANSI C37.20.1, C37.51, and UL Standard 1558 and is built in an ISO certified facility.

Maximum ratings for Magnum DS Switchgear are 600 volts ac, 6000 amperes continuous cross bus and 200,000 amperes short circuit capacity.

Ratings

Table R1 - Voltage Ratings (AC)

System Voltage	Maximum Voltage
208/240	254
480	508
600	635

Table R2 - Available Bus Ratings

Cross Bus Ampacity	Vertical Bus Ampacity	Bus Bracing
2000	2000	100kA, 150kA, 200kA
3200	3200	
4000	4000	
5000	5000	
6000	—	

Table R3 - Standards

Magnum DS switchgear conforms to the following standards: NEMA SG3 and SG5, CSA, ANSI C37.20.1, C37.51, and UL Standard 1558.

**Note:** In addition to the available bus bracings shown above, the bus has been tested for short circuit values of 85,000 amperes for a full 60 cycles.

Table R4 - Ratings of Magnum DS Breakers

Breaker Type	Frame Amperes	Ratings, RMS Symmetrical Amperes (000)					
		Interrupting Rating			Short Time Rating <sup>①</sup>		
		208-240V	480V	600V	208-240V	480V	600V
MDS-408	800	42	42	42	42	42	42
MDS-608	800	65	65	65	65	65	65
MDS-808	800	85	85	85	85	85	85
MDS-C08	800	100	100	100	85	85	85
MDS-616	1600	65	65	65	65	65	65
MDS-816	1600	85	85	85	85	85	85
MDS-C16	1600	100	100	100	85	85	85
MDS-620	2000	65	65	65	65	65	65
MDS-820	2000	85	85	85	85	85	85
MDS-C20	2000	100	100	100	85	85	85
MDS-632	3200	65	65	65	65	65	65
MDS-832	3200	85	85	85	85	85	85
MDS-C32	3200	100	100	100	85	85	85
MDS-840	4000	130	85	85	85	85	85
MDS-C40	4000	130	100	100	100	100	100
MDS-850	4000	130	85	85	85	85	85
MDS-C50	5000	130	100	100	100	100	100

Maximum voltages at which the interrupting ratings in Table R4 apply are:

System Voltage	Maximum Voltage
208 or 240	254
480	508
600	635

These interrupting ratings are based on the standard duty cycle consisting of an opening operation, a 15-second interval and a close-open operation, in succession, with delayed tripping in case of short-delay devices.

The standard duty cycle for short-time ratings consists of maintaining the rated current for two periods of 1/2 second each, with a 15-second interval of zero current between the two periods.

Table R5 - Magnum DS Breaker Control Voltages and Currents

Control Voltage	24 DC	48 DC	125 DC	120 AC	240 AC
Close current (SR), ampere	2.70	1.30	0.67	0.59	0.34
Shunt trip current, ampere	2.70	1.30	0.67	0.59	0.34
Spring charge motor ampere	8.00	4.00	3.00	3.00	3.00
Control voltage range:					
Close -	18-26	38-56	100-140	104-127	208-254
Trip -	18-26	28-56	70-140	60-127	208-254

Motor currents are running currents. Inrush is approximately 400%. Motor running time to charge spring approximately 5 seconds.

① Also ratings without instantaneous trip.

Ratings

Table R6 - Available Sensor Ratings and Rating Plugs for Digitrip RMS<sup>①</sup>

Breaker Frame	Available Ratings
800	200, 250, 300, 400, 600, 800
1600	200, 250, 300, 400, 600, 800, 1000, 1200, 1600
2000	200, 250, 300, 400, 600, 800, 1000, 1200, 1600, 2000
3200	2500, 3000, 3200
4000	3200, 4000
5000	3200, 4000, 5000

The narrow-band characteristic curve graphically illustrates the close coordination obtainable in breaker systems with Digitrip RMS tripping devices. Repeatability is within 2%.

The maximum breaker current rating for any breaker frame size is determined by the rating of the sensor used.

The breaker current rating for any frame size can be changed by simply changing the sensors and associated rating plug, which are easily removed from the breaker draw-out element. The wide range of long-delay pickup makes one set of sensors more flexible on a wider range of loads. The Digitrip RMS itself need not be changed when the associated sensors and rating plugs are changed.

Digitrip RMS can be supplied in various combinations of four independent, continuously adjustable, overcurrent protection functions:

- ※ Long delay (L)
- ※ Instantaneous (I)
- ※ Short delay (S)
- ※ Ground (G)
- ※ Ground Alarm only (GA)

Every Magnum DS trip unit comes standard with LSI characteristics. Optional ground (G) or ground alarm (GA) may also be provided. These trip units also provide the ability to defeat instantaneous protection. In addition, short delay protection may be set to the maximum instantaneous level, effectively disabling short delay protection if instantaneous protection is turned off. Under no condition is it possible to set the trip unit beyond the capabilities of the circuit breaker.

① The Rating Plug is for 50 and 60 Hertz applications. Rating Plugs are not interchangeable with 60 Hertz or 50 Hertz only Rating Plugs.

Table R7 - Digitrip RMS Adjustable Trip Settings

Time/Current Characteristics	Pickup Setting	Pickup Point (see note)	Time Band, Seconds
Long Delay	0.4, 0.5, 0.6, 0.7, 0.8, 0.9, 0.95, 1.0	$I_n$ Times Long Delay Setting	2, 4, 7, 10, 12, 15, 20, 24 (at 6 times pickup value)
Instantaneous	Off, 2, 3, 4, 6, 10, M1	$I_n$ Times Instantaneous Setting	
Short Delay	2, 2.5, 3, 4, 6, 8, 10, M <sub>1</sub>	$I_r$ Times Short Delay Setting	0.1, 0.2, 0.3, 0.4, 0.5 (Flat Response) 0.1*, 0.3*, 0.5* (*I <sup>2</sup> t Response)
Ground Fault	0.25, 0.3, 0.35, 0.4, 0.5, 0.6, 0.75, 1.00 (1200A Max.)	$I_n$ Times Ground Fault Setting	0.1, 0.2, 0.3, 0.4, 0.5 (Flat Response) 0.1*, 0.3*, 0.5* (*I <sup>2</sup> t Response)

Note:  $I_n$  = Rating Plug Value  
 $I_r$  = Long Delay Pickup Setting Times  $I_n$

Ratings

Table R8 – Digitrip Ground Fault Current Pickup Settings

Pickup Settings – Ground Fault Currents (Amperes) <sup>①</sup>									
	0.25 <sup>②</sup>	0.3 <sup>②</sup>	0.35 <sup>②</sup>	0.4 <sup>②</sup>	0.5 <sup>②</sup>	0.6	0.75	1.00	
Installed Rating Plug (Amperes) I <sub>n</sub>	200	50	60	70	80	100	120	150	200
	250	63	75	88	100	125	150	188	250
	300	75	90	105	120	150	180	225	300
	400	100	120	140	160	200	240	300	400
	600	150	180	210	240	300	360	450	600
	800	200	240	280	320	400	480	600	800
	1000	250	300	350	400	500	600	750	1000
	1200	300	360	420	480	600	720	900	1200
	1600	400	480	560	640	800	960	1200	1200
	2000	500	600	700	800	1000	1200	1200	1200
	2500	600	720	840	960	1200	1200	1200	1200
	3000	750	900	1050	1200	1200	1200	1200	1200
	3200	800	960	1120	1200	1200	1200	1200	1200
	4000	1000	1200	1200	1200	1200	1200	1200	1200
	5000	1200	1200	1200	1200	1200	1200	1200	1200

Table R9 – Digitrip Ground Fault Pickup Values for Secondary Injection Test Kit Amperes

Installed Rating Plug	Sensor Rating	Pickup (Dial) Setting Values In Secondary Amperes <sup>①</sup>							
		25% <sup>②</sup>	30% <sup>②</sup>	35% <sup>②</sup>	40% <sup>②</sup>	50% <sup>②</sup>	60%	75%	100%
200	200	1.25	1.50	1.75	2.00	2.50	3.00	3.75	5.00
250	250	1.25	1.50	1.75	2.00	2.50	3.00	3.75	5.00
300	300	1.25	1.50	1.75	2.00	2.50	3.00	3.75	5.00
400	400	1.25	1.50	1.75	2.00	2.50	3.00	3.75	5.00
600	600	1.25	1.50	1.75	2.00	2.50	3.00	3.75	5.00
800	800	1.25	1.50	1.75	2.00	2.50	3.00	3.75	5.00
1000	1000	1.25	1.50	1.75	2.00	2.50	3.00	3.75	5.00
1200	1200	1.25	1.50	1.75	2.00	2.50	3.00	3.75	5.00
1600	1600	1.25	1.50	1.75	2.00	2.50	3.00	3.75	3.75
2000	2000	1.25	1.50	1.75	2.00	2.50	3.00	3.00	3.00
2500	2500	1.25	1.50	1.75	2.00	2.40	2.40	2.40	2.40
3000	3000	1.25	1.50	1.75	2.00	2.00	2.00	2.00	2.00
3200	3200	1.25	1.50	1.50	1.88	1.88	1.88	1.88	1.88
4000	4000	1.25	1.50	1.50	1.50	1.50	1.50	1.50	1.50
5000	5000	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20


① Tolerance on pickup levels are ±10% of values shown in chart.

② For Testing Purposes Only: When using an external single-phase current source to test low level ground fault current settings, it is advisable to use the Auxiliary Power Module (APM). Especially when the single-phase current is low, without the APM it may appear as if the trip unit does not respond until the current is well above the set value, leading the tester to believe there is an error in the trip unit when there is none. The reason this occurs is that the single-phase test current is not a good simulation of the normal three-phase circuit. If three-phase had been flowing, the trip unit would have performed correctly. Use the APM for correct trip unit performance when single-phase tests are made.

Ratings


Table R10 – Magnum DS Circuit Breakers with Digitrip RMS 520 Trip Unit  
Typical Long Delay and Short Delay Time/Phase Current Characteristic Curve (LS)

Digitrip 520- Long Delay & Short Delay Curves

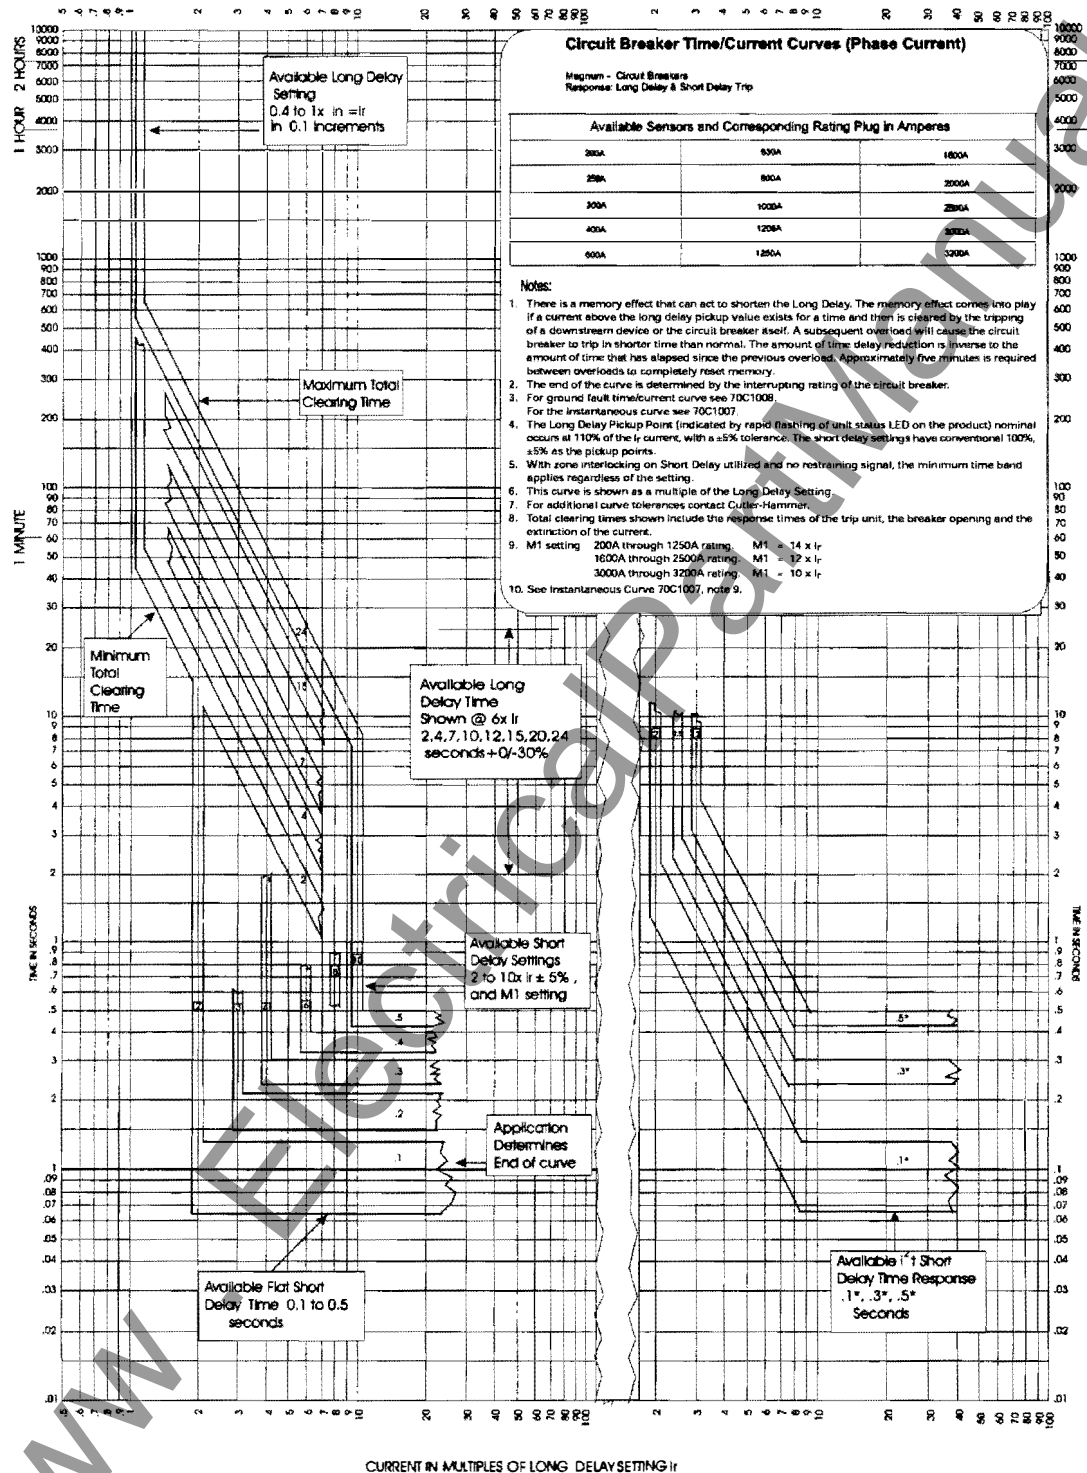

Ratings


Table R11 - Magnum DS Circuit Breakers with Digitrip RMS 520 Trip Unit  
Typical Instantaneous Time/Phase Current Characteristic Curve (I)

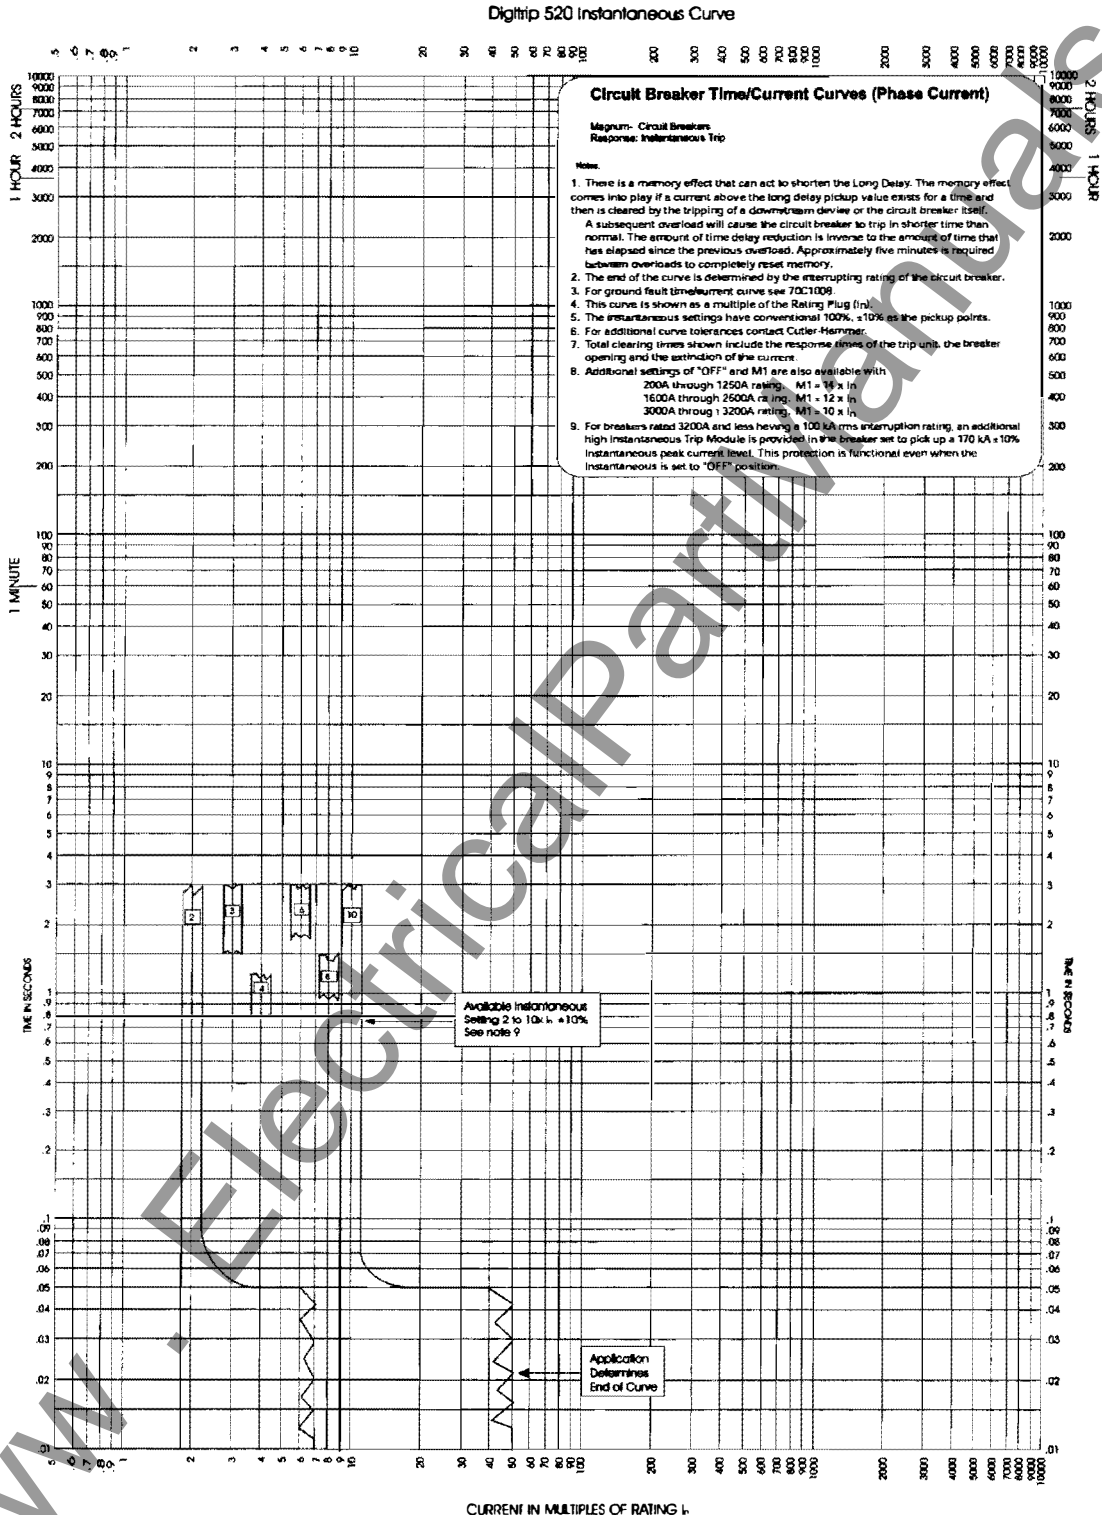

Ratings

Table R12 – Magnum DS Circuit Breakers with Digitrip RMS 520 Trip Unit  
Typical Ground Fault Time/Phase Current Characteristic Curve (G)

Digitrip 520- Ground Curve

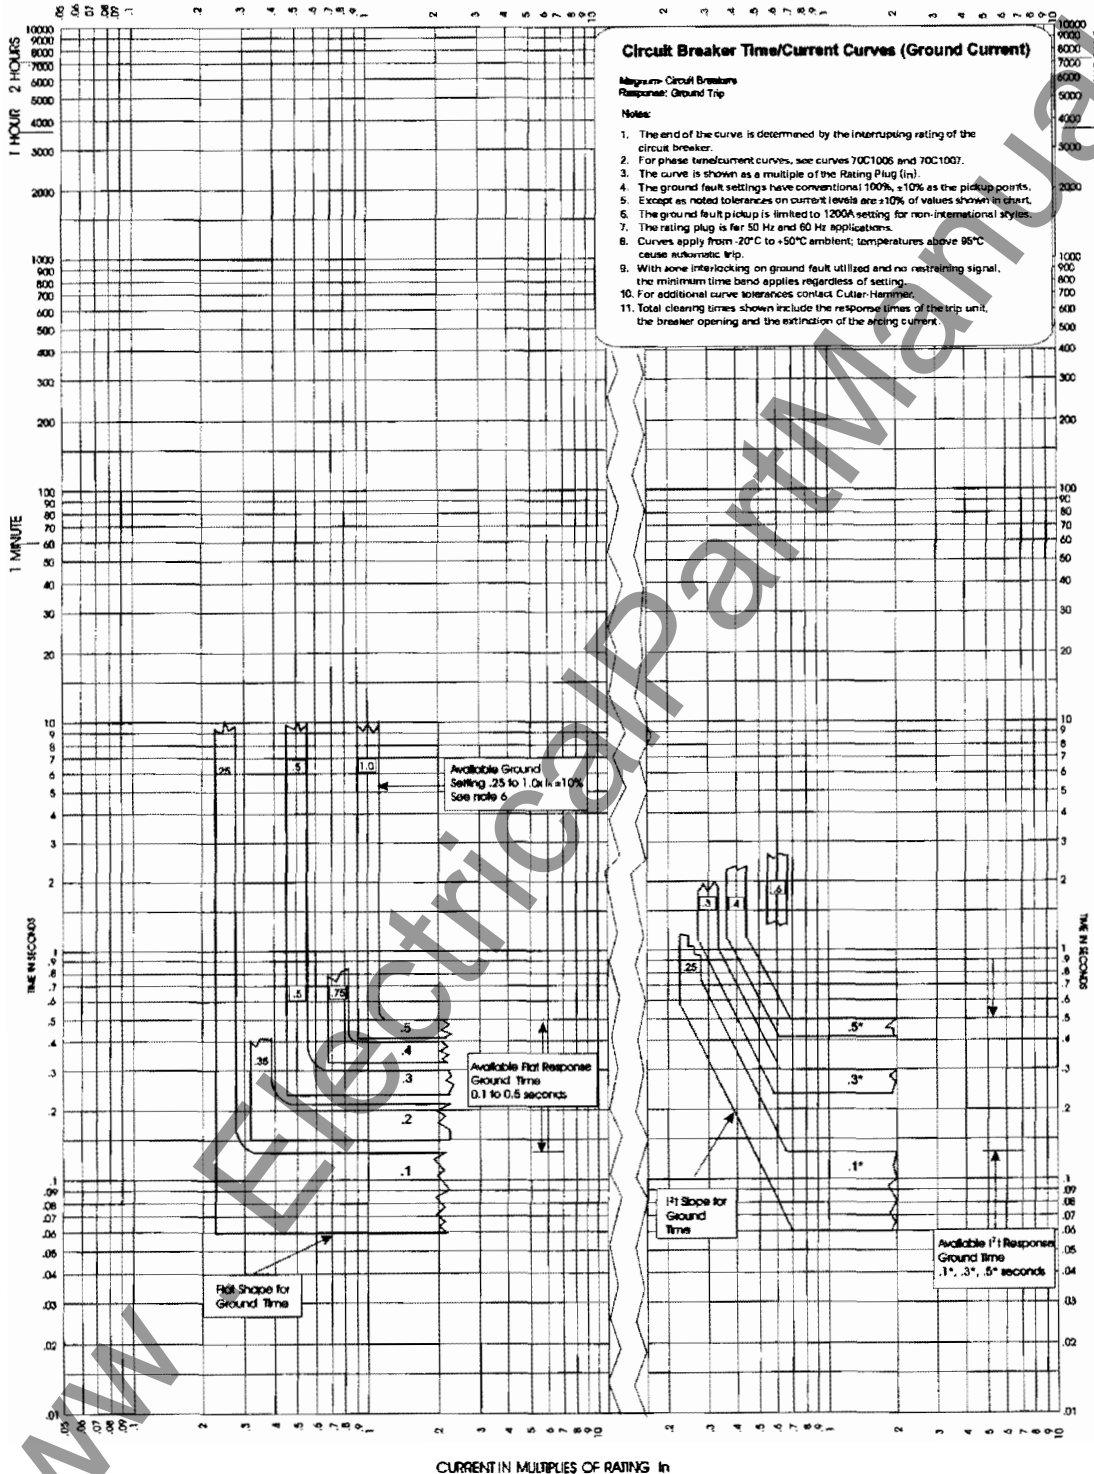



Ratings

Table R13 – Metering Type Current Transformers for Mounting in Circuit Breaker Compartments

ANSI Meter Accuracy Classification							
Breaker Frame Rating	Ratio	Ratio	B-0.1	B-0.2	B-0.5	B-0.9	B-1.8
800, 1600, 2000	100/5	100/1	2.4	—	—	—	—
	150/5	150/1	1.2	2.4	—	—	—
	200/5	200/1	1.2	2.4	2.4	—	—
	250/5	250/1	0.6	1.2	2.4	—	—
	300/5	300/1	0.6	0.6	1.2	2.4	—
	400/5	400/1	0.3	0.6	1.2	1.2	—
	500/5	500/1	0.3	0.3	0.6	1.2	2.4
	600/5	600/1	0.3	0.3	0.6	1.2	1.2
	750/5	750/1	0.3	0.3	0.3	0.6	1.2
	800/5	800/1	0.3	0.3	0.3	0.6	1.2
	1000/5	1000/1	0.3	0.3	0.3	0.6	0.6
	1200/5	1200/1	0.3	0.3	0.3	0.6	0.6
	1500/5	1500/1	0.3	0.3	0.3	0.6	0.6
	1600/5	1600/1	0.3	0.3	0.3	0.6	0.6
	2000/5	2000/1	0.3	0.3	0.3	0.6	0.3
3200	1600/5	1600/1	0.3	0.3	0.6	0.6	1.2
	2000/5	2000/1	0.3	0.3	0.3	0.6	0.6
	2400/5	2400/1	0.3	0.3	0.3	0.3	0.6
	2500/5	2500/1	0.3	0.3	0.3	0.3	0.3
	3000/5	3000/1	0.3	0.3	0.3	0.3	0.3
	3200/5	3200/1	0.3	0.3	0.3	0.3	0.3
	3500/5	3500/1	0.3	0.3	0.3	0.3	0.3
	4000/5	4000/1	0.3	0.3	0.3	0.3	0.3
	4000	4000/5	4000/1	0.3	0.3	0.3	0.3
5000	5000/5	5000/1	Refer to Cutler-Hammer				

Current transformers with meter accuracy classifications at higher burdens and/or suitable for relaying are also available. They will be mounted in the rear cable connection compartment.

Table R14 – Voltage Transformers

Insulation Class is 600 volt dielectric, 10 kV full wave BIL. Accuracy Class is 0.6 for W and 1.2 for X burdens at 60 Hz. Thermal ratings are 150VA @ 300°C and 100 VA @ 55°C. Primary and secondary fuses are mounted on the face of the VT.

Available Standard Ratios:

120:120
240:120
288:120
480:120
600:120

Table R15 – Control Power Transformers

Insulation Class is 600 volt dielectric. Primary and secondary fuses are mounted on the face of the CPT. An optional primary fuse cover is available. 1kVA, 2 kVA, 3 kVA and 5 kVA ratings are available as standard.

Available Standard Ratios:

208:120/240
240:120/240
480:120/240
600:120/240

**Application**

**Standards**

Magnum DS circuit breakers meet or exceed all applicable requirements of ANSI Standards C37.13, C37.17, C37.50 and CSA.

**System Voltage and Frequency**

Magnum DS breakers are designed for operation on ac systems only, 60 Hz or 50 Hz, 635 volts maximum.

**Continuous Current Ratings**

Unlike transformers, generators and motors, circuit breakers are maximum-rated devices and have no built-in temporary overload current ratings. Consequently, it is vital that each application takes into consideration the maximum anticipated current demand, initial and future, including temporary overloads.

The continuous rating of any Magnum DS breaker is limited to the sensor rating, or the frame size current rating, whichever is the lesser. For instance, an MDS-616 1600 ampere frame breaker with 800 ampere sensors has a maximum continuous rating of 800 amperes, but the same breaker with 1600 ampere sensors is limited to 1600 amperes maximum.

All current ratings are based on a maximum ambient air temperature of 40°C (104°F).

**Ambient Temperature**

The temperature of the air surrounding the enclosure should be within the limits of:

-30° (-22°F) to +40°C (104°F).

**Altitude**

The breakers are applicable at their full voltage and current ratings up to a maximum altitude of 6600 feet (2000 meters) above sea level. When installed at higher altitudes, the ratings are subject to the following correction factors in accordance with ANSI C37.20.1:

**Altitude Derating Factors**

Altitude		Voltage Correction	Current Correction
Feet	Meters		
6,600	2,000	1.000	1.000
7,000	2,150	0.989	0.998
7,500	2,300	0.976	0.995
8,000	2,450	0.963	0.993
8,500	2,600	0.950	0.990
9,000	2,750	0.933	0.987
9,500	2,900	0.917	0.983
10,000	3,050	0.900	0.980
10,500	3,200	0.883	0.977
11,000	3,350	0.867	0.973
11,500	3,500	0.850	0.970
12,000	3,650	0.833	0.967
12,500	3,800	0.817	0.963
13,000	3,950	0.800	0.960

**Unusual Environmental and Operating Conditions**

Special attention should be given to applications subject to the following conditions:

1. Damaging or hazardous fumes, vapors, etc.
2. Excessive or abrasive dust.

For such conditions, it is generally recommended that the switchgear be installed in a clean, dry room, with filtered and/or pressurized clean air. This method permits the use of standard indoor switchgear and avoids the derating effect of non-ventilated enclosures.

3. Salt spray, excessive moisture, dripping, etc.

Drip shields in equipment rooms and space heaters in indoor switchgear, or outdoor weatherproof enclosures, may be indicated, depending upon the severity of the conditions.

4. Excessively high or low ambient temperatures.

For ambient temperatures exceeding 40°C, and based on a standard temperature rise of 65°C, the continuous current ratings of breaker frame sizes, and also buses, current transformers, etc., will be subject to a derating factor calculated from the following formula:

$$\frac{105^\circ\text{C Total} - \text{Special Ambient, } ^\circ\text{C}}{105^\circ\text{C Total} - 40^\circ\text{C Standard Ambient}}$$

Circuit breakers are not adversely affected by very low outdoor ambient temperatures, particularly when energized and carrying load currents. The standard space heaters in weatherproof switchgear will raise the temperature slightly and prevent condensation.

Electrical components such as relays and instruments, however, must be applied within the manufacturer's specified limits.

5. Exposure to Seismic Shock.

Magnum DS assemblies and breakers have been certified for applications through UBC Zone 4 and for the California Building Code. Assembly modifications are required, so such conditions must be specified.

6. Abnormally high frequency of operation.

In line with above, a lesser number of operations between servicing, and more frequent replacement of parts, may be indicated.

## Application

### Unit Substations

Most Magnum DS Switchgear Assemblies are configured as unit substations.

A Unit Substation, as referred to in this publication, is defined as a coordinated assembly consisting of 3-phase transformers with high-voltage incoming line sections and an assembly of low-voltage distribution sections, with the following parameters:

Transformer kVA – 112.5 through 3750  
Low-Voltage – 208, 240, 480 or 600 V

Unit Substations may be indoor or outdoor, with a selection of high-voltage incoming sections, a choice of transformer types and an arrangement of Magnum DS Switchgear to suit the application.

### Why Unit Substations?

Unit substations follow the system concept of locating transformers as close as practicable to areas of load concentration at utilization voltages, thus minimizing the lengths of

secondary distribution cables and buses. This concept provides several basic advantages, such as:

- ⌘ Reduced power losses
- ⌘ Improved voltage regulation
- ⌘ Improved service continuity
- ⌘ Reduced likelihood of faults
- ⌘ Increased flexibility
- ⌘ Minimized installation expense
- ⌘ Availability of non-flammable types of transformers eliminates necessity of vaults
- ⌘ Efficient space utilization

### Advantages of Magnum DS Unit Substations

- ⌘ Complete coordination, both mechanical and electrical
- ⌘ Extreme flexibility with wide choice of components and ratings to meet exact application requirements
- ⌘ Optimum safety to operators
- ⌘ Modern design
- ⌘ Meets all applicable ANSI, IEEE, NEMA and UL Standards

### Transition Sections

All indoor Unit Substations utilizing liquid filled transformers require an 11-inch (279 mm) or 22-inch (559 mm) wide transition section. The center-line location of the low-voltage throat is based upon the depth of the Magnum DS assembly.


In many indoor applications, it is desirable to minimize floor space by eliminating the need for a transformer transition section. For these situations, Magnum DS switchgear is designed to accommodate close coupling to dry type transformers if their low-voltage terminations conform to a specific vertically oriented arrangement. This configuration may be provided if: (1) additional space is not required for auxiliary devices such as grounding resistors, instrumentation, etc.; (2) zero sequence ground fault is not applied on main breakers; (3) connection to assemblies with no main breaker do not utilize "A" or "B" position feeder breakers; (4) adequate conduit space is available for any top exit cable connections in this section.

**Application**

**Types of Systems**


**A. Simple Radial**

- ※ Simplest and least costly
- ※ Easy to coordinate

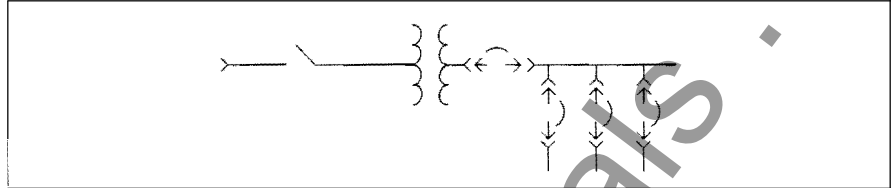

**B. Primary Selective Radial**


Similar to simple radial, with added advantage of spare primary incoming cable circuit. By switching to spare circuit, duration of outage from cable failure is limited.

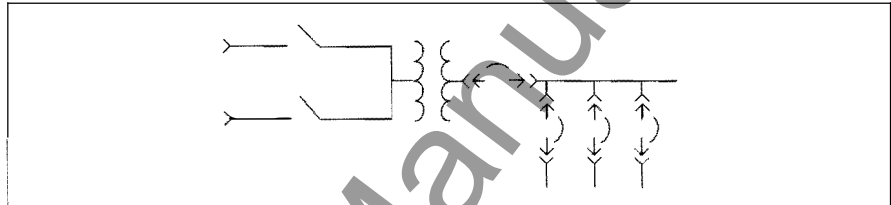

**C. Secondary Selective**

Normally operates as two electrically independent unit substations, with bus tie breaker (T) open, and with approximately half of total load on each bus. In case of failure of either primary incoming circuit, only one bus is affected, and opening main breaker (M) on dead bus and closing tie breaker (T) can promptly restore service. This operation can be made automatic, with duration of outage on either bus limited to a few seconds.

Since the transformers are not continuously paralleled, secondary fault currents and breaker application are similar to those on radial unit substations.

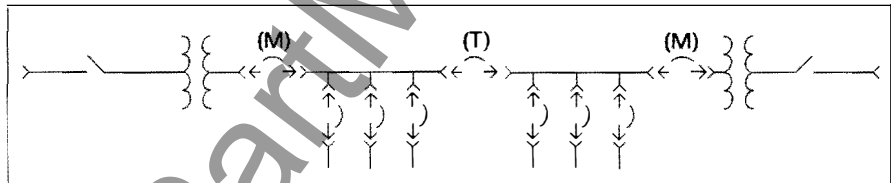


If required, and equipped with the appropriate relaying, either transformer can be removed from service and isolated with no interruption of service on either bus, by first closing the tie breaker and then opening the associated main breaker.

Service continuity and substation capacity can be further improved by substituting selector type primary switches, shown above in B.

**D. Spot Network**

The transformers are paralleled through network protectors. In case of primary voltage failure, the associated protector automatically opens. The other protector remains closed, and there is no "dead time" on the bus, even momentarily. When primary voltage is restored, the protector automatically checks for synchronism and recloses.

- ※ Secondary voltage regulation is improved by paralleled transformers

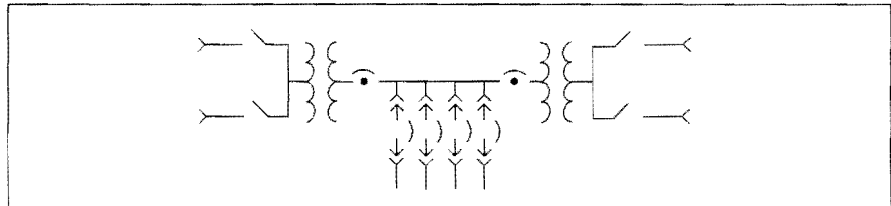

- ※ Secondary fault capability is increased by paralleled transformers, and the feeder breakers and bus bracing must be selected accordingly

- ※ Primary switches are usually selector or duplex type, so that transformers can be transferred to alternate live sources, thus shortening duration of overloads

**Application****System Application**

Most Magnum DS Switchgear is fed from power transformers. To facilitate minimum breaker sizing, Tables A1 through A4 lists the calculated secondary short circuit currents and applicable main secondary and feeder breakers for various transformer sizes and voltages.

The short circuit currents are calculated by dividing the transformer basic (100%) rated amperes by the sum of the transformer and primary system impedances, expressed in "per unit." The transformer impedance percentages are standard for most secondary unit substation transformers. The primary impedance is obtained by dividing the transformer base (100%) kVA by the primary short circuit kVA. The motor contributions to the short circuit currents are estimated as approximately 4 times the motor load amperes, which in turn are based upon 50% of the total load for 208 system voltages and 100% for all other voltages.

High transformer impedances and/or lower percentages of motor loads will reduce the short circuit currents correspondingly. Supplementary transformer cooling and temperature ratings will not increase the short circuit currents, provided the motor loads are not increased.

The tables do not apply for 3-phase banks of single-phase distribution transformers, which usually have impedances of 2% to 3% or even lower. The short circuit currents must be recalculated for all such applications, and the breakers selected accordingly.

**Transformer Main Secondary Breakers**

Transformer secondary breakers are required or recommended for one or more of the following purposes:

1. To provide a one-step means of removing all load from the transformer.
2. To provide transformer overload protection in the absence of an individual primary breaker, and/or when primary fuses are used.
3. To provide the fastest clearing of a short circuit in the secondary main bus.

4. To provide a local disconnecting means, in the absence of a local primary switch or breaker, for maintenance purposes.
5. For automatic or manual transfer of loads to alternate sources, as in double-ended secondary selective unit substations.
6. For simplifying key interlocking with primary interrupter switches.
7. To satisfy NEC service entrance requirements when more than six feeder breakers are required.

Main secondary breakers, as selected in Tables A1 through A4, have adequate interrupting ratings, but not necessarily adequate continuous current ratings. They should be able to carry continuously not only the anticipated maximum continuous output of the transformer but also any temporary overloads.

For a fully selective system, instantaneous protection on main breakers should be defeated, as they typically cannot be coordinated with downstream devices.

Maximum capabilities of transformers of various types, in terms of kVA and secondary current, are given in Tables A1 through A4. It will be noted that the maximum ratings will often require the substitution of larger frame main breakers than those listed in the tables. Even if a self-cooled transformer only is considered, it should be remembered that with ratings of 750 kVA and higher, provision for the future addition of cooling fans is automatically included. It is recommended that the main breaker have sufficient capacity for the future fan-cooled rating, plus an allowance for overloads, if possible, particularly since load growth cannot always be predicted.

The same considerations should be given to the main bus capacities and main current transformer ratios.

**Bus Sectionalizing (Tie) Breakers**

The minimum recommended continuous current rating of bus sectionalizing or tie breakers, as used in double-ended secondary selective unit

substations, or for connecting two single-ended substations, is one-half that of the associated main breakers. The interrupting rating should be at least equal to that of the feeder breakers. It is common practice to select the tie breaker of the next frame size below that of the main breakers. However, many users and engineers prefer that the tie breaker be identical to and interchangeable with the main breakers, so that under normal conditions it will be available as a spare main breaker.

In general, the tie breaker, like the main breaker, trip unit should have its instantaneous tripping defeated.

**Generator Breakers**

In most applications where generators are connected through breakers to the secondary bus, they are used as emergency standby sources only, and are not synchronized or paralleled with the unit substation transformers. Under these conditions, the interrupting rating of the generator breaker will be based solely on the generator kVA and sub-transient reactance. This reactance varies with the generator type and rpm, from a minimum of approximately 9% for a 2-pole 3600 rpm turbine driven generator to 15% or 20% or more for a medium or slow speed engine type generator. Thus the feeder breakers selected for the unit substation will usually be adequate for a standby generator of the same kVA as the transformer.

Most generators have a 2-hour 25% overload rating, and the generator breaker must be adequate for this overload current. Selective type long and short delay trip protection only is usually recommended for coordination with the feeder breakers, with the long delay elements set at 125% to 150% of the maximum generator current rating for generator protection.

In the case of two or more paralleled generators, anti-motoring reverse power relays (device 32) are recommended for protection of the prime movers, particularly piston type engines. For larger generators requiring a Magnum MDS-632 or larger, voltage-restraint type overcurrent relays (device 51V) are recommended.

**Application****Feeder Breakers – General**

Circuit breakers for feeder circuit protection may be manually or electrically operated, with long and short delay or long delay and instantaneous type trip devices, and trip settings, as required for the specific circuit and load requirements.

Feeder breakers as selected in Tables A1 through A4 have adequate interrupting ratings, and are assumed to have adequate continuous current ratings for maximum load demands.

General purpose feeder breakers, such as for lighting circuits, are usually equipped with long delay and instantaneous trip devices, with the long delay pickup set for the maximum load demand in the circuit. Where arcing fault protection is required, the instantaneous trip setting should be as low as practicable consistent with inrush requirements.

**Motor Starting Feeder Breakers**


These breakers are usually electrically operated, with long delay and instantaneous tripping characteristics for motor running, locked rotor and fault protection. The breaker sensor rating should be chosen so that the long delay pickup can be set at 125% of motor full load current for motors with a 1.15 service factor, or at 115% for all other motors. Contactors are recommended for this application when there are a number of daily operations involved.

When system short circuits are less than 40 times the motor full load current, the motor breaker tripping characteristic should include a short delay characteristic for greater fault protection.

**Group Motor Feeder Breakers**

Typical loads for such circuits are motor control centers. The feeder breakers may be either manually or electrically operated as preferred, and are usually equipped with long and short delay trip protection only for coordination with the individual motor circuit devices. The minimum long delay pickup setting should be 115% of the running current of the largest motor in the group, plus the sum of the running circuits of all other motors.

## Application

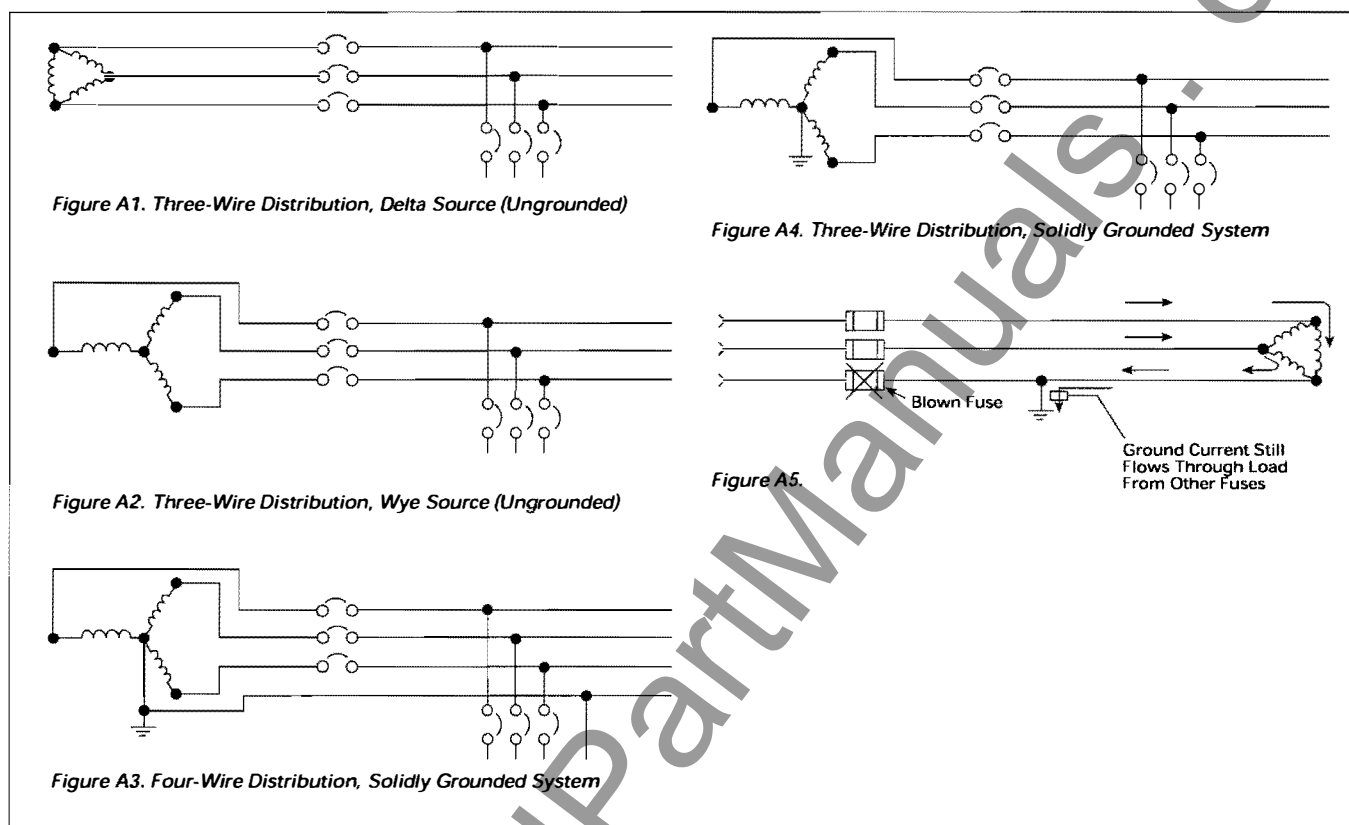

## Ground Fault Application

## Distribution Systems

The power distribution in three-phase low-voltage systems can be three- or four-wire distribution. The three-wire distribution can be served from either delta or wye sources, but the four-wire distribution is obtained from wye solidly grounded source only. Fig. A1 shows three-wire distribution with delta source and Fig. A2 shows three-wire distribution with wye source. It is significant on Fig. A2, that the wye connection of a transformer secondary does not necessarily mean four-wire distribution in switchgear. This is worthwhile to note because four-wire distribution is quite frequently assumed when the transformer secondary is wye connected. The low-voltage system is three-phase four-wire distribution only if a fourth wire is carried through the switchgear, the transformer neutral is solidly grounded, and single phase loads are connected to feeder breakers. This fourth wire is the neutral bus. The neutral bus is connected to the neutral of the wye connected transformer secondary as shown on Fig. A3.

Three- or four-wire sources can be grounded or ungrounded in service. Generally, where the source is delta connected it is ungrounded, but in some very rare cases it is grounded at one corner of the delta, or at some other point. When the source is wye connected it can be grounded or ungrounded, and when grounded, the grounding is at the neutral. When low-voltage systems are grounded they are generally solidly grounded; however, occasionally the grounding is through a resistor. Three- and four-wire solidly grounded systems are shown on Fig. A3 and A4. Most installations are solidly grounded. Solidly grounded systems have the advantage of being the easiest to maintain, yet have the potential for producing extremely high fault levels.

When feeding critical facilities, or continuous industrial processes, it is sometimes preferable to allow the system to continue operating when a phase conductor goes to ground.

There are two methods of accommodating this application; the source transformer may either be left ungrounded or high resistance grounded. If the correct system conditions of inductance and capacitance manifests themselves, arcing ground on ungrounded systems can produce escalating line-to-ground voltages, which in turn can lead to insulation breakdown in other devices. This condition is known as ferro-resonance. The high resistance grounded system does not suffer from this potential phenomenon. Regardless of which system is selected, both require the application of an appropriate UL recognized ground detection method. Upon grounding of one of the phase conductors, the detection device alerts operators of the condition. Personnel trained to locate these grounds can do so and remove the ground when the process permits, and before a second ground occurs on another phase.

**Application**

Since ungrounded and resistance grounded systems produce minimal ground current, no damage occurs to the grounded equipment. These ground currents are also too low for detection by integral trip unit ground elements, therefore serve no ground fault tripping function if applied on these systems. Ground fault elements on these types of systems can, however, provide supplemental protection. If a second ground occurs on another phase, and exceeds the ground element pickup setting, the ground element can serve as a more sensitive short delay trip.

Ungrounded or resistance grounded systems can not be applied as 4-wire networks. Even if supplied from a 4-wire source, no line-to-neutral loads may be served. These applications are limited to 3-wire distribution systems only.

**Need For Ground Fault Protection**

If the magnitude of all ground currents would be large enough to operate the short delay or instantaneous elements of the phase overcurrent trip devices, there would be no need for separate ground fault protection on solidly grounded systems. Unfortunately, because low magnitude ground currents are quite common, this is not the case. Low level ground currents can exist if the ground is in the winding of a motor or a transformer, or if it is a high impedance ground. Low level ground currents may also be due to an arcing type ground. The arcing type grounds are the source of the most severe damages to electrical equipment. The lower limit of the arcing ground currents is unpredictable and the magnitude may be considerably below the setting of the breaker phase overcurrent trip devices. It is for this reason that the National Electric Code, and UL, require ground fault protection for all service disconnect breakers rated 1000 amperes and greater, applied on systems with greater than 150 volts line-to-ground.

Since the breaker phase overcurrent trip devices cannot provide sensitive enough protection against low magnitude ground faults, there is a need for an additional protective device. This additional device is not to operate on normal overloads and it is to be sensitive and fast enough to protect against low magnitude grounds. It is also important that this additional ground protecting device be simple and reliable. If the Magnum DS breaker solid-state tripping system including an optional "ground element" is selected, good ground fault protection will be assured.

**The Ground Element**

The ground element of the solid-state trip unit is in addition to the usual phase protection. The ground element has adjustable pickup with calibrated marks as shown in Tables R8 and R9 and adjustable time delay. The input current to the trip unit can be provided by:

- (a) Residual connection of phase sensors, with the residual circuit connected to the ground element terminals. This is the Magnum DS Low-Voltage Switchgear standard ground protection system for 3-wire systems. On 4-wire systems, standard ground fault protection includes a fourth "neutral sensor." It is connected to vectorally subtract from the residual current of the phase sensors. Its only function is to sense neutral currents. It does not sense ground current. These systems produce pickup values as shown in Table R8.
- (b) External ground sensing current transformers connected to the ground element terminals. This means that this external ground sensor will trip the breaker whenever its secondary output current exceeds the values shown in Table R8. Tripping is independent of phase currents. The lower the CT ratio, the more sensitive the ground fault protection.

**Ground Fault Protection Application and Coordination**

In all power systems, continuity of service is very important. For reliable service continuity, selective tripping is applied between main, tie, and feeder breakers, and downstream protecting devices, for phase-to-phase faults. Similar selective tripping is desirable when breakers trip on grounds. The application of ground protection only to main breakers may assure good ground protection. However, it will not provide good service continuity because the main breaker will trip on grounds that should have been cleared by feeder breakers. For proper protection and for good service continuity, main, tie and feeder breakers all should be equipped with ground fault protection.

In view of the above, it is evident that properly applied ground protection requires ground elements as far down the system to the loads as practical. For best results, downstream molded case breakers should have individual ground protection. This would result in excellent ground protection because ground elements of Magnum DS and downstream breakers having similar tripping characteristics can be coordinated.

Depending on the sensitivity of the ground fault protection method applied, coordination between Magnum DS Breaker ground elements and downstream branch circuit fuses is sometimes impractical. This is due to the basic fact that the blowing of one phase fuse will not clear a ground on a three-phase system. The other two-phase fuses will let the load "single-phase," and also continue to feed the ground through the load, as shown in Figure A5.



## Application

### High-Resistance Grounding

Where continuity of service is a high priority, high-resistance grounding can add the safety of a grounded system while minimizing the risk of service interruptions due to grounds. The concept is a simple one: provide a path for ground current via a resistance that limits the current magnitude, and monitor to determine when an abnormal condition exists.

The ground current path is provided at the point where the service begins, by placing resistance in the connection from system neutral to ground. Control equipment continuously measures ground current. A relay detects when the current exceeds a predetermined level. An alarm alerts building personnel that a ground exists. The system has built-in fault tracing means to assist in finding the source of the ground. An integral transformer provides control power from the primary source.

### 600 Volt (Maximum) Delta Systems

To add high-resistance grounding to an ungrounded delta-connected system, a neutral point must be created. Three single-phase transformers can be interconnected in a zigzag or wye-broken delta configuration to provide such a neutral point. The transformers and grounding resistors are chosen to limit the ground current to a maximum value of 5 amperes. **Application note** – The neutral point may not be used to serve phase-to-neutral loads. Also, this technique may be applied on wye-connected sources when the neutral point is not conveniently accessible from the service entrance location.

### 600/347 Volt (Maximum) Wye Systems

To add high-resistance grounding to a wye-connected system, resistors are placed in series with the neutral-to-ground connection of the power source. The resistors are chosen to limit the current to a maximum value of 5 amperes. **Application note** – Per 1993 NEC 250-5b, exception no. 5 line-to-neutral loads may not be connected to a system where the neutral is resistance-grounded.

### Ground Current Detection

Any time a system is energized, a small ground current called the "capacitive charging current" will be observed. For low-voltage (600V and below) systems, this naturally-occurring current is typically 1 ampere or less.

When one phase becomes grounded, additional current above the charging level will flow. As all ground current must flow through the grounding resistor/grounding transformer assembly, an ammeter in this circuit will read the total amount of ground current. By placing a current-sensing relay in series with the ammeter, the current relay can be adjusted to pick up at a level in excess of the capacitive charging current, thus indicating the abnormal condition.

Alternatively, an optional voltmeter-relay can be connected across the grounding resistors. The voltage across the resistors is proportional to the amount of ground current. The voltmeter-relay's pickup adjustment is set above the capacitive charging current, to the desired detection level.

In both current and voltage detection methods, the ground current ammeter provides a direct reading of the total, actual ac ground current present in the system at that time. It will be helpful to periodically note the ammeter's reading; a trend towards higher values may indicate the need for equipment maintenance, and hence reduce the occurrence of unplanned shutdowns.

### Indication and Alarm Circuits

When a fault is detected, an adjustable time delay is provided to override transients. When the time delay has been exceeded, the green "normal" light will turn off, the red "ground fault" light will turn on, and the ground alarm contacts will transfer. If equipped with the optional alarm horn, it will sound.

When the fault is cleared, the current/voltage relay will reset. If the reset control is set on "auto," the lights will return to "normal" on, "ground fault" off, and the ground alarm contacts will re-transfer. If the reset control is set on "manual," the lights and relay contacts will remain latched until the operator turns the reset control to "reset." The lights and ground alarm contacts will then return to normal. The system can be reset only if the fault has been cleared.

During a fault, the optional alarm horn can be silenced at any time by using the "alarm silence" pushbutton. It will not re-sound until either the system is reset, or the re-alarm timer expires. The re-alarm timer is activated by the "alarm silence" control. If the horn has been silenced but the fault has not

been cleared, the timer will run. It has a range of 2–48 hours. When the timer times out, the horn will re-sound, alerting maintenance personnel that the fault has not been cleared.

### Test Circuit

A test circuit is provided to allow the user to quickly determine that the system is working properly. The test circuit will operate only under normal conditions — it will not allow testing if the system is sensing a fault. A separate grounding resistor is provided, connected to a relay operated by the "test" position of the mode selector switch. The relay's contact grounds phase B through the test resistor, causing ground current to flow. The system then reacts as it would under actual system ground conditions: lights transfer, alarm contacts transfer and the (optional) horn sounds.

### Pulsar Circuit

The pulsar circuit offers a convenient means to locate the faulted feeder and trace the fault to its origin. The pulsar is available any time a fault has been detected. An adjustable recycle timer controls the pulse intervals. The "pulse" light flashes on and off, corresponding to the on-off cycles of the pulsar contactor. The pulsar contactor switches a bank of resistors on and off, thus allowing a momentary increase in the ground current (approximately a 5 ampere current pulse above the ground current).

### Locating a Ground Fault

The current pulses can be noted with a clamp-on ammeter when the ammeter is placed around the cables or conduit feeding the fault. The operator tests each conduit or set of cables until the pulsing current is noted. By moving the ammeter along the conduit, or checking the conduit periodically along its length, the fault can be traced to its origin. The fault may be located at the point where the pulsing current drops off or stops.

If little or no change in the pulsing current is noted along the entire length of a cable, then the fault may be in the connected load. If the load is a panelboard, distribution switchboard or motor control center, repeat the process of checking all outgoing cable groups to find the faulted feeder. If the fault is not found in an outgoing feeder, the fault may be internal to that equipment.

**Application**

**Application note:** It may not be possible to precisely locate faults within a conduit. The ground current may divide into many components, depending on the number of cables per phase, number of conduits per feeder, and the number and resistance of each ground point along the conduits. The resulting currents may be too small to allow detection, or may take a path that the ammeter cannot trace. An important note to keep in mind is that while the pulser can greatly aid in locating a fault, there may be certain conditions under which the pulses cannot be readily traced, and other test procedures (meg-ohm, high-potential, etc.) may be needed.

**Sequence of Operation**

**Normal**

- Green "normal" light on.
- Red "ground fault" light off.
- White "pulse" light off.
- System control switch in "normal" position.
- Reset control switch in either "auto" or "manual."

**Test**

Turn and hold the system control switch in the "test" position. Phase B will be grounded via the test resistor. The ground current will activate the sensing circuit, causing the green "normal" light to turn off and the red "ground fault" light to turn on. The pulser will be activated as well. The white "pulse" light will turn on and off as the pulser contactor closes and opens. The ground current ammeter will display the total ground current, including the incremental pulse current. When ready, return the system control switch to "normal." The pulser will stop. If the reset control is in the "manual" position, turn it to "reset" to reset the fault sensing circuit. The red "ground fault" light will turn off, and the green "normal" light will turn on. Test mode is not available if the system is detecting a ground. The sensing circuit will disable the test circuit.

**Ground Fault**

When the sensing circuit detects a fault, the green "normal" light will turn off and the red "ground fault" light will turn on. The ground current ammeter will indicate the total ground current. To use the pulser, turn the system control switch to "pulse." The pulser contactor will cycle on and off as controlled by the recycle timer relay. Use the clamp-on ammeter to locate the faulted feeder. Open the feeder and clear the fault. If the reset control switch is in the "manual" position, turn it to "reset" to reset the sensing circuit. (If reset control is in "auto," it will reset itself.) When ready to restore service to the load, close the feeder. Return the system control to "normal."

**Zone Selective Interlocking**

By definition, a selectively coordinated system is one where by adjusting trip unit pickup and time delay settings, the circuit breaker closest to the fault trips first. The upstream breaker serves two functions:

1. Back-up protection to the downstream breaker and
2. Protection of the conductors between the upstream and downstream breakers. These elements are provided for on Digitrip trip units.

For faults that occur on the conductors between the upstream and downstream breakers it is ideally desirable for the upstream breaker to trip with no time delay. This is the feature provided by zone selective interlocking. Digitrip trip units may be specified to utilize this option.

Zone selective interlocking is a communication signal between trip units applied on upstream and downstream breakers. Each trip unit must be applied as if zone selective interlocking were not employed, and set for selective coordination.

During fault conditions, each trip unit that senses the fault sends a restraining signal to all upstream trip units. This restraining signal results in causing the upstream trip to continue timing as it is set. In the absence of a restraining signal, the trip unit trips the associated breaker with no intentional time delay, minimizing damage to the fault point. This restraining signal is a very low level. To minimize the potential for induced noise, and to provide a low impedance interface between trip units, special twisted pair conductors are utilized for interconnection. For this reason, zone selective interlocking must be specified.

Ground fault and short delay pickup on Digitrip Trip Units may be specified with zone selective interlocking. Since most system faults start as arcing ground faults, zone selective interlocking on ground fault pickup only is usually adequate. Zone selective interlocking on short delay pickup may be utilized where no ground fault protection is provided.

Zone selective interlocking may be applied as a type of bus differential protection. It must be recognized, however, that one must accept the minimum pickup of the trip unit for sensitivity.

It must also be recognized that not all systems may be equipped with zone selective interlocking. Systems containing multiple sources, or where the direction of power flow varies, require special considerations, or may not be suitable for this feature. Digitrip zone interlocking has been tested with up to three levels with up to 20 trip units per level.

Application

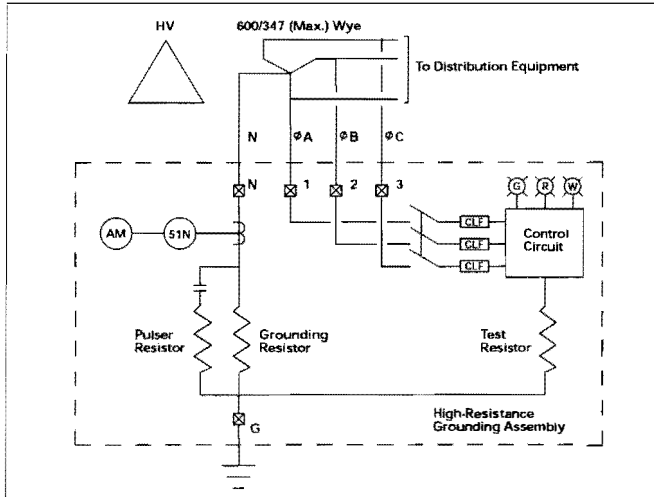


Figure A7: 4-Wire System – Fault Detection via Current Relay

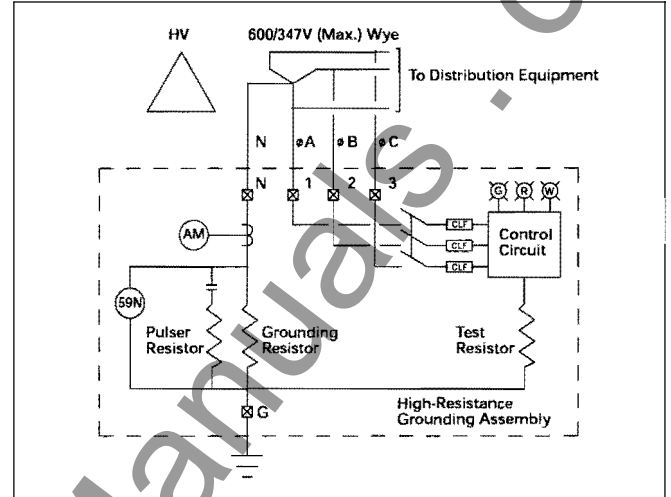


Figure A8: 4-Wire System – Fault Detection via Voltmeter Relay

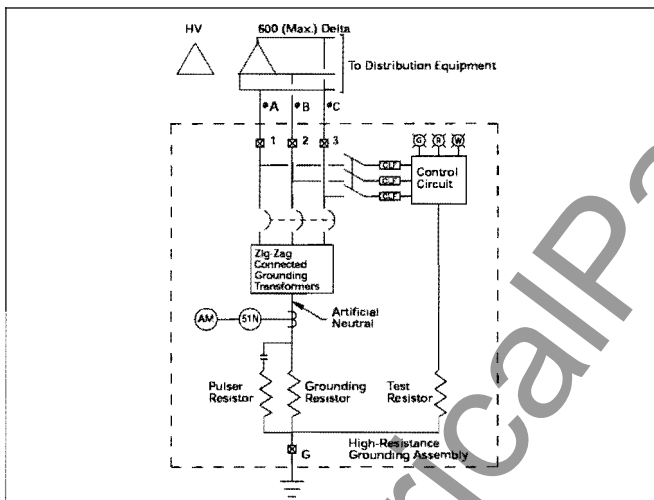


Figure A9: 3-Wire System – Zig-Zag Grounding Transformers Fault Detection via Current Relay

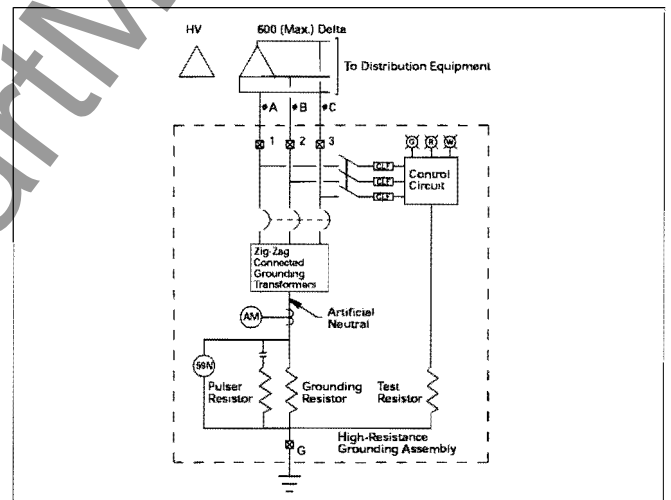


Figure A10: 3-Wire System – Zig-Zag Grounding Transformers Fault Detection via Voltmeter Relay

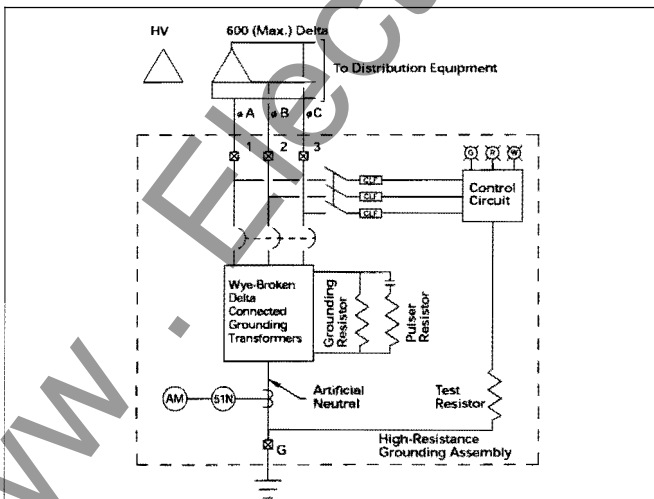


Figure A11: 3-Wire System – Wye-Broken Delta Grounding Transformers Fault Detection via Current Relay

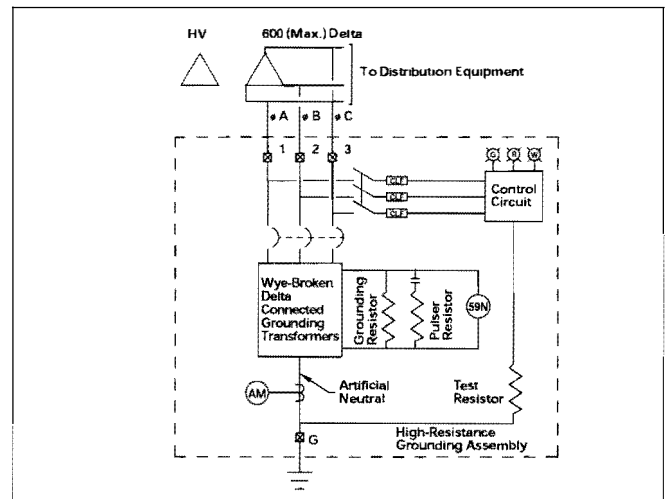


Figure A12: 3-Wire System – Wye-Broken Delta Grounding Transformers Fault Detection via Voltmeter Relay

Application


The Following Provides Guidelines for Ground Fault Protection.

System	Advantages	Disadvantages	Equipment Available for Protection			
			Main Breaker	Tie Breaker	Fdr. Breaker	Notes
Ungrounded (3-Wire)	Minimum disturbance to service continuity. Currents for the majority of grounds will be limited to capacitance charging current of the system. Can operate with the first ground until it is removed during a regular shutdown. Low cost. Supplemental protection for an ungrounded system utilizing trip unit ground element.	When ground detector shows that a ground exists, corrective action must be taken at the earliest possible shutdown. However, experience indicates that this attention is not always possible. Therefore, these systems tend to operate with one phase grounded through the first uncleared ground. A high impedance ground on another part of the system would result in low values of current, which would not operate a breaker phase trip, and could produce fire damage. High voltages from arcing grounds are possible.	Lamp type ground detector or ground detecting voltmeters with or without voltage transformers. If voltage transformers are used, a ground alarm relay can be added for remote or local alarming. 3-wire residual protection, minimum pickup. 0.50 sec. time delay. See SK No. 1, No. 4, and No. 6.	3-wire residual protection, minimum pickup. 0.35 sec. time delay. See sketch No. 4 and No. 6.	3-wire protection, minimum pickup. 0.22 sec. time delay. See SK No. 1, No. 4, and No. 6.	20
Solid Grounded	20	20	Standard residual ground protection for single source systems, and source ground, per SK 5, for multiple ground sources. Minimum pickup. 0.50 sec. time delay.	Ground 3-wire or 4-wire (as required) fault protection. Minimum pickup. 0.35 sec. time delay. See SK No. 4 or 5.	Ground 3-wire or 4-wire (as required) fault protection. Minimum pickup. 0.22 sec. time delay or zero sequence current transformer feeding into trip unit. See SK No. 1, No. 2, and No. 6.	This is the most common system in use today. As long as it is not necessary to coordinate with phase devices down the line, it will give very good main bus and feeder protection.
High Resistance Grounded (3-Wire)	Ground fault current is limited. Ungrounding can result in high voltages during arcing grounds, and this is corrected by high resistance grounding. Can operate with the first ground until it is removed during a regular shutdown.	Very sensitive detection is required to detect the limited fault current. When the ground detector shows that a ground exists, corrective action must be taken at the earliest possible shutdown. However, experience indicates that this attention is not always possible, therefore, these systems tend to operate with one phase grounded through the first uncleared ground. A high impedance ground on another part of the system would result in low values of current, which would not operate a breaker phase trip, and could produce fire damage. Higher cost than ungrounded.	Same as for ungrounded except ground voltage alarm relay is connected across grounding resistor, or current relay between resistor and ground.	Same as for ungrounded.	Same as for ungrounded.	Same as for ungrounded. This system is most effective when supplied with a pulsing option.




Application

Sketch 1<sup>①</sup>

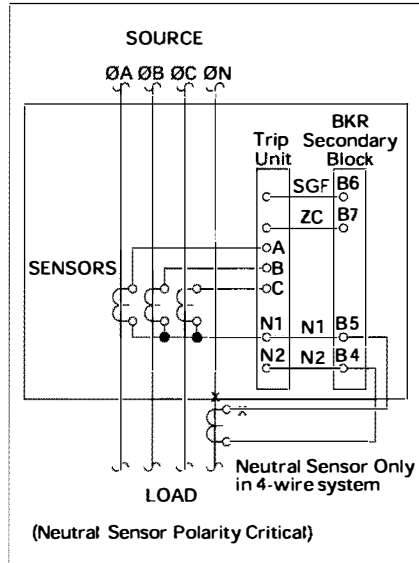


Residual Main and Feeder Breaker

Sketch 2

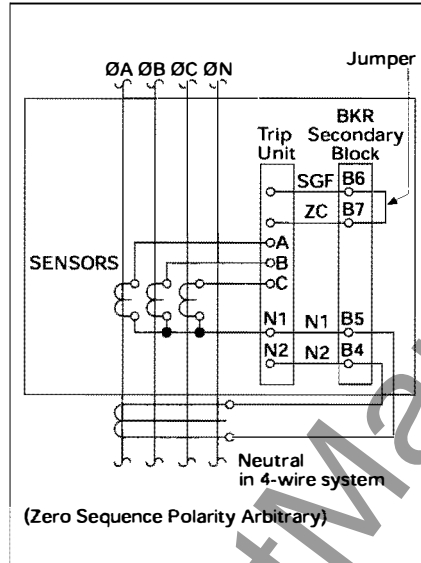

Zero Sequence Feeder Breaker

Sketch 3

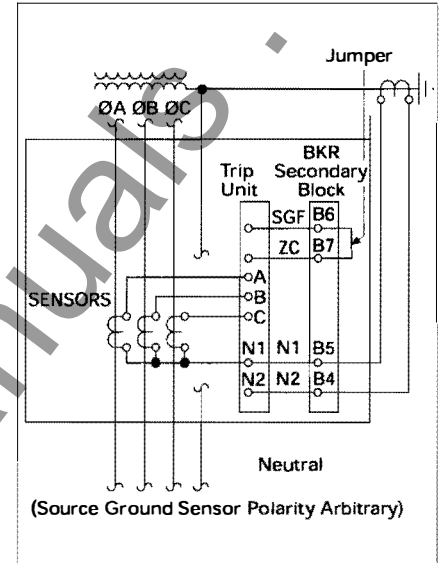


Source Neutral Main Breaker

**Note:** For double-ended secondary unit substations, ground fault protection should be as indicated on sketches No. 4 and No. 5; however, for this type of application, Cutler-Hammer should be consulted for the actual bill of materials to be used. The application becomes rather complex if single phase to neutral loads are being served.

<sup>①</sup> Apply in 4-Wire Systems for Main Breaker only when no other grounded sources are connected to the same system.

Application

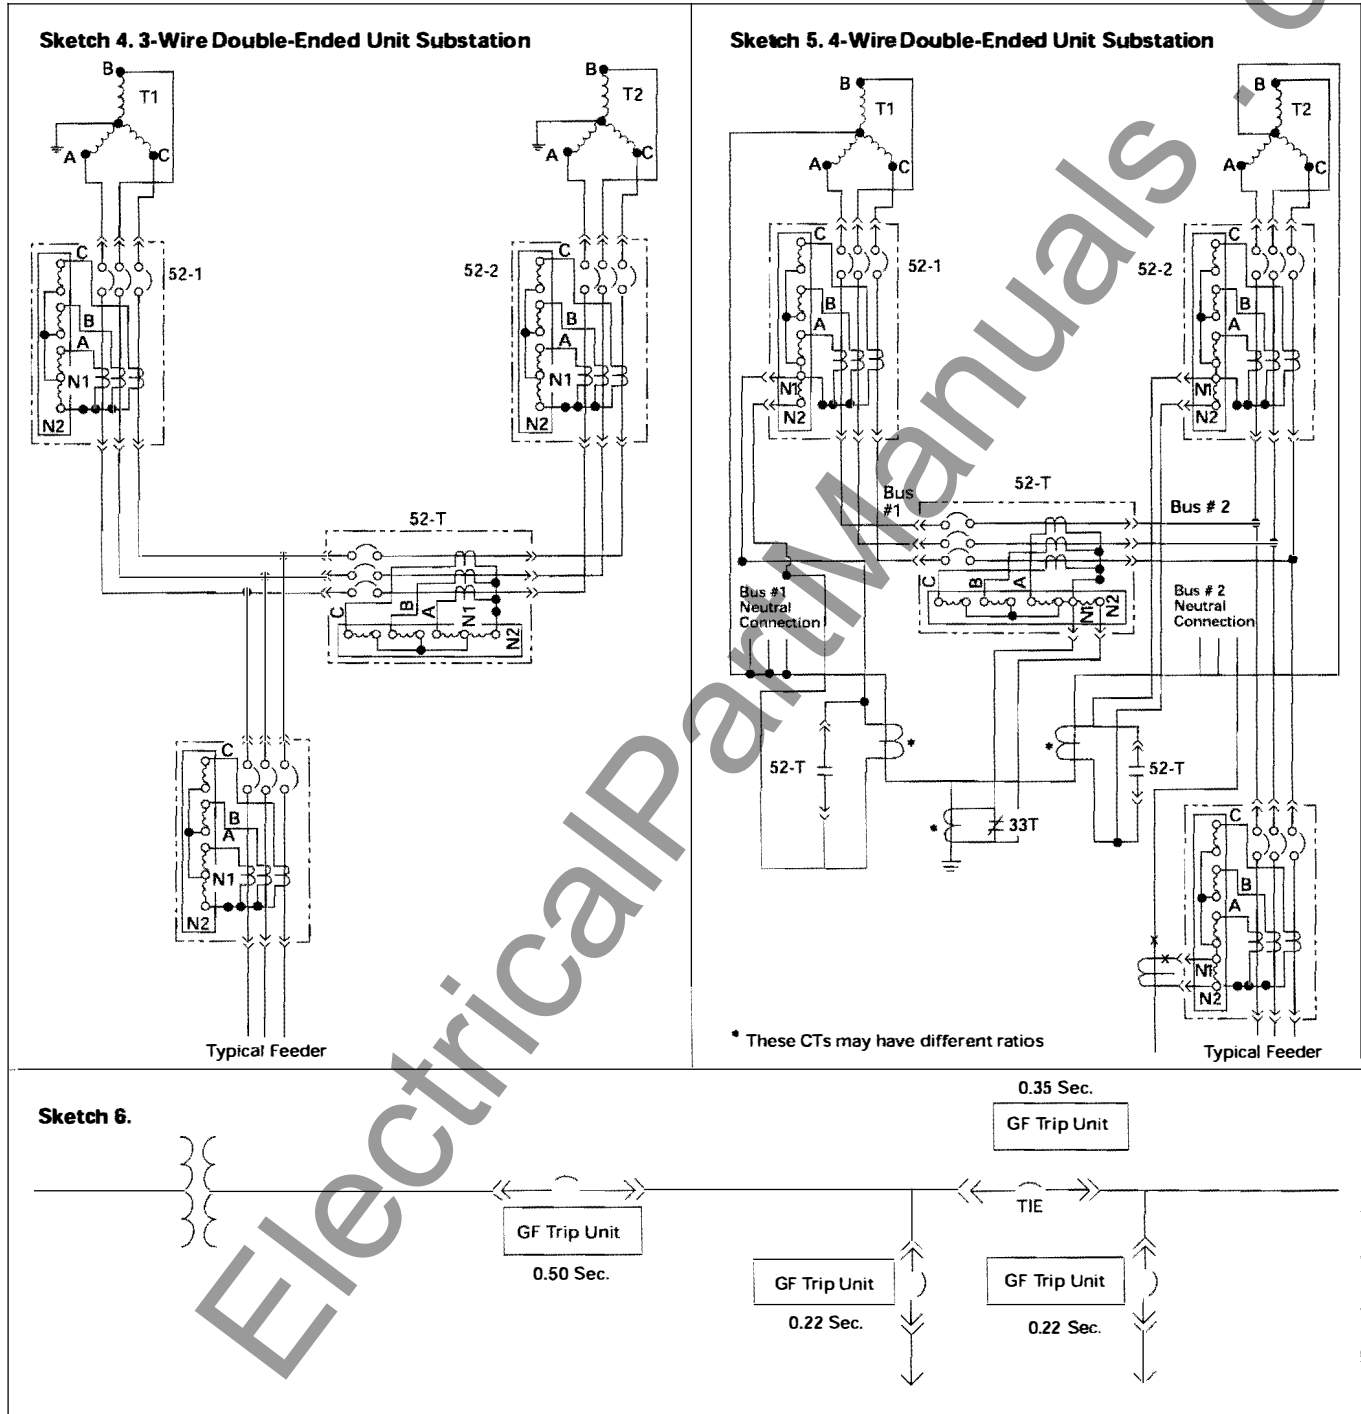

Application

Application of Magnum DS Power Circuit Breakers  
With Standard Three-Phase Transformers – Fluid Filled and Ventilated Dry Types

Transformer Base (100%) Rating			Secondary Short-Circuit Currents RMS Symmetrical Amperes			Minimum Size Breakers for Selective Trip Systems		
kVA and Percent Impedance	Amperes <sup>①</sup>	Maximum Short Circuit kVA Available from Primary System	Through Transformer Only	Motor Contribution	Combined	Main Breaker Short Delay Trip	Feeder Breaker Short Delay Trip	Feeder Breaker Instantaneous Trip

Table A1 – 208 Volts Three-Phase — 50% Motor Load

300 5.0%	833	50000	14900	1700	16600	MDS-616	MDS-408	MDS-408
		100000	15700		17400			
		150000	16000		17700			
		250000	16300		18000			
		500000	16500		18200			
		Unlimited	16700		18400			
500 5.0%	1389	50000	23100	2800	25900	MDS-616 <sup>②</sup>	MDS-408	MDS-408
		100000	25200		28000			
		150000	26000		28800			
		250000	26700		29500			
		500000	27200		30000			
		Unlimited	27800		30600			
750 5.75%	2083	50000	28700	4200	32900	MDS-632	MDS-408	MDS-408
		100000	32000		36200			
		150000	33300		37500			
		250000	34400		38600			
		500000	35200		39400			
		Unlimited	36200		40400			
1000 5.75%	2778	50000	35900	5600	41500	MDS-632 <sup>②</sup>	MDS-408	MDS-408
		100000	41200		46800			
		150000	43300		48900			
		250000	45200		50800			
		500000	46700		52300			
		Unlimited	48300		53900			

Table A2 – 240 Volts Three-Phase — 100% Motor Load

300 5.0%	722	50000	12900	2900	15800	MDS-408 <sup>②</sup>	MDS-408	MDS-408
		100000	13600		16500			
		150000	13900		16800			
		250000	14100		17000			
		500000	14300		17200			
		Unlimited	14400		17300			
500 5.0%	1203	50000	20000	4800	24800	MDS-616 <sup>②</sup>	MDS-408	MDS-08
		100000	21900		26700			
		150000	22500		27300			
		250000	23100		27900			
		500000	23600		28400			
		Unlimited	24100		28900			
750 5.75%	1804	50000	24900	7200	32100	MDS-620 <sup>②</sup>	MDS-408	MDS-408
		100000	27800		35000			
		150000	28900		36100			
		250000	29800		37000			
		500000	30600		37800			
		Unlimited	31400		38600			
1000 5.75%	2406	50000	31000	9600	40600	MDS-632 <sup>②</sup>	MDS-408	MDS-408
		100000	35600		45200			
		150000	37500		47100			
		250000	39100		48700			
		500000	40400		50000			
		Unlimited	41800		51400			

① At transformer self-cooled rating.

② Next larger frame size main breaker may be required for 55/65°C rise and/or forced air-cooled (FA) transformer. Check Transformer Secondary Ampere Rating.

**Application**

**Application of Magnum DS Power Circuit Breakers  
With Standard Three-Phase Transformers - Fluid Filled and Ventilated Dry Types, Continued**

Transformer Base (100%) Rating			Secondary Short-Circuit Currents RMS Symmetrical Amperes			Minimum Size Breakers for Selective Trip Systems		
kVA and Percent Impedance	Amperes <sup>①</sup>	Maximum Short Circuit kVA Available from Primary System	Through Transformer Only	Motor Contribution	Combined	Main Breaker Short Delay Trip	Feeder Breaker Short Delay Trip	Feeder Breaker Instantaneous Trip

**Table A3 - 480 Volts Three-Phase - 100% Motor Load**

500 5.0%	601	50000	10000	2400	12400	MDS-408 <sup>②</sup>	MDS-408	MDS-408
		100000	10900		13300		MDS-408	MDS-408
		150000	11300		13700		MDS-408	MDS-408
		250000	11600		14000		MDS-408	MDS-408
		500000	11800		14200		MDS-408	MDS-408
		Unlimited	12000		14400		MDS-408	MDS-408
750 5.75%	902	50000	12400	3600	16000	MDS-616	MDS-408	MDS-408
		100000	13900		17500		MDS-408	MDS-408
		150000	14400		18000		MDS-408	MDS-408
		250000	14900		18500		MDS-408	MDS-408
		500000	15300		18900		MDS-408	MDS-408
		Unlimited	15700		19300		MDS-408	MDS-408
1000 5.75%	1203	50000	15500	4800	20300	MDS-616 <sup>②</sup>	MDS-408	MDS-408
		100000	17800		22600		MDS-408	MDS-408
		150000	18700		23500		MDS-408	MDS-408
		250000	19600		24400		MDS-408	MDS-408
		500000	20200		25000		MDS-408	MDS-408
		Unlimited	20900		25700		MDS-408	MDS-408
1500 5.75%	1804	50000	20600	7200	27800	MDS-620 <sup>②</sup>	MDS-408	MDS-408
		100000	24900		32100		MDS-408	MDS-408
		150000	26700		33900		MDS-408	MDS-408
		250000	28400		35600		MDS-408	MDS-408
		500000	29800		37000		MDS-408	MDS-408
		Unlimited	31400		38600		MDS-408	MDS-408
2000 5.75%	2406	50000	24700	9600	34300	MDS-632 <sup>②</sup>	MDS-408	MDS-408
		100000	31000		40600		MDS-408	MDS-408
		150000	34000		43600		MDS-608	MDS-608
		250000	36700		46300		MDS-608	MDS-608
		500000	39100		48700		MDS-608	MDS-608
		Unlimited	41800		51400		MDS-608	MDS-608
2500 5.75%	3008	50000	28000	12000	40000	MDS-632 <sup>②</sup>	MDS-408	MDS-408
		100000	36500		48500		MDS-608	MDS-608
		150000	40500		52500		MDS-608	MDS-608
		250000	44600		56600		MDS-608	MDS-608
		500000	48100		60100		MDS-608	MDS-608
		Unlimited	52300		64300		MDS-608	MDS-608
3000 5.75%	3609	50000	30700	14000	44700	MDS-840 <sup>②</sup>	MDS-608	MDS-608
		100000	41200		55200		MDS-608	MDS-608
		150000	46600		60600		MDS-608	MDS-608
		250000	51900		65900		MDS-808	MDS-808
		500000	56800		70800		MDS-808	MDS-808
		Unlimited	62800		76800		MDS-808	MDS-808
3750 5.75%	4511	50000	34000	18000	52000	MDS-850	MDS-608	MDS-608
		100000	47500		65500		MDS-808	MDS-808
		150000	54700		72700		MDS-808	MDS-808
		250000	62200		80200		MDS-808	MDS-808
		500000	69400		87400		MDS-L08	MDS-C08
		Unlimited	78500		96500		MDS-L08	MDS-C08

① At transformer self-cooled rating.

② Next larger frame size main breaker may be required for 55/65°C rise and/or forced air-cooled (FA) transformer. Check Transformer Secondary Ampere Rating.



Application

Application of Magnum DS Power Circuit Breakers  
With Standard Three-Phase Transformers - Fluid Filled and Ventilated Dry Types, *Continued*

Transformer Base (100%) Rating			Secondary Short-Circuit Currents RMS Symmetrical Amperes			Minimum Size Breakers for Selective Trip Systems		
kVA and Percent Impedance	Amperes <sup>①</sup>	Maximum Short Circuit kVA Available from Primary System	Through Transformer Only	Motor Contribution	Combined	Main Breaker Short Delay Trip	Feeder Breaker Short Delay Trip	Feeder Breaker Instantaneous Trip

Table A4 - 600 Volts Three-Phase - 100% Motor Load

500 5.0%	481	50000	8000	1900	9900	MDS-408	MDS-408	MDS-408		
		100000	8700		10600				MDS-408	MDS-408
		150000	9000		10900				MDS-408	MDS-408
		250000	9300		11200				MDS-408	MDS-408
		500000	9400		11300				MDS-408	MDS-408
Unlimited	9600	11500	MDS-408	MDS-408						
750 5.75%	722	50000	10000	2900	12900	MDS-408 <sup>②</sup>	MDS-408	MDS-408		
		100000	11100		14000				MDS-408	MDS-408
		150000	11600		14500				MDS-408	MDS-408
		250000	11900		14800				MDS-408	MDS-408
		500000	12200		15100				MDS-408	MDS-408
Unlimited	12600	15500	MDS-408	MDS-408						
1000 5.75%	962	50000	12400	3900	16300	MDS-616	MDS-408	MDS-408		
		100000	14300		18200				MDS-408	MDS-408
		150000	15000		18900				MDS-408	MDS-408
		250000	15600		19500				MDS-408	MDS-408
		500000	16200		20100				MDS-408	MDS-408
Unlimited	16700	20600	MDS-408	MDS-408						
1500 5.75%	1443	50000	16500	5800	22300	MDS-616 <sup>②</sup>	MDS-408	MDS-408		
		100000	20000		25800				MDS-408	MDS-408
		150000	21400		27200				MDS-408	MDS-408
		250000	22700		28500				MDS-408	MDS-408
		500000	23900		29700				MDS-408	MDS-408
Unlimited	25100	30900	MDS-408	MDS-408						
2000 5.75%	1924	50000	19700	7700	27400	MDS-620 <sup>②</sup>	MDS-408	MDS-408		
		100000	24800		32500				MDS-408	MDS-408
		150000	27200		34900				MDS-408	MDS-408
		250000	29400		37100				MDS-408	MDS-408
		500000	31300		39000				MDS-408	MDS-408
Unlimited	33500	41200	MDS-408	MDS-408						
2500 5.75%	2406	50000	22400	9600	32000	MDS-632 <sup>②</sup>	MDS-408	MDS-408		
		100000	29200		38800				MDS-408	MDS-408
		150000	32400		42000				MDS-408	MDS-408
		250000	35600		45200				MDS-608	MDS-608
		500000	38500		48100				MDS-608	MDS-608
Unlimited	41800	51400	MDS-608	MDS-608						
3000 5.75%	2886	50000	24600	11500	36100	MDS-632 <sup>②</sup>	MDS-408	MDS-408		
		100000	33000		44500				MDS-608	MDS-608
		150000	37300		48800				MDS-608	MDS-608
		250000	41500		53000				MDS-608	MDS-608
		500000	45500		57000				MDS-608	MDS-608
Unlimited	50200	61700	MDS-608	MDS-608						
3750 5.75%	3608	50000	27200	14400	41600	MDS-840 <sup>②</sup>	MDS-408	MDS-408		
		100000	38000		52400				MDS-608	MDS-608
		150000	43700		58100				MDS-608	MDS-608
		250000	49800		64200				MDS-608	MDS-608
		500000	55500		69900				MDS-808	MDS-808
Unlimited	62800	77200	MDS-808	MDS-808						

① At transformer self-cooled rating.

② Next larger frame size main breaker may be required for 55/65°C rise and/or forced air-cooled (FA) transformer. Check Transformer Secondary Ampere Rating.

Application

Table A5 – Breaker Arrangements ①②③④

Main Sections

Blank or Instrument	Blank or Instrument	Blank or Instrument	Blank or Instrument	Blank or Instrument	
Main 800 1600 2000 3200	Blank or Instrument	Feeder 800 1600 2000	Blank or Instrument	Main 4000 5000	
Feeder 800 1600 2000 3200⑤	Main 800 1600 2000 3200	Main 800 1600 2000 3200	Blank or Instrument	Feeder 800 1600 2000 3200⑤	Feeder 800 1600 2000 3200⑤
Feeder 800 1600 2000 3200⑤	Feeder 800 1600 2000 3200	Feeder 800 1600 2000 3200	Main 800 1600 2000 3200	Feeder 800 1600 2000 3200⑤	Feeder 800 1600 2000 3200⑤
22 (559) Fig. 1	22 (559) Fig. 2	22 (559) Fig. 3	30 (762) Fig. 4	44 (1118) Fig. 5	

Main Sections

Blank or Instrument		Blank or Instrument	
Blank or Instrument		Feeder 800 1600 2000 3200	Feeder 800 1600 2000 3200
Main 4000 5000		Main 4000 5000	
Feeder 800 1600 2000 3200	Feeder 800 1600 2000 3200	Blank or Instrument	
44 (1118) Fig. 6		44 (1118) Fig. 7	

- ① Maximum indoor shipping section width is 5 vertical sections or 120 inches (3048 mm), whichever is smaller. Maximum outdoor shipping width is 96 inches (2438 mm) including aisle doors, any transformer connections, etc.
- ② All vertical sections are 92 inches (2339 mm) high plus 4 inches (102 mm) for ventilators and non-removable lifting angle. When a top-of-gear breaker lifter is used, height is 99 inches (2515 mm) total.

- ③ When bus ducts out of the feeder sections are required, the depth of the lineup may increase and vertical stacking may be effected. Refer to Cutler-Hammer.
- ④ Vertical bus is sized per main cross bus maximum rating or by ANSIC37.20.1 section 7.4.1.3 (Table 11) to a maximum of 5000 amperes.

- ⑤ Maximum of (2) 3200 ampere breakers per 22-inch (559 mm) width of switchgear, one of which must be a main or tie.

Dimensions are in inches (millimeters).

Application

Table A5 – Breaker Arrangements<sup>①②③④</sup>  
Main Sections

Blank or Instrument
Blank or Instrument
Blank or Instrument
Main 4000 5000

44 (1118)  
Fig. 8

Feeder Sections

Feeder 800 1600 2000 <sup>⑤</sup>	Feeder 800 1600	Feeder 800 1600
Feeder 800 1600 2000 <sup>⑤</sup> 3200 <sup>⑥</sup>	Feeder 4000 5000	
Feeder 800 1600 2000 <sup>⑤</sup> 3200 <sup>⑥</sup>	Feeder 800 1600 2000 3200 <sup>⑥</sup>	Feeder 800 1600 2000 3200 <sup>⑥</sup>
Feeder 800 1600 2000 <sup>⑤</sup> 3200 <sup>⑥</sup>	Feeder 800 1600 2000 3200 <sup>⑥</sup>	Feeder 800 1600 2000 3200 <sup>⑥</sup>

22 (559)  
Fig. 9

44 (1118)  
Fig. 10

Feeder Sections

Feeder 800 1600	Feeder 800 1600
Feeder 800 1600 2000 3200 <sup>⑥</sup>	Feeder 800 1600 2000 3200 <sup>⑥</sup>
Feeder 4000 5000	
Feeder 800 1600 2000 3200 <sup>⑥</sup>	Feeder 800 1600 2000 3200 <sup>⑥</sup>

44 (1118)  
Fig. 11

Feeder 800 1600	Feeder 800 1600
Feeder 800 1600 2000 3200 <sup>⑥</sup>	Feeder 800 1600 2000 3200 <sup>⑥</sup>
Feeder 800 1600 2000 3200 <sup>⑥</sup>	Feeder 800 1600 2000 3200 <sup>⑥</sup>
Feeder 4000 5000	

44 (1118)  
Fig. 12

- ① Maximum indoor shipping section width is 5 vertical sections or 120 inches (3048 mm), whichever is smaller. Maximum outdoor shipping width is 96 inches (2438 mm) including aisle doors, any transformer connections, etc.
- ② All vertical sections are 92 inches (2339 mm) high plus 4 inches (102 mm) for ventilators and non-removable lifting angle. When a top-of-gear breaker lifter is used, height is 99 inches (2515 mm) total.

- ③ When bus ducts out of the feeder sections are required, the depth of the lineup may increase and vertical stacking may be effected. Refer to Cutler-Hammer.
- ④ Vertical bus is sized per main cross bus maximum rating or by ANSI C37.20.1 section 7.4.1.3 (Table 11) to a maximum of 5000 amperes.

- ⑤ Maximum of (3) 2000 ampere breakers per 22-inch (559 mm) width of switchgear. If (3) are required, positions B, C and D must be utilized.
- ⑥ Maximum of (2) 3200 ampere breakers per 22-inch (559 mm) width of switchgear, one of which must be a main or tie.

Dimensions are in inches (millimeters).

Application

Table A5 - Breaker Arrangements<sup>1,2,3,4</sup>

Tie Sections/Combination Main and Tie Sections

Feeder 800 1600 2000	Feeder 800 1600 2000	Blank or Instrument	Feeder 800 1600	Blank or Instrument
Tie 800 1600 2000 3200 <sup>5</sup>	Feeder 800 1600 2000 3200 <sup>5</sup>	Main 800 1600 2000 3200	Tie 800 1600 2000 3200	Main 800 1600 2000 3200
Feeder 800 1600 2000 3200 <sup>5</sup>	Tie 800 1600 2000 3200 <sup>5</sup>	Tie 800 1600 2000 3200	Main 800 1600 2000 3200	Tie 800 1600 2000 3200
Feeder 800 1600 2000 3200 <sup>5</sup>	Feeder 800 1600 2000 3200 <sup>5</sup>	Feeder 800 1600 2000	Blank or Instrument	Main 800 1600 2000 3200
22 (559) Fig. 13	22 (559) Fig. 14	22 (559) Fig. 15	22 (559) Fig. 16	22 (559) Fig. 17

Tie Sections/Combination Main and Tie Sections

Blank or Instrument	Feeder 800 1600	Feeder 800 1600
Main 4000 5000	Tie 4000 5000	
Tie 4000 5000	Main 4000 5000	
Feeder 800 1600 2000 3200	Feeder 800 1600 2000 3200	Blank or Instrument
44 (1118) Fig. 18	44 (1118) Fig. 19	

- Maximum indoor shipping section width is 5 vertical sections or 120 inches (3048 mm), whichever is smaller. Maximum outdoor shipping width is 96 inches (2438 mm) including aisle doors, any transformer connections, etc.
- ② All vertical sections are 92 inches (2339 mm) high plus 4 inches (102 mm) for ventilators and non-removable lifting angle. When a top-of-gear breaker lifter is used, height is 99 inches (2515 mm) total.

- ③ When bus ducts out of the feeder sections are required, the depth of the lineup may increase and vertical stacking may be effected. Refer to Cutler-Hammer.
- ④ Vertical bus is sized per main cross bus maximum rating or by ANSI C37.20.1 section 7.4.1.3 (Table 11) to a maximum of 5000 amperes.

- ⑤ Maximum of (2) 3200 ampere breakers per 22-inch (559 mm) width of switchgear, one of which must be a main or tie.

Dimensions are in inches (millimeters).

Application

Table A5 - Breaker Arrangements<sup>①②③④</sup>

Tie Sections/Combination Main and Tie Sections

Blank or Instrument
Main 4000 5000
Tie 4000 5000
Main 4000 5000

44 (1118)  
Fig. 20


Feeder 800 1600	Feeder 800 1600
Tie 4000 5000	
Feeder 800 1600 2000 3200 <sup>⑤</sup>	Feeder 800 1600 2000 3200 <sup>⑤</sup>
Feeder 800 1600 2000 3200 <sup>⑤</sup>	Feeder 800 1600 2000 3200 <sup>⑤</sup>

44 (1118)  
Fig. 21

Feeder 800 1600	Feeder 800 1600
Feeder 800 1600 2000 3200 <sup>⑤</sup>	Feeder 800 1600 2000 3200 <sup>⑤</sup>
Tie 4000 5000	
Feeder 800 1600 2000 3200 <sup>⑤</sup>	Feeder 800 1600 2000 3200 <sup>⑤</sup>

44 (1118)  
Fig. 22


Transition Sections<sup>⑥</sup>

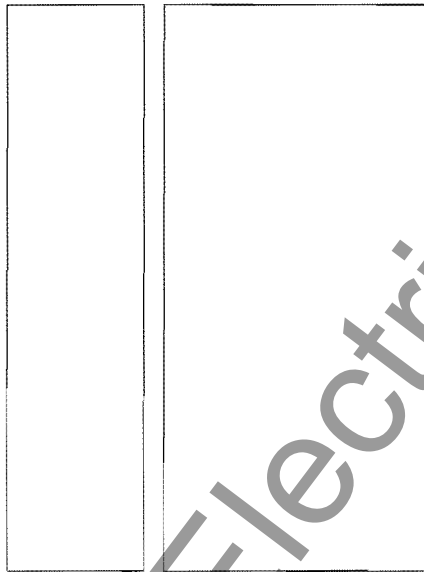

11 (279)  
Fig. 23

22 (559)  
Fig. 24

Auxiliary Sections

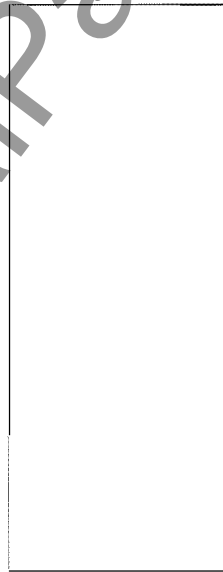

22 (559)  
Fig. 25

- ① Maximum indoor shipping section width is 5 vertical sections or 120 inches (3048 mm), whichever is smaller. Maximum outdoor shipping width is 96 inches (2438 mm) including aisle doors, any transformer connections, etc.
- ② All vertical sections are 92 inches (2339 mm) high plus 4 inches (102 mm) for ventilators and non-removable lifting angle. When a top-of-gear breaker lifter is used, height is 99 inches (2515 mm) total.


- ③ When bus ducts out of the feeder sections are required, the depth of the lineup may increase and vertical stacking may be effected. Refer to Cutler-Hammer.
- ④ Vertical bus is sized per main crossbus maximum rating or by ANSI C37.20.1 section 7.4.1.3 (Table 11) to a maximum of 5000 amperes.

- ⑤ Maximum of (2) 3200 ampere breakers per 22-inch (559 mm) width of switchgear, one of which must be a main or tie.
- ⑥ Transitions to transformers may be omitted if: standard dry type transformer is used; auxiliary and metering devices are not located in transition; there is no fire pump breaker; there is no zero sequence ground fault.

Dimensions are in inches (millimeters).

Application

Section View of Typical Structure - Dimensions in Inches (mm)

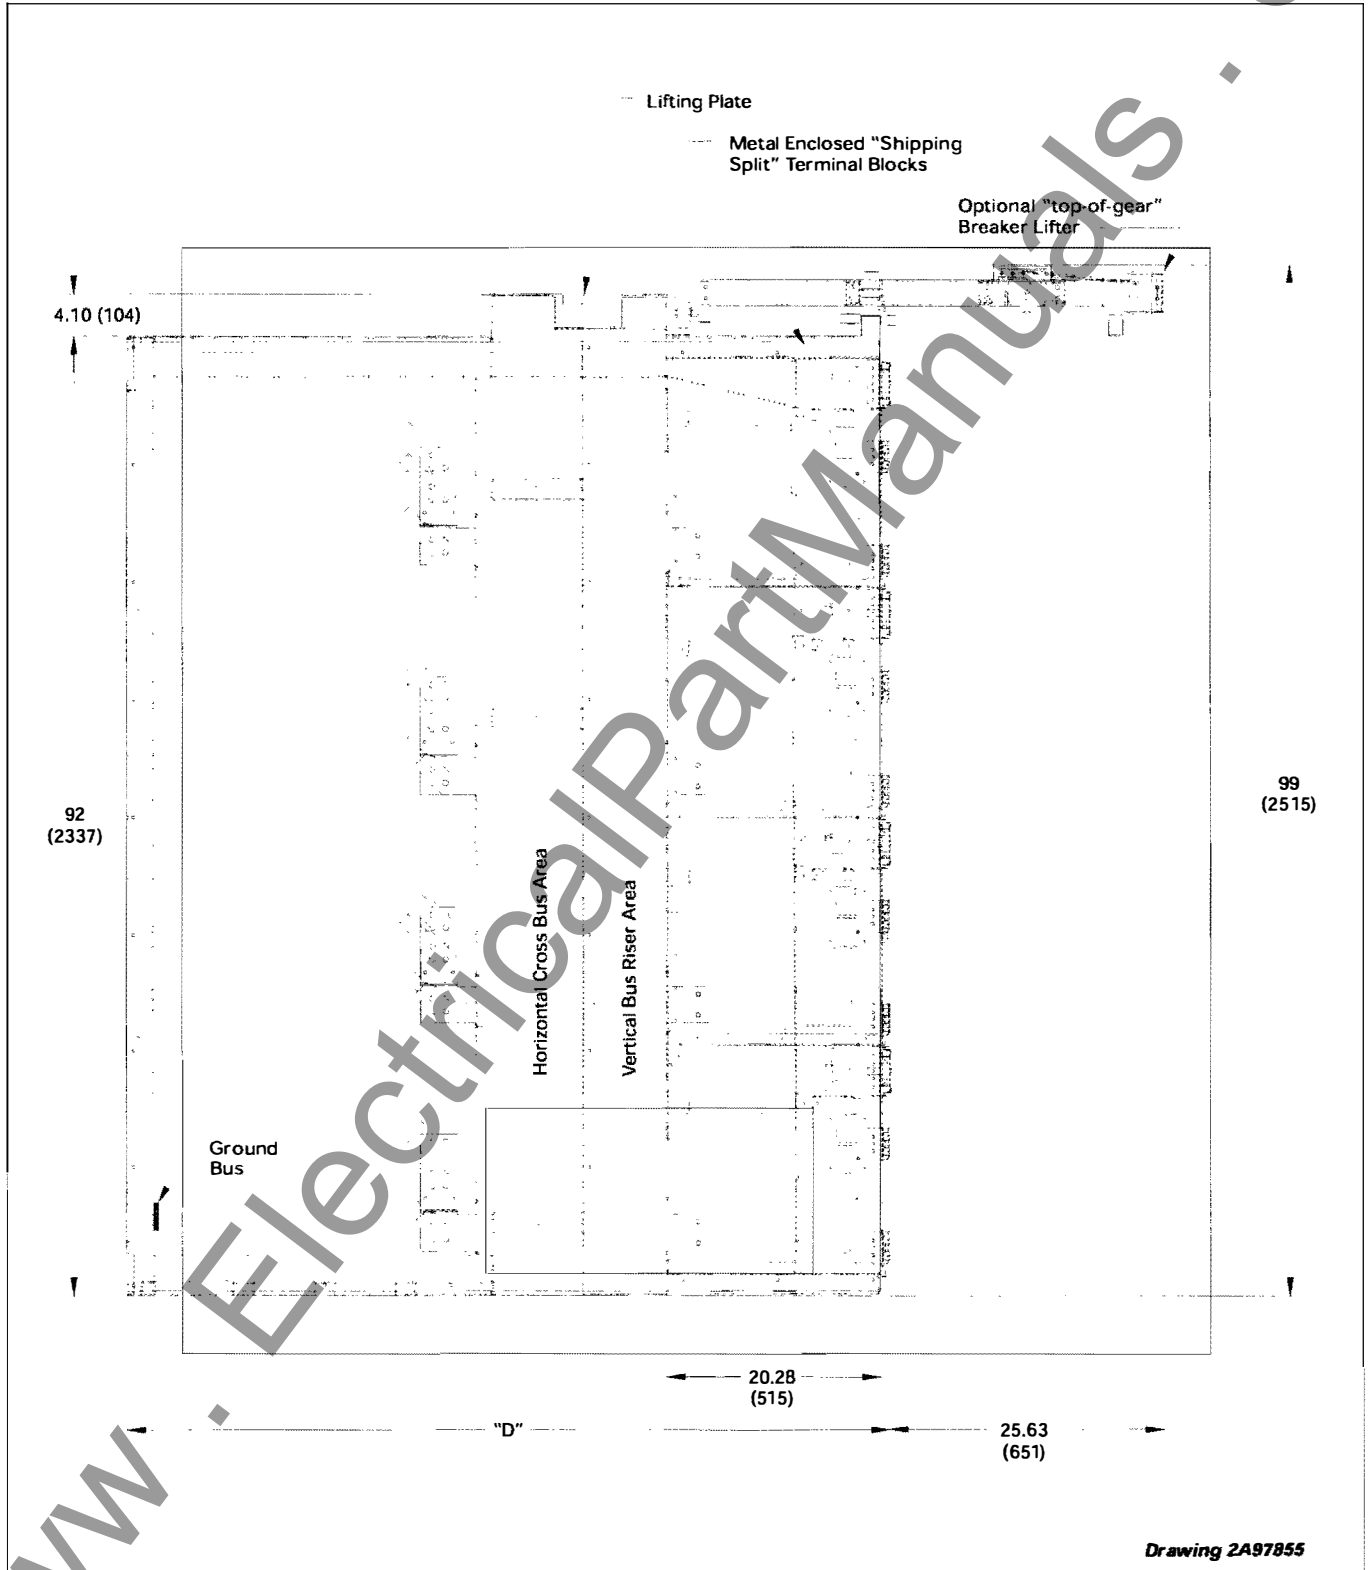

WWW.ElectricalPartManuals.com

Application

Floor Plan/Conduit Area

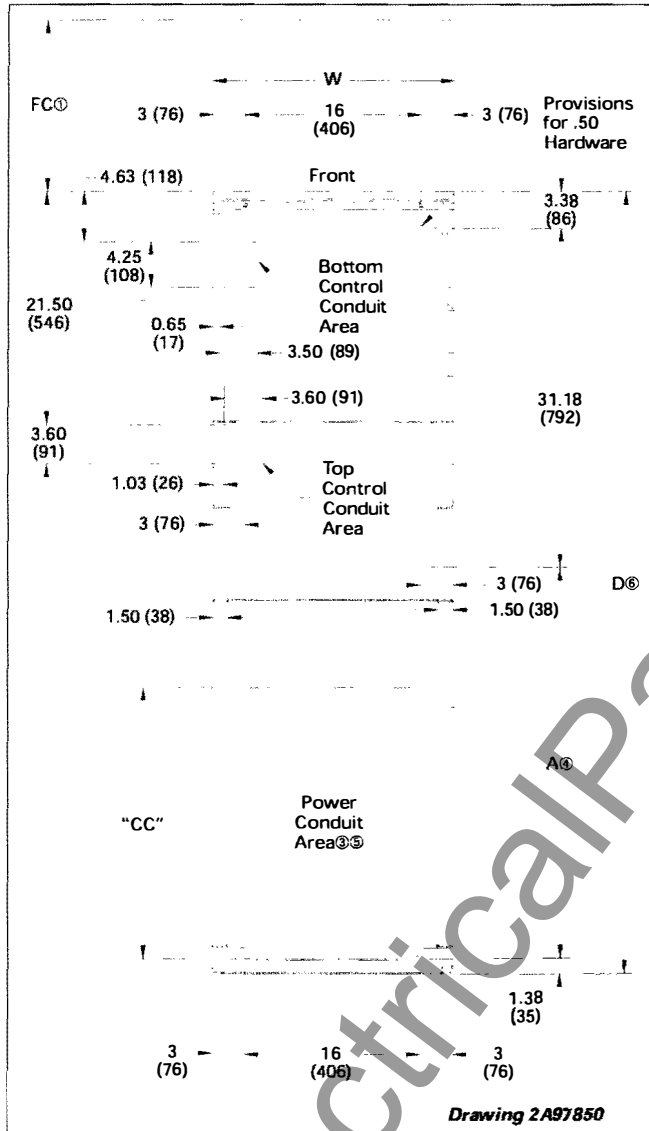


Table A6 – Dimensions, in Inches (Millimeters)

FC <sup>①</sup>	W	D <sup>②</sup>	A <sup>③</sup>	CC <sup>④</sup>	Recommended Number of Power Conduits (Maximum) <sup>⑤</sup>	
					3.5-Inch	4-Inch
36 (914)	22 (559)	60 (1524)	24 (611)	13.3 (338)	6	6
		66 (1676)	30 (764)	19.3 (490)	9	9
		72 (1829)	36 (916)	25.3 (643)	12	12
		78 (1981)	42 (1069)	31.3 (795)	15	15
		84 (2134)	48 (1221)	37.3 (948)	18	18
36 (914)	44 (1118)	60 (1524)		13.3 (338)	12	12
		66 (1676)		19.3 (490)	18	18
		72 (1829)		25.3 (643)	24	24
		78 (1981)		31.3 (795)	30	30
		84 (2134)		37.3 (948)	36	36
		90 (2286)		43.3 (1100)	42	42

Table A7 – Center of Gravity Location

Center of Gravity	
For seismic calculations, the following dimensions should be used to locate the center of gravity for Indoor Magnum DS Switchgear:	
Vertical	60 inches (1524 mm)
Left-to-right	center of lineup
From the front	26 inches (660 mm)

- ① FC is the recommended front clearance for breaker removal with top-of-switchgear-mounted breaker lifter. If a portable breaker lifter is to be used, allow at least 84 inches (2134 mm) of aisle space.
- ② When a zero-sequence ground-fault CT is mounted on line-side or load-side of a breaker, reduce CC dimension by 10 inches (254 mm).
- ③ Stub conduit 2 inches (50 mm) maximum in power cable area, 1 inch (25 mm) maximum in control wiring area.
- ④ Bolt hole location for mounting the center floor channel when required. Floor channels not included.
- ⑤ For available area for bus duct connection contact Cutler-Hammer.
- ⑥ Hinged rear doors add 1.25 inches (32 mm).

**Application**

**Table A8 – Heat Loss Data<sup>③</sup>**

Estimated Heat Loss Per Breaker (Watts)		
MDS-408		②
MDS-608		②
MDS-808		②
MDS-C08		②
MDS-616		②
MDS-816		②
MDS-C16		②
MDS-620		②
MDS-820		②
MDS-C20		②
MDS-632		②
MDS-832		②
MDS-C32		②
MDS-840		②
MDS-C40		②
MDS-850		②
MDS-C50		②

**Estimated Heat Loss (Watts) Per Structure<sup>③</sup>**

Loss is based on the same fully loaded vertical and cross bus rating in a structure as given below.

2,000 amperes	698
3,200 amperes	②
4,000 amperes	②
5,000 amperes	②
6,000 amperes	②

**Table A9 – Magnum DS Indoor Switchgear Structure Approximate Weights (less breakers)**

Width	Depth	Pounds (Kilograms)
22-in. (559 mm) (Breaker Structure)	60 in. (1524 mm)	1250 (568)
	66 in. (1676 mm)	1300 (591)
	72 in. (1829 mm)	1350 (614)
	78 in. (1981 mm)	1400 (636)
	84 in. (2134 mm)	1450 (659)
	90 in. (2286 mm)	1500 (682)
44-in. (1118 mm) (Breaker Structure)	60 in. (1524 mm)	2500 (1136)
	66 in. (1676 mm)	2600 (1182)
	72 in. (1829 mm)	2700 (1227)
	78 in. (1981 mm)	2800 (1272)
	84 in. (2134 mm)	2900 (1318)
	90 in. (2286 mm)	3000 (1364)
22-in. (559 mm) (Auxiliary Structure)	60 in. (1524 mm)	950 (432)
	66 in. (1676 mm)	1000 (455)
	72 in. (1829 mm)	1050 (477)
	78 in. (1981 mm)	1100 (500)
	84 in. (2134 mm)	1150 (523)
	90 in. (2286 mm)	1200 (545)
11-in. (279 mm) (Transition)	60 in. (1524 mm)	475 (216)
	66 in. (1676 mm)	500 (227)
	72 in. (1829 mm)	525 (239)
	78 in. (1981 mm)	550 (250)
	84 in. (2134 mm)	575 (261)
	90 in. (2286 mm)	600 (273)
22-in. (559 mm) (Transition)	60 in. (1524 mm)	950 (432)
	66 in. (1676 mm)	1000 (455)
	72 in. (1829 mm)	1050 (477)
	78 in. (1981 mm)	1100 (500)
	84 in. (2134 mm)	1150 (523)
	90 in. (2286 mm)	1200 (545)

**Table A10 – Magnum DS Breaker Weights – Pounds (Kilograms)<sup>①</sup>**

Breaker	Fixed	Drawout
MDS-408	110 (50)	130 (59)
MDS-608	110 (50)	130 (59)
MDS-808	120 (55)	145 (66)
MDS-C08	120 (55)	145 (66)
MDS-616	110 (50)	130 (59)
MDS-816	120 (55)	145 (66)
MDS-C16	120 (55)	145 (66)
MDS-620	120 (55)	145 (66)
MDS-820	120 (55)	145 (66)
MDS-C20	120 (55)	145 (66)
MDS-632	135 (61)	175 (80)
MDS-832	135 (61)	175 (80)
MDS-C32	135 (61)	175 (80)
MDS-840	250 (114)	310 (141)
MDS-C40	250 (114)	310 (141)
MDS-850	250 (114)	310 (141)
MDS-C50	250 (114)	310 (141)

① Manually or electrically operated. For approximate impact weight, add 50% of breaker weight.

② Contact Cutler-Hammer.

③ For lower than maximum load currents, watt loss may be estimated by reducing the full load loss by the following:

$$W_L = (I_L / I_{FL})^2 W_{FL}$$

Where:

$W_L$  = Load Watts

$W_{FL}$  = Full Load Watts

$I_L$  = Actual Load Current

$I_{FL}$  = Full Load Current




**Features - Structure**

**Standard Finish** — Gray paint finish (ANSI 61) using a modern completely automated and continuously monitored electrostatic powder coating. This continually monitored system includes spray de-grease and clean, spray rinse, iron phosphate spray coating spray rinse, non-chemical seal, oven drying, electrostatic powder spray paint coating and oven curing.

**Integral Base** — The rugged formed base greatly increases the rigidity of the structure and reduces the possibility of damage during the installation of the equipment and is suitable for rolling, jacking and handling. A lifting angle is permanently welded into the bus compartment structure for increased strength.

**Heavy Duty Door Hinges** — Each breaker door is mounted with hinge pins. Removal of the door is easily accomplished by just lifting the hinge pin. This allows easy access to the breaker internal compartment for inspection and maintenance.

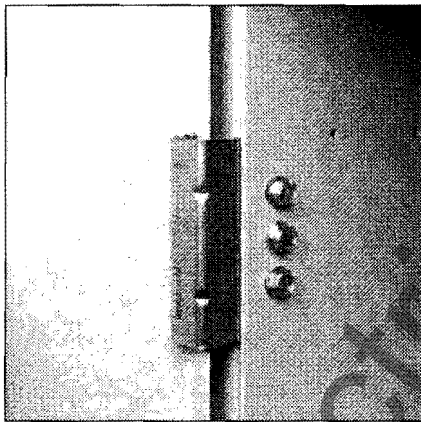

Heavy Duty Hinge Pins


**Rear Cover/Doors** — In Magnum DS Switchgear standard rear covers with captive hardware are the bolt-on type. They are split into two sections to facilitate handling during removal and installation. Optional rear doors are also available.

**Through the Door Design** — The following functions may be performed without the need to open the circuit breaker door: levering the breaker between positions, operate manual charging system and view the spring charge status flag, close and open breaker, view and adjust trip unit and read the breaker rating nameplate.



Through-the-Door Design

**Front Accessible** — When the door is open or removed each breaker compartment provides front access to isolated, vertical wireways, primary disconnects, cell current transformers and other breaker compartment accessories for ease of field wiring and troubleshooting field connections.

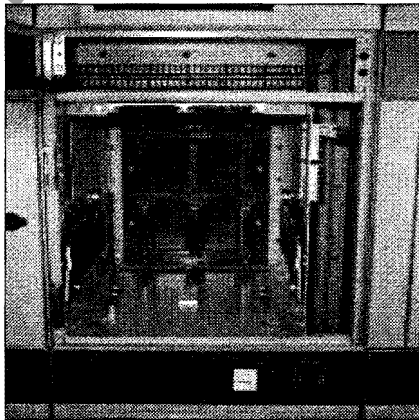

Breaker Cell

**Four Position Drawout** — Breakers can be in connected, test, disconnected or removed position. The breaker compartment door can be closed in the connected, test and disconnected positions.

**Closing Spring Automatic Discharge** Mechanical interlocking automatically discharges the closing springs when the breaker is removed from its compartment.

**Optional Safety Shutters** — Positive acting safety shutters which isolate the breaker connections to the main bus when the breaker is withdrawn from the cell is an option offered for additional safety beyond our standard design. Insulating covers ("boots") are furnished on live main stationary disconnecting contacts in compartments equipped for future breakers.

**Breaker Inspection** — When withdrawn on the rails, breaker is completely accessible for visual inspection; tilting is not necessary. The rails are permanent parts of every breaker compartment.

Interference interlocks are supplied on breakers and in compartments where the compartments are of the same physical size to assure an incorrect breaker cannot be inserted.

**Key Interlock (Switchgear Mounted)** Breaker can be stored in compartment, and completely removed for maintenance or for use as a spare without disturbing the interlock. No modification of the breaker required. This mechanism holds the breaker mechanically trip-free to prevent electrical or manual closing. An additional single cylinder breaker mounted key interlock is also available as an option.

**Optional Mechanical Interlock** — Available between adjacent breakers.

# Magnum DS Metal-Enclosed Low-Voltage Switchgear

Cutler-Hammer

## Features – Bus

**Buses and Connections** — Vertical and cross bus ratings in Magnum DS Switchgear are based on a UL and ANSI standard temperature rise of 65°C above a maximum ambient air temperature of 40°C.

**Bus Ampacities** — Vertical and cross bus ratings in Magnum DS are 2000, 3200, 4000, and 5000 amperes. In addition, a 6000 ampere cross bus rating is available.

**Bus Bracing** — Unique vertical bus configuration provides an optional industry leading short circuit withstand rating of 200,000 amperes without the need for preceding current limiting fuses. Standard bracing is 100,000 amperes. The “U” shaped bar is the heart of the Magnum DS vertical bus. This configuration provides a much higher mechanical strength. To further demonstrate the strength and rigidity of this bus system, it has been verified through testing to withstand 85,000 amperes short circuit for a full 60 cycles.

**Silver Plating** — Bolted, silver-plated copper main buses are standard. The plating is over the entire length of the bar, not just at the joints. Optional tinned copper buses are available.

**Bus Joints** — All joints are bolted and secured with Belleville-type spring washers for maximum joint integrity. These washers reduce the potential of joint hardware loosening during the change of joint temperature associated with variations of the loads.


**Full Neutral** — For 4-wire applications the neutral bus is rated 100% of main bus rating as standard. Half (50%) neutrals and neutral ratings up to a maximum of 6000 amperes are available as an option.

**Ground** — A ground bus is furnished the full length of the switchgear assembly and is fitted with terminals for purchaser’s connections.


**Glass Reinforced Polyester and Ultramid Stand-Off Insulation System** — Glass reinforced polyester has been used on both low- and medium-voltage switchgear for decades. By combining this industry proven material with Ultramid insulation, a total system providing exceptional mechanical and dielectric withstand strength, as well as high resistance to heat, flame, and moisture, is produced. Substantial testing to demonstrate accelerated effects of heating and cooling on the mechanical and dielectric properties of this system prove it to provide superior performance for decades of trouble-free operation.

**Optional Conductor Insulation Covering** — For applications requiring additional bus protection in harsh environments, Magnum DS Switchgear is designed for the addition of optional conductor insulation covering, in addition to providing full UL air clearance without insulation. This material is applied during the assembly of the bus and covers all vertical and horizontal phase bus bars. Removable boots provide access to section-to-section bus joints for inspection and maintenance purposes.

**Barriers** — Optional grounded metal barriers isolate the main bus and connections from the cable compartment providing added safety to the workers while reducing the potential of objects falling into the bus compartment.

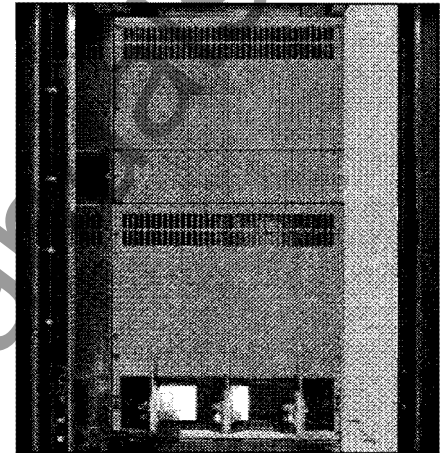

Optional Bus Compartment Barriers

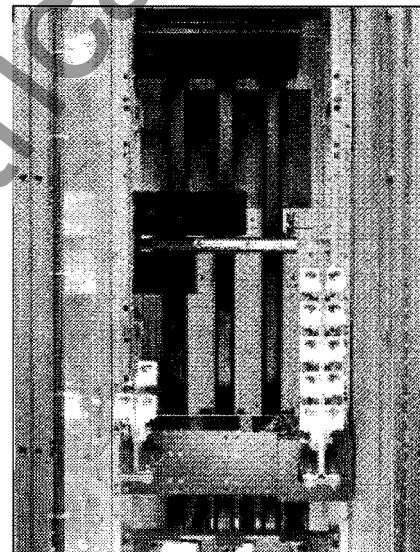

Optional Insulated Bus

**Features - Wiring**

**Cable Compartment** — The cable compartment gives ample room for terminating the power cables. Removable top roof sheets allow for easy conduit hub installation. The floor of the cable compartment is open to allow cable entry from underground duct banks. Optional floor plates are available.


Optional grounded metal barriers isolate the main bus and connections from the cable compartment, as well as optional barriers to separate adjacent cable compartments.

In addition to cable, Pow-R-Way Busway and nonsegregated Busduct can be terminated in the compartment.

**Lug Pad** — The lugs are located on the breaker run-backs to accommodate lug orientations at a 45° angle to reduce the bending radius of the cable needed for making the connections, thus reducing installation and maintenance time. Mechanical setscrew type lugs are standard. Optional NEMA 2-hole compression lugs are available as an option.

**Control Wireway** — An isolated vertical wireway is provided for routing of factory and field wiring in each switchgear section. Breaker secondary terminal blocks are mounted as standard above each circuit breaker. The terminal blocks are rated 30 amperes and will accept bare wire, ring or spade terminals for wire size ranges of #22 to #10. Extruded loops are punched in side sheets of the vertical wireway to allow securing of customer control wiring without the use of adhesive wire anchors.

For applications involving excessive wiring, or nonstandard terminal blocks, terminal blocks are mounted on the rear frame with the power cables where they are readily accessible for customer's connections and inspection.

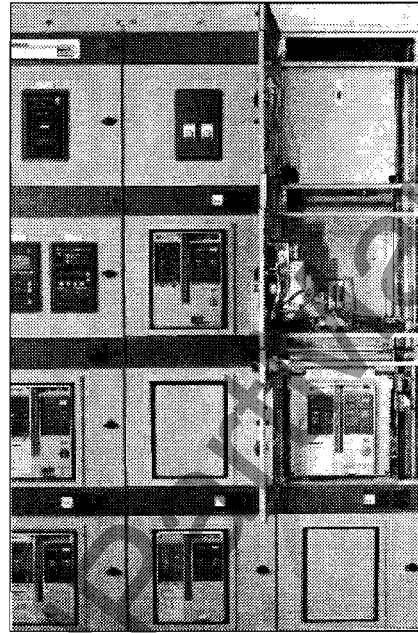

Control Wireway

**Control Wire** — Standard wire is Type SIS insulated stranded copper, extra flexible No. 14 AWG minimum.

**Secondary Terminal Compartment Door** — The customer's secondary terminal connections are located behind a separate door providing access to these connections without the need to open the breaker compartment door.



Secondary Control Terminals

**Short Circuiting Terminal Blocks** — One provided for each set of instrumentation or relaying application current transformers.

**Shipping Split Connection** — At each shipping split, the control connections are made with plug-in terminal blocks rated 600 volts, 40 amperes. The terminal blocks interlock mechanically without removing the line or load connections. This method of making the shipping split control connections increases the speed of installation and reduces the potential of incorrect connections.

**Features - Instrumentation/  
Metering**

**Flexibility** — Magnum DS Switchgear allows for a variety of metering options:

- ⊗ Analog switchboard type meters such as ammeters, voltmeters, watt-hour, power factor, etc.
- ⊗ Electronic power metering such as the IQ family of Analyzer, DP-4000, etc.
- ⊗ Instrument door mounted meters. For feeder circuit instrumentation, 2% accuracy ammeters and ammeter switches can be mounted on the secondary contact compartment door between the breaker compartment doors. The ammeters and switches are immediately associated with definite breaker circuits. Other devices, such as control push-buttons, breaker control switches, indicating lights, and test switches can be mounted on these panels, within space limitations.

**Voltage Transformers** — Voltage transformers are rated 10 kV BIL and are protected by both primary and secondary fuses. The primary fuses are of the current limiting type.



**Current Transformers** — Current Transformers for metering and instrumentation are mounted in the breaker compartments and are front accessible. Secondary wiring between the current transformer and the standard shorting terminal block is color-coded for ease of identification.

**Control Power Transformers** — Control transformers are provided when required for ac control of circuit breakers, space heaters, and/or transformer fans. Like voltage transformers, they are protected by current limiting primary fuses. Non-current limiting fuses are used on the secondary side to protect branch circuits.


**Instrumentation - Door Mounted Secondary Terminal Compartment Door** — Devices, such as control push-buttons, breaker control switches, indicating lights, and test switches can be mounted on these panels, within space limitations. The ammeters and switches are immediately associated with definite breaker circuits.

**Instrument Compartment Door** — Devices, such as electronic power metering and analog switchboard type meters that do not fit on the secondary terminal compartment door, are

mounted on the Instrument compartment door or on a the panel of a blank cell.

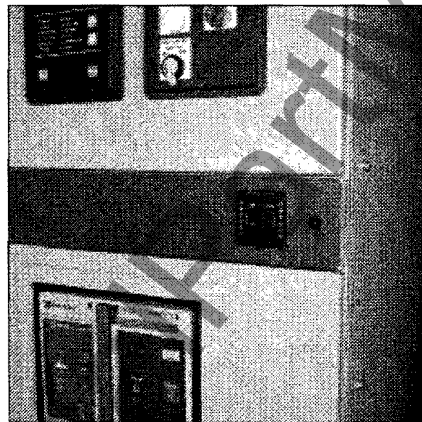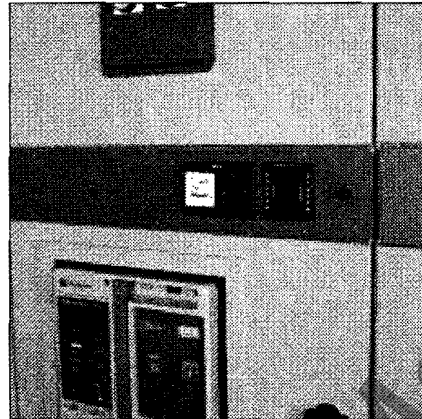

*Devices Mounted on Secondary Terminal Compartment Door*

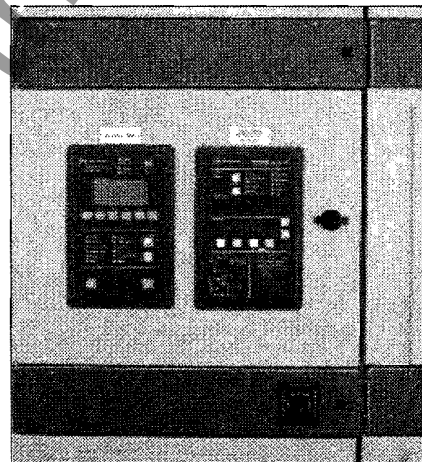

*Devices Mounted on Instrument Compartment Door*


**Features - Accessories  
and Options**

**Switchgear Accessories** — Standard accessories furnished with each Magnum DS Switchgear assembly include:

- ⊗ One breaker levering crank
- ⊗ Insulating covers or "boots" are furnished on live main stationary disconnecting contacts in compartments equipped for future breakers
- ⊗ Removable cover to block opening in the door when the breaker is temporarily removed from its compartment

**Optional Accessories**

- ⊗ Traveling type circuit breaker lifter, rail-mounted on top of switchgear
- ⊗ Floor running portable circuit breaker lifter and transfer truck with manual lifting mechanism. This requires approximate 84-inch (2134 mm) deep front aisle space
- ⊗ Test cabinet for electrically operated breakers, with pushbuttons, control cable and receptacle, for separate mounting
- ⊗ Portable test kit for secondary injection testing and verification of trip units. Utilizes standard 120 volt, 15 ampere, single-phase, 60 Hz supply, available from any outlet
- ⊗ Additional removable cover to block opening in the door when breaker is temporarily removed from its compartment
- ⊗ Removable insulating boots over power cable lug adapters

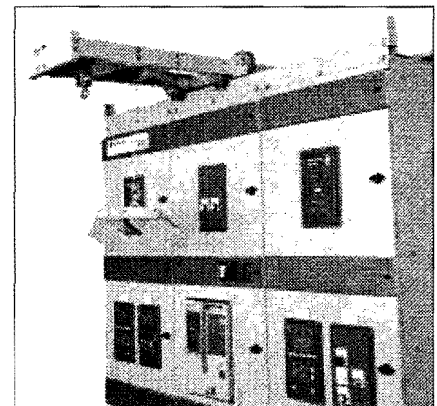


*Optional Switchgear Mounted Lifter*

**Features – Breaker****Contacts**

The Magnum DS has silver tungsten moving contacts and silver graphite stationary contacts. The contacts provide a long-wearing, low-resistance joint. The contacts are protected from arcing damage even after repeated interruptions by the "heel-toe" action which causes the integral arcing contacts to mate before the main contacts part. The arcing contacts then part last, striking the arc away from the main contacts.

The main contacts are of the butt type and are composed of a multiplicity of fingers to give many points of contact without alignment being critical.

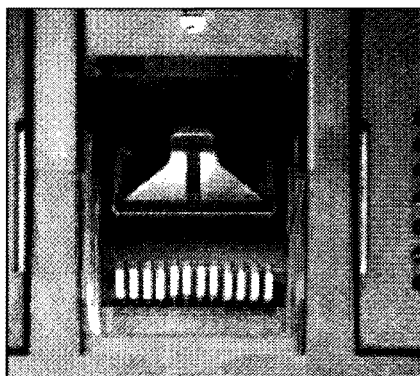

*Magnum DS Breaker Contacts  
(Arc Chutes Removed)*

**Stored-Energy Mechanism**

A cam-type closing mechanism closes the breaker. It receives its energy from a spring that can be charged by a manual handle on the front of the breaker or by a universal electric motor.

Release of the stored energy is accomplished by manually depressing a button on the front of the breaker or electrically energizing a releasing solenoid.

**Arc Chute**

There are three basic means of extinguishing an arc: lengthening the arc path; cooling by gas blast or contraction; deionizing or physically removing the conduction particles from the arc path.

The De-ion® principle is incorporated in all Magnum DS circuit breakers. This makes possible faster arc extinction for a given contact travel, ensures positive interruption and minimum contact burning.

**Levering Mechanism**

The worm gear levering mechanism is self-contained on the breaker drawout element and engages slots in the breaker compartment. A removable crank is used to lever the breaker between the connected, test and disconnected positions.

Mechanical interlocking is arranged so that levering cannot be accomplished unless the breaker is in the opened position.

**Protection During Levering Operation**

When levering the breaker between the connected, test and disconnected positions, the operator is protected from contact with live parts by the breaker door.



*Levering Magnum DS Breaker*

**True Two-Step Stored Energy Closing** refers to the sequence required to charge and close the breaker.

1. The breaker closing springs are charged either through the manual-charging handle or by the optional charging motor. The breaker is mechanically interlocked to prevent closing of the breaker until the closing springs are fully charged.
2. With the closing springs fully charged, the breaker can then be closed by pressing the manual close pushbutton on the breaker, or by the optional spring release coil through a remote electrical signal.

This means that the energy required to open the breaker is always prestored following a closing operation.

"Stored energy" is energy held in waiting, ready to open or close the breaker within five cycles or less. The unique cam and spring design provides necessary energy for a single close-open sequence as well as the energy for multiple charge-close operations such as this possible sequence: charge-close-recharge-open-close-open.

The closing springs are interlocked with the breaker racking mechanism to insure the closing springs are discharged before the breaker can be removed from the compartment.

**Manually Operated Breakers** — Manually operated breakers are equipped with a manual charging handle to charge the closing springs. Manual closing and tripping pushbuttons are utilized to operate the breaker. Remote closing and tripping can be accomplished by installing optional electric spring release and shunt trip coils (see Table R5 for available control voltages, currents and motor-operated spring charging times). The breaker closing springs must be charged manually, then remote closing and tripping signals can be sent to the breaker.

**Electrically Operated Breakers** — Electrically operated breakers are equipped with a spring charging motor and electrically operated spring release and shunt trip coils (see Table R5 for available control voltages, currents and motor-operated spring charging times). The breaker manual charging handle can be used to charge the closing springs when power is not available to the charging motor.

**Provisions for Padlocking** — All breakers include provision for padlocking open to prevent electrical or manual closing. This padlocking can secure the breaker in the connected, test or disconnected position by preventing levering of the breaker.

**Ease of Inspection and Maintenance** — Magnum DS breakers are designed for maximum accessibility and the utmost ease of inspection and maintenance.

**Features – Breaker**

**Magnum DS Switchgear – Trip Units**

**Digitrip RMS Trip Unit** — The Digitrip RMS trip units feature a dependent curve that is depicted in the nameplate by a blue shaded area of the trip curve. The dependent curve affords better protection flexibility. Additionally, all of the trip units have, as standard, thermal memory, 50/60 Hz operation, and thermal self-protection at 90°C.

Also, the 520M trip units have a large display window and 2% metering accuracy.

**Digitrip RMS Integral Microprocessor-Based Breaker Overcurrent Trip Systems**

— Provides maximum reliability with true RMS sensing as standard, gives excellent repeatability, and requires minimum maintenance. No external control source is required for its protective functions.

**Trip Functions** — Magnum DS trip units provide the maximum in flexibility and are available in the following configurations: LSI, LSIG, LSIGA (ground fault alarm only). In each case, either the short delay or instantaneous (not both) functions may be defeated. This reduces the need for spare breaker inventories and provides maximum utilization of interchangeable breakers.

**Change in Trip Rating** — The overcurrent trip pickup range is established by a combination of trip unit rating plugs and matching current sensor ratings on the breaker.

**Optional Breaker Attachments and Accessories**

- a. Shunt trip on manually operated breakers, for any standard control voltage.
- b. Auxiliary contacts on manually or electrically operated breakers. Maximum of 6 normally open and 6 normally closed contacts (5 normally closed contacts on electrically operated breakers) are available on any breaker, manually or electrically operated. The contact rating is 10 amperes.
- c. Compartment position switch, 6 or 12 contact, actuated by movement of drawout breaker from the connected position. Most common uses are for disconnecting remote control circuits of electrically operated breaker, and for bypassing “b” interlocking auxiliary contacts when breaker is withdrawn from the connected position.
- d. Undervoltage trip (ac and dc available). Acts to trip the breaker when the coil voltage is insufficient to restrain a spring-loaded core. The dropout point is within 30 to 60 percent of the nominal coil voltage and is not adjustable.
- e. Overcurrent trip switch (OTS). A latching type switch with two independent FORM C contacts. Operates only when the trip unit trips the breaker. It may be used for alarm and/or interlocking circuits. Resetting is done by a pushbutton on the breaker faceplate.
- f. Electric close on manually operated breakers, for any standard control voltage. Breaker can be closed by remote control switch or pushbutton after the closing spring is manually charged.
- g. Operation counter.
- h. Breaker mounted key interlock.
- i. Second shunt trip coil in place of UVR coil.

Features

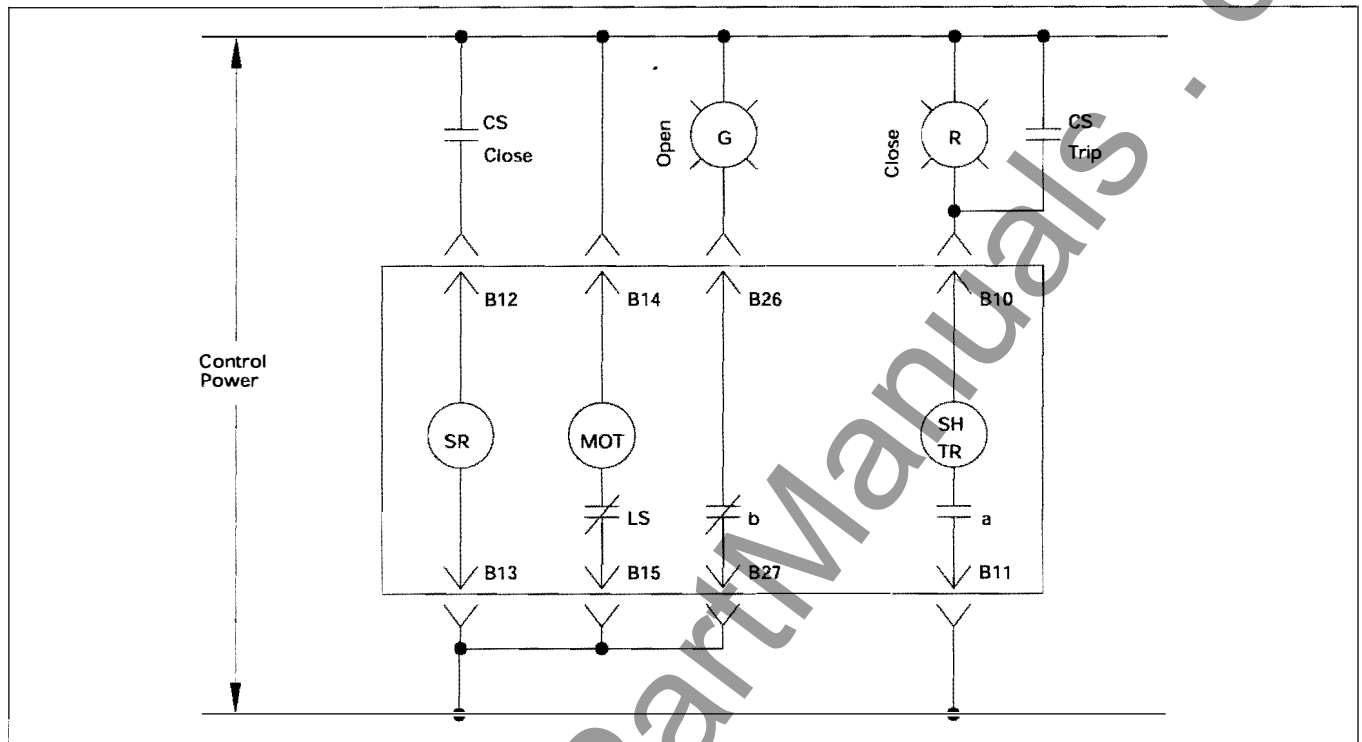


Figure F1: Typical Control Diagram for Magnum DS Electrically Operated Breaker

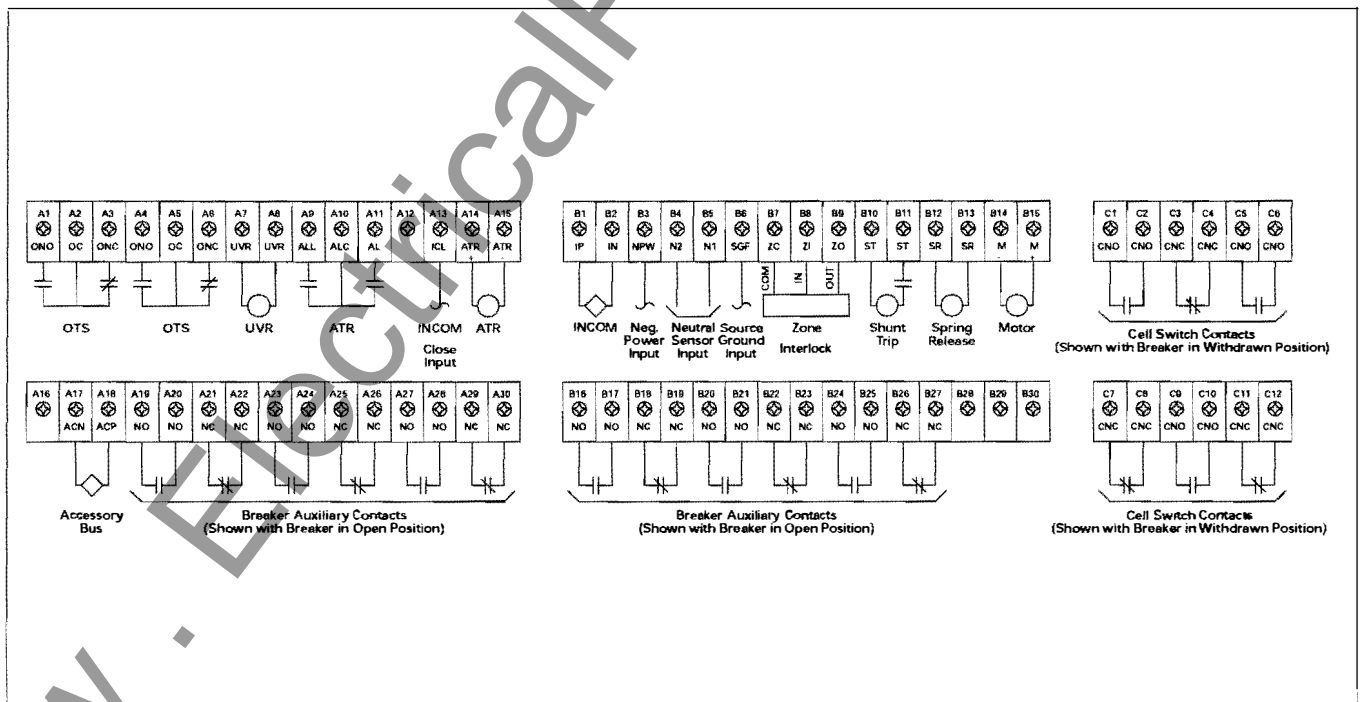


Figure F2: Magnum DS Switchgear Cell Secondary Contact Configuration



# Magnum DS Metal-Enclosed Low-Voltage Switchgear

## Typical Specification

**General** — Magnum DS indoor low-voltage metal-enclosed switchgear shall consist of a stationary structure assembly and one or more removable Magnum DS power circuit breakers complete with disconnecting devices and other necessary accessories. The switchgear shall be suitable for 600 volts maximum service and shall withstand a 2200 Vac dielectric test in accordance with ANSI standards. It shall be designed, manufactured and tested in accordance with the latest applicable standards of IEEE, NEMA, ANSI, UL and CSA. Documentation of design testing shall be third-party certified.

**Stationary Structure** — Each steel unit forming part of the stationary assembly shall be a self-contained housing having one or more individual breaker or instrument compartments, and a rear compartment for the buses and outgoing cable connections.

Prying slots shall be provided on the base of the structures for ease of positioning in equipment rooms.

A rigid integral steel base shall be provided for each section, which will allow movement of shipping groups directly on rollers without the need for a separate skid.

Each circuit breaker compartment shall be equipped with primary and secondary contacts, drawout extension rails, stationary levering mechanism parts, and required instrument current transformers. A formed steel door, supported on concealed hinges with removable pins, shall be provided for each circuit breaker compartment. Access to the integral circuit breaker control panel, including the trip unit, shall be provided without the need to open the breaker compartment door. Closed-door spring charging and levering operations shall also be accomplished without the need to open the breaker compartment door.

The top of the unit shall be enclosed with removable steel sheets, which include necessary hooded ventilation openings. A separate removable access panel shall be provided for drilling of control conduit hubs. A metal wireway with removable covers shall be provided for shipping-split wiring. Pull-apart type terminal blocks shall also be provided for rapid, error-free, shipping split assembly. A metal-enclosed vertical wireway shall be provided for routing of field installed control wiring.

The structure shall be so designed that future additions may readily be made at any time. The steel structure shall be thoroughly cleaned and phosphatized prior to the application of the ANSI No. 61 finish.

A white, laminated, plastic engraved circuit designation nameplate shall be provided on each circuit breaker door.

**Buses and Connections** — Each breaker circuit shall include the necessary three-phase copper bus and connections between the source bus and one set of circuit breaker studs. NEMA 2-hole cable lugs, attached to silver-plated copper extensions for the outgoing cables, shall be provided on the other set of circuit breaker studs. The buses and connections shall consist of high-conductivity (silver-plated) (tin-plated) copper bar mounted on heavy-duty supports, and having bolted joints. All bolted bus joints shall utilize Belleville type spring washers to maintain maximum joint integrity through continuous thermal cycling. The bus system shall be suitable for applications on power systems requiring a (100) (150) (200) kA short circuit withstand rating without upstream current limiting fuses.

Terminal blocks with integral-type barriers shall be provided for circuit breaker secondary circuits. The terminal blocks shall be front accessible through a hinged access panel above each circuit breaker.

All control wiring shall be securely fastened to the switchgear assembly without the use of adhesive wire anchors. A dedicated wiring path shall be provided for purchaser's installed control wiring. Non-adhesive anchors shall also be provided for anchoring of purchaser's installed wiring.

**Disconnecting Devices** — The stationary part of the primary disconnecting devices for each circuit breaker shall consist of a set of contacts extending through a glass polyester insulating base. Buses and outgoing cable terminals shall be directly connected to them. The corresponding moving contacts shall consist of a set of contact fingers suitably spaced on the circuit breaker studs. For ease of inspection and maintenance, contact fingers shall not be a permanent part of the stationary structure. In the "connected" position, these contacts shall form a current-carrying bridge. The assembly shall provide a multitude of silver-to-

silver high-pressure point contacts. High uniform pressure on each finger shall be maintained by springs. The entire assembly shall be full floating and shall provide ample flexibility between the stationary and moving elements. Contact engagement shall be maintained only in the "connected" position.

The secondary disconnecting devices shall consist of floating fingers mounted on the stationary unit and automatically engages contacts located at the front of the compartment. The secondary disconnecting contacts shall be silver-plated to insure permanence of contact. Contact engagement shall be maintained in the "connected" and "test" positions.

**Removable Element** — The removable element shall consist of a Magnum DS power circuit breaker equipped with the necessary disconnecting contacts and interlocks for drawout application. The removable element shall have four-position features and shall permit closing the compartment door with the breaker in the "connected," "test," and "disconnected" positions.

**Power Circuit Breakers** — The circuit breaker shall be Magnum DS, operating on the De-ion arc interruption principle. These breakers shall incorporate specially designed circuit-interrupting devices that provide high interrupting efficiency and minimize the formation of arc flame and gases.

The primary contacts shall have an easily accessible wear indicator to indicate main contact erosion. The breaker closing time shall be no more than three cycles. Each breaker shall have three windows in the front cover to offer clear indication of trip and close electrical accessories mounted in the breaker. The breaker shall be equipped with "De-ion" arc chutes which effectively enclose the arcing contacts and confine the arc to reduce the disturbance caused by short-circuit interruption. Each breaker shall be equipped with a position indicator, mechanically connected to the circuit breaker mechanism.



**Typical Specification**

Each breaker shall be equipped with a microprocessor-based, true RMS sensing trip device. The adjustments shall be:

- ⊗ Long delay pickup between 40% and 100% of the trip rating
- ⊗ Long delay time between 2 and 24 seconds at 6 times trip rating
- ⊗ Short delay pickup between 2 and 10 times long delay trip setting, short delay time between 0.1 and 0.5 seconds at 2.5 times short delay pickup. Short delay protection shall be defeatable, but only if instantaneous protection is activated. Both "flat" and " $I^2t$ " protection shall be provided. (Optional) Zone Selective Interlocking.
- ⊗ Instantaneous pickup between 2 and 12 times trip rating. Instantaneous protection shall be defeatable, but only if short delay protection is activated.
- ⊗ (Optional) Ground fault pickup approximately 25% of sensor rating, and ground fault time between 0.1 and 0.5 seconds. Both "flat" and " $I^2t$ " protection shall be provided. Pickup shall not exceed 1200A, regardless of circuit breaker maximum continuous rating. Ground fault shall be field selectable for residual, zero sequence or source ground protection. Selectability shall be made in the circuit breaker compartment, not on the drawout element, to maximize the flexibility of interchangeable drawout power circuit breakers. (Optional) Zone selective interlocking shall be provided for Ground Fault protection.

It shall be possible to test and verify the time and current characteristics and trip circuit by means of a portable plug-in test device.

Both electrically operated and manually operated breakers shall have stored energy operating mechanisms. The device to close the breaker shall be by means of a mechanical pushbutton, which insures positive control of the closing operation.

**Seismic**

The switchgear assembly and circuit breakers shall be suitable for and certified to meet all applicable seismic requirements of (UBC) (The California Building Code) for zone 4 application. Guidelines for the installation, consistent with these requirements, shall be provided by the switchgear manufacturer and be based upon actual testing of representative equipment. The test response spectrum shall be based upon a 5% minimum damping factor, (Insert the following for UBC: a peak of 0.75g, and a ZPA of 0.38g), (Insert the following for CBC: a peak of 1.8g, and a ZPA of 0.45g). The tests shall fully envelop this response spectrum for all equipment natural frequencies up to at least 35 Hz.

**Factory Assembly and Tests**

The switchgear shall be completely assembled, wired, adjusted and tested at the factory. After assembly, the complete switchgear control and instrumentation circuits shall be tested for operation under simulated service conditions to assure the accuracy of the wiring and the functioning of the equipment.

The main circuits shall be given a dielectric test of 2200 volts for one minute between live parts and ground and between opposite polarities. The wiring and control circuits shall be given a dielectric test of 1500 volts for one minute, or 1800 volts for one second, between live parts and ground.

**Note:** Arrangement sketch and single line diagram should accompany the written specification.

www.ElectricalPartManuals.com

www.ElectricalPartManuals.com

www.ElectricalPartManuals.com